



Technical Guide: YORK® Sun™ Core ZQ, ZX, ZY, and ZL SERIES 3 to 12.5 Ton, 60 Hertz



York International Corporation, 5005
York Drive, Norman, OK 73069

www.york.com

2021-04-06

1068152-YTG-DD-0421

Revision: DD-0421



Contents

| | |
|--|-----|
| Product highlights..... | 7 |
| Patents..... | 7 |
| Options and accessories..... | 8 |
| Component location..... | 9 |
| Features and benefits..... | 11 |
| Factory installed options..... | 17 |
| Field installed accessories..... | 21 |
| Nomenclature..... | 23 |
| Accessories..... | 24 |
| AHRI cooling rating table..... | 29 |
| AHRI 270 outdoor sound power levels..... | 31 |
| Physical data..... | 32 |
| ZQ04 to ZQ06 physical data..... | 32 |
| ZXA7, ZX08 to ZX14 physical data..... | 38 |
| ZY04 to ZY12 physical data..... | 48 |
| ZL04 to ZL06 physical data..... | 63 |
| ZL08 to ZL14 physical data..... | 69 |
| ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations..... | 77 |
| Capacity performance..... | 78 |
| ZQ04 to 06 cooling capacities..... | 78 |
| ZXA7, 08 to 14 cooling capacities..... | 84 |
| ZY04 to 12 cooling capacities..... | 94 |
| ZL04 to 06 cooling capacities..... | 110 |
| ZL08 to 14 cooling capacities..... | 116 |
| Drive selection..... | 123 |
| Airflow performance..... | 125 |
| Altitude and temperature correction for cfm, static pressure, and power..... | 125 |
| Altitude/temperature correction factors..... | 126 |
| Indoor blower specifications..... | 127 |
| RPM selection..... | 128 |
| Additional static resistance..... | 130 |
| Airflow performance..... | 133 |
| ZQ04 to 06 side duct application (belt drive)..... | 133 |
| ZQ04 to 06 bottom duct application (belt drive)..... | 135 |
| ZXA7, 08 to 14 side duct application (belt drive)..... | 137 |
| ZXA7, 08 to 14 bottom duct application (belt drive)..... | 139 |
| ZY04 to 12 side duct application (belt drive)..... | 143 |
| ZY04 to 12 bottom duct application (belt drive)..... | 147 |
| ZL04 to ZL06 side duct application (belt drive)..... | 151 |
| ZL04 to ZL06 bottom duct application (belt drive)..... | 153 |

| | |
|--|-----|
| ZL08 to 14 side duct application (belt drive)..... | 155 |
| ZL08 to 14 bottom duct application (belt drive)..... | 157 |
| ZQ04 to 06 side duct application (direct drive)..... | 159 |
| ZQ04 to 06 bottom duct application (direct drive)..... | 160 |
| ZY04 to 06 side duct application (direct drive)..... | 161 |
| ZY04 to 06 bottom duct application (direct drive)..... | 162 |
| ZL04 to ZL06 side duct application (direct drive)..... | 163 |
| ZL04 to ZL06 bottom duct application (direct drive)..... | 164 |
| Power exhaust blower curves..... | 165 |
| Electrical data..... | 167 |
| ZQ04 to 06 standard static indoor blower - without powered convenience outlet..... | 167 |
| ZQ04 to 06 standard static indoor blower - with powered convenience outlet..... | 169 |
| ZQ04 to 06 medium static indoor blower - without powered convenience outlet..... | 171 |
| ZQ04 to 06 medium static indoor blower - with powered convenience outlet..... | 173 |
| ZQ04 to 06 high static indoor blower - without powered convenience outlet..... | 175 |
| ZQ04 to 06 high static indoor blower - with powered convenience outlet..... | 177 |
| ZXA7, 08 to 14 standard static indoor blower - without powered convenience outlet..... | 179 |
| ZXA7, 08 to 14 standard static indoor blower - with powered convenience outlet..... | 182 |
| ZXA7, ZX08 to 14 medium static indoor blower - without powered convenience outlet..... | 185 |
| ZXA7, ZX08 to 14 medium static indoor blower - with powered convenience outlet..... | 188 |
| ZXA7, 08 to 14 high static indoor blower - without powered convenience outlet..... | 191 |
| ZXA7, 08 to 14 high static indoor blower - with powered convenience outlet..... | 194 |
| ZY04 to 12 standard static indoor blower - without powered convenience outlet..... | 197 |
| ZY04 to 12 standard static indoor blower - with powered convenience outlet..... | 203 |
| ZY04 to 12 medium static indoor blower - without powered convenience outlet..... | 209 |
| ZY04 to 12 medium static indoor blower - with powered convenience outlet..... | 215 |
| ZY04 to 12 high static indoor blower - without powered convenience outlet..... | 221 |
| ZY04 to 12 high static indoor blower - with powered convenience outlet..... | 226 |
| ZL04 to 06 standard indoor blowers - without powered convenience outlet..... | 231 |
| ZL04 to 06 standard indoor blower - with powered convenience outlet..... | 233 |
| ZL04 to 06 medium indoor blower - without powered convenience outlet..... | 235 |
| ZL04 to 06 medium indoor blower - with powered convenience outlet..... | 237 |
| ZL04 to 06 high indoor blower - without powered convenience outlet..... | 239 |
| ZL04 to 06 high indoor blower - with powered convenience outlet..... | 241 |
| ZL08 to 14 static indoor blowers - without powered convenience outlet..... | 243 |
| ZL08 to 14 standard indoor blower - with powered convenience outlet..... | 245 |
| ZL08 to 14 medium indoor blower - without powered convenience outlet..... | 247 |
| ZL08 to 14 medium indoor blower - with powered convenience outlet..... | 249 |
| ZL08 to 14 high indoor blower - without powered convenience outlet..... | 251 |
| ZL08 to 14 high indoor blower - with powered convenience outlet..... | 253 |

| | |
|---|-----|
| Weights and dimensions..... | 255 |
| ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit weights..... | 255 |
| ZQ04-06, ZXA7, 08-14, ZY04-12, ZL04-06 and ZL08-14 unit dimensions..... | 258 |
| ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit roof curb dimensions..... | 264 |
| Economizer options..... | 266 |
| Guide specifications..... | 269 |

Product highlights

- Assembled in Norman, OK
 - ASHRAE 90.1 Compliant
 - R-410A Refrigerant
 - Cooling only and gas/electric configurations available
 - Scroll compressors
 - Up to 17.2 SEER on 3-5 ton ZL level
 - Up to 16.3 IEER and 12.2 EER on the 3 stage cooling advanced building code compliant level.
 - Up to 15.4 SEER and 12.2 EER on the Energy Star Compliant Energy Level
 - Up to 14.0 SEER and 11.2 EER on the ASHRAE 90.1 Compliant Standard Efficiency Level
 - Department of Energy (DOE) compliant - All models meet minimum DOE efficiencies for cooling and fan efficiencies. Single-phase gas heating products are fan energy rated (FER) to meet DOE requirements.
 - State-of-the-art microprocessor controls with specific programming for product applications
 - MicroChannel condenser coils
 - Evaporator coils use copper tube/aluminum fin design for proven reliability and performance.
 - Thermostatic Expansion Valve (TXV) Standard on: ASHRAE 90.1 Compliant Standard Efficiency Level 5 ton to 12.5 ton models, Energy Star Compliant Efficiency Level 3 ton to 10 ton models and advanced building code compliant efficiency level 7.5 ton to 12.5 ton models.
 - Single-stage cooling (3 ton to 6 ton models)
 - Two-stage cooling (3 ton to 5 ton ZL models and 6 ton to 12.5 ton models)
 - Three-stage cooling available (7.5 ton to 12.5 ton models)
 - Alternate motor and drives
- ① **Note:** All single-phase 3 ton to 5 ton gas heating units are equipped with an ECM motor on direct drive units.

Patents

Patents: <https://jciptat.com>

Options and accessories

- Economizers with barometric relief
- Louvered hail guards
- Non-fused disconnect (verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat may exceed the factory installed disconnect amperage rating.)
- Power exhaust
- Propane conversion kits
- High altitude heating conversion kits
- Flue exhaust extension kit
- Flue heat shield
- Smoke detectors
- Manual and motorized dampers
- Hinged cabinet doors
- Low ambient head pressure control kit
- Optional stainless steel heat exchanger (standard on 3 ton to 5 ton Low-NOx Models)
- Thru-the-base connections for power, gas and control wiring.
- IntelliSpeed™ with premium efficiency indoor motors to meet ASHRAE 90.1 requirements (3 ton to 5 ton ZL belt drive models and 6 ton to 12.5 ton models)
- *Field Installed Electric Heat Kit - Installation Instructions* for the Electric Heat Kits may be found in the Electric Heat Kits
- Factory Standard with the Smart Equipment™ Board with the option to downgrade to the Everyday Thermostat Control (ETC) board on ZQ/ZX/ZY models.

Component location

Figure 1: Cooling with gas heat (3 ton through 5 ton) front


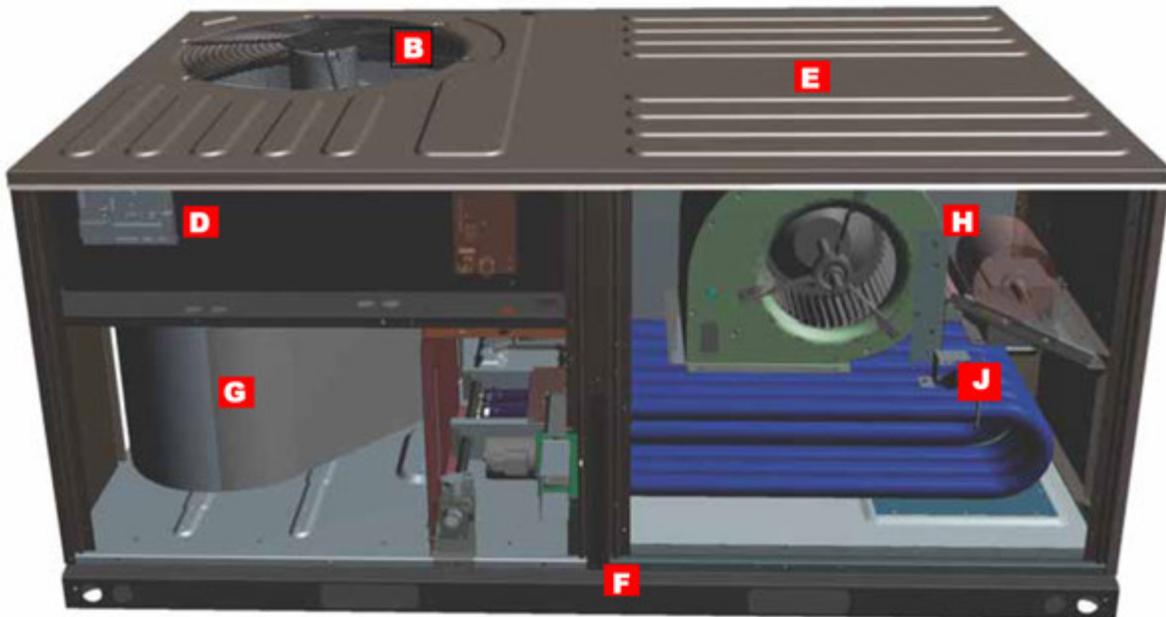


Figure 2: Cooling with gas heat (3 ton through 5 ton) back

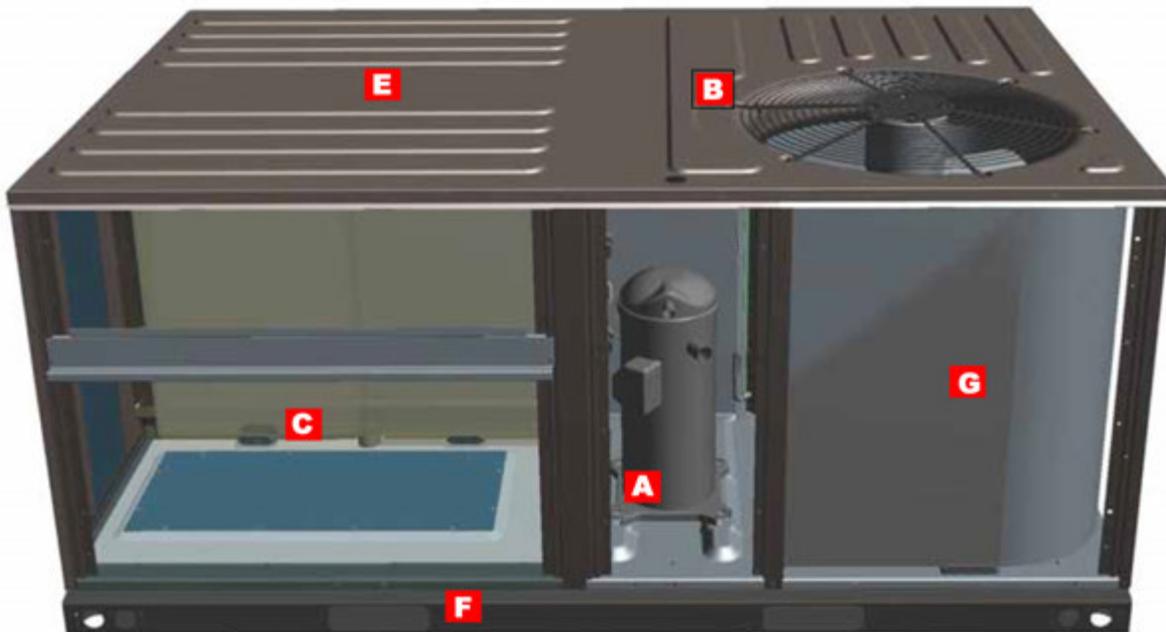

| Letter | Features |
|--------|-------------------------|
| A | Scroll compressor |
| B | Outdoor fan |
| C | Convertible filter rack |

| Letter | Features |
|--------|---|
| D | Everyday Thermostat Control (ETC) board |
| E | Embossed top |
| F | Perimeter base rail |
| G | Coils |
| H | Indoor fans |
| J | Two-stage gas heating |

See letters in for further description of the features.

Features and benefits

The letters in brackets in the text correspond to the letters in Figure 1 and Figure 2.

Three tiers of efficiency

14 SEER standard efficiency provides a cost effective 14 SEER/11.0 EER product that meets ASHRAE 90.1 requirements. The high-efficiency meets the requirements for Energy Star that exceeds 15 SEER and 12 EER. The 17 SEER ZL units contain two stage compressors and multi-stage blower control to achieve advanced rebate codes. The high efficiency 3-stage cooling units are available from 7.5 tons to 12.5 tons to meet advanced building code requirements. Gas/electric units have electronic spark ignition and power vented combustion steady state efficiencies of 80%. These efficiencies meet or exceed all legislated minimum levels providing lower operating costs.

(A) All models utilize scroll compressors

that are environmentally friendly by utilizing R-410A refrigerant. Use of the scroll compressor technology means a simple internal design, fewer moving parts, equating to a quiet, reliable, easy to service and efficient system. Internal compressor protection is standard and compressors include protection to prevent liquid damage.



Total system design

A TXV is used for precise metering on the 6 ton to 12.5 ton and high SEER 3 ton to 5 ton products and a fixed orifice is used to keep the cost of the product down on the 3 ton to 5 ton product. Two independent refrigerant circuits and compressors are used on the 7.5 ton to 12.5 ton units for economical and precise control. A single circuit, single compressor design is used on the 3 ton to 6 ton units for cost effectiveness and reliability without compromising quality.


System protection

Liquid line filter-driers, high and low pressure safeties are standard on each independent refrigerant circuit. Suction line sensors monitor temperature to prevent possible liquid flood back to the compressors and also protect against loss of charge and coil frosting.

(B) Balanced outdoor fan design makes for a quieter unit - The outdoor condenser fans are dynamically balanced for better performance and reliability. The direct drive fan design mounted to the fan grill allows for quick and easy service. Where other's components might fail at extreme temperatures Our units are tested and rated up to 125°F ambient cooling operation.



(C) Convertible filter rack - No tools required for easy field conversion of the filter rack to accommodate either 2 in. or 4 in. filters. Units will ship with MERV 4 throwaway filters standard; however MERV 8 and MERV 13 filters can be easily added through the tool-free filter access panel to meet LEED requirements. Refer to physical data tables for filter size details.

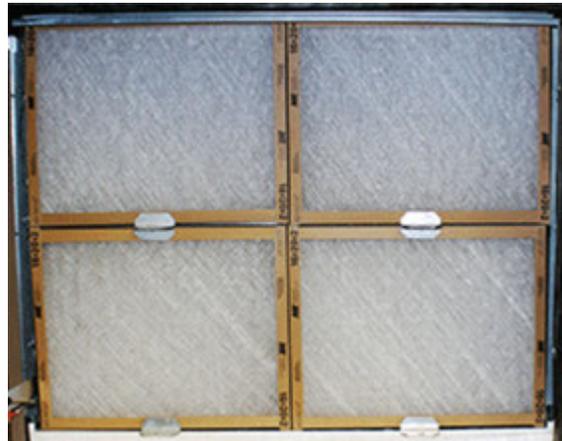

(D) ZQ, ZX, and ZY units optionally come with the Everyday Thermostat Control (ETC) board. The ETC comes in the same footprint as the Smart Equipment™ Control board and utilizes the same cutting edge technology. The ETC board focuses on providing the quickest field install, start-up, and service possible. All units are Factory run tested.



Intuitive – The ETC board can only be commanded by a traditional Thermostat, utilizing common screw terminal blocks for connection, thus minimizing complexity or the need for advanced service training.

Simple diagnostics - The ETC board has two simple colored LEDs and these LEDs will display flash codes for fault condition states. A table of these flash codes will be mounted on each Unit to aid in trouble shooting and diagnostics in the field.

Equipment protection - The ETC board, similar to Smart Equipment™, monitors high and low pressure switch status on the independent refrigerant circuits, as well as freeze stat status. On units with heating, the gas valve and high temperature limit switches are monitored on gas and electric heating units. The control also monitors the voltage supplied to the unit and will protect the unit if low voltage occurs due to a brown out, or other electrical issue.

Anti-short cycle protection - An anti-short cycle delay is incorporated into the standard control to aid compressor life. Compressor reliability is further ensured by programmable minimum run times. For testing, the anti-short cycle delay can be temporarily overridden with the push of a button.

Fan delay versatility - The ETC board offers three field selectable heating fan delay options based off simple jumper positions, allowing quick adjustment in the field.

All units will come factory standard with the state-of-the-art Smart Equipment™ control system. The unit control incorporates the best of the already proven Smart Equipment™ controls and creates a more robust, intelligent control. The goal of this control is to utilize cutting edge technology making the equipment easier to install, operate, and service. All units are Factory run tested.



Versatile

The Smart Equipment™ control can be configured to use with a standard thermostat (easy to connect screw terminals), a zone sensor, or can be setup to communicate with multiple BAS communication protocols to integrate with building automation systems.

Reduce field installed complexity

Each unit will come equipped with factory installed supply air, return air, and outdoor air temperature sensors providing key temperature readings thus reduce field installed complexity.

On-board USB port

The control comes with a long list of features including data logging, current and previous system faults and software update capabilities using the on board USB port and common flash drive. Energy use monitoring capabilities allow custom tailoring to allow a system to work more efficiently at all times and occupancy levels. Self test and start-up reports also available from the board VIA the USB port.

Embedded LCD display

The board has a easy to read, builtin LCD display and easy to use navigation joystick and buttons allowing the user to quickly navigate the menus displaying unit status, options, current function, supply, return and outdoor temperatures, fault codes and other information.

Safety monitoring

The control monitors the outdoor, supply, and return air temperatures and the high and low pressure switch status on the independent refrigerant circuits. On units with heating the gas valve and high temperature limit switches are monitored on gas and electric heating units. The control also monitors the voltage supplied to the unit and will protect the unit if low voltage due to a brown out, or other electrical issue occurs.

Low ambient

An integrated low-ambient control allows units to operate in the cooling mode down to 0°F outdoor ambient without additional components or intervention. Optionally, the control board can be programmed to lockout the compressors when the outdoor air temperature is low or when free cooling is available.

Anti-short cycle protection

To aid compressor life, an antishort cycle delay is incorporated into the standard control. Compressor reliability is further ensured by programmable minimum run times. For testing, the anti-short cycle delay can be temporarily overridden with the push of a button.

Fan delays

Fan on and fan off delays are fully programmable. Furthermore, the heating and cooling fan delay times are independent of one another. All units are programmed with default values based upon their configuration of cooling and/or heating capacity.

Nuisance trip protection and three strikes

To prevent nuisance calls, the control board uses a three times, you're out philosophy. The high, low-pressure switch, anti-freeze protection, low voltage or heating high limit must trip three times within two hours before the unit control board will lock out the associated compressor. The same safety must trip three times before a hard lockout will occur.

(E) Robust design - Each unit is designed with an embossed top to increase structural support and ensure rigidity. The unit has a powder paint exterior finish including a industry leading 750 hour salt spray rating. All units are painted with a long lasting, powder paint that stands up over the life of the unit.



(F) Full perimeter base rail that fits on many existing curbs -This product was designed with the replacement market in mind which is why it will fit on many existing curbs in the field but it also takes into account the new construction market by being versatile and sturdy. This unit is equipped with heavier gauge and innovatively designed base rails to prevent damage from transporting and rigging.



(G) Coils -All units utilize Microchannel "all-aluminum" condenser coils that provides improved heat transfer capabilities and reduced refrigerant charge volumes. This equates to all units meeting LEED EA Credit 4 Requirements for Enhanced Refrigerant Management. Microchannel coils are also much easier to clean than your typical fin/tube designs.



All evaporator coils utilize copper tube with aluminum fin design for proven reliability and performance.

(H) Rigid mounted blower assembly -

Dynamically balanced indoor fans ensure better performance and reliability. Large access panels for easier access, service, and maintenance. X13 Direct drive (Standard Static Option) and belt drive (Medium Static and High Static Options) options available on 3 ton to 5 ton products. The belt drive option is standard on 6 ton to 12.5 ton products. Low, Medium, and High Static drive options for airflow versatility up to 2 in. ESP with no field installed drive packages necessary. The X13 motor technology offers several benefits w/ respect to efficiency, operation, comfort, and cost when compared to other motors. Premium efficiency indoor motors are standard on ZY06 and ZX14. The IntelliSpeed™ option is available on 6 ton to 12.5 ton products and standard on the belt drive 17 SEER units and the 3 stage cooling models to meet ASHRAE 90.1 and Title 24 Requirements. The blower section includes a dual density insulation for indoor air quality.



(J) Balanced heating - The two stage gas heating offers ultimate heating comfort with a balance between 1st and 2nd stage gas heating. The first stage of a two stage gas heat option provides approximately 70% of the heating capacity in all 3 tons to 12.5 tons two stage gas heat models. Balanced heating allows the unit to better maintain desired temperatures and helps save energy. Low-NOx comes standard with a stainless steel heat exchanger to meet California environmental requirements. The heat exchanger section includes foil faced insulation that is not only environmentally friendly but meets all NFPA codes.



Warranty

All models include a 1-year limited warranty on the complete unit. Compressors carry a 5-year warranty. Aluminized steel heat exchangers carry a 10-year warranty and stainless steel heat exchangers carry a 15-year warranty.

Factory installed options

(Nomenclature digit position)

Airflow options (8)

Alternate indoor blower motor - For applications with high static restrictions, units are offered with optional indoor motors providing higher external static capability and/or higher airflow, depending upon the installer's needs.

- A=Standard static (direct drive for 3 ton to 5 ton; Belt Drive for 6 ton to 12.5 ton)
- B=Medium static (belt drive for 3 ton to 12.5 ton)
- C=High static (belt drive for 3 ton to 12.5 ton; 3 Phase Models Only)

VFD/VAV options (9)

IntelliSpeed™ supply fan control option (ASHRAE 90.1 compliant) - Units configured with the IntelliSpeed™ supply fan option will contain a VFD for variable volume supply fan operation. This option allows the supply fan RPM to vary based on the number of compressors or heating stages energized. The economizer's minimum position is also configurable.

- 1=None (Comes with standard constant volume controls)
- 2=VFD/VAV (ZL 3-Stage only)
- 3=VFD IntelliSpeed™ (17 SEER belt drive models and standard on ZL High Efficiency 3-stage cooling models)

Coil options (10)

E-coat coils - Coils are coated with an epoxy polymer coating to protect against corrosion. A 3-year warranty is added when this option is selected.

- A=Standard indoor & outdoor coils (fin/tube design on indoor coil and MicroChannel design used on outdoor coil with no E-Coat coating added).
- B=Standard indoor coil & E-coat coil outdoor coil (fin/ tube design on indoor coil and MicroChannel design used on outdoor coil. E-Coat coating added to outdoor coil)
- C= E-coat indoor coil & standard outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-Coat coating added to indoor coil)
- D= E-coat indoor coil & outdoor coil (fin/tube design on indoor coil and MicroChannel design used on outdoor coil. E-Coat coating added to indoor and outdoor coil)

Controls (11)

Everyday Thermostat Control (ETC) - ZQ, ZX and ZY units optionally may come with the Everyday Thermostat Control (ETC) board. The ETC comes in the same footprint as the Smart Equipment™ Control board and utilizes the same cutting edge technology. The ETC board focuses on providing the quickest field install, start-up, and service possible.

Smart Equipment™ - This is the Standard microprocessor control for all units, with capabilities to work with a sensor or thermostat only. Smart Equipment™ with BAS includes communication board with BACnet open-protocol system.

Verasys - Verasys provides a simple user experience with configurable self-recognizing controllers without the need for any additional tools. Verasys creates enhanced integration of HVACR equipment, zoning, and controls. Contractors are able to offer a complete bundled solution of equipment and controls to serve the light commercial market.

- A=Smart Equipment™
- B=Smart Equipment™ + BACnet MSTP, Mdb, N2 COM Card
- E=Everyday Thermostat Control (ETC)
- J=Verasys single zone
- K=Verasys change over bypass

Sensor options (12)

- 1=None (Units come standard with factory installed supply air, return air, and outdoor air temperature sensors)
- 2=RA¹ smoke detector
- 3=SA smoke detector
- 4=RA¹ & SA Smoke Detector

¹ Return air smoke detector sensor must be relocated in the field. (See Unit Installation manual.)

Economizer/Damper (13) (Smart Equipment™ models only)

Down flow economizers (with barometric relief) - All units offer a variety of optional factory installed economizers that are shipped, installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/ sq. ft. at 1 in. of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).

Dry bulb economizer - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.

Enthalpy economizer - The added outdoor air enthalpy sensor enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.

- A=None
- B=Dry bulb economizer
- C=Enthalpy economizer

Convenience outlet (14)

Convenience outlet - (Powered and non-powered) - This option locates a 120 V single-phase GFCI outlet with cover, on the corner of the unit housing adjacent to the compressors. The non-powered option requires the installer to provide the 120 V single-phase power source and wiring. Factory installed option only.

- 1=None
- 2=Non-powered convenience outlet
- 3=Powered convenience outlet

Electrical options (15)

Disconnect switch - For units with field installed electric heat kits, two factory installed disconnect sizes are available (60 A or 100 A non-fused disconnect). Depending on the field installed heater kit selected, the factory installed disconnect may not be sufficient. Always refer to the unit nameplate or unit electrical data for the proper disconnect size. If the heater application requires a disconnect above 100 A, the factory installed disconnect should be removed and an appropriately sized external disconnect should be installed.

- 1=None
- 2=Non-fused Disconnect¹

¹ Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat may exceed the factory installed disconnect amperage rating.

Cabinet options (16)

Louvered hail guard - This kit includes a decorative louvered panel which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.

Hinged cabinet doors - The factory installed hinged panel option will save time, money and labor while allowing easy servicing of blower components, filters and controls. With this option there is no longer a need to remove panels to access these critical sections and running the risk of losing panels or roof damage from loose panels and materials. Extra care was taken to design a durable hinged panel with leak tight seal.

- 1=None
- 2=Louvered panels
- 3=Hinged cabinet doors
- 4=Hinged cabinet doors and louvered panels

FDD (Fault Detection and Diagnostics), refrigerant side - A modification shop offering for an additional installed control system for commercial equipment that constantly monitors refrigerant circuit pressures, refrigerant circuit temperatures, as well as the environmental temperatures and humidity via multiple sensor inputs.


Field installed accessories

- **Down flow economizers/horizontal economizers (with barometric relief)** - All units offer a variety of field installed economizers that are installed and wired with AMCA 511 Licensed Class 1A low leak dampers designed to exceed ASHRAE 90.1 and the International Energy Conservation Code (IECC) certification requirements by achieving leakage rates of 3 cfm/sq. ft. at 1 in. of static pressure. Each economizer goes through a rigorous 60,000 cycle test. Dry bulb, single enthalpy, and dual enthalpy (with field installed kit) can be selected. All economizer options are fully integrated into the Smart Equipment™ controls or the Everyday Thermostat Control board. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the outdoor air dry bulb temperature or the outdoor air enthalpy input. The dual enthalpy kit provides a second input used to monitor the return air (field installed). The installer needs only to assemble the outdoor air hood, attach the enthalpy control the hood and mount the hood to the unit (Hood and control are provided).
- **Dry bulb economizer** - Economizer operation is enabled by the outdoor air temperature being less than the setpoint of the economizer module.
- **Single enthalpy control, accessory for economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Dual enthalpy control, accessory for economizer** - All field installed economizers will come standard as a dry bulb economizer. This kit adds an outdoor air enthalpy sensor and return air enthalpy sensor which enables economizer operation if the outdoor enthalpy is less than the setpoint of the economizer logic module.
- **Power exhaust** - This accessory installs in the unit with a down flow economizer or in the ductwork for a horizontal application.
- **Louvered hail guard** - This kit includes a decorative louvered panel which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes.
- **Flue exhaust extension kit** - In locations where wind or weather conditions may interfere with proper exhausting of furnace combustion products, this kit can be installed to prevent the flue exhaust from entering nearby fresh air intakes.
- **Propane conversion kit** - This kit converts a gas heat unit to operate with propane gas at altitudes up to 2,000 feet.
- **Gas heat high altitude kit** - This kit converts a gas heat unit to operate at high altitudes, 2,000 ft to 10,000 ft. Conversion kits are available for natural gas and propane.
- **Roof curbs** - The roof curbs have insulated decks and are shipped disassembled. The roof curbs are available in 14 and 24 heights.
- **Thermostat** - The units are designed to operate with 24-V electronic and electro-mechanical thermostats. All 7.5 ton through 12.5 ton units operate with two-stage heat/ two-stage cool or two-stage cooling only thermostats and two-stage heat / three-stage cool on ZL tier products, depending upon unit configuration.
- **Smoke detectors** - The smoke detectors stop operation of the unit by interrupting power and providing a fault message to the control board if smoke is detected within the air compartment. Smoke detectors are available for both the supply and/or return air configurations.

- **Hinged filter access panel for use with horizontal flow economizer** - Allows hinged access to the filter section when used with a horizontal economizer.
- **Low ambient head pressure control kit** - The Electronic Low Ambient Controller is designed to regulate condenser head pressure at low ambient temperatures by varying the amount of airflow through the condenser.
- **Manual outdoor air damper** - Like the motorized outdoor air damper, each manual outdoor air damper includes a slide-in damper assembly with an outdoor air hood and filters. Customers have a choice of dampers with ranges of 0% to 100% or 0% to 35% outdoor air entry.
- **Thru the base connection** - Kits are available to provide a way to route wiring to the unit through the base of the unit and gas supplied to the unit through the base or through the curb. These kits provide a seal tight way to bring power and gas to the unit without additional roof penetrations.
- **Electric heat (field installed option only)** - Select heater sizes for 3 ton to 12.5 ton units available. Necessary hardware and connectors are included with the heaters.

Nomenclature

3-12.5 Ton Model Number Nomenclature

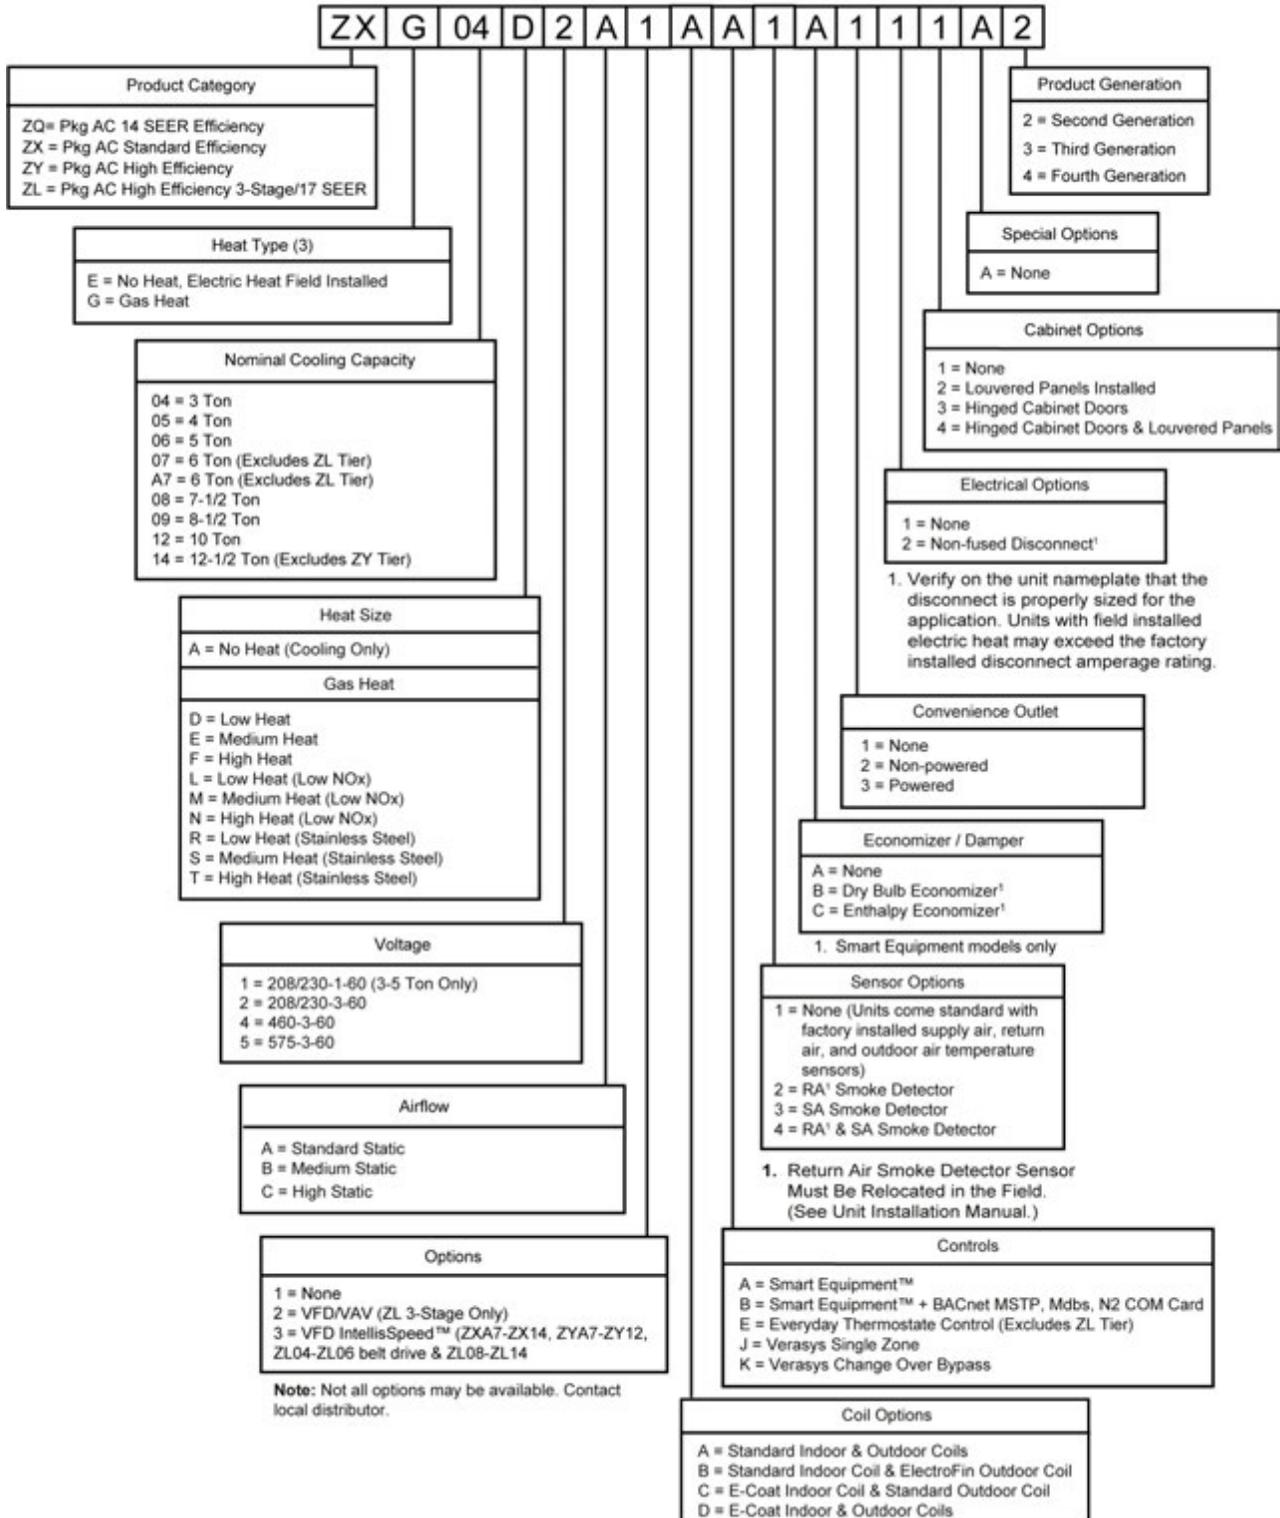

Accessories

Table 1: Accessories

| Accessory kit number | Description | Where used | Voltage |
|----------------------|---|--|---------|
| 2EE04706725 | Econ, DB, vertical flow, small footprint with barometric relief with ETC | ZY04, ZY05, ZY06, ZQ04, ZQ5, ZQ06, ZXA7 | All |
| 2EE04706825 | Econ, DB, vertical flow, large footprint with barometric relief with ETC | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12 | All |
| 2EE04707025 | Econ, DB, horizontal flow, small footprint, short cabinet with barometric relief with ETC | ZY04, ZQ04, ZQ05 | All |
| 2EE04707125 | Econ, DB, horizontal flow, small footprint, tall cabinet with barometric relief with ETC | ZX07, ZXA7, ZY05, ZY06, ZQ06 | All |
| 2EE04707225 | Econ, DB, horizontal flow, large footprint, short cabinet with barometric relief with ETC | ZX08, ZY07, ZYA7 | All |
| 2EE04707325 | Econ, DB, horizontal flow, large footprint, tall cabinet with barometric relief with ETC | ZX09, ZX12, ZX14, ZY08, ZY09, ZY12 | All |
| 2EE04706724 | Econ, DB, vertical flow, small footprint with SE | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ5, ZQ06, ZXA7 | All |
| 2EE04706824 | Econ, DB, vertical flow, large footprint with SE | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2EE04707024 | Econ, DB, horizontal flow, small footprint, short cabinet with sE | ZL04, ZY04, ZQ04, ZQ05 | All |
| 2EE04707124 | Econ, DB, horizontal flow, small footprint, tall cabinet with SE | ZL05, ZL06, ZX07, ZXA7, ZY05, ZY06, ZQ06 | All |
| 2EE04707224 | Econ, DB, horizontal flow, large footprint, short cabinet with SE | ZX08, ZY07, ZYA7 | All |
| 2EE04707324 | Econ, DB, horizontal flow, large footprint, tall cabinet with SE | ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1FA0415 | Manual outside air damper 0-35% | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1FA0416 | Manual outside air damper 0-35% | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1FA0417 | Manual outside air damper 0-100% | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1FA0418 | Manual outside air damper 0-100% | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2MD04704424 | 0-35% motorized outside air damper | ZX04-07, ZQ04-06, ZY04-06, ZL04-06, | All |
| 2MD04704524 | 0-35% motorized outside air damper | ZX08-14, ZY07-12 | All |
| 2MD04704224 | Motorized outside air damper 0-100% | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZXA7 | All |
| 2MD04704324 | Motorized outside air damper 0-100% | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2EC0401 | Kit, single enthalpy field installed | All | All |
| 2EC0402 | Kit, dual enthalpy field installed | All | All |
| 1HD0401 | Hinged filter access panel for units with a horizontal economizer | ZQ04, ZQ05, ZY04, ZL04 | All |
| 1HD0402 | Hinged filter access panel for units with a horizontal economizer | ZQ06, ZL05, ZL06, ZY05, ZY06, ZXA7 | All |
| 1HD0403 | Hinged filter access panel for units with a horizontal economizer | ZX08, ZY07, ZYA7 | All |
| 1HD0404 | Hinged filter access panel for units with a horizontal economizer | ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |

Table 1: Accessories

| Accessory kit number | Description | Where used | Voltage |
|----------------------|---|--|--------------|
| 1HG0419 | Hail guard kit small footprint, short cabinet | ZY04, ZL04, ZQ04, ZQ05 | All |
| 1HG0420 | Hail guard kit small footprint, tall cabinet | ZL05, ZL06, ZY05, ZY06, ZQ06, ZXA7 | All |
| 1HG0423 | Hail guard kit large footprint, short cabinet | ZX08, ZY07, ZYA7 | All |
| 1HG0424 | Hail guard kit large footprint, tall cabinet | ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1RC0456 | Curb rigid 14 in. small footprint | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1RC0457 | Curb rigid 14 in. large footprint | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1RC0458 | Curb rigid 24 in. small footprint | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1RC0459 | Curb rigid 24 in. large footprint | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2PE04704206 | Power exhaust vertical flow small footprint 208 V to 230 V 1-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-1-60 |
| 2PE04704225 | Power exhaust vertical flow small footprint 208 V to 230 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-3-60 |
| 2PE04704246 | Power exhaust vertical flow small footprint 460 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 460-3-60 |
| 2PE04704258 | Power exhaust vertical flow small footprint 575 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 575-3-60 |
| 2PE04704306 | Power exhaust vertical flow large footprint 208 V to 230 V 1-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-1-60 |
| 2PE04704325 | Power exhaust vertical flow large footprint 208 V to 230 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |
| 2PE04704346 | Power exhaust vertical flow large footprint 460 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |
| 2PE04704358 | Power exhaust vertical flow large footprint 575 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 575-3-60 |
| 2PE04704406 | Power exhaust horizontal flow small footprint 208 V to 230 V 1-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-1-60 |
| 2PE04704425 | Power exhaust horizontal flow small footprint 208 V to 230 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-3-60 |
| 2PE04704446 | Power exhaust horizontal flow small footprint 460 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 460-3-60 |
| 2PE04704458 | Power exhaust horizontal flow small footprint 575 V 3-ph | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 575-3-60 |
| 2PE04704506 | Power exhaust horizontal flow large footprint 208 V to 230 V 1-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-1-60 |
| 2PE04704525 | Power exhaust horizontal flow large footprint 208 V to 230 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |
| 2PE04704546 | Power exhaust horizontal flow large footprint 460 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |

Table 1: Accessories

| Accessory kit number | Description | Where used | Voltage |
|----------------------|--|--|---------------------|
| 2PE04704558 | Power exhaust horizontal flow large footprint 575 V 3-ph | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 575-3-60 |
| 1HA0454 | High altitude kit for natural gas (2,000-10,000 ft) | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZY07, ZYA7 - Low Heat | All |
| 1HA0455 | High altitude kit for natural gas (2,000-10,000 ft) | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZY07, ZYA7 - Med, High Heat | All |
| 1NP0456 | Propane conversion kit. Note: not for use with low NOx | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZY07, ZYA7 - Low Heat | All |
| 1NP0457 | Propane conversion kit | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZY07, ZYA7 - Med, High Heat | All |
| 1HA0458 | High altitude kit for propane (2,000-10,000 ft) Note: Not for use with low NOx | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 - Low, Med, High Heat ZY07, ZYA7 - Low Heat | All |
| 1HA0459 | High altitude kit for propane (2,000-10,000 ft) | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 - Low, Med, High Heat ZY07, ZYA7 - Med, High Heat | All |
| 1FE0414 | Flue exhaust kit | ZLG04, ZYG04, ZQG04, ZQG05 | All |
| 1FE0415 | Flue exhaust kit | ZXGA7, ZXG08, ZLG05, ZLG06, ZYG05, ZYG06, ZYG07, ZYGA7, ZQG06 | All |
| 1FE0416 | Flue exhaust kit | ZXG09, ZXG12, ZXG14, ZYG08, ZYG09, ZYG12, ZL08, ZL09, ZL12, ZL14 | All |
| 1HS0401 | Flue heat shield accessory | ZQ04, ZQ05, ZQ06, ZXA7, ZX08, ZX09, ZX12, ZX14, ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2EK04510625 | 6.5 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-(1 or 3)-60 |
| 2EK04510646 | 6.0 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 460-3-60 |
| 2EK04510725 | 6.5 KW electric heat | ZY07, ZYA7 | 208/230-3-60 |
| 2EK04510746 | 6.0 KW electric heat | ZY07, ZYA7 | 460-3-60 |
| 2EK04511058 | 9.2 KW electric heat | ZL04, ZL05, ZY04, ZY05, ZQ04, ZQ05 | 575-3-60 |
| 2EK04511125 | 10.5 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-(1 or 3)-60 |
| 2EK04511146 | 11.5 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 460-3-60 |
| 2EK04511458 | 13.8 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06 | 575-3-60 |
| 2EK04511446 | 14 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 460-3-60 |
| 2EK04511625 | 16 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-3-60 |
| 2EK04511725 | 16 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |

Table 1: Accessories

| Accessory kit number | Description | Where used | Voltage |
|----------------------|---|--|--------------------------------------|
| 2EK04511746 | 16.5 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |
| 2EK04511758 | 17 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZL08, ZL09, ZL14 | 575-3-60 |
| 2EK04512358 | 23 KW electric heat | ZL06, ZX06, ZY06, ZQ06 | 575-3-60 |
| 2EK04510625 | 6.5 KW electric heat | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | 208/230-(1 or 3)-60 |
| 2EK04512525 | 24.8 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |
| 2EK04512646 | 25.5KW electric heat | ZY07, ZYA7 | 460-3-60 |
| 2EK04512658 | 25.7KW electric heat | ZY07, ZYA7 | 575-3-60 |
| 2EK04512846 | 27.8 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |
| 2EK04513225 | 32 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |
| 2EK04513346 | 33 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |
| 2EK04513458 | 34 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZL08, ZL09, ZL14 | 575-3-60 |
| 2EK04514225 | 42.4 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 208/230-3-60 |
| 2EK04514246 | 41.7 KW electric heat | ZX08, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | 460-3-60 |
| 2LA04704725 | Low ambient accessory kit | ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06 | 208 V/230 V-1-60 or 208 V/230 V-3-60 |
| 2LA04704746 | Low ambient accessory kit | ZY04, ZY05, ZY07, ZYA7, ZQ04, ZQ05, ZQ06 | 460 V-3-60 |
| 2LA04704758 | Low ambient accessory kit | ZY04, ZY05, ZY08, ZQ04, ZQ05, ZQ06 | 575 V-3-60 |
| 2LA04704825 | Low ambient accessory kit | ZX08, ZX09, ZX12, ZY07, ZYA7, ZY08, ZY09, ZL08, ZL09 | 208 V/230 V-1-60 or 208 V/230 V-3-60 |
| 2LA04704846 | Low ambient accessory kit | ZX08, ZX09, ZX12, ZY07, ZYA7, ZY08, ZY09, ZL08, ZL09 | 460 V-3-60 |
| 2LA04704858 | Low ambient accessory kit | ZX08, ZX09, ZX12, ZY07, ZYA7, ZY08, ZY09, ZL08, ZL09 | 575 V-3-60 |
| 2LA04704925 | Low ambient accessory kit | ZX14, ZY12, ZL12, ZL14 | 208 V/230 V-3-60 |
| 2LA04704946 | Low ambient accessory kit | ZX14, ZY12, ZL12, ZL14 | 460 V-3-60 |
| 2LA04704958 | Low ambient accessory kit | ZX14, ZY12, ZL12, ZL14 | 575 V-3-60 |
| 2SD04701224 | Supply air stream smoke detector | ZXA7, ZX08, ZX09, ZX12, ZX14, ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZY07, ZYA7, ZY08, ZY09, ZY12, ZQ04, ZQ05, ZQ06, ZL08, ZL09, ZL12, ZL14 | All |
| 2SD04701124 | Return air stream smoke detector | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 2SD04701424 | Return air stream smoke detector | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 2SD04701324 | Combination supply & return air stream smoke detector | ZY04, ZY05, ZY06, ZL04, ZL05, ZL06, ZQ04, ZQ05, ZQ06, ZXA7 | All |

Table 1: Accessories

| Accessory kit number | Description | Where used | Voltage |
|----------------------|--|--|--------------|
| 2SD04701624 | Combination supply & return air stream smoke detector | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1TB0401 | Small footprint thru the base electrical & thru the curb gas | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1TB0402 | Large footprint thru the base electrical & thru the curb gas | ZX08, ZX09, ZX12, ZX14, ZY07, ZYA7, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1TB0403 | Small footprint thru the base electrical & gas | ZL04, ZL05, ZL06, ZY04, ZY05, ZY06, ZQ04, ZQ05, ZQ06, ZXA7 | All |
| 1TB0404 | Large footprint thru the base electrical & gas | ZX08, ZY07, ZYA7, ZX09, ZX12, ZX14, ZY08, ZY09, ZY12, ZL08, ZL09, ZL12, ZL14 | All |
| 1LD0420 | High speed drive kit | ZQ05 | 3-phase only |

AHRI cooling rating table

Table 2: AHRI cooling rating table

| Unit | Cooling stages | Nom. cooling capacity (tons) | Net cooling capacity (MBH) | Total power (kW) | SEER | EER (cooling only) | EER (A/C with gas heat) | IEER (cooling only) | IEER (A/C with gas heat) | IEER with Intelli Speed (cooling only) | IEER with Intelli Speed (gas heat) |
|-------------------|----------------|------------------------------|----------------------------|------------------|------|--------------------|-------------------------|---------------------|--------------------------|--|------------------------------------|
| ZQ04 | 1 | 3 | 35.0 | 2.8 | 14.0 | 12.2 | 12.2 | --- | --- | --- | --- |
| ZQ05 | 1 | 4 | 48.0 | 4.0 | 14.0 | 12.0 | 12.0 | --- | --- | --- | --- |
| ZQ06 | 1 | 5 | 58.5 | 4.8 | 14.1 | 12.1 | 12.1 | --- | --- | --- | --- |
| ZXA7 | 2 | 6 | 67.0 | 6.0 | --- | 11.2 | 11.0 | 12.9 | 12.9 | 14.8 | 14.8 |
| ZX08 | 2 | 7.5 | 85.0 | 6.6 | --- | 11.2 | 11.0 | N/A | N/A | 13.5 | 13.4 |
| ZX09 | 2 | 8.5 | 99.0 | 7.7 | --- | 11.2 | 11.0 | N/A | N/A | 13.3 | 13.0 |
| ZX12 | 2 | 10.0 | 116.0 | 10.3 | --- | 11.2 | 11.0 | N/A | N/A | 14.2 | 14.0 |
| ZX14 | 2 | 12.5 | 135.0 | 12.4 | --- | 11.0 | 10.8 | N/A | N/A | 12.7 | 12.5 |
| ZY04 | 1 | 3 | 36.0 | 2.6 | 15.0 | 12.0 | 12.0 | --- | --- | --- | --- |
| ZY05 | 1 | 4 | 49.0 | 3.5 | 15.4 | 12.0 | 12.0 | --- | --- | --- | --- |
| ZY06 | 1 | 5 | 58.0 | 4.4 | 15.2 | 12.0 | 12.0 | --- | --- | --- | --- |
| ZY07 | 1 | 6 | 72.0 | 5.0 | --- | 12.2 | 12.0 | 12.9 | 12.7 | --- | --- |
| ZYA7 | 2 | 6 | 71.0 | 5.89 | --- | 12.0 | 12.0 | 14.6 | 14.6 | 16.0 | 16.0 |
| ZY08 | 2 | 7.5 | 89.0 | 7.4 | --- | 12.2 | 12.0 | 12.9 | 12.7 | 14.1 | 14.0 |
| ZY09 | 2 | 8.5 | 98.0 | 7.3 | --- | 12.2 | 12.0 | 12.9 | 12.7 | 14.8 | 14.6 |
| ZY12 | 2 | 10.0 | 116.0 | 8.9 | --- | 11.7 | 11.5 | 12.9 | 12.7 | 14.0 | 14.0 |
| ZL04 ¹ | 2 | 3 | 36.0 | 2.7 | 17.2 | 13.2 | 13.2 | --- | --- | --- | --- |
| ZL05 ¹ | 2 | 4 | 47.5 | 3.7 | 17.1 | 12.7 | 12.7 | --- | --- | --- | --- |
| ZL06 ¹ | 2 | 5 | 59.0 | 4.6 | 17.0 | 12.8 | 12.8 | --- | --- | --- | --- |
| ZL08 | 3 | 7.5 | 89.0 | 7.4 | --- | 12.2 | 12.0 | N/A | N/A | 15.8 | 15.6 |
| ZL09 | 3 | 8.5 | 98.0 | 8.0 | --- | 12.2 | 12.0 | N/A | N/A | 16.3 | 16.1 |
| ZL12 | 3 | 10.0 | 116.0 | 9.6 | --- | 12.2 | 12.0 | N/A | N/A | 15.6 | 15.4 |
| ZL14 | 3 | 12.5 | 135.0 | 11.9 | --- | 11.2 | 11.0 | N/A | N/A | 14.9 | 14.7 |

¹ 208/230V & 460V direct drive units

Table 3: AHRI cooling ratings for two-stage cooling with multistage direct blower

| Voltage | Model | Tonnage | Cooling stage | KW | SEER | EER | AHRI capacity | Blowertype |
|-------------|-------|---------|---------------|-----|------|------|---------------|-------------------|
| 230 V/460 V | ZL04 | 3 | 2 | 2.7 | 17.2 | 13.2 | 36,000 | Multistage direct |
| | ZL05 | 4 | 2 | 3.7 | 17.1 | 12.7 | 47,500 | Multistage direct |
| | ZL06 | 5 | 2 | 4.6 | 17.0 | 12.8 | 59,000 | Multistage direct |
| 575 V | ZL04 | 3 | 2 | 2.8 | 16.5 | 12.8 | 36,000 | Multistage direct |
| | ZL05 | 4 | 2 | 3.8 | 16 | 12.5 | 47,000 | Multistage direct |
| | ZL06 | 5 | 2 | 4.8 | 15.6 | 12.2 | 58,500 | Multistage direct |

Table 4: AHRI cooling ratings: Two-stage cooling with belt drive and VFD blower

| Voltage | Model | Tonnage | Cooling stage | KW | SEER | EER | AHRI capacity | Blower type |
|----------------|--------------|----------------|----------------------|-----------|-------------|------------|----------------------|--------------------|
| 230V/460V | ZL04 | 3 | 2 | 2.9 | 16.0 | 12.5 | 36,000 | Belt drive +VFD |
| | ZL05 | 4 | 2 | 3.9 | 15.6 | 12.0 | 47,000 | Belt drive +VFD |
| | ZL06 | 5 | 2 | 4.7 | 15.8 | 12.4 | 58,500 | Belt drive +VFD |
| 575V | ZL04 | 3 | 2 | 3.0 | 15.1 | 12.2 | 36,000 | Belt drive +VFD |
| | ZL05 | 4 | 2 | 4.2 | 14.4 | 11.2 | 47,000 | Belt drive +VFD |
| | ZL06 | 5 | 2 | 4.9 | 14.9 | 11.9 | 58,000 | Belt drive +VFD |

AHRI 270 outdoor sound power levels

Table 5: Outdoor sound power levels

| Size (ton) | Sound rating ¹ dB(A) | Octave bands (Hz) | | | | | | | |
|-------------|---------------------------------|-------------------|------|------|------|------|------|------|------|
| | | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 |
| ZQ04 (3) | 81 | 79.0 | 83.0 | 77.5 | 76.0 | 76.0 | 76.0 | 71.0 | 66.5 |
| ZQ05 (4) | 79 | 81.5 | 84.0 | 78.0 | 75.0 | 74.0 | 69.5 | 66.0 | 61.5 |
| ZQ06 (5) | 80 | 85.0 | 83.0 | 77.0 | 76.0 | 76.5 | 72.0 | 67.5 | 65.5 |
| ZXA7 (6) | 79 | 84.0 | 82.0 | 77.0 | 75.0 | 74.5 | 71.0 | 66.5 | 63.0 |
| ZX08 (7.5) | 84 | 87.0 | 86.0 | 82.0 | 80.5 | 79.5 | 75.0 | 70.5 | 66.5 |
| ZX09 (8.5) | 83 | 91.0 | 86.0 | 79.0 | 79.5 | 78.0 | 74.0 | 70.5 | 69.0 |
| ZX12 (10) | 84 | 87.5 | 85.0 | 81.0 | 80.0 | 80.0 | 74.5 | 70.0 | 66.5 |
| ZX14 (12.5) | 90 | 87.5 | 88.5 | 85.0 | 86.0 | 85.0 | 81.0 | 78.5 | 73.0 |
| ZY04 (3) | 79 | 81.0 | 86.5 | 77.0 | 76.0 | 75.0 | 70.5 | 66.5 | 63.5 |
| ZY05 (4) | 79 | 84.0 | 83.0 | 76.0 | 75.0 | 74.0 | 70.0 | 66.0 | 63.5 |
| ZY06 (5) | 79 | 83.0 | 83.0 | 76.0 | 75.0 | 75.0 | 69.5 | 66.0 | 63.0 |
| ZY07 (6) | 84 | 90.0 | 87.0 | 81.5 | 81.0 | 79.0 | 74.5 | 71.0 | 69.5 |
| ZY08 (7.5) | 83 | 91.5 | 84.5 | 79.5 | 79.5 | 78.5 | 74.0 | 68.5 | 66.0 |
| ZY09 (8.5) | 83 | 92.0 | 87.0 | 81.0 | 80.5 | 79.0 | 74.0 | 69.0 | 66.0 |
| ZY12 (10) | 87 | 88.0 | 88.5 | 84.5 | 84.0 | 82.5 | 78.5 | 76.0 | 73.0 |
| ZL04 (3) | 75.0 | 76.5 | 80.0 | 74.5 | 71.0 | 71.0 | 65.0 | 63.5 | 63.0 |
| ZL05 (4) | 76.0 | 83.0 | 79.0 | 74.5 | 72.0 | 73.0 | 66.5 | 62.0 | 59.5 |
| ZL06 (5) | 78.0 | 84.0 | 84.5 | 76.5 | 75.5 | 73.5 | 68.5 | 65.0 | 60.5 |
| ZL08 (7.5) | 82 | 85.0 | 85.5 | 79.5 | 78.5 | 77.5 | 72.5 | 68.0 | 64.0 |
| ZL09 (8.5) | 82 | 88.5 | 83.0 | 81.0 | 79.0 | 78.0 | 73.5 | 69.0 | 65.5 |
| ZL12 (10) | 86 | 82.0 | 88.5 | 85.0 | 82.5 | 80.5 | 76.0 | 73.5 | 69.5 |
| ZL14 (12.5) | 86 | 84.0 | 88.5 | 84.5 | 83.5 | 81.0 | 76.5 | 73.5 | 69.5 |

¹ Rated in accordance with AHRI 270-2015.

Physical data

ZQ04 to ZQ06 physical data

Table 6: ZQ04 physical data

| Component | | Models | | | | Models |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|-------|---------------------|
| | | ZQG04 | | | | ZQE04 |
| Nominal tonnage | | 3 | | | | 3 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 38,100 | | | | 38,100 |
| | AHRI net capacity (Btu) | 35,000 | | | | 35,000 |
| | EER | 12.2 | | | | 12.2 |
| | SEER | 14 | | | | 14 |
| | IEER | - | | | | - |
| | Nominal CFM | 1,200 | | | | 1,200 |
| | System power (KW) | 2.8 | | | | 2.8 |
| | Refrigerant type | R-410A | | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | | |
| | System 1 | 3-6 | | | | 3-6 |
| System 2 | - | | | | - | |
| AHRI heating performance single-phase | Heating option | L | D | M | E | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - |
| | First stage heat input (K Btu) | - | - | - | - | - |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | - |
| | First stage heat output (K Btu) | - | - | - | - | - |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | - |
| | AFUE % | - | - | - | 81 | - |
| | FER compliant | - | - | - | Yes | - |
| | Number of burners | 2 | 2 | 3 | 3 | - |
| | Number of stages | 1 | 1 | 1 | 1 | - |
| | Temperature rise range (°F) | 10-40 | 20-50 | 35-65 | 50-80 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - |
| AHRI heating performance three-phase | Heating option | L | D | M | E | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - |
| | First stage heat input (K Btu) | - | - | - | 82 | - |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | - |
| | First stage heat output (K Btu) | - | - | - | 66 | - |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | - |
| | Number of burners | 2 | 2 | 3 | 3 | - |
| | Number of stages | 1 | 1 | 1 | 2 | - |
| | Temperature rise range (°F) | 28-46 | 35-58 | 44-74 | 55-78 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - |
| | Dimensions (in.) | Length | 74.1 | | | |
| Width | | 48.9 | | | | 48.9 |
| Height | | 32.5 | | | | 32.5 |
| Operating weight (lb) | | 498 | | | | 450 |
| Compressors | Type | Scroll | | | | Scroll |
| | Quantity | 1 | | | | 1 |
| | Unit capacity steps (%) | 100 | | | | 100 |
| Condenser coil data | Face area (sq. ft) | 16.3 | | | | 16.3 |
| | Rows | 1 | | | | 1 |
| | Fins per in. | 23 | | | | 23 |
| | Tube diameter (in./mm) | 0.63/16 | | | | 0.63/16 |
| | Circuitry type | 2-pass Microchannel | | | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft) | 5.5 | | | | 5.5 |
| | Rows | 2 | | | | 2 |
| | Fins per in. | 15 | | | | 15 |
| | Tube diameter | 0.375 | | | | 0.375 |
| | Circuitry type | Intertwined | | | | Intertwined |
| | Refrigerant control | Orifice | | | | Orifice |

Table 6: ZQ04 physical data

| Component | | Models | | Models | |
|------------------------------------|---------------------|--------------------------------|-------------|--------------------------------|-------------|
| | | ZQG04 | | ZQE04 | |
| Nominal tonnage | | 3 | | 3 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/4 | | 1/4 | |
| | Number of speeds | 1 | | 1 | |
| | RPM | 1,100 | | 1,100 | |
| Evaporator fan data - Direct drive | Nominal total CFM | 3,800 | | 3,800 | |
| | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan size (in.) | 10 x 10 | | 10 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 3/4 | | 3/4 | |
| Evaporator fan data - Belt drive | Motor RPM | 1,050 | | 1,050 | |
| | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 10 x 10 | 10 x 10 | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | Centrifugal | Centrifugal | Centrifugal |
| | Motor sheave | 1VL34 | 1VL44 | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A39 | A40 | A39 | A40 |
| | Motor HP, 1-phase | 1.5 | -- | 1.5 | -- |
| | Frame size, 1-phase | 56 Hz | -- | 56 Hz | -- |
| | Motor HP, 3-phase | 2.4 | 2.4 | 2.4 | 2.4 |
| | Frame size, 3-phase | 56Y | 56Y | 56Y | 56Y |
| Motor RPM | 1,725 | 1,725 | 1,725 | 1,725 | |
| Filters | Quantity - size | 2 - (16 x 25 x 2) ¹ | | 2 - (16 x 25 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

Table 7: ZQ05 physical data

| Component | | Models | | | | | | Models |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|-------|-----------------|-------|---------------------|
| | | ZQG05 | | | | | | ZQE05 |
| Nominal tonnage | | 4 | | | | | | 4 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 51,300 | | | | | | 51,300 |
| | AHRI net capacity (Btu) | 48,000 | | | | | | 48,000 |
| | EER | 12 | | | | | | 12 |
| | SEER | 14 | | | | | | 14 |
| | IEER | - | | | | | | - |
| | Nominal CFM | 1,575 | | | | | | 1,575 |
| | System power (KW) | 4 | | | | | | 4 |
| | Refrigerant type | R-410A | | | | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | | | | |
| | System 1 | 4-6 | | | | | | 4-6 |
| System 2 | - | | | | | | - | |
| AHRI heating performance single-phase | Heating option | L | D | M | E | N | F | |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | |
| | First stage heat input (K Btu) | - | - | - | - | - | - | |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 116 | 142 | |
| | First stage heat output (K Btu) | - | - | - | - | - | - | |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 93 | 114 | |
| | AFUE % | - | - | - | 81 | - | - | |
| | FER compliant | - | - | - | Yes | - | - | |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | |
| | Number of stages | 1 | 1 | 1 | 1 | 1 | 1 | |
| | Temperature rise range (°F) | 05-35 | 15-45 | 25-55 | 40-70 | 35-65 | 45-75 | |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 150 | 145 | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | | |
| AHRI heating performance three-phase | Heating option | L | D | M | E | N | F | |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | |
| | First stage heat input (K Btu) | - | - | - | - | - | 100 | |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | |
| | First stage heat output (K Btu) | - | - | - | - | - | 80 | |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | |
| | Number of stages | 1 | 1 | 1 | 1 | 1 | 2 | |
| | Temperature rise range (°F) | 21-35 | 26-43 | 33-56 | 41-69 | 44-73 | 49-77 | |
| Gas limit setting (°F) | 150 | 150 | 140 | 140 | 150 | 145 | | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | | |
| Dimensions (in.) | Length | 74.1 | | | | | | 74.1 |
| | Width | 48.9 | | | | | | 48.9 |
| | Height | 32.5 | | | | | | 32.5 |
| Operating weight (lb) | | 538 | | | | | | 487 |
| Compressors | Type | Scroll | | | | | | Scroll |
| | Quantity | 1 | | | | | | 1 |
| | Unit capacity steps (%) | 100 | | | | | | 100 |
| Condenser coil data | Face area (sq. ft) | 16.3 | | | | | | 16.3 |
| | Rows | 1 | | | | | | 1 |
| | Fins per in. | 23 | | | | | | 23 |
| | Tube diameter (in./mm) | .63/16 | | | | | | .63/16 |
| | Circuitry type | 2-pass Microchannel | | | | | | 2-pass Microchannel |

Table 7: ZQ05 physical data

| Component | | Models | | Models | |
|-----------------------------------|---------------------|--------------------------------|-------------|--------------------------------|-------------|
| | | ZQG05 | | ZQE05 | |
| Nominal tonnage | | 4 | | 4 | |
| Evaporator coil data | Face area (sq. ft) | 5.5 | | 5.5 | |
| | Rows | 3 | | 3 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| | Refrigerant control | Orifice | | Orifice | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/4 | | 1/4 | |
| | Number of speeds | 1 | | 1 | |
| | RPM | 1,100 | | 1,100 | |
| | Nominal total CFM | 3,800 | | 3,800 | |
| | Airflow option | A | | A | |
| Evaporatorfan data - Direct drive | Quantity | 1 | | 1 | |
| | Fan Size (in.) | 10 x 10 | | 10 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 1 | | 1 | |
| | Motor RPM | 1,050 | | 1,050 | |
| Evaporatorfan data - Belt drive | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 10 x 10 | 10 x 10 | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | Centrifugal | Centrifugal | Centrifugal |
| | Motor sheave | 1VL34 | 1VL44 | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A39 | A40 | A39 | A40 |
| | Motor HP, 1-phase | 1.5 | -- | 1.5 | -- |
| | Frame size, 1-phase | 56 Hz | -- | 56 Hz | -- |
| | Motor HP, 3-phase | 2.4 | 2.4 | 2.4 | 2.4 |
| | Frame size, 3-phase | 56Y | 56Y | 56Y | 56Y |
| Motor RPM | 1,725 | 1,725 | 1,725 | 1,725 | |
| Filters | Quantity - size | 2 - (16 x 25 x 2) ¹ | | 2 - (16 x 25 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

Table 8: ZQ06 physical data

| Component | Models | | | | | | | Models | |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|-------|----------------|-------|--------|---------------------|
| | ZQG06 | | | | | | | ZQE06 | |
| Nominal tonnage | | 5 | | | | | | | 5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 60,500 | | | | | | | 60,500 |
| | AHRI net capacity (Btu) | 58,500single phase | | | | | | | 58,500 |
| | EER | 12.1 | | | | | | | 12.1 |
| | SEER | 14.1 | | | | | | | 14.1 |
| | IEER | - | | | | | | | - |
| | Nominal CFM | 1,800 | | | | | | | 1,800 |
| | System power (KW) | 4.8 | | | | | | | 4.8 |
| | Refrigerant type | R-410A | | | | | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | | | | | |
| System 1 | 5-10 | | | | | | | 5-10 | |
| System 2 | - | | | | | | | - | |
| AHRI heating performance single-phase | Heating option | L | D | M | E | N | F | | |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High (Low-NOx) | High | | |
| | First stage heat input (K Btu) | - | - | - | - | - | - | | |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 116 | 142 | | |
| | First stage heat output (K Btu) | - | - | - | - | - | - | | |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 93 | 114 | | |
| | AFUE % | - | - | - | 81 | - | - | | |
| | FER compliant | - | - | - | Yes | - | - | | |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | | |
| | Number of stages | 1 | 1 | 1 | 1 | 1 | 1 | | |
| | Temperature rise range (°F) | 05-35 | 10-40 | 15-45 | 30-60 | 30-60 | 40-70 | | |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 145 | 140 | | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | | | |
| AHRI heating performance three-phase | Heating option | L | D | M | E | N | F | | |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High (Low-NOx) | High | | |
| | First stage heat input (K Btu) | - | - | - | - | - | 100 | | |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | | |
| | First stage heat output (K Btu) | - | - | - | - | - | 80 | | |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | | |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | | |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | | |
| | Number of stages | 1 | 1 | 1 | 1 | 1 | 2 | | |
| | Temperature rise range (°F) | 17-28 | 21-35 | 27-44 | 33-55 | 35-58 | 43-72 | | |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 145 | 140 | | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | | | |
| Dimensions (in.) | Length | 74.1 | | | | | | | 74.1 |
| | Width | 48.9 | | | | | | | 48.9 |
| | Height | 40.6 | | | | | | | 40.6 |
| Operating weight (lb) | | 610 | | | | | | | 561 |
| Compressors | Type | Scroll | | | | | | | Scroll |
| | Quantity | 1 | | | | | | | 1 |
| | Unit capacity steps (%) | 100 | | | | | | | 100 |
| Condenser coil data | Face area (sq. ft) | 21.1 | | | | | | | 21.1 |
| | Rows | 1 | | | | | | | 1 |
| | Fins per in. | 23 | | | | | | | 23 |
| | Tube diameter (in./mm) | .71/18 | | | | | | | .71/18 |
| | Circuitry type | 2-pass Microchannel | | | | | | | 2-pass Microchannel |

Table 8: ZQ06 physical data

| Component | Models | | Models |
|------------------------------------|---------------------|-------------|--------------------------------|
| | ZQG06 | | ZQE06 |
| Nominal tonnage | | 5 | 5 |
| Evaporator coil data | Face area (sq. ft) | 7.3 | |
| | Rows | 3 | |
| | Fins per in. | 15 | |
| | Tube diameter | 0.375 | |
| | Circuitry type | Intertwined | |
| | Refrigerant control | Orifice | |
| Condenser fan data | Quantity of fans | 1 | |
| | Fan diameter (in.) | 22 | |
| | Type | Prop | |
| | Drive type | Direct | |
| | Quantity of motors | 1 | |
| | Motor HP each | 1/2 | |
| | Number of speeds | 1 | |
| | RPM | 1,085 | |
| | Nominal total CFM | 4,500 | |
| Evaporator fan data - Direct drive | Airflow option | A | |
| | Quantity | 1 | |
| | Fan size (in.) | 11 x 10 | |
| | Type | Centrifugal | |
| | Motor HP | 1 | |
| | Motor RPM | 1,050 | |
| Evaporator fan data - Belt drive | Airflow option | B | C |
| | Quantity | 1 | 1 |
| | Fan size (in.) | 11 x 10 | 11 x 10 |
| | Type | Centrifugal | Centrifugal |
| | Motor sheave | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 |
| | Belt | A37 | A39 |
| | Motor HP, 1-phase | 1.5 | -- |
| | Frame size, 1-phase | 56 Hz | -- |
| | Motor HP, 3-phase | 2.4 | 2.9 |
| | Frame size, 3-phase | 56Y | 56 Hz |
| Motor RPM | 1,725 | 1,725 | |
| Filters | Quantity - size | | 4 - (16 x 16 x 2) ¹ |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

ZXA7, ZX08 to ZX14 physical data

Table 9: ZXA7 physical data

| Component | | Models | | | |
|--------------------------|-------------------------------------|---------------------|-------|---------------------|---|
| | | ZXGA7 | | ZXEA7 | |
| Nominal tonnage | | 6 | | 6 | |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 70,000 | | 70,000 | |
| | AHRI net capacity (Btu) | 67,000 | | 67,000 | |
| | EER | 11.0 | | 11.2 | |
| | SEER | - | | - | |
| | IEER | 12.9 | | 12.9 | |
| | IEER IntelliSpeed | 14.8 | | 14.8 | |
| | Nominal CFM | 2,200 | | 2,200 | |
| | System power (KW) | 6.0 | | 6.0 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 7-4 | | 7-4 | |
| System 2 | | | | | |
| AHRI heating performance | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | - | - | 100 | - |
| | Second stage heat input (K Btu) | 70 | 114 | 145 | - |
| | First stage heat output (K Btu) | - | - | 80 | - |
| | Second stage heat output (K Btu) | 56 | 91 | 116 | - |
| | AFUE % | - | - | - | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 2 | 3 | 3 | - |
| | Number of stages | 1 | 1 | 2 | - |
| | Temperature rise range (°F) | 17-29 | 28-47 | 36-60 | - |
| | Gas limit setting (°F) | 150 | 140 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | - |
| Dimensions (in.) | Length | 74.1 | | 74.1 | |
| | Width | 48.9 | | 48.9 | |
| | Height | 40.6 | | 40.6 | |
| Operating weight (lb) | | 668 | | 614 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 1 | | 1 | |
| | Unit capacity steps (%) | 67/100 | | 67/100 | |
| Condenser coil data | Face area (sq. ft) | 21.1 | | 21.1 | |
| | Rows | 1 | | 1 | |
| | Fins per in. | 23 | | 23 | |
| | Tube diameter (in./mm) | .79/20 | | .79/20 | |
| Circuitry type | | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 7.3 | | 7.3 | |
| | Rows | 4 | | 4 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| Refrigerant control | | TXV | | TXV | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/2 | | 1/2 | |
| | Number of speeds | 2 | | 2 | |
| | RPM | 900 / 1,150 | | 900 / 1,150 | |
| | Nominal total CFM | 3,600 / 4,600 | | 3,600 / 4,600 | |

Table 9: ZXA7 physical data

| Component | | Models | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZXGA7 | | | ZXEA7 | | |
| Nominal tonnage | | 6 | | | 6 | | |
| Airflow option | | A | B | C | A | B | C |
| Evaporator fan data belt drive | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 10 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK51 | AK51 | AK51 | AK51 | AK51 | AK51 |
| | Belt | A39 | A40 | A41 | A39 | A40 | A41 |
| | Motor max Bhp, 3 phase | 2.4 | 2.9 | 3.7 | 2.4 | 2.9 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| | Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ |
| Filters | Quantity - size | 4 - (16 x 16 x 2) ¹ | | | 4 - (16 x 16 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 10: ZX08 physical data

| Component | Models | | | | |
|--------------------------|-------------------------------------|---------------------|-------|---------------------|-------------|
| | ZXG08 | | | ZXE08 | |
| Nominal tonnage | | 7.5 | | | 7.5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 86,000 | | | 86,000 |
| | AHRI net capacity (Btu) | 83,000 | | | 83,000 |
| | EER | 11 | | | 11.2 |
| | SEER | - | | | - |
| | IEER IntelliSpeed | 12.8 | | | 13.0 |
| | Nominal CFM | 2,900 | | | 2,900 |
| | System power (KW) | 7.5 | | | 7.5 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 3-14 | | | 3-14 |
| System 2 | 3-14 | | | 3-14 | |
| AHRI heating performance | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 90 | 125 | 176 | - |
| | Second stage heat input (K Btu) | 125 | 180 | 220 | - |
| | First stage heat output (K Btu) | 72 | 100 | 141 | - |
| | Second stage heat output (K Btu) | 100 | 144 | 176 | - |
| | AFUE % | - | - | - | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 3 | 4 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 25-41 | 36-59 | 43-72 | - |
| | Gas limit setting (°F) | 140 | 150 | 140 | - |
| | Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - |
| Dimensions (in.) | Length | 87.1 | | | 87.1 |
| | Width | 61.7 | | | 61.7 |
| | Height | 40.6 | | | 40.6 |
| Operating weight (lb) | | 884 | | | 782 |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 2 | | | 2 |
| | Unit capacity steps (%) | 50/100 | | | 50/100 |
| Condenser coil data | Face area (sq. ft) | 21.1 | | | 21.1 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 23 | | | 23 |
| | Tube diameter (in./mm) | 1/25 | | | 1/25 |
| Circuitry type | | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 8.9 | | | 8.9 |
| | Rows | 3 | | | 3 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | | Intertwined |
| Refrigerant control | | Orifice | | Orifice | |
| Condenser fan data | Quantity of fans | 2 | | | 2 |
| | Fan diameter (in.) | 22 | | | 22 |
| | Type | Prop | | | Prop |
| | Drive type | Direct | | | Direct |
| | Quantity of motors | 2 | | | 2 |
| | Motor HP each | 1/2 | | | 1/2 |
| | Number of speeds | 1 | | | 1 |
| | RPM | 1,085 | | | 1,085 |
| | Nominal total CFM | 7,600 | | | 7,600 |

Table 10: ZX08 physical data

| Component | | Models | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZXG08 | | | ZXE08 | | |
| Nominal tonnage | | 7.5 | | | 7.5 | | |
| | | A | B | C | A | B | C |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 15 X 15 | 15 X 15 | 15 X 15 | 15 X 15 | 15 X 15 | 15 X 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A48 | A47 | A48 | A48 |
| | Motor max Bhp, 3 phase | 2.4 | 2.9 | 3.7 | 2.4 | 2.9 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ | |
| Filters | Quantity - size | 4 - (16 x 20 x 2) ¹ | | | 4 - (16 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 11: ZX09 physical data

| Component | | Models | | | |
|--------------------------|-------------------------------------|---------------------|-------|---------------------|---------|
| | | ZXG09 | | | ZXE09 |
| Nominal tonnage | | 8.5 | | | 8.5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 100,500 | | | 100,500 |
| | AHRI net capacity (Btu) | 97,500 | | | 97,500 |
| | EER | 11 | | | 11.2 |
| | SEER | - | | | - |
| | IEER IntelliSpeed | 12.7 | | | 12.9 |
| | Nominal CFM | 2,900 | | | 2,900 |
| | System power (KW) | 8.7 | | | 8.7 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 4.5 | | 4.5 | |
| | System 2 | 4.5 | | 4.5 | |
| AHRI heating performance | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 90 | 125 | 176 | - |
| | Second stage heat input (K Btu) | 125 | 180 | 220 | - |
| | First stage heat output (K Btu) | 72 | 100 | 141 | - |
| | Second stage heat output (K Btu) | 100 | 144 | 176 | - |
| | AFUE % | - | - | - | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 3 | 4 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 22-36 | 31-52 | 38-64 | - |
| | Gas limit setting (°F) | 140 | 150 | 140 | - |
| | Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - |
| Dimensions (in.) | Length | 87.2 | | | 87.2 |
| | Width | 61.7 | | | 61.7 |
| | Height | 48.6 | | | 48.6 |
| Operating weight (lb) | | 944 | | | 842 |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 2 | | | 2 |
| | Unit capacity steps (%) | 50/100 | | | 50/100 |
| Condenser coil data | Face area (sq. ft) | 25.5 | | | 25.5 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 23 | | | 23 |
| | Tube diameter (in./mm) | 1/25 | | | 1/25 |
| | Circuitry type | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | | 11.1 |
| | Rows | 3 | | | 3 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | Intertwined | |
| Refrigerant control | | Orifice | | | Orifice |
| Condenser fan data | Quantity of fans | 2 | | | 2 |
| | Fan diameter (in.) | 22 | | | 22 |
| | Type | Prop | | | Prop |
| | Drive type | Direct | | | Direct |
| | Quantity of motors | 2 | | | 2 |
| | Motor HP each | 1/2 | | | 1/2 |
| | Number of speeds | 1 | | | 1 |
| | RPM | 1,085 | | | 1,085 |
| Nominal total CFM | | 8,600 | | | 8,600 |

Table 11: ZX09 physical data

| Component | | Models | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZXG09 | | | ZXE09 | | |
| Nominal tonnage | | 8.5 | | | 8.5 | | |
| | | A | B | C | A | B | C |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A50 | A47 | A48 | A50 |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | 3.7 | 2.4 | 2.4 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (minimum efficiency reporting value).

Table 12: ZX12 physical data

| Component | Models | | | | |
|-----------------------------|-------------------------------------|---------------------|-------|---------------------|---|
| | ZXG12 | | ZXE12 | | |
| Nominal tonnage | | 10 | | 10 | |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 121,000 | | 121,000 | |
| | AHRI net capacity (Btu) | 116,000 | | 116,000 | |
| | EER | 11 | | 11.2 | |
| | SEER | - | | - | |
| | IEER IntelliSpeed | 14 | | 14.2 | |
| | Nominal CFM | 3,400 | | 3,400 | |
| | System power (KW) | 10.3 | | 10.3 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 5-4 | | 5-4 | |
| System 2 | 5-4 | | 5-4 | | |
| AHRI heating performance | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 125 | 176 | 200 | - |
| | Second stage heat input (K Btu) | 180 | 220 | 250 | - |
| | First stage heat output (K Btu) | 100 | 141 | 160 | - |
| | Second stage heat output (K Btu) | 144 | 176 | 200 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 4 | 5 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 27-44 | 33-54 | 37-62 | - |
| Gas limit setting (°F) | 150 | 140 | 160 | - | |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - | |
| Dimensions (in.) | Length | 87.2 | | 87.2 | |
| | Width | 61.7 | | 61.7 | |
| | Height | 55.3 | | 55.3 | |
| Operating weight (lb) | | 975 | | 869 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 2 | | 2 | |
| | Unit capacity steps (%) | 50/100 | | 50/100 | |
| Condenser coil data | Face area (sq. ft) | 25.5 | | 25.5 | |
| | Rows | 1 | | 1 | |
| | Fins per in. | 23 | | 23 | |
| | Tube diameter (in./mm) | 0.79/20 | | 0.79/20 | |
| Circuitry type | | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 | |
| | Rows | 4 | | 4 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| Refrigerant control | | Orifice | | Orifice | |
| Condenser fan data | Quantity of fans | 2 | | 2 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 21 | |
| | Motor HP each | 1/2 | | 1/2 | |
| | Number of speeds | 1 | | 1 | |
| | RPM | 1,140 | | 1,140 | |
| | Nominal total CFM | 8,200 | | 8,200 | |

Table 12: ZX12 physical data

| Component | | Models | | | | | |
|-----------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZXG12 | | | ZXE12 | | |
| Nominal tonnage | | 10 | | | 10 | | |
| | | A | B | C | A | B | C |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL44 | 1VP50 | 1VP56 | 1VL44 | 1VP50 | 1VP56 |
| | Blower sheave | AK79 | AK79 | BK85 | AK79 | AK79 | BK85 |
| | Belt | A50 | A50 | BX52 | A50 | A50 | BX52 |
| | Motor max Bhp, 3 phase | 2.4 | 3.7 | 5.25 | 2.4 | 3.7 | 5.25 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56HZ | 145TY | 56Y | 56HZ | 145TY | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 13: ZX14 physical data

| Component | | Models | | | |
|--------------------------------------|-------------------------------------|---------------------|-------|---------------------|---|
| | | ZXG14 | | ZXE14 | |
| Nominal tonnage | | 12.5 | | 12.5 | |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 140,000 | | 140,000 | |
| | AHRI net capacity (Btu) | 135,000 | | 135,000 | |
| | EER | 10.8 | | 11.0 | |
| | SEER | - | | - | |
| | IEER IntelliSpeed | 12.5 | | 12.7 | |
| | Nominal CFM | 3,900 | | 3,900 | |
| | System power (KW) | 12.40 | | 12.40 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-0 | | 6-0 | |
| System 2 | 6-0 | | 6-0 | | |
| AHRI heating performance three phase | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 125 | 176 | 200 | - |
| | Second stage heat input (K Btu) | 180 | 220 | 250 | - |
| | First stage heat output (K Btu) | 100 | 141 | 160 | - |
| | Second stage heat output (K Btu) | 144 | 176 | 200 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 4 | 5 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 21-36 | 26-43 | 30-49 | - |
| | Gas limit setting (°F) | 150 | 140 | 160 | - |
| | Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - |
| Dimensions (in.) | Length | 87.2 | | 87.2 | |
| | Width | 61.7 | | 61.7 | |
| | Height | 55.3 | | 55.3 | |
| Operating weight (lb) | | 1,037 | | 931 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 2 | | 2 | |
| | Unit capacity steps (%) | 50/100 | | 50/100 | |
| Condenser coil data | Face area (sq. ft) | 25.5 | | 25.5 | |
| | Rows | 1 | | 1 | |
| | Fins per in. | 23 | | 23 | |
| | Tube diameter (in./mm) | 1/25 | | 1/25 | |
| | Circuitry type | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 | |
| | Rows | 4 | | 4 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| | Refrigerant control | TXV | | TXV | |

Table 13: ZX14 physical data

| Component | Models | | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | ZXG14 | | | ZXE14 | | | |
| Nominal tonnage | | 12.5 | | | 12.5 | | |
| Condenser fan data | Quantity of fans | 1 | | | 1 | | |
| | Fan diameter (in.) | 30 | | | 30 | | |
| | Type | Prop | | | Prop | | |
| | Drive type | Direct | | | Direct | | |
| | Quantity of motors | 1 | | | 1 | | |
| | Motor HP each | 1 1/2 | | | 1 1/2 | | |
| | Number of speeds | 1 | | | 1 | | |
| | RPM | 1,140 | | | 1,140 | | |
| Nominal total CFM | 10,800 | | | 10,800 | | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL44 | 1VP50 | 1VP56 | 1VL44 | 1VP50 | 1VP56 |
| | Blower sheave | AK79 | AK79 | BK85 | AK79 | AK79 | BK85 |
| | Belt | A50 | A50 | BX54 | A50 | A50 | BX54 |
| | Motor max Bhp, 3 phase | 2.9 | 3.7 | 5.25 | 2.9 | 3.7 | 5.25 |
| | RPM | 1,750 | 1,750 | 1,750 | 1,750 | 1,750 | 1,750 |
| Frame size | 56Y | 182TZ | 184TZ | 56Y | 182TZ | 184TZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

ZY04 to ZY12 physical data

Table 14: ZY04 physical data

| Component | | Models | | | | |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|---------------------|------|
| | | ZYG04 | | | ZYE04 | |
| Nominal Tonnage | | 3 | | | 3 | |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 40,700 | | | 40,700 | |
| | AHRI net capacity (Btu) | 36,000 | | | 36,000 | |
| | EER | 12 | | | 12 | |
| | SEER | 15 | | | 15 | |
| | IEER | - | | | - | |
| | IEER IntelliSpeed | - | | | - | |
| | Nominal CFM | 1,200 | | | 1,200 | |
| | System power (KW) | 2.60 | | | 2.60 | |
| | Refrigerant type | R-410A | | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | | |
| System 1 | 4-10 | | | 4-10 | | |
| System 2 | - | | | - | | |
| AHRI heating performance single phase | Heating option | L | D | M | E | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - |
| | 1st stage heat input (K Btu) | - | - | - | - | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | - |
| | 1st stage heat output (K Btu) | - | - | - | - | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | - |
| | AFUE % | - | - | - | 81 | - |
| | FER compliant | - | - | - | Yes | - |
| | No. burners | 2 | 2 | 3 | 3 | - |
| | No. stages | 1 | 1 | 1 | 1 | - |
| | Temperature rise range (°F) | 10-40 | 20-50 | 35-65 | 50-80 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - |
| AHRI heating performance three phase | Heating option | L | D | M | E | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - |
| | 1st stage heat input (K Btu) | - | 49 | - | 82 | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | - |
| | 1st stage heat output (K Btu) | - | 39 | - | 66 | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | - |
| | No. burners | 2 | 2 | 3 | 3 | - |
| | No. stages | 1 | 2 | 1 | 2 | - |
| | Temperature rise range (°F) | 28-46 | 35-58 | 44-74 | 55-78 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - |
| | Dimensions (in.) | Length | 74.1 | | | 74.1 |
| Width | | 48.9 | | | 48.9 | |
| Height | | 32.5 | | | 32.5 | |
| Operating weight (lb) | 527 | | | 481 | | |
| Compressors | Type | Scroll | | | Scroll | |
| | Quantity | 1 | | | 1 | |
| | Unit capacity steps (%) | 100 | | | 100 | |
| Condenser coil data | Face area (sq. ft.) | 16.3 | | | 16.3 | |
| | Rows | 1 | | | 1 | |
| | Fins per in. | 23 | | | 23 | |
| | Tube diameter (in./mm) | .63/16 | | | .63/16 | |
| | Circuitry type | 2-pass Microchannel | | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft.) | 5.5 | | | 5.5 | |
| | Rows | 3 | | | 3 | |
| | Fins per in. | 15 | | | 15 | |
| | Tube diameter | 0.375 | | | 0.375 | |
| | Circuitry type | Intertwined | | | Intertwined | |
| Refrigerant control | TXV | | | TXV | | |

Table 14: ZY04 physical data

| Component | Models | | | | |
|----------------------------------|------------------------|--------------------------------|---------|--------------------------------|---------|
| | ZYG04 | | ZYE04 | | |
| Nominal Tonnage | | 3 | | 3 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/4 | | 1/4 | |
| | No. speeds | 1 | | 1 | |
| | RPM | 1,100 | | 1,100 | |
| Nominal total CFM | | 3,800 | | 3,800 | |
| Evaporator fan data direct drive | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan Size (in.) | 10 x 10 | | 10 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 3/4 | | 3/4 | |
| | RPM | 1,050 | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 10 x 10 | 10 x 10 | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A39 | A40 | A39 | A40 |
| | Motor Hp, 1 phase | 1.5 | - | 1.5 | - |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | 2.4 | 2.4 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56Y | 56Y | |
| FILTERS | Quantity - size | 2 - (16 x 25 x 2) ¹ | | 2 - (16 x 25 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 15: ZY05 physical data

| Component | Models | | | | | | | |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|-------|---------------------|-------|---|
| | ZYG05 | | | | ZYE05 | | | |
| Nominal tonnage | | 4 | | | | 4 | | |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 54,800 | | | | 54,800 | | |
| | AHRI net capacity (Btu) | 49,000 | | | | 49,000 | | |
| | EER | 12 | | | | 12 | | |
| | SEER | 15.4 | | | | 15.4 | | |
| | IEER | - | | | | - | | |
| | IEER IntelliSpeed | - | | | | - | | |
| | Nominal CFM | 1,600 | | | | 1,600 | | |
| | System power (KW) | 3.50 | | | | 3.50 | | |
| | Refrigerant type | R-410A | | | | R-410A | | |
| | Refrigerant charge (lb-oz) | | | | | | | |
| System 1 | 6-8 | | | | 6-8 | | | |
| System 2 | - | | | | - | | | |
| AHRI heating performance single phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | 1st stage heat input (K Btu) | - | - | - | - | - | - | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | 116 | 142 | - |
| | 1st stage heat output (K Btu) | - | - | - | - | - | - | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | 93 | 114 | - |
| | AFUE % | - | - | - | 81 | - | - | - |
| | FER compliant | - | - | - | Yes | - | - | - |
| | No. burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | No. stages | 1 | 1 | 1 | 1 | 1 | 1 | - |
| AHRI heating performance three phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | 1st stage heat input (K Btu) | - | 49 | - | 82 | - | 100 | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | - |
| | 1st stage heat output (K Btu) | - | 39 | - | 66 | - | 80 | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | - |
| | No. burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | No. stages | 1 | 2 | 1 | 2 | 1 | 2 | - |
| | Temperature rise range (°F) | 21-35 | 26-43 | 33-56 | 41-69 | 44-73 | 49-77 | - |
| Gas limit setting (°F) | 150 | 150 | 140 | 140 | 150 | 145 | - | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | - | |
| Dimensions (in.) | Length | 74.1 | | | | 74.1 | | |
| | Width | 48.9 | | | | 48.9 | | |
| | Height | 40.6 | | | | 40.6 | | |
| Operating weight (lb) | 618 | | | | 564 | | | |
| Compressors | Type | Scroll | | | | Scroll | | |
| | Quantity | 1 | | | | 1 | | |
| | Unit capacity steps (%) | 100 | | | | 100 | | |
| Condenser coil data | Face area (sq. ft.) | 21.1 | | | | 21.1 | | |
| | Rows | 1 | | | | 1 | | |
| | Fins per in. | 23 | | | | 23 | | |
| | Tube diameter (in./mm) | .79/20 | | | | .79/20 | | |
| Evaporator coil data | Circuitry type | 2-pass Microchannel | | | | 2-pass Microchannel | | |
| | Face area (sq. ft.) | 7.3 | | | | 7.3 | | |
| | Rows | 3 | | | | 3 | | |
| | Fins per in. | 15 | | | | 15 | | |
| | Tube diameter | 0.375 | | | | 0.375 | | |
| Refrigerant control | Circuitry type | Intertwined | | | | Intertwined | | |
| | Refrigerant control | TXV | | | | TXV | | |

Table 15: ZY05 physical data

| Component | Models | | | | |
|--------------------------------|------------------------|--------------------------------|---------|--------------------------------|---------|
| | ZYG05 | | ZYE05 | | |
| Nominal tonnage | | 4 | | 4 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/4 | | 1/4 | |
| | No. speeds | 1 | | 1 | |
| | RPM | 1,100 | | 1,100 | |
| Nominal total CFM | | 4,000 | | 4,000 | |
| Evap fan data direct drive | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan Size (in.) | 10 x 10 | | 10 x10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 1 | | 1 | |
| RPM | | 1,050 | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 10 x 10 | 10 x 10 | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | 1VL44 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A39 | A40 | A39 | A40 |
| | Motor Hp, 1 phase | 1.5 | - | 1.5 | - |
| | Motor Max Bhp, 3 phase | 2.4 | 2.9 | 2.4 | 2.9 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56Y | 56Y | |
| Filters | Quantity - size | 4 - (16 x 16 x 2) ¹ | | 4 - (16 x 16 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 16: ZY06 physical data

| Component | Models | | | | | | | |
|---------------------------------------|-------------------------------------|---------------------|-------|---------------|-------|-----------------|-------|---------------------|
| | ZYG06 | | | | | | ZYE06 | |
| Nominal Tonnage | | 5 | | | | | | 5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 60,000 | | | | | | 60,000 |
| | AHRI net capacity (Btu) | 58,000 | | | | | | 58,000 |
| | EER | 12 | | | | | | 12 |
| | SEER | 15.2 | | | | | | 15.2 |
| | IEER | - | | | | | | - |
| | IEER IntelliSpeed | - | | | | | | - |
| | Nominal CFM | 1,600 | | | | | | 1,600 |
| | System power (KW) | 4.40 | | | | | | 4.40 |
| | Refrigerant type | R-410A | | | | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | | | | |
| System 1 | 7-10 | | | | | | 7-10 | |
| System 2 | - | | | | | | - | |
| AHRI heating performance single phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | 1st stage heat input (K Btu) | - | - | - | - | - | - | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | 116 | 142 | - |
| | 1st stage heat output (K Btu) | - | - | - | - | - | - | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | 93 | 114 | - |
| | AFUE % | | | | 81 | | | - |
| | FER compliant | | | | Yes | | | - |
| | No. burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | No. stages | 1 | 1 | 1 | 1 | 1 | 1 | - |
| | Temperature rise range (°F) | 05-35 | 10-40 | 15-45 | 30-60 | 30-60 | 40-70 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 145 | 140 | - |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | - | |
| AHRI heating performance three phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | 1st stage heat input (K Btu) | - | 49 | - | 82 | - | 100 | - |
| | 2nd stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | - |
| | 1st stage heat output (K Btu) | - | 39 | - | 66 | - | 80 | - |
| | 2nd stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | - |
| | No. burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | No. stages | 1 | 2 | 1 | 2 | 1 | 2 | - |
| | Temperature rise range (°F) | 17-28 | 21-35 | 27-44 | 33-55 | 35-58 | 43-72 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 145 | 140 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | - |
| Dimensions (in.) | Length | 74.1 | | | | | | 74.1 |
| | Width | 48.9 | | | | | | 48.9 |
| | Height | 40.6 | | | | | | 40.6 |
| Operating weight (lb) | 636 | | | | | | 582 | |
| Compressors | Type | Scroll | | | | | | Scroll |
| | Quantity | 1 | | | | | | 1 |
| | Unit capacity steps (%) | 100 | | | | | | 100 |
| Condenser coil data | Face area (sq. ft.) | 21.1 | | | | | | 21.1 |
| | Rows | 1 | | | | | | 1 |
| | Fins per in. | 23 | | | | | | 23 |
| | Tube diameter (in./mm) | .79/20 | | | | | | .79/20 |
| | Circuitry type | 2-pass Microchannel | | | | | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft.) | 7.3 | | | | | | 7.3 |
| | Rows | 4 | | | | | | 4 |
| | Fins per in. | 15 | | | | | | 15 |
| | Tube diameter | 0.375 | | | | | | 0.375 |
| | Circuitry type | Intertwined | | | | | | Intertwined |
| Refrigerant control | TXV | | | | | | TXV | |

Table 16: ZY06 physical data

| Component | Models | | | | |
|----------------------------------|------------------------|--------------------------------|---------|--------------------------------|---------|
| | ZYG06 | | ZYE06 | | |
| Nominal Tonnage | | 5 | | 5 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/2 | | 1/2 | |
| | No. speeds | 1 | | 1 | |
| | RPM | 1,085 | | 1,085 | |
| Nominal total CFM | | 4,600 | | 4,600 | |
| Evaporator fan data direct drive | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan size (in.) | 11 x 10 | | 11 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 1 | | 1 | |
| | RPM | 1,050 | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 10 |
| | Type | Centrifugal | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A37 | A39 | A37 | A39 |
| | Motor Hp, 1 phase | 1.5 | - | 1.5 | - |
| | Motor max Bhp, 3 phase | 2.4 | 2.9 | 2.4 | 2.9 |
| | RPM | 1,750 | 1,750 | 1,750 | 1,750 |
| Frame size | 56HZ | 56Z | 56HZ | 56Z | |
| Filters | Quantity - size | 4 - (16 x 16 x 2) ¹ | | 4 - (16 x 16 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 17: ZY07 physical data

| Component | | Models | | |
|--------------------------|-------------------------------------|---------------------|-------|---------------------|
| | | ZYG07 | | ZYE07 |
| Nominal Tonnage | | 6 | | 6 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 73,500 | | 73,500 |
| | AHRI net capacity (Btu) | 72,000 | | 72,000 |
| | EER | 12 | | 12.2 |
| | SEER | - | | - |
| | IEER | 12.7 | | 12.9 |
| | IEER IntelliSpeed | - | | - |
| | Nominal CFM | 2,200 | | 2,200 |
| | System power (KW) | 6.1 | | 6.1 |
| | Refrigerant type | R-410A | | R-410A |
| | Refrigerant charge (lb-oz) | | | |
| | System 1 | 7-12 | | 7-12 |
| System 2 | - | | - | |
| AHRI heating performance | Heating option | D | E | F |
| | Heating model | Low | Med | High |
| | 1st stage heat input (K Btu) | 57 | 90 | 110 |
| | 2nd stage heat input (K Btu) | 72 | 125 | 150 |
| | 1st stage heat output (K Btu) | 46 | 72 | 88 |
| | 2nd stage heat output (K Btu) | 58 | 100 | 120 |
| | AFUE % | | | |
| | Steady state efficiency (%) | 80 | 80 | 80 |
| | No. burners | 2 | 3 | 3 |
| | No. stages | 2 | 2 | 2 |
| | Temperature rise range (°F) | 18-30 | 31-51 | 37-62 |
| | Gas limit setting (°F) | 140 | 140 | 160 |
| | Gas piping connection (in.) | 1/2 | 3/4 | 3/4 |
| Dimensions (in.) | Length | 87.2 | | 87.2 |
| | Width | 61.7 | | 61.7 |
| | Height | 40.6 | | 40.6 |
| Operating weight (lb) | 795 | | 725 | |
| Compressors | Type | Scroll | | Scroll |
| | Quantity | 1 | | 1 |
| | Unit capacity steps (%) | 100 | | 100 |
| Condenser coil data | Face area (sq. ft.) | 21.1 | | 21.1 |
| | Rows | 1 | | 1 |
| | Fins per in. | 23 | | 23 |
| | Tube diameter (in./mm) | 1/20 | | 1/20 |
| | Circuitry type | 2-pass Microchannel | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft.) | 8.9 | | 8.9 |
| | Rows | 3 | | 3 |
| | Fins per in. | 15 | | 15 |
| | Tube diameter | 0.375 | | 0.375 |
| | Circuitry type | Intertwined | | Intertwined |
| | Refrigerant control | TXV | | TXV |
| Condenser fan data | Quantity of fans | 2 | | 2 |
| | Fan diameter (in.) | 22 | | 22 |
| | Type | Prop | | Prop |
| | Drive type | Direct | | Direct |
| | Quantity of motors | 2 | | 2 |
| | Motor HP each | 1/2 | | 1/2 |
| | No. speeds | 1 | | 1 |
| | RPM | 1,085 | | 1,085 |
| | Nominal total CFM | 7,600 | | 7,600 |

Table 17: ZY07 physical data

| Component | | Models | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZYG07 | | | ZYE07 | | |
| Nominal Tonnage | | 6 | | | 6 | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A48 | A47 | A48 | A48 |
| | Motor max Bhp, 3 phase | 2.4 | 2.9 | 3.7 | 2.4 | 2.9 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| | Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ |
| Filters | Quantity - size | 4 - (16 x 20 x 2) ¹ | | | 4 - (16 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 18: ZYA7 physical data

| Component | Models | | | | |
|---------------------------------------|-------------------------------------|---------------------|-------|-------|---------------------|
| | ZYGA7 | | | ZYEA7 | |
| Nominal tonnage | | 6 | | | 6 |
| AHRI cooling performance | Gross Capacity @ AHRI A point (Btu) | 73,000 | | | 73,000 |
| | AHRI net capacity (Btu) | 71,000 | | | 71,000 |
| | EER | 12 | | | 12 |
| | SEER | - | | | - |
| | CV IEER | 14.6 | | | 14.6 |
| | IEER IntelliSpeed | 16 | | | 16 |
| | Nominal CFM | 2,350 | | | 2,350 |
| | System power (KW) | 5.87 | | | 5.89 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 7-11 | | | 7-11 |
| System 2 | - | | | - | |
| ¹ AHRI heating performance | Heating Option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | 1st stage heat input (K Btu) | 57 | 90 | 110 | - |
| | 2nd stage heat input (K Btu) | 72 | 125 | 150 | - |
| | 1st stage heat output (K Btu) | 46 | 72 | 88 | - |
| | 2nd stage heat output (K Btu) | 58 | 100 | 120 | - |
| | AFUE % | | | | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | No. burners | 2 | 3 | 3 | - |
| | No. stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 18-30 | 31-51 | 37-62 | - |
| | Gas limit setting (°F) | 140 | 140 | 160 | - |
| | Gas piping connection (in.) | 1/2 | 3/4 | 3/4 | - |
| Dimensions (in.) | Length | 87.2 | | | 87.2 |
| | Width | 61.7 | | | 61.7 |
| | Height | 40.6 | | | 40.6 |
| Operating weight (lb) | 899 | | | 829 | |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 1 | | | 1 |
| | Unit capacity steps (%) | 67/100 | | | 67/100 |
| Condenser coil data | Face area (sq. ft.) | 21.1 | | | 21.1 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 23 | | | 23 |
| | Tube diameter (in./mm) | 1/25 | | | 1/25 |
| | Circuitry type | 2-pass Microchannel | | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft.) | 8.9 | | | 8.9 |
| | Rows | 3 | | | 3 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | | Intertwined |
| | Refrigerant control | TXV | | | TXV |
| Condenser fan data | Quantity of fans | 2 | | | 2 |
| | Fan diameter (in.) | 22 | | | 22 |
| | Type | Prop | | | Prop |
| | Drive type | Direct | | | Direct |
| | Quantity of motors | 2 | | | 2 |
| | Motor HP each | 1/2 | | | 1/2 |
| | No. speeds | 1 | | | 1 |
| | RPM | 1,085 | | | 1,085 |
| | Nominal total CFM | 7,600 | | | 7,600 |

Table 18: ZYA7 physical data

| Component | | Models | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZYGA7 | | | ZYEA7 | | |
| Nominal tonnage | | 6 | | | 6 | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A48 | A47 | A48 | A48 |
| | Motor Max Bhp, 3 phase | 2.4 | 2.9 | 3.7 | 2.4 | 2.9 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| | Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ |
| Filters | Quantity - size | 4 - (16 x 20 x 2) ² | | | 4 - (16 x 20 x 2) ¹ | | |

1 1st Stage 60% of 2nd Stage.

2 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 19: ZY08 physical data

| Component | | Models | | | |
|--------------------------------------|-------------------------------------|---------------------|-------|-------|---------------------|
| | | ZYG08 | | | ZYE08 |
| Nominal tonnage | | 7.5 | | | 7.5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 93,000 | | | 93,000 |
| | AHRI net capacity (Btu) | 89,000 | | | 89,000 |
| | EER | 12 | | | 12.2 |
| | SEER | - | | | - |
| | IEER | 12.7 | | | 12.9 |
| | IEER IntelliSpeed | 14.0 | | | 14.1 |
| | Nominal CFM | 2,900 | | | 2,900 |
| | System power (KW) | 7.40 | | | 7.40 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| System 1 | 5-12 | | | 5-12 | |
| System 2 | 5-14 | | | 5-14 | |
| AHRI heating performance three phase | Heating Option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | 1st stage heat input (K Btu) | 90 | 125 | 176 | - |
| | 2nd stage heat input (K Btu) | 125 | 180 | 220 | - |
| | 1st stage heat output (K Btu) | 72 | 100 | 141 | - |
| | 2nd stage heat output (K Btu) | 100 | 144 | 176 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | No. burners | 3 | 4 | 5 | - |
| | No. stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 25-41 | 36-59 | 43-72 | - |
| | Gas limit setting (°F) | 140 | 150 | 140 | - |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - | |
| Dimensions (in.) | Length | 87.2 | | | 87.2 |
| | Width | 61.7 | | | 61.7 |
| | Height | 48.6 | | | 48.6 |
| Operating weight (lb) | 970 | | | 868 | |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 2 | | | 2 |
| | Unit Capacity Steps (%) | 50/100 | | | 50/100 |
| Condenser coil data | Face area (sq. ft.) | 25.5 | | | 25.5 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 23 | | | 23 |
| | Tube diameter (in./mm) | .79/20 | | | .79/20 |
| | Circuitry type | 2-pass Microchannel | | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft.) | 11.1 | | | 11.1 |
| | Rows | 4 | | | 4 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | | Intertwined |
| | Refrigerant control | TXV | | | TXV |

Table 19: ZY08 physical data

| Component | Models | | | | | | |
|-----------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | ZYG08 | | | ZYE08 | | | |
| Nominal tonnage | | 7.5 | | | 7.5 | | |
| Condenser fan data | Quantity of fans | 2 | | | 2 | | |
| | Fan diameter (in.) | 22 | | | 22 | | |
| | Type | Prop | | | Prop | | |
| | Drive type | Direct | | | Direct | | |
| | Quantity of motors | 2 | | | 2 | | |
| | Motor HP each | 1/2 | | | 1/2 | | |
| | No. speeds | 1 | | | 1 | | |
| | RPM | 1,085 | | | 1,085 | | |
| Nominal total CFM | 8,200 | | | 8,200 | | | |
| Evap fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A50 | A47 | A48 | A50 |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | 3.7 | 2.4 | 2.4 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. Throwaway, Standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 20: ZY09 physical data

| Component | Model | | | | |
|--------------------------|-------------------------------------|---------------------|-------|-------|---------------------|
| | ZYG09 | | | ZYE09 | |
| Nominal tonnage | | 8.5 | | | 8.5 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 109,500 | | | 109,500 |
| | AHRI net capacity (Btu) | 98,000 | | | 98,000 |
| | EER | 12 | | | 12.2 |
| | SEER | - | | | - |
| | IEER | 12.7 | | | 12.9 |
| | IEER IntelliSpeed | 14.6 | | | 14.8 |
| | Nominal CFM | 3,300 | | | 3,300 |
| | System power (KW) | 7.30 | | | 7.30 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-8 | | | 6-8 |
| System 2 | 6-0 | | | 6-0 | |
| AHRI heating performance | Heating options | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | 1st stage heat input (K Btu) | 90 | 125 | 176 | - |
| | 2nd stage heat input (K Btu) | 125 | 180 | 220 | - |
| | 1st stage heat output (K Btu) | 72 | 100 | 141 | - |
| | 2nd stage heat output (K Btu) | 100 | 144 | 176 | - |
| | AFUE % | - | - | - | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | No. burners | 3 | 4 | 5 | - |
| | No. stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 22-36 | 31-52 | 38-64 | - |
| | Gas limit setting (°F) | 140 | 150 | 140 | - |
| | Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - |
| | Dimensions (in.) | Length | 87.2 | | |
| Width | | 61.7 | | | 61.7 |
| Height | | 48.6 | | | 48.6 |
| Operating weight (lb) | 980 | | | 878 | |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 2 | | | 2 |
| | Unit capacity steps (%) | 50/100 | | | 50/100 |
| Condenser coil data | Face area (sq. ft.) | 25.5 | | | 25.5 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 23 | | | 23 |
| | Tube diameter (in./mm) | 1/25 | | | 1/25 |
| | Circuitry type | 2-pass Microchannel | | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft.) | 11.1 | | | 11.1 |
| | Rows | 4 | | | 4 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | | Intertwined |
| | Refrigerant control | TXV | | | TXV |
| Condenser fan data | Quantity of fans | 2 | | | 2 |
| | Fan diameter (in.) | 22 | | | 22 |
| | Type | Prop | | | Prop |
| | Drive type | Direct | | | Direct |
| | Quantity of motors | 2 | | | 2 |
| | Motor HP each | 1/2 | | | 1/2 |
| | No. speeds | 1 | | | 1 |
| | RPM | 1,085 | | | 1,085 |
| | Nominal total CFM | 8,600 | | | 8,600 |

Table 20: ZY09 physical data

| Component | | Model | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZYG09 | | | ZYE09 | | |
| Nominal tonnage | | 8.5 | | | 8.5 | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A50 | A47 | A48 | A50 |
| | Motor Max Bhp, 3 phase | 2.4 | 2.4 | 3.7 | 2.4 | 2.4 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| | Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 21: ZY12 physical data

| Component | Model | | | | |
|--------------------------|-------------------------------------|---------------------|-------|-------|---------------------|
| | ZYG12 | | | ZYE12 | |
| Nominal tonnage | | 10 | | | 10 |
| AHRI cooling performance | Gross capacity @ AHRI A point (Btu) | 123,700 | | | 123,700 |
| | AHRI net capacity (Btu) | 116,000 | | | 116,000 |
| | EER | 11.5 | | | 11.7 |
| | SEER | - | | | - |
| | IEER | 12.7 | | | 12.9 |
| | IEER IntelliSpeed | 14.0 | | | 14.0 |
| | Nominal CFM | 3,200 | | | 3,200 |
| | System power (KW) | 8.90 | | | 8.90 |
| | Refrigerant type | R-410A | | | R-410A |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-8 | | | 6-8 |
| System 2 | 7-0 | | | 7-0 | |
| AHRI heating performance | Heating options | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | 1st stage heat input (K Btu) | 125 | 176 | 200 | - |
| | 2nd stage heat input (K Btu) | 180 | 220 | 250 | - |
| | 1st stage heat output (K Btu) | 100 | 141 | 160 | - |
| | 2nd stage heat output (K Btu) | 144 | 176 | 200 | - |
| | AFUE % | - | - | - | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | No. burners | 4 | 5 | 5 | - |
| | No. stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 27-44 | 33-54 | 37-62 | - |
| | Gas limit setting (°F) | 150 | 140 | 160 | - |
| | Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - |
| Dimensions (in.) | Length | 87.2 | | | 87.2 |
| | Width | 61.7 | | | 61.7 |
| | Height | 55.3 | | | 55.3 |
| Operating weight (lb) | 1,008 | | | 902 | |
| Compressors | Type | Scroll | | | Scroll |
| | Quantity | 2 | | | 2 |
| | Unit capacity steps (%) | 50/100 | | | 50/100 |
| Condenser coil data | Face area (Sq. Ft.) | 24.9 | | | 24.9 |
| | Rows | 1 | | | 1 |
| | Fins per in. | 21 | | | 21 |
| | Tube diameter (in./MM) | 1.26/32 | | | 1.26/32 |
| | Circuitry type | 2-pass Microchannel | | | 2-pass Microchannel |
| Evaporator coil data | Face area (Sq. Ft.) | 11.1 | | | 11.1 |
| | Rows | 4 | | | 4 |
| | Fins per in. | 15 | | | 15 |
| | Tube diameter | 0.375 | | | 0.375 |
| | Circuitry type | Intertwined | | | Intertwined |
| | Refrigerant control | TXV | | | TXV |
| Condenser fan data | Quantity of fans | 1 | | | 1 |
| | Fan diameter (in.) | 30 | | | 30 |
| | Type | Prop | | | Prop |
| | Drive type | Direct | | | Direct |
| | Quantity of motors | 1 | | | 1 |
| | Motor HP each | 1 1/2 | | | 1 1/2 |
| | No. speeds | 1 | | | 1 |
| | RPM | 1,140 | | | 1,140 |
| | Nominal total CFM | 9,700 | | | 9,700 |

Table 21: ZY12 physical data

| Component | | Model | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | | ZYG12 | | | ZYE12 | | |
| Nominal tonnage | | 10 | | | 10 | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL44 | 1VP50 | 1VP56 | 1VL44 | 1VP50 | 1VP56 |
| | Blower sheave | AK79 | AK79 | BK85 | AK79 | AK79 | BK85 |
| | Belt | A50 | A50 | BX52 | A50 | A50 | BX52 |
| | Motor Max Bhp, 3 phase | 2.4 | 3.7 | 5.25 | 2.4 | 3.7 | 5.25 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Filters | Quantity - Size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

ZL04 to ZL06 physical data

Table 22: ZL04 physical data

| Component | | Models | | | | |
|---------------------------------------|--------------------------------------|---------------|-------|---------------|-------|---|
| | | ZLG04 | | ZLE04 | | |
| Nominal tonnage | | 3 | | 3 | | |
| AHRI cooling performance direct drive | Gross capacity at AHRI A point (Btu) | 36,850 | | 36,850 | | |
| | AHRI net capacity (Btu) | 36,000 | | 36,000 | | |
| | EER 230 V/460 V | 13.2 | | 13.2 | | |
| | SEER 230 V/460 V | 17.2 | | 17.2 | | |
| | EER 575 V | 12.8 | | 12.8 | | |
| | SEER 575 V | 16.5 | | 16.5 | | |
| | Nominal CFM | 1,300 | | 1,300 | | |
| | System power 230 V/460 V (kW) | 2.7 | | 2.7 | | |
| | System power 575 V (kW) | 2.8 | | 2.8 | | |
| | Refrigerant type | R-410A | | R-410A | | |
| | Refrigerant charge (lb-oz) | | | | | |
| | System 1 | 4-3 | | 4-3 | | |
| System 2 | - | | - | | | |
| AHRI cooling performance belt drive | Gross capacity at AHRI A point (Btu) | 37,200 | | 37,200 | | |
| | AHRI net capacity (Btu) | 36,000 | | 36,000 | | |
| | EER 230 V/460 V | 12.5 | | 12.5 | | |
| | SEER 230 V/460 V | 16.0 | | 16.0 | | |
| | EER 575 V | 12.2 | | 12.2 | | |
| | SEER 575 V | 15.1 | | 15.1 | | |
| | Nominal CFM | 1,300 | | 1,300 | | |
| | System power 230 V/460 V (kW) | 2.9 | | 2.9 | | |
| | System power 575 V (kW) | 3.0 | | 3.0 | | |
| | Refrigerant type | R-410A | | R-410A | | |
| | Refrigerant charge (lb-oz) | | | | | |
| | System 1 | 4-3 | | 4-3 | | |
| System 2 | - | | - | | | |
| AHRI heating performance single phase | Heating option | L | D | M | E | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - |
| | First stage heat input (K Btu) | - | - | - | - | - |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | - |
| | First stage heat output (K Btu) | - | - | - | - | - |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | - |
| | AFUE % | - | - | - | 81 | - |
| | FER compliant | - | - | - | Yes | - |
| | Number of burners | 2 | 2 | 3 | 3 | - |
| | Number of stages | 1 | 1 | 1 | 1 | - |
| | Temperature rise range (°F) | 10-40 | 20-50 | 35-65 | 50-80 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | - |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - | |

Table 22: ZL04 physical data

| Component | Models | | | | | | |
|--------------------------------------|----------------------------------|--------------------------------|---------|---------------|-------|--------------------------------|---------|
| | ZLG04 | | | | ZLE04 | | |
| Nominal tonnage | | 3 | | | | 3 | |
| AHRI heating performance three phase | Heating option | L | D | M | E | - | |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | - | |
| | First stage heat input (K Btu) | - | 49 | - | 82 | - | |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | - | |
| | First stage heat output (K Btu) | - | 39 | - | 66 | - | |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | - | |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | - | |
| | Number of burners | 2 | 2 | 3 | 3 | - | |
| | Number of stages | 1 | 2 | 1 | 2 | - | |
| | Temperature rise range (°F) | 28-46 | 35-58 | 44-74 | 55-78 | - | |
| Gas limit setting (°F) | 150 | 150 | 140 | 140 | - | | |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | - | | |
| Dimensions (in.) | Length | 74.1 | | | | 74.1 | |
| | Width | 48.9 | | | | 48.9 | |
| | Height | 32.5 | | | | 32.5 | |
| Operating weight (lb) | 555 | | | | 481 | | |
| Compressors | Type | Scroll | | | | Scroll | |
| | Quantity | 1 | | | | 1 | |
| | Unit capacity steps (%) | 67/100 | | | | 67/100 | |
| Condenser coil data | Face area (sq. ft) | 16.3 | | | | 16.3 | |
| | Rows | 1 | | | | 1 | |
| | Fins per in. | 23 | | | | 23 | |
| | Tube diameter (in./mm) | 0.63/16 | | | | 0.63/16 | |
| | Circuitry type | 2-pass Microchannel | | | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 5.5 | | | | 5.5 | |
| | Rows | 3 | | | | 3 | |
| | Fins per in. | 15 | | | | 15 | |
| | Tube diameter | 0.375 | | | | 0.375 | |
| | Circuitry type | Intertwined | | | | Intertwined | |
| | Refrigerant control | TXV | | | | TXV | |
| Condenser fan data | Quantity of fans | 1 | | | | 1 | |
| | Fan diameter (in.) | 22 | | | | 22 | |
| | Type | Prop | | | | Prop | |
| | Drive type | Direct | | | | Direct | |
| | Quantity of motors | 1 | | | | 1 | |
| | Motor HP each | 1/3 | | | | 1/3 | |
| | Number of speeds | 1 | | | | 1 | |
| | RPM | 800/1,000 | | | | 800/1,000 | |
| | Nominal total CFM | 3,800 | | | | 3,800 | |
| Evaporator fan data direct drive | Airflow option | A | | | | A | |
| | Quantity | 1 | | | | 1 | |
| | Fan size (in.) | 10 x 10 | | | | 10 x 10 | |
| | Type | Centrifugal | | | | 1,100 Centrifugal | |
| | Motor HP | 3/4 | | | | 3/4 | |
| | RPM | 1,050 | | | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | | | B | C |
| | Quantity | 1 | 1 | | | 1 | 1 |
| | Fan size (in.) | 10 x 10 | 10 x 10 | | | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | | | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | | | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | | | AK46 | AK46 |
| | Belt | A39 | A40 | | | A39 | A40 |
| | Motor Hp, 1 phase | 1.5 | - | | | 1.5 | - |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | | | 2.4 | 2.4 |
| | RPM | 1,750 | 1,750 | | | 1,750 | 1,750 |
| Frame size | 56Y | 56Y | | | 56Y | 56Y | |
| Filters | Quantity - size | 2 - (16 x 25 x 2) ¹ | | | | 2 - (16 x 25 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 23: ZL05 physical data

| Component | Models | | | | | | | |
|---------------------------------------|--------------------------------------|---------------------|-------|---------------|-------|---------------------|-------|---|
| | ZLG05 | | | | ZLE05 | | | |
| Nominal tonnage | | 4 | | | | 4 | | |
| AHRI cooling performance direct drive | Gross capacity at AHRI A point (Btu) | 49,000 | | | | 49,000 | | |
| | AHRI net capacity (Btu) | 47,500 | | | | 47,500 | | |
| | EER 230 V/460 V | 12.7 | | | | 12.7 | | |
| | SEER 230 V/460 V | 17.1 | | | | 17.1 | | |
| | EER 575 V | 12.5 | | | | 12.5 | | |
| | SEER 575 V | 16.0 | | | | 16.0 | | |
| | Nominal CFM | 1,600 | | | | 1,600 | | |
| | System power 230 V/460 V (kW) | 3.7 | | | | 3.7 | | |
| | System power 575 V (kW) | 3.8 | | | | 3.8 | | |
| | Refrigerant type | R-410A | | | | R-410A | | |
| | Refrigerant charge (lb-oz) | - | | | | - | | |
| | System 1 | 6-4 | | | | 6-4 | | |
| System 2 | - | | | | - | | | |
| AHRI cooling performance belt drive | Gross capacity at AHRI A point (Btu) | 49,000 | | | | 49,000 | | |
| | AHRI net capacity (Btu) | 47,000 | | | | 47,000 | | |
| | EER 230 V/460 V | 12.0 | | | | 12.0 | | |
| | SEER 230 V/460 V | 15.6 | | | | 15.6 | | |
| | EER 575 V | 11.2 | | | | 11.2 | | |
| | SEER 575 V | 14.4 | | | | 14.4 | | |
| | Nominal CFM | 1,600 | | | | 1,600 | | |
| | System power 230V/460V (kW) | 3.7 | | | | 3.7 | | |
| | System power 575 V (kW) | 4.2 | | | | 4.2 | | |
| | Refrigerant type | R-410A | | | | R-410A | | |
| | Refrigerant charge (lb-oz) | - | | | | - | | |
| | System 1 | 6-4 | | | | 6-4 | | |
| | System 2 | - | | | | - | | |
| | Nominal CFM | 1,600 | | | | 1,600 | | |
| AHRI heating performance three phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | First stage heat input (K Btu) | - | 49 | - | 82 | - | 100 | - |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | - |
| | First stage heat output (K Btu) | - | 39 | - | 66 | - | 80 | - |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | - |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | Number of stages | 1 | 2 | 1 | 2 | 1 | 2 | - |
| | Temperature rise range (°F) | 21-35 | 26-43 | 33-56 | 41-69 | 44-73 | 49-77 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 150 | 145 | - |
| | Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | - |
| Dimensions (in.) | Length | 74.1 | | | | 74.1 | | |
| | Width | 48.9 | | | | 48.9 | | |
| | Height | 40.6 | | | | 40.6 | | |
| Operating weight (lb) | 602 | | | | 564 | | | |
| Compressors | Type | Scroll | | | | Scroll | | |
| | Quantity | 1 | | | | 1 | | |
| | Unit capacity steps (%) | 67/100 | | | | 67/100 | | |
| Condenser coil data | Face area (sq. ft) | 21.1 | | | | 21.1 | | |
| | Rows | 1 | | | | 1 | | |
| | Fins per in. | 23 | | | | 23 | | |
| | Tube diameter (in./mm) | 0.79/20 | | | | 0.79/20 | | |
| Evaporator coil data | Circuitry Type | 2-pass Microchannel | | | | 2-pass Microchannel | | |
| | Face area (sq. ft) | 7.3 | | | | 7.3 | | |
| | Rows | 3 | | | | 3 | | |
| | Fins per in. | 15 | | | | 15 | | |
| | Tube diameter | 0.375 | | | | 0.375 | | |
| | Circuitry type | Intertwined | | | | Intertwined | | |
| Refrigerant control | TXV | | | | TXV | | | |

Table 23: ZL05 physical data

| Component | Models | | | | |
|----------------------------------|------------------------|--------------------------------|---------|--------------------------------|---------|
| | ZLG05 | | ZLE05 | | |
| Nominal tonnage | | 4 | | 4 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/3 | | 1/3 | |
| | Number of speeds | 1 | | 1 | |
| | RPM | 1,100 | | 1,100 | |
| Nominal total CFM | | 4,000 | | 4,000 | |
| Evaporator fan data direct drive | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan size (in.) | 10 x 10 | | 10 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 1 | | 1 | |
| RPM | | 1,050 | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | B | C |
| | Quantity | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 10 x 10 | 10 x 10 | 10 x 10 | 10 x 10 |
| | Type | Centrifugal | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | 1VL44 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A39 | A40 | A39 | A40 |
| | Motor Hp, 1 phase | 1.5 | - | 1.5 | - |
| | Motor max Bhp, 3 phase | 2.4 | 2.9 | 2.4 | 2.9 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | | 56Y | 56Y | 56Y | 56Y |
| Filters | Quantity - size | 4 - (16 x 16 x 2) ¹ | | 4 - (16 x 16 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

Table 24: ZL06 physical data

| Component | Models | | | | | | | |
|---------------------------------------|--------------------------------------|---------------------|-------|---------------|-------|---------------------|-------|---|
| | ZLG06 | | | | ZLE06 | | | |
| Nominal tonnage | | 5 | | | | 5 | | |
| AHRI cooling performance direct drive | Gross capacity at AHRI A point (Btu) | 60,700 | | | | 60,700 | | |
| | AHRI net capacity (Btu) | 59,000 | | | | 59,000 | | |
| | EER 230 V/460 V | 12.8 | | | | 12.8 | | |
| | SEER 230 V/460 V | 17.0 | | | | 17.0 | | |
| | EER 575 V | 12.2 | | | | 12.2 | | |
| | SEER 575 V | 15.6 | | | | 15.6 | | |
| | Nominal CFM | 1,825 | | | | 1,825 | | |
| | System power 230 V/460 V (kW) | 4.6 | | | | 4.6 | | |
| | System power 575 V (kW) | 4.8 | | | | 4.8 | | |
| | Refrigerant type | R-410A | | | | R-410A | | |
| | Refrigerant charge (lb-oz) | | | | | | | |
| System 1 | 8-8 | | | | 8-8 | | | |
| System 2 | - | | | | - | | | |
| AHRI cooling performance belt drive | Gross capacity at AHRI A point (Btu) | 60,100 | | | | 60,100 | | |
| | AHRI net capacity (Btu) | 58,500 | | | | 58,500 | | |
| | EER 230 V/460 V | 12.4 | | | | 12.4 | | |
| | SEER 230 V/460 V | 15.8 | | | | 15.8 | | |
| | EER 575 V | 11.9 | | | | 11.9 | | |
| | SEER 575 V | 14.9 | | | | 14.9 | | |
| | Nominal CFM | 1,825 | | | | 1,825 | | |
| | System power 230 V/460 V (kW) | 4.7 | | | | 4.7 | | |
| | System power 575 V (kW) | 4.9 | | | | 4.9 | | |
| | Refrigerant type | R-410A | | | | R-410A | | |
| | Refrigerant charge (lb-oz) | | | | | | | |
| System 1 | 8-8 | | | | 8-8 | | | |
| System 2 | - | | | | - | | | |
| AHRI heating performance three phase | Heating options | L | D | M | E | N | F | - |
| | Heating model | Low (Low-NOx) | Low | Med (Low-NOx) | Med | High, (Low-NOx) | High | - |
| | First stage heat input (K Btu) | - | 49 | - | 82 | - | 100 | - |
| | Second stage heat input (K Btu) | 56 | 70 | 90 | 112 | 118 | 145 | - |
| | First stage heat output (K Btu) | - | 39 | - | 66 | - | 80 | - |
| | Second stage heat output (K Btu) | 45 | 56 | 72 | 90 | 94 | 116 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | 80 | 80 | 80 | - |
| | Number of burners | 2 | 2 | 3 | 3 | 3 | 3 | - |
| | Number of stages | 1 | 2 | 1 | 2 | 1 | 2 | - |
| | Temperature rise range (°F) | 17-28 | 21-35 | 27-44 | 33-55 | 35-58 | 43-72 | - |
| | Gas limit setting (°F) | 150 | 150 | 140 | 140 | 145 | 140 | - |
| Gas piping connection (in.) | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | 1/2 | - | |
| Dimensions (in.) | Length | 74.1 | | | | 74.1 | | |
| | Width | 48.9 | | | | 48.9 | | |
| | Height | 40.6 | | | | 40.6 | | |
| Operating weight (lb) | 631 | | | | 582 | | | |
| Compressors | Type | Scroll | | | | Scroll | | |
| | Quantity | 1 | | | | 1 | | |
| | Unit capacity steps (%) | 67/100 | | | | 67/100 | | |
| Condenser coil data | Face area (sq. ft) | 21.1 | | | | 21.1 | | |
| | Rows | 2 | | | | 2 | | |
| | Fins per in | 23 | | | | 23 | | |
| | Tube diameter (in./mm) | 0.79/20 | | | | 0.79/20 | | |
| | Circuitry type | 3-pass Microchannel | | | | 3-pass Microchannel | | |
| Evaporator coil data | Face area (sq. ft) | 7.3 | | | | 7.3 | | |
| | Rows | 4 | | | | 4 | | |
| | Fins per in. | 15 | | | | 15 | | |
| | Tube diameter | 0.375 | | | | 0.375 | | |
| | Circuitry type | Intertwined | | | | Intertwined | | |
| | Refrigerant control | TXV | | | | TXV | | |

Table 24: ZL06 physical data

| Component | Models | | | | |
|----------------------------------|------------------------|--------------------------------|---------|--------------------------------|---------|
| | ZLG06 | | ZLE06 | | |
| Nominal tonnage | | 5 | | 5 | |
| Condenser fan data | Quantity of fans | 1 | | 1 | |
| | Fan diameter (in.) | 22 | | 22 | |
| | Type | Prop | | Prop | |
| | Drive type | Direct | | Direct | |
| | Quantity of motors | 1 | | 1 | |
| | Motor HP each | 1/3 | | 1/3 | |
| | Number of speeds | 1 | | 1 | |
| | RPM | 1,000/1,100 | | 1,000/1,100 | |
| Nominal total CFM | | 4,600 | | 4,600 | |
| Evaporator fan data direct drive | Airflow option | A | | A | |
| | Quantity | 1 | | 1 | |
| | Fan size (in.) | 11 x 10 | | 11 x 10 | |
| | Type | Centrifugal | | Centrifugal | |
| | Motor HP | 1 | | 1 | |
| | RPM | 1,050 | | 1,050 | |
| Evaporator fan data belt drive | Airflow option | B | C | B | C |
| | quantity | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 10 |
| | Type | Centrifugal | | Centrifugal | |
| | Motor sheave | 1VL34 | 1VL44 | 1VL34 | 1VL44 |
| | Blower sheave | AK46 | AK46 | AK46 | AK46 |
| | Belt | A37 | A39 | A37 | A39 |
| | Motor Hp, 1 phase | 1.5 | - | 1.5 | - |
| | Motor Max Bhp, 3 Phase | 2.4 | 2.9 | 2.4 | 2.9 |
| | RPM | 1,750 | 1,750 | 1,750 | 1,750 |
| Frame size | 56HZ | 56Z | 56HZ | 56Z | |
| Filters | Quantity - size | 4 - (16 x 16 x 2) ¹ | | 4 - (16 x 16 x 2) ¹ | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value).

ZL08 to ZL14 physical data

Table 25: ZL08 physical data

| Component | | Models | | |
|--------------------------------------|--------------------------------------|---------------------|-------|---------------------|
| | | ZLG08 | | ZLE08 |
| Nominal tonnage | | 7.5 | | 7.5 |
| AHRI cooling performance | Gross capacity at AHRI A point (Btu) | 93,000 | | 93,000 |
| | AHRI net capacity (Btu) | 89,000 | | 89,000 |
| | EER | 12 | | 12.2 |
| | SEER | - | | - |
| | IEER IntelliSpeed | 15.6 | | 15.8 |
| | VAV IEER | 15.2 | | 15.4 |
| | Nominal CFM | 2,900 | | 2,900 |
| | System power (KW) | 7.40 | | 7.40 |
| | Refrigerant type | R-410A | | R-410A |
| | Refrigerant charge (lb-oz) | | | |
| System 1 | 6-0 | | 6-0 | |
| System 2 | 6-6 | | 6-6 | |
| AHRI heating performance three phase | Heating option | D | E | F |
| | Heating model | Low | Med | High |
| | First stage heat input (K Btu) | 90 | 125 | 176 |
| | Second stage heat input (K Btu) | 125 | 180 | 220 |
| | First stage heat output (K Btu) | 72 | 100 | 141 |
| | Second stage heat output (K Btu) | 100 | 144 | 176 |
| | Steady state efficiency (%) | 80 | 80 | 80 |
| | Number of burners | 3 | 4 | 5 |
| | Number of stages | 2 | 2 | 2 |
| | Temperature rise range (°F) | 25-41 | 36-59 | 43-72 |
| | Gas limit setting (°F) | 140 | 150 | 140 |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | |
| Dimensions (in.) | Length | 87.2 | | 87.2 |
| | Width | 61.7 | | 61.7 |
| | Height | 48.6 | | 48.6 |
| Operating weight (lb) | | 1,040 | | 920 |
| Compressors | Type | Scroll | | Scroll |
| | Quantity | 2 | | 2 |
| | Unit capacity steps (%) | 34 / 67 / 100 | | 34 / 67 / 100 |
| Condenser coil data | Face area (sq. ft) | 25.5 | | 25.5 |
| | Rows | 1 | | 1 |
| | Fins per in. | 23 | | 23 |
| | Tube diameter (in./mm) | 1/25 | | 1/25 |
| | Circuitry Type | 2-pass Microchannel | | 2-pass Microchannel |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 |
| | Rows | 4 | | 4 |
| | Fins per in. | 15 | | 15 |
| | Tube diameter | 0.375 | | 0.375 |
| | Circuitry type | Intertwined | | Intertwined |
| | Refrigerant control | TXV | | TXV |

Table 25: ZL08 physical data

| Component | Models | | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | ZLG08 | | | ZLE08 | | | |
| Nominal tonnage | | 7.5 | | | 7.5 | | |
| Condenser fan data | Quantity of fans | 2 | | | 2 | | |
| | Fan diameter (in.) | 22 | | | 22 | | |
| | Type | Prop | | | Prop | | |
| | Drive type | Direct | | | Direct | | |
| | Quantity of motors | 2 | | | 2 | | |
| | Motor HP each | 1/2 | | | 1/2 | | |
| | Number of speeds | 1 | | | 1 | | |
| | RPM | 1,085 | | | 1,085 | | |
| Nominal total CFM | 8,600 | | | 8,600 | | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan Size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A50 | A47 | A48 | A50 |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | 3.7 | 2.4 | 2.4 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

Table 26: ZL09 physical data

| Component | | Models | | | |
|--------------------------------------|--------------------------------------|---------------------|-------|---------------------|---|
| | | ZLG09 | | ZLE09 | |
| Nominal tonnage | | 8.5 | | 8.5 | |
| AHRI cooling performance | Gross capacity at AHRI A point (Btu) | 101,000 | | 101,000 | |
| | AHRI net capacity (Btu) | 98,000 | | 98,000 | |
| | EER | 12 | | 12.2 | |
| | SEER | - | | - | |
| | IEER IntelliSpeed | 16.1 | | 16.3 | |
| | VAV IEER | 15.7 | | 15.9 | |
| | Nominal CFM | 3,000 | | 3,000 | |
| | System power (KW) | 8.00 | | 8.00 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-4 | | 6-4 | |
| System 2 | 6-4 | | 6-4 | | |
| AHRI heating performance three phase | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 90 | 125 | 176 | - |
| | Second stage heat input (K Btu) | 125 | 180 | 220 | - |
| | First stage heat output (K Btu) | 72 | 100 | 141 | - |
| | Second stage heat output (K Btu) | 100 | 144 | 176 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 3 | 4 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 22-36 | 31-52 | 38-64 | - |
| | Gas limit setting (°F) | 140 | 150 | 140 | - |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - | |
| Dimensions (in.) | Length | 87.2 | | 87.2 | |
| | Width | 61.7 | | 61.7 | |
| | Height | 48.6 | | 48.6 | |
| Operating weight (lb) | | 1,030 | | 925 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 2 | | 2 | |
| | Unit capacity steps (%) | 34 / 67 /100 | | 34 / 67 /100 | |
| Condenser coil data | Face area (sq. ft) | 25.5 | | 25.5 | |
| | Rows | 1 | | 1 | |
| | Fins per inch | 23 | | 23 | |
| | Tube diameter (in./mm) | 1/25 | | 1/25 | |
| | Circuitry type | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 | |
| | Rows | 4 | | 4 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| | Refrigerant control | TXV | | TXV | |

Table 26: ZL09 physical data

| Component | Models | | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | ZLG09 | | | ZLE09 | | | |
| Nominal tonnage | | 8.5 | | | 8.5 | | |
| Condenser fan data | Quantity of fans | 2 | | | 2 | | |
| | Fan diameter (in.) | 22 | | | 22 | | |
| | Type | Prop | | | Prop | | |
| | Drive type | Direct | | | Direct | | |
| | Quantity of motors | 2 | | | 2 | | |
| | Motor HP each | 1/2 | | | 1/2 | | |
| | Number of speeds | 1 | | | 1 | | |
| | RPM | 1,085 | | | 1,085 | | |
| Nominal total CFM | 8,600 | | | 8,600 | | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL34 | 1VL44 | 1VP50 | 1VL34 | 1VL44 | 1VP50 |
| | Blower sheave | AK74 | AK74 | AK74 | AK74 | AK74 | AK74 |
| | Belt | A47 | A48 | A50 | A47 | A48 | A50 |
| | Motor max Bhp, 3 phase | 2.4 | 2.4 | 3.7 | 2.4 | 2.4 | 3.7 |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 |
| Frame size | 56Y | 56Y | 56HZ | 56Y | 56Y | 56HZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

Table 27: ZL12 physical data

| Component | | Models | | | |
|--------------------------------------|--------------------------------------|---------------------|-------|---------------------|---|
| | | ZLG12 | | ZLE12 | |
| Nominal tonnage | | 10 | | 10 | |
| AHRI cooling performance | Gross capacity at AHRI A point (Btu) | 120,200 | | 120,200 | |
| | AHRI net capacity (Btu) | 116,000 | | 116,000 | |
| | EER | 12 | | 12.2 | |
| | SEER | - | | - | |
| | IEER IntelliSpeed | 15.4 | | 15.6 | |
| | VAV IEER | 15.2 | | 15.4 | |
| | Nominal CFM | 3,100 | | 3,100 | |
| | System power (KW) | 9.60 | | 9.60 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-0 | | 6-0 | |
| System 2 | 6-10 | | 6-10 | | |
| AHRI heating performance three phase | Heating Option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 125 | 176 | 200 | - |
| | Second stage heat input (K Btu) | 180 | 220 | 250 | - |
| | First stage heat output (K Btu) | 100 | 141 | 160 | - |
| | Second stage heat output (K Btu) | 144 | 176 | 200 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 4 | 5 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 27-44 | 33-54 | 37-62 | - |
| | Gas limit setting (°F) | 150 | 140 | 160 | - |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - | |
| Dimensions (in.) | Length | 87.2 | | 87.2 | |
| | Width | 61.7 | | 61.7 | |
| | Height | 55.3 | | 55.3 | |
| Operating weight (lb) | | 1,050 | | 955 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 2 | | 2 | |
| | Unit Capacity Steps (%) | 34 / 67 /100 | | 34 / 67 /100 | |
| Condenser coil data | Face area (sq. ft) | 24.9 | | 24.9 | |
| | Rows | 1 | | 1 | |
| | Fins per in. | 21 | | 21 | |
| | Tube diameter (in./mm) | 1.26/32 | | 1.26/32 | |
| | Circuitry type | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 | |
| | Rows | 4 | | 4 | |
| | Fins per in. | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry type | Intertwined | | Intertwined | |
| | Refrigerant control | TXV | | TXV | |

Table 27: ZL12 physical data

| Component | Models | | | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|--|
| | ZLG12 | | | ZLE12 | | | | |
| Nominal tonnage | | 10 | | | 10 | | | |
| Condenser fan data | Quantity of fans | 1 | | | 1 | | | |
| | Fan diameter (i) | 30 | | | 30 | | | |
| | Type | Prop | | | Prop | | | |
| | Drive type | Direct | | | Direct | | | |
| | Quantity of motors | 1 | | | 1 | | | |
| | Motor HP each | 1 1/2 | | | 1 1/2 | | | |
| | Number of speeds | 1 | | | 1 | | | |
| | RPM | 1,140 | | | 1,140 | | | |
| Nominal total CFM | 9,700 | | | 9,700 | | | | |
| Evaporator fan data belt drive | Airflow Option | A | B | C | A | B | C | |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 | |
| | Fan Size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | |
| | Type | Centrifugal | | | | | | |
| | Motor sheave | 1VL44 | 1VP50 | 1VP56 | 1VL44 | 1VP50 | 1VP56 | |
| | Blower sheave | AK79 | AK79 | BK85 | AK79 | AK79 | BK85 | |
| | Belt | A50 | A50 | BX52 | A50 | A50 | BX52 | |
| | Motor max Bhp, 3 phase | 2.4 | 3.7 | 5.25 | 2.4 | 3.7 | 5.25 | |
| | RPM | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | 1,725 | |
| Frame size | 56Y | 56HZ | 145TY | 56Y | 56HZ | 145TY | | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

Table 28: ZL14 physical data

| Component | | Models | | | |
|--------------------------------------|--------------------------------------|---------------------|-------|---------------------|---|
| | | ZLG14 | | ZLE14 | |
| Nominal tonnage | | 12.5 | | 12.5 | |
| AHRI cooling performance | Gross capacity at AHRI A point (Btu) | 139,500 | | 139,500 | |
| | AHRI net capacity (Btu) | 135,000 | | 135,000 | |
| | EER | 11.0 | | 11.2 | |
| | SEER | - | | - | |
| | IEER IntelliSpeed | 14.7 | | 14.9 | |
| | VAV IEER | 14.5 | | 14.7 | |
| | Nominal CFM | 3,900 | | 3,900 | |
| | System power (KW) | 11.90 | | 11.90 | |
| | Refrigerant type | R-410A | | R-410A | |
| | Refrigerant charge (lb-oz) | | | | |
| | System 1 | 6-2 | | 6-2 | |
| System 2 | 6-8 | | 6-8 | | |
| AHRI heating performance three phase | Heating option | D | E | F | - |
| | Heating model | Low | Med | High | - |
| | First stage heat input (K Btu) | 125 | 176 | 200 | - |
| | Second stage heat input (K Btu) | 180 | 220 | 250 | - |
| | First stage heat output (K Btu) | 100 | 141 | 160 | - |
| | Second stage heat output (K Btu) | 144 | 176 | 200 | - |
| | Steady state efficiency (%) | 80 | 80 | 80 | - |
| | Number of burners | 4 | 5 | 5 | - |
| | Number of stages | 2 | 2 | 2 | - |
| | Temperature rise range (°F) | 21-36 | 26-43 | 30-49 | - |
| | Gas limit setting (°F) | 150 | 140 | 160 | - |
| Gas piping connection (in.) | 3/4 | 3/4 | 3/4 | - | |
| Dimensions (in.) | Length | 87.2 | | 87.2 | |
| | Width | 61.7 | | 61.7 | |
| | Height | 55.3 | | 55.3 | |
| Operating weight (lb) | | 1,070 | | 980 | |
| Compressors | Type | Scroll | | Scroll | |
| | Quantity | 2 | | 2 | |
| | Unit capacity steps (%) | 34 / 67 /100 | | 34 / 67 /100 | |
| Condenser coil data | Face area (sq. ft) | 24.9 | | 24.9 | |
| | Rows | 1 | | 1 | |
| | Fins per in. | 21 | | 21 | |
| | Tube diameter (in./mm) | 1.26/32 | | 1.26/32 | |
| | Circuitry Type | 2-pass Microchannel | | 2-pass Microchannel | |
| Evaporator coil data | Face area (sq. ft) | 11.1 | | 11.1 | |
| | Rows | 4 | | 4 | |
| | Fins per inch | 15 | | 15 | |
| | Tube diameter | 0.375 | | 0.375 | |
| | Circuitry Type | Intertwined | | Intertwined | |
| | Refrigerant control | TXV | | TXV | |

Table 28: ZL14 physical data

| Component | Models | | | | | | |
|--------------------------------|------------------------|--------------------------------|---------|---------|--------------------------------|---------|---------|
| | ZLG14 | | | ZLE14 | | | |
| Nominal tonnage | | 12.5 | | | 12.5 | | |
| Condenser fan data | Quantity of fans | 1 | | | 1 | | |
| | Fan diameter (in.) | 30 | | | 30 | | |
| | Type | Prop | | | Prop | | |
| | Drive type | Direct | | | Direct | | |
| | Quantity of motors | 1 | | | 1 | | |
| | Motor HP each | 1 1/2 | | | 1 1/2 | | |
| | Number of speeds | 1 | | | 1 | | |
| | RPM | 1,140 | | | 1,140 | | |
| Nominal total CFM | 9,700 | | | 9,700 | | | |
| Evaporator fan data belt drive | Airflow option | A | B | C | A | B | C |
| | Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| | Fan size (in.) | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 | 15 x 15 |
| | Type | Centrifugal | | | Centrifugal | | |
| | Motor sheave | 1VL44 | 1VP50 | 1VP56 | 1VL44 | 1VP50 | 1VP56 |
| | Blower sheave | AK79 | AK79 | BK85 | AK79 | AK79 | BK85 |
| | Belt | A50 | A50 | BX54 | A50 | A50 | BX54 |
| | Motor max Bhp, 3 phase | 2.9 | 3.7 | 5.25 | 2.9 | 3.7 | 5.25 |
| | RPM | 1,750 | 1,750 | 1,750 | 1,750 | 1,750 | 1,750 |
| Frame size | 56Y | 182TZ | 184TZ | 56Y | 182TZ | 184TZ | |
| Filters | Quantity - size | 4 - (20 x 20 x 2) ¹ | | | 4 - (20 x 20 x 2) ¹ | | |

¹ 2 in. throwaway, standard, MERV 4 (Minimum Efficiency Reporting Value)

ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations

Table 29: ZQ/ZX/ZY/ZL 04 to 14, A7 unit limitations

| Model | Size (ton) | Unit voltage | SCCR (kVA) | Unit limitations | | |
|-----------|------------|--------------|------------|------------------|-----|-----------------|
| | | | | Applied voltage | | Outdoor DB temp |
| | | | | Min | Max | Max (°F) |
| ZQ/ZY/ZL | 04 (3) | 208/230-1-60 | 5 | 187 | 252 | 125 |
| | | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZQ/ZY | 05 (4) | 208/230-1-60 | 5 | 187 | 252 | 125 |
| | | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZQ/ZY | 06 (5) | 208/230-1-60 | 5 | 187 | 252 | 125 |
| | | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZL | 05 (4) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZL | 06 (5) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZY | 07 (6) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZX/ZY | A7 (6) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZX/ZY/ZL | 08 (7.5) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZX/ZY//ZL | 09 (8.5) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZX/ZY//ZL | 12 (10) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |
| ZX/ZL | 14 (12.5) | 208/230-3-60 | 5 | 187 | 252 | 125 |
| | | 460-3-60 | 5 | 432 | 504 | 125 |
| | | 575-3-60 | 5 | 540 | 630 | 125 |

Capacity performance

ZQ04 to 06 cooling capacities

Table 30: ZQ04 (3.0 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total Input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | | 85°F | | | | | | |
| 750 | 77 | 42.7 | 2.1 | 22.8 | 19.1 | 15.4 | - | - | - | 41.4 | 2.4 | 22.1 | 18.3 | 14.6 | - | - | - |
| | 72 | 39.9 | 2.1 | 27.3 | 23.3 | 19.3 | 15.4 | - | - | 38.3 | 2.4 | 26.5 | 22.5 | 18.4 | 14.4 | - | - |
| | 67 | 37.1 | 2.1 | 31.5 | 27.6 | 23.3 | 19.2 | 15.4 | - | 35.2 | 2.3 | 30.8 | 26.6 | 22.3 | 18.2 | 14.3 | - |
| | 62 | 34.3 | 2.1 | 31.5 | 29.4 | 27.3 | 23.4 | 19.5 | 15.5 | 33.1 | 2.3 | 31.9 | 29.0 | 26.2 | 22.3 | 18.3 | 14.4 |
| 900 | 77 | 42.7 | 2.1 | 24.0 | 19.5 | 14.9 | - | - | - | 41.4 | 2.4 | 23.7 | 19.0 | 14.2 | - | - | - |
| | 72 | 40.3 | 2.1 | 28.7 | 24.3 | 19.9 | 15.4 | - | - | 38.7 | 2.4 | 28.1 | 23.6 | 19.1 | 14.5 | - | - |
| | 67 | 37.9 | 2.1 | 33.3 | 29.1 | 24.8 | 20.2 | 15.8 | - | 36.1 | 2.3 | 32.5 | 28.2 | 23.9 | 19.3 | 14.7 | - |
| | 62 | 35.7 | 2.1 | 33.3 | 31.5 | 29.8 | 25.2 | 20.6 | 16.0 | 34.5 | 2.3 | 33.4 | 31.1 | 28.7 | 24.1 | 19.5 | 14.9 |
| | 57 | 33.5 | 2.0 | 33.3 | 33.3 | 33.3 | 30.0 | 25.3 | 20.7 | 33.4 | 2.3 | 33.4 | 33.4 | 33.4 | 28.9 | 24.2 | 19.6 |
| 1050 | 77 | 42.6 | 2.1 | 25.3 | 19.9 | 14.5 | - | - | - | 41.3 | 2.4 | 25.3 | 19.6 | 13.9 | - | - | - |
| | 72 | 40.6 | 2.1 | 30.1 | 25.2 | 20.4 | 15.5 | - | - | 39.2 | 2.4 | 29.7 | 24.7 | 19.7 | 14.7 | - | - |
| | 67 | 38.7 | 2.1 | 34.8 | 30.6 | 26.3 | 21.1 | 16.2 | - | 37.0 | 2.3 | 34.1 | 29.8 | 25.5 | 20.3 | 15.2 | - |
| | 62 | 37.1 | 2.1 | 35.2 | 33.7 | 32.2 | 27.0 | 21.7 | 16.4 | 35.9 | 2.3 | 34.9 | 33.1 | 31.3 | 26.0 | 20.7 | 15.4 |
| | 57 | 35.5 | 2.1 | 35.5 | 35.5 | 35.5 | 32.7 | 27.2 | 21.8 | 35.2 | 2.3 | 35.2 | 35.2 | 35.2 | 31.6 | 26.2 | 20.7 |
| 1200 | 77 | 42.5 | 2.1 | 26.5 | 20.3 | 14.0 | - | - | - | 41.3 | 2.4 | 26.9 | 20.2 | 13.5 | - | - | - |
| | 72 | 41.0 | 2.1 | 31.5 | 26.2 | 20.9 | 15.6 | - | - | 39.6 | 2.4 | 31.3 | 25.8 | 20.3 | 14.8 | - | - |
| | 67 | 39.4 | 2.1 | 36.4 | 32.1 | 27.8 | 22.1 | 16.6 | - | 38.0 | 2.3 | 35.7 | 31.4 | 27.1 | 21.3 | 15.6 | - |
| | 62 | 38.5 | 2.1 | 37.0 | 35.8 | 34.6 | 28.7 | 22.8 | 16.9 | 37.3 | 2.3 | 36.5 | 35.2 | 33.8 | 27.9 | 21.8 | 15.8 |
| | 57 | 37.6 | 2.1 | 37.6 | 37.6 | 37.6 | 35.3 | 29.1 | 22.9 | 36.9 | 2.3 | 36.9 | 36.9 | 36.9 | 34.4 | 28.1 | 21.9 |
| 1350 | 72 | 41.3 | 2.1 | 32.8 | 27.1 | 21.4 | 15.7 | - | - | 40.1 | 2.4 | 32.9 | 26.9 | 20.9 | 14.9 | - | - |
| | 67 | 40.2 | 2.1 | 37.9 | 33.6 | 29.2 | 23.0 | 16.9 | - | 38.9 | 2.3 | 37.3 | 33.0 | 28.7 | 22.3 | 16.0 | - |
| | 62 | 39.9 | 2.1 | 38.8 | 37.9 | 37.1 | 30.5 | 23.9 | 17.4 | 38.8 | 2.3 | 38.0 | 37.2 | 36.4 | 29.7 | 23.0 | 16.3 |
| | 57 | 39.7 | 2.1 | 39.7 | 39.7 | 39.7 | 37.9 | 30.9 | 24.0 | 38.7 | 2.3 | 38.7 | 38.7 | 38.7 | 37.1 | 30.1 | 23.0 |
| 1500 | 72 | 41.7 | 2.1 | 34.2 | 28.1 | 21.9 | 15.7 | - | - | 40.5 | 2.3 | 34.5 | 28.0 | 21.5 | 15.1 | - | - |
| | 67 | 41.0 | 2.1 | 39.4 | 35.1 | 30.7 | 24.0 | 17.3 | - | 39.8 | 2.3 | 38.8 | 34.5 | 30.2 | 23.3 | 16.4 | - |
| | 62 | 41.4 | 2.1 | 40.7 | 40.1 | 39.5 | 32.3 | 25.1 | 17.8 | 40.2 | 2.3 | 39.5 | 39.2 | 39.0 | 31.6 | 24.2 | 16.8 |
| | 57 | 41.7 | 2.1 | 41.7 | 41.7 | 41.7 | 40.5 | 32.8 | 25.1 | 40.5 | 2.4 | 40.2 | 40.2 | 40.2 | 39.8 | 32.0 | 24.2 |

1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.

2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 31: ZQ04 (3.0 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 95°F | | | | | | 105°F | | | | | | | | | |
| 750 | 77 | 40.2 | 2.7 | 21.4 | 17.6 | 13.8 | - | - | - | 37.0 | 3.1 | 20.2 | 16.4 | 12.6 | - | - | - | | |
| | 72 | 36.7 | 2.6 | 25.8 | 21.7 | 17.5 | 13.4 | - | - | 33.8 | 3.0 | 24.5 | 20.4 | 16.4 | 12.3 | - | - | | |
| | 67 | 33.2 | 2.6 | 30.2 | 25.7 | 21.3 | 17.3 | 13.2 | - | 30.7 | 3.0 | 28.7 | 24.4 | 20.1 | 16.1 | 12.1 | - | | |
| | 62 | 31.9 | 2.6 | 31.9 | 28.7 | 25.0 | 21.1 | 17.2 | 13.3 | 30.0 | 2.9 | 30.0 | 27.0 | 23.9 | 19.9 | 15.9 | 11.9 | | |
| 900 | 77 | 40.1 | 2.7 | 23.4 | 18.5 | 13.6 | - | - | - | 37.1 | 3.0 | 22.4 | 17.4 | 12.4 | - | - | - | | |
| | 72 | 37.2 | 2.6 | 27.6 | 22.9 | 18.3 | 13.6 | - | - | 34.5 | 3.0 | 26.3 | 21.7 | 17.1 | 12.5 | - | - | | |
| | 67 | 34.3 | 2.6 | 31.8 | 27.4 | 23.0 | 18.3 | 13.7 | - | 31.9 | 3.0 | 30.2 | 26.0 | 21.8 | 17.2 | 12.5 | - | | |
| | 62 | 33.3 | 2.6 | 33.3 | 30.6 | 27.7 | 23.0 | 18.4 | 13.8 | 31.3 | 2.9 | 31.3 | 28.9 | 26.5 | 21.8 | 17.1 | 12.4 | | |
| 1050 | 77 | 40.1 | 2.7 | 25.3 | 19.3 | 13.3 | - | - | - | 37.2 | 3.0 | 24.6 | 18.4 | 12.2 | - | - | - | | |
| | 72 | 37.7 | 2.6 | 29.4 | 24.2 | 19.0 | 13.8 | - | - | 35.1 | 3.0 | 28.1 | 23.0 | 17.8 | 12.7 | - | - | | |
| | 67 | 35.4 | 2.6 | 33.4 | 29.0 | 24.7 | 19.4 | 14.1 | - | 33.0 | 3.0 | 31.6 | 27.6 | 23.5 | 18.2 | 12.9 | - | | |
| | 62 | 34.7 | 2.6 | 34.7 | 32.6 | 30.4 | 25.0 | 19.6 | 14.3 | 32.6 | 2.9 | 32.5 | 30.9 | 29.2 | 23.7 | 18.3 | 12.8 | | |
| 1200 | 77 | 40.1 | 2.6 | 27.3 | 20.1 | 13.0 | - | - | - | 37.4 | 3.0 | 26.7 | 19.3 | 11.9 | - | - | - | | |
| | 72 | 38.3 | 2.6 | 31.1 | 25.4 | 19.7 | 14.0 | - | - | 35.8 | 3.0 | 29.9 | 24.2 | 18.5 | 12.9 | - | - | | |
| | 67 | 36.5 | 2.6 | 35.0 | 30.7 | 26.4 | 20.5 | 14.6 | - | 34.2 | 3.0 | 33.1 | 29.1 | 25.2 | 19.2 | 13.3 | - | | |
| | 62 | 36.1 | 2.6 | 35.9 | 34.5 | 33.1 | 27.0 | 20.9 | 14.8 | 33.9 | 3.0 | 33.7 | 32.8 | 31.8 | 25.6 | 19.5 | 13.3 | | |
| 1350 | 77 | 40.1 | 2.6 | 36.3 | 36.3 | 36.3 | 33.5 | 27.2 | 20.9 | 34.0 | 3.0 | 34.0 | 34.0 | 34.0 | 31.1 | 25.6 | 20.1 | | |
| | 72 | 38.8 | 2.6 | 32.9 | 26.7 | 20.4 | 14.2 | - | - | 36.5 | 3.0 | 31.7 | 25.5 | 19.3 | 13.0 | - | - | | |
| | 67 | 37.6 | 2.6 | 36.6 | 32.4 | 28.1 | 21.6 | 15.0 | - | 35.4 | 3.0 | 34.6 | 30.7 | 26.9 | 20.3 | 13.7 | - | | |
| | 62 | 37.6 | 2.6 | 37.1 | 36.5 | 35.8 | 28.9 | 22.1 | 15.3 | 35.2 | 3.0 | 34.9 | 34.7 | 34.4 | 27.5 | 20.7 | 13.8 | | |
| 1500 | 77 | 39.3 | 2.6 | 34.7 | 27.9 | 21.2 | 14.4 | - | - | 37.1 | 3.0 | 33.6 | 26.8 | 20.0 | 13.2 | - | - | | |
| | 72 | 38.7 | 2.6 | 38.3 | 34.0 | 29.8 | 22.6 | 15.5 | - | 36.6 | 3.0 | 36.0 | 32.3 | 28.5 | 21.3 | 14.1 | - | | |
| | 67 | 39.0 | 2.6 | 38.4 | 38.4 | 38.4 | 30.9 | 23.3 | 15.8 | 36.5 | 3.0 | 36.1 | 36.1 | 36.1 | 29.5 | 21.9 | 14.2 | | |
| | 62 | 39.3 | 2.6 | 38.4 | 38.4 | 38.4 | 38.4 | 31.2 | 23.3 | 36.7 | 3.0 | 36.2 | 36.2 | 36.2 | 35.7 | 29.6 | 23.4 | | |
| | | | | 115°F | | | | | | 125°F | | | | | | | | | |
| 750 | 77 | 33.9 | 3.4 | 19.0 | 15.2 | 11.4 | - | - | - | 30.7 | 3.8 | 17.8 | 14.0 | 10.2 | - | - | - | | |
| | 72 | 31.0 | 3.4 | 23.1 | 19.2 | 15.2 | 11.2 | - | - | 28.2 | 3.7 | 21.8 | 17.9 | 14.0 | 10.1 | - | - | | |
| | 67 | 28.1 | 3.3 | 27.3 | 23.1 | 19.0 | 15.0 | 10.9 | - | 25.6 | 3.7 | 25.6 | 21.8 | 17.8 | 13.8 | 9.8 | - | | |
| | 62 | 28.0 | 3.3 | 28.0 | 25.4 | 22.8 | 18.7 | 14.6 | 10.5 | 26.1 | 3.7 | 25.9 | 23.8 | 21.7 | 17.5 | 13.3 | 9.1 | | |
| 900 | 77 | 34.1 | 3.4 | 21.4 | 16.3 | 11.2 | - | - | - | 31.1 | 3.7 | 20.4 | 15.2 | 10.0 | - | - | - | | |
| | 72 | 31.8 | 3.4 | 25.0 | 20.5 | 15.9 | 11.4 | - | - | 29.1 | 3.7 | 23.7 | 19.2 | 14.8 | 10.3 | - | - | | |
| | 67 | 29.4 | 3.3 | 28.6 | 24.6 | 20.6 | 16.0 | 11.3 | - | 27.0 | 3.7 | 27.0 | 23.2 | 19.5 | 14.8 | 10.1 | - | | |
| | 62 | 29.2 | 3.3 | 29.2 | 27.3 | 25.4 | 20.6 | 15.8 | 11.0 | 27.2 | 3.7 | 27.0 | 25.6 | 24.2 | 19.3 | 14.4 | 9.5 | | |
| 1050 | 77 | 34.4 | 3.4 | 23.8 | 17.4 | 11.0 | - | - | - | 31.5 | 3.7 | 23.1 | 16.5 | 9.9 | - | - | - | | |
| | 72 | 32.5 | 3.3 | 26.9 | 21.8 | 16.7 | 11.5 | - | - | 30.0 | 3.7 | 25.6 | 20.5 | 15.5 | 10.4 | - | - | | |
| | 67 | 30.7 | 3.3 | 29.9 | 26.1 | 22.3 | 17.0 | 11.7 | - | 28.4 | 3.7 | 28.1 | 24.6 | 21.1 | 15.8 | 10.4 | - | | |
| | 62 | 30.5 | 3.3 | 30.3 | 29.1 | 27.9 | 22.4 | 16.9 | 11.4 | 28.3 | 3.7 | 28.1 | 27.4 | 26.7 | 21.1 | 15.5 | 9.9 | | |
| 1200 | 77 | 34.7 | 3.4 | 26.2 | 18.5 | 10.8 | - | - | - | 31.9 | 3.7 | 25.7 | 17.7 | 9.7 | - | - | - | | |
| | 72 | 33.3 | 3.3 | 28.7 | 23.0 | 17.4 | 11.7 | - | - | 30.8 | 3.7 | 27.5 | 21.9 | 16.2 | 10.6 | - | - | | |
| | 67 | 32.0 | 3.3 | 31.2 | 27.6 | 24.0 | 18.0 | 12.1 | - | 29.7 | 3.7 | 29.3 | 26.0 | 22.7 | 16.8 | 10.8 | - | | |
| | 62 | 31.7 | 3.3 | 31.5 | 31.0 | 30.5 | 24.3 | 18.1 | 11.8 | 29.4 | 3.7 | 29.3 | 29.3 | 29.3 | 23.0 | 16.6 | 10.3 | | |
| 1350 | 77 | 34.1 | 3.3 | 31.8 | 31.8 | 31.8 | 28.7 | 24.1 | 19.4 | 29.5 | 3.7 | 29.4 | 29.4 | 29.4 | 26.4 | 22.5 | 18.6 | | |
| | 72 | 34.1 | 3.3 | 30.6 | 24.3 | 18.1 | 11.9 | - | - | 31.7 | 3.7 | 29.4 | 23.2 | 16.9 | 10.7 | - | - | | |
| | 67 | 33.3 | 3.3 | 32.5 | 29.1 | 25.6 | 19.0 | 12.4 | - | 31.1 | 3.7 | 30.4 | 27.4 | 24.4 | 17.7 | 11.1 | - | | |
| | 62 | 32.9 | 3.3 | 32.7 | 32.7 | 32.7 | 26.2 | 19.2 | 12.3 | 30.5 | 3.7 | 30.4 | 30.4 | 30.4 | 24.8 | 17.8 | 10.7 | | |
| 1500 | 77 | 34.9 | 3.3 | 32.9 | 32.9 | 32.9 | 30.5 | 26.0 | 21.4 | 30.6 | 3.7 | 30.5 | 30.5 | 30.5 | 27.7 | 24.4 | 21.1 | | |
| | 72 | 34.9 | 3.3 | 32.4 | 25.6 | 18.8 | 12.0 | - | - | 32.6 | 3.7 | 31.3 | 24.5 | 17.7 | 10.9 | - | - | | |
| | 67 | 34.6 | 3.3 | 33.8 | 30.5 | 27.3 | 20.0 | 12.8 | - | 32.5 | 3.7 | 31.6 | 28.8 | 26.0 | 18.7 | 11.5 | - | | |
| | 62 | 34.1 | 3.3 | 33.8 | 33.8 | 33.8 | 28.0 | 20.4 | 12.7 | 31.6 | 3.7 | 31.6 | 31.6 | 31.6 | 26.6 | 18.9 | 11.1 | | |
| 57 | 34.2 | 3.4 | 33.9 | 33.9 | 33.9 | 32.3 | 27.9 | 23.5 | 31.6 | 3.8 | 31.6 | 31.6 | 31.6 | 28.9 | 26.3 | 23.6 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 32: ZQ05 (4.0 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|------|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 1000 | 77 | 61.7 | 2.8 | 31.1 | 23.1 | 15.0 | - | - | - | 59.0 | 3.2 | 29.6 | 21.7 | 13.7 | - | - | - | | |
| | 72 | 56.3 | 2.8 | 37.3 | 30.4 | 23.5 | 16.6 | - | - | 53.4 | 3.1 | 35.9 | 29.0 | 22.1 | 15.2 | - | - | | |
| | 67 | 50.9 | 2.7 | 43.4 | 37.7 | 32.0 | 26.6 | 21.4 | - | 47.9 | 3.1 | 42.2 | 36.3 | 30.5 | 25.2 | 20.1 | - | | |
| | 62 | 47.7 | 2.7 | 43.4 | 41.9 | 40.5 | 37.2 | 33.1 | 29.5 | 45.8 | 3.0 | 43.4 | 41.1 | 38.8 | 35.6 | 32.0 | 28.6 | | |
| 1200 | 77 | 62.7 | 2.8 | 34.0 | 25.1 | 16.2 | - | - | - | 59.9 | 3.2 | 33.0 | 23.9 | 14.9 | - | - | - | | |
| | 72 | 57.7 | 2.8 | 40.1 | 32.6 | 25.2 | 17.7 | - | - | 54.8 | 3.1 | 38.9 | 31.3 | 23.8 | 16.3 | - | - | | |
| | 67 | 52.6 | 2.7 | 46.2 | 40.2 | 34.2 | 27.9 | 21.7 | - | 49.8 | 3.1 | 44.8 | 38.8 | 32.8 | 26.6 | 20.4 | - | | |
| | 62 | 49.8 | 2.7 | 46.2 | 44.7 | 43.2 | 38.5 | 33.3 | 28.3 | 47.9 | 3.1 | 45.7 | 43.7 | 41.7 | 37.0 | 32.0 | 27.2 | | |
| 1400 | 57 | 47.0 | 2.7 | 46.2 | 46.2 | 46.2 | 46.2 | 44.8 | 41.1 | 46.1 | 3.0 | 46.1 | 46.1 | 46.1 | 46.1 | 43.7 | 40.2 | | |
| | 77 | 63.7 | 2.8 | 36.8 | 27.1 | 17.3 | - | - | - | 60.7 | 3.2 | 36.3 | 26.1 | 16.0 | - | - | - | | |
| | 72 | 59.0 | 2.8 | 42.9 | 34.8 | 26.8 | 18.8 | - | - | 56.2 | 3.1 | 41.8 | 33.7 | 25.5 | 17.4 | - | - | | |
| | 67 | 54.3 | 2.7 | 48.9 | 42.6 | 36.3 | 29.1 | 22.1 | - | 51.7 | 3.1 | 47.3 | 41.2 | 35.1 | 27.9 | 20.7 | - | | |
| 1600 | 62 | 52.0 | 2.7 | 48.9 | 47.4 | 45.9 | 39.8 | 33.4 | 27.1 | 49.9 | 3.1 | 48.1 | 46.4 | 44.6 | 38.5 | 32.1 | 25.8 | | |
| | 57 | 49.6 | 2.7 | 48.9 | 48.9 | 48.9 | 48.9 | 44.6 | 39.3 | 48.4 | 3.1 | 48.4 | 48.4 | 48.4 | 48.4 | 43.5 | 38.2 | | |
| | 77 | 64.7 | 2.9 | 39.6 | 29.0 | 18.5 | - | - | - | 61.5 | 3.2 | 39.6 | 28.4 | 17.1 | - | - | - | | |
| | 72 | 60.4 | 2.8 | 45.7 | 37.1 | 28.5 | 19.9 | - | - | 57.6 | 3.2 | 44.8 | 36.0 | 27.3 | 18.5 | - | - | | |
| 1800 | 67 | 56.0 | 2.7 | 51.7 | 45.1 | 38.5 | 30.4 | 22.4 | - | 53.6 | 3.1 | 49.9 | 43.7 | 37.4 | 29.2 | 21.0 | - | | |
| | 62 | 54.1 | 2.7 | 51.7 | 50.1 | 48.6 | 41.2 | 33.5 | 25.9 | 52.0 | 3.1 | 50.4 | 49.0 | 47.6 | 39.9 | 32.2 | 24.5 | | |
| | 57 | 52.2 | 2.7 | 51.7 | 51.7 | 51.6 | 44.5 | 37.5 | - | 50.7 | 3.1 | 50.7 | 50.7 | 50.7 | 50.5 | 43.4 | 36.2 | | |
| | 72 | 61.8 | 2.8 | 48.5 | 39.3 | 30.2 | 21.0 | - | - | 59.0 | 3.2 | 47.7 | 38.4 | 29.0 | 19.6 | - | - | | |
| 2000 | 67 | 57.8 | 2.8 | 54.5 | 47.6 | 40.7 | 31.7 | 22.7 | - | 55.5 | 3.1 | 52.5 | 46.1 | 39.7 | 30.5 | 21.2 | - | | |
| | 62 | 56.3 | 2.8 | 54.5 | 52.9 | 51.3 | 42.5 | 33.6 | 24.7 | 54.1 | 3.1 | 52.8 | 51.6 | 50.5 | 41.4 | 32.2 | 23.1 | | |
| | 57 | 54.8 | 2.8 | 54.5 | 54.5 | 54.5 | 53.1 | 44.4 | 35.7 | 52.9 | 3.1 | 52.9 | 52.9 | 52.9 | 52.2 | 43.2 | 34.3 | | |
| | 72 | 63.1 | 2.8 | 51.3 | 41.5 | 31.8 | 22.1 | - | - | 60.3 | 3.2 | 50.7 | 40.7 | 30.7 | 20.7 | - | - | | |
| 95°F | 1000 | 67 | 59.5 | 2.8 | 57.2 | 50.1 | 42.9 | 33.0 | 23.0 | - | 57.4 | 3.1 | 55.1 | 48.6 | 42.0 | 31.8 | 21.5 | - | |
| | | 62 | 58.4 | 2.8 | 57.2 | 55.6 | 54.0 | 43.8 | 33.7 | 23.5 | 56.1 | 3.1 | 55.1 | 54.2 | 53.4 | 42.8 | 32.3 | 21.8 | |
| | | 57 | 57.4 | 2.8 | 57.2 | 57.2 | 57.2 | 54.7 | 44.3 | 33.9 | 55.2 | 3.2 | 55.1 | 55.1 | 55.1 | 53.9 | 43.1 | 32.3 | |
| | | 72 | 63.1 | 2.8 | 51.3 | 41.5 | 31.8 | 22.1 | - | - | 60.3 | 3.2 | 50.7 | 40.7 | 30.7 | 20.7 | - | - | |
| 105°F | 1000 | 77 | 56.3 | 3.5 | 28.1 | 20.3 | 12.5 | - | - | - | 51.7 | 4.1 | 28.9 | 21.2 | 13.5 | - | - | - | |
| | | 72 | 50.6 | 3.5 | 34.5 | 27.6 | 20.7 | 13.8 | - | - | 47.7 | 4.0 | 34.0 | 27.4 | 20.8 | 14.2 | - | - | |
| | | 67 | 44.8 | 3.4 | 40.9 | 34.9 | 29.0 | 23.9 | 18.9 | - | 43.7 | 3.9 | 39.1 | 33.6 | 28.1 | 23.3 | 18.5 | - | |
| | | 62 | 43.9 | 3.4 | 43.3 | 40.2 | 37.2 | 34.0 | 30.8 | 27.6 | 42.9 | 3.9 | 41.5 | 38.4 | 35.4 | 32.4 | 29.5 | 26.5 | |
| 1200 | 77 | 57.0 | 3.5 | 31.9 | 22.8 | 13.6 | - | - | - | 52.3 | 4.1 | 32.2 | 23.3 | 14.3 | - | - | - | | |
| | 72 | 52.0 | 3.5 | 37.6 | 30.1 | 22.5 | 14.9 | - | - | 48.8 | 4.0 | 36.8 | 29.5 | 22.1 | 14.8 | - | - | | |
| | 67 | 46.9 | 3.4 | 43.3 | 37.4 | 31.4 | 25.3 | 19.1 | - | 45.3 | 3.9 | 41.3 | 35.6 | 30.0 | 24.2 | 18.4 | - | | |
| | 62 | 45.9 | 3.4 | 45.2 | 42.8 | 40.3 | 35.6 | 30.8 | 26.1 | 44.4 | 4.0 | 43.2 | 40.5 | 37.8 | 33.6 | 29.3 | 25.1 | | |
| 1400 | 57 | 45.2 | 3.4 | 45.2 | 45.2 | 45.2 | 42.6 | 39.3 | - | 43.8 | 4.0 | 43.8 | 43.8 | 43.8 | 42.9 | 40.2 | 37.5 | | |
| | 77 | 57.7 | 3.6 | 35.8 | 25.2 | 14.7 | - | - | - | 53.0 | 4.1 | 35.6 | 25.4 | 15.1 | - | - | - | | |
| | 72 | 53.4 | 3.5 | 40.8 | 32.5 | 24.3 | 16.0 | - | - | 49.9 | 4.0 | 39.5 | 31.5 | 23.5 | 15.5 | - | - | | |
| | 67 | 49.1 | 3.4 | 45.7 | 39.8 | 33.8 | 26.6 | 19.3 | - | 46.9 | 3.9 | 43.4 | 37.6 | 31.8 | 25.1 | 18.3 | - | | |
| 1600 | 62 | 47.9 | 3.4 | 47.2 | 45.3 | 43.4 | 37.1 | 30.9 | 24.6 | 45.9 | 4.0 | 44.8 | 42.5 | 40.2 | 34.7 | 29.2 | 23.7 | | |
| | 57 | 47.2 | 3.4 | 47.2 | 47.2 | 47.2 | 47.2 | 42.4 | 37.1 | 45.3 | 4.0 | 45.3 | 45.3 | 45.3 | 44.3 | 40.0 | 35.8 | | |
| | 77 | 58.4 | 3.6 | 39.6 | 27.7 | 15.8 | - | - | - | 53.6 | 4.1 | 39.0 | 27.5 | 15.9 | - | - | - | | |
| | 72 | 54.8 | 3.5 | 43.9 | 35.0 | 26.0 | 17.1 | - | - | 51.1 | 4.0 | 42.3 | 33.5 | 24.8 | 16.1 | - | - | | |
| 1800 | 67 | 51.2 | 3.5 | 48.2 | 42.2 | 36.3 | 27.9 | 19.5 | - | 48.5 | 4.0 | 45.6 | 39.6 | 33.7 | 26.0 | 18.2 | - | | |
| | 62 | 49.9 | 3.5 | 49.1 | 47.8 | 46.5 | 38.7 | 30.9 | 23.1 | 47.4 | 4.0 | 46.5 | 44.6 | 42.6 | 35.8 | 29.0 | 22.2 | | |
| | 57 | 49.1 | 3.5 | 49.1 | 49.1 | 49.1 | 49.1 | 42.2 | 35.0 | 46.7 | 4.0 | 46.7 | 46.7 | 46.7 | 45.7 | 39.8 | 34.0 | | |
| | 72 | 56.2 | 3.5 | 47.0 | 37.4 | 27.8 | 18.2 | - | - | 52.2 | 4.0 | 45.0 | 35.6 | 26.2 | 16.8 | - | - | | |
| 2000 | 67 | 53.3 | 3.5 | 50.6 | 44.7 | 38.7 | 29.3 | 19.8 | - | 50.1 | 4.0 | 47.7 | 41.6 | 35.6 | 26.8 | 18.1 | - | | |
| | 62 | 51.8 | 3.5 | 51.1 | 50.4 | 49.6 | 40.3 | 30.9 | 21.6 | 48.9 | 4.0 | 48.2 | 46.6 | 45.0 | 36.9 | 28.9 | 20.8 | | |
| | 57 | 51.1 | 3.5 | 51.1 | 51.1 | 51.1 | 51.1 | 42.1 | 32.8 | 48.2 | 4.0 | 48.2 | 48.2 | 48.2 | 47.0 | 39.6 | 32.3 | | |
| | 72 | 57.6 | 3.5 | 50.1 | 39.9 | 29.6 | 19.3 | - | - | 53.3 | 4.0 | 47.8 | 37.6 | 27.5 | 17.4 | - | - | | |
| 2000 | 67 | 55.4 | 3.5 | 53.0 | 47.1 | 41.2 | 30.6 | 20.0 | - | 51.7 | 4.0 | 49.8 | 43.6 | 37.4 | 27.7 | 18.0 | - | | |
| | 62 | 53.8 | 3.5 | 53.0 | 52.9 | 52.8 | 41.9 | 30.9 | 20.0 | 50.4 | 4.0 | 49.9 | 48.6 | 47.4 | 38.1 | 28.7 | 19.4 | | |
| 57 | 53.0 | 3.5 | 53.0 | 53.0 | 53.0 | 53.0 | 41.9 | 30.7 | 49.9 | 4.0 | 49.9 | 49.9 | 49.9 | 48.4 | 39.5 | 30.5 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 33: ZQ05 (4.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | | Return dry bulb (°F) | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 1000 | 77 | 47.1 | 4.6 | 29.7 | 22.1 | 14.5 | - | - | - | 42.4 | 5.1 | 30.4 | 23.0 | 15.5 | - | - | - |
| | 72 | 44.8 | 4.5 | 33.5 | 27.2 | 20.9 | 14.6 | - | - | 41.9 | 5.0 | 33.0 | 27.0 | 20.9 | 14.9 | - | - |
| | 67 | 42.6 | 4.4 | 37.3 | 32.3 | 27.2 | 22.7 | 18.2 | - | 41.4 | 4.9 | 35.6 | 31.0 | 26.4 | 22.1 | 17.8 | - |
| | 62 | 42.0 | 4.5 | 39.7 | 36.6 | 33.6 | 30.8 | 28.1 | 25.3 | 41.0 | 5.0 | 37.9 | 34.8 | 31.8 | 29.3 | 26.7 | 24.2 |
| 1200 | 77 | 47.7 | 4.6 | 32.6 | 23.8 | 15.0 | - | - | - | 43.0 | 5.1 | 32.9 | 24.3 | 15.8 | - | - | - |
| | 72 | 45.7 | 4.5 | 35.9 | 28.8 | 21.8 | 14.7 | - | - | 42.5 | 5.0 | 35.0 | 28.2 | 21.4 | 14.6 | - | - |
| | 67 | 43.6 | 4.4 | 39.2 | 33.9 | 28.5 | 23.1 | 17.7 | - | 42.0 | 5.0 | 37.1 | 32.1 | 27.1 | 22.1 | 17.1 | - |
| | 62 | 43.0 | 4.5 | 41.1 | 38.2 | 35.3 | 31.5 | 27.8 | 24.0 | 41.5 | 5.0 | 39.0 | 35.9 | 32.8 | 29.5 | 26.3 | 23.0 |
| 1400 | 57 | 42.4 | 4.5 | 42.4 | 42.4 | 42.0 | 39.9 | 37.8 | 35.7 | 41.0 | 5.1 | 40.9 | 39.6 | 38.4 | 36.9 | 35.5 | 34.0 |
| | 77 | 48.3 | 4.6 | 35.4 | 25.5 | 15.6 | - | - | - | 43.6 | 5.1 | 35.3 | 25.6 | 16.0 | - | - | - |
| | 72 | 46.5 | 4.5 | 38.3 | 30.5 | 22.7 | 14.9 | - | - | 43.1 | 5.0 | 37.0 | 29.5 | 21.9 | 14.4 | - | - |
| | 67 | 44.7 | 4.5 | 41.1 | 35.5 | 29.8 | 23.6 | 17.3 | - | 42.6 | 5.0 | 38.7 | 33.3 | 27.8 | 22.1 | 16.3 | - |
| | 62 | 44.0 | 4.5 | 42.5 | 39.7 | 37.0 | 32.2 | 27.5 | 22.7 | 42.0 | 5.0 | 40.2 | 36.9 | 33.7 | 29.8 | 25.8 | 21.8 |
| 1600 | 57 | 43.4 | 4.5 | 43.4 | 43.4 | 43.4 | 40.9 | 37.6 | 34.4 | 41.5 | 5.1 | 41.5 | 40.6 | 39.6 | 37.4 | 35.2 | 33.0 |
| | 77 | 48.9 | 4.6 | 38.3 | 27.2 | 16.1 | - | - | - | 44.2 | 5.1 | 37.7 | 27.0 | 16.3 | - | - | - |
| | 72 | 47.4 | 4.5 | 40.6 | 32.1 | 23.6 | 15.1 | - | - | 43.7 | 5.0 | 39.0 | 30.7 | 22.4 | 14.1 | - | - |
| | 67 | 45.8 | 4.5 | 42.9 | 37.0 | 31.1 | 24.0 | 16.9 | - | 43.2 | 5.0 | 40.3 | 34.4 | 28.6 | 22.0 | 15.5 | - |
| | 62 | 45.0 | 4.5 | 43.9 | 41.3 | 38.6 | 32.9 | 27.2 | 21.4 | 42.5 | 5.0 | 41.3 | 38.0 | 34.7 | 30.0 | 25.3 | 20.6 |
| 1800 | 57 | 44.3 | 4.5 | 44.3 | 44.3 | 44.3 | 41.8 | 37.4 | 33.1 | 41.9 | 5.0 | 41.9 | 41.6 | 40.8 | 37.9 | 35.0 | 32.1 |
| | 72 | 48.2 | 4.5 | 43.0 | 33.8 | 24.5 | 15.3 | - | - | 44.2 | 5.0 | 41.0 | 31.9 | 22.9 | 13.8 | - | - |
| | 67 | 46.9 | 4.5 | 44.8 | 38.6 | 32.4 | 24.4 | 16.4 | - | 43.7 | 5.0 | 41.9 | 35.6 | 29.3 | 22.0 | 14.8 | - |
| | 62 | 46.0 | 4.5 | 45.3 | 42.8 | 40.3 | 33.6 | 26.8 | 20.1 | 43.1 | 5.0 | 42.5 | 39.1 | 35.7 | 30.2 | 24.8 | 19.4 |
| 2000 | 57 | 45.3 | 4.5 | 45.3 | 45.3 | 45.3 | 42.7 | 37.2 | 31.7 | 42.5 | 5.0 | 42.5 | 42.5 | 42.0 | 38.4 | 34.8 | 31.2 |
| | 72 | 49.1 | 4.5 | 45.4 | 35.4 | 25.4 | 15.5 | - | - | 44.8 | 5.0 | 43.0 | 33.2 | 23.4 | 13.6 | - | - |
| | 67 | 48.0 | 4.5 | 46.7 | 40.2 | 33.7 | 24.9 | 16.0 | - | 44.3 | 5.0 | 43.5 | 36.7 | 30.0 | 22.0 | 14.0 | - |
| | 62 | 47.0 | 4.5 | 46.7 | 44.4 | 42.0 | 34.3 | 26.5 | 18.8 | 43.6 | 5.0 | 43.6 | 40.1 | 36.6 | 30.5 | 24.3 | 18.2 |
| 57 | 46.7 | 4.5 | 46.7 | 46.7 | 46.7 | 43.7 | 37.0 | 30.4 | 43.6 | 5.0 | 43.6 | 43.5 | 43.3 | 38.9 | 34.6 | 30.3 | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 34: ZQ06 (5.0 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 1250 | 77 | 75.2 | 3.6 | 38.2 | 32.6 | 26.9 | - | - | - | 72.1 | 4.0 | 36.7 | 31.2 | 25.7 | - | - | - | | |
| | 72 | 69.4 | 3.5 | 46.6 | 40.0 | 33.5 | 26.9 | - | - | 66.0 | 4.0 | 45.2 | 38.6 | 32.1 | 25.6 | - | - | | |
| | 67 | 63.6 | 3.4 | 55.0 | 47.5 | 40.0 | 33.4 | 26.9 | - | 59.9 | 3.9 | 53.6 | 46.0 | 38.5 | 31.9 | 25.3 | - | | |
| | 62 | 60.2 | 3.4 | 60.2 | 53.6 | 46.6 | 38.7 | 33.4 | 26.9 | 57.1 | 3.8 | 57.1 | 51.3 | 44.8 | 37.6 | 31.6 | 24.9 | | |
| 1500 | 77 | 76.2 | 3.6 | 42.0 | 34.3 | 26.7 | - | - | - | 72.8 | 4.1 | 41.0 | 33.2 | 25.5 | - | - | - | | |
| | 72 | 70.9 | 3.5 | 50.3 | 42.6 | 34.9 | 27.1 | - | - | 67.5 | 4.0 | 49.1 | 41.3 | 33.5 | 25.7 | - | - | | |
| | 67 | 65.7 | 3.5 | 58.7 | 50.9 | 43.1 | 35.2 | 27.4 | - | 62.1 | 3.9 | 57.2 | 49.4 | 41.6 | 33.6 | 25.7 | - | | |
| | 62 | 63.0 | 3.4 | 60.0 | 57.3 | 51.3 | 42.3 | 35.4 | 27.4 | 59.9 | 3.9 | 57.5 | 55.0 | 49.6 | 41.1 | 33.6 | 25.5 | | |
| 1750 | 77 | 77.1 | 3.6 | 45.8 | 36.1 | 26.4 | - | - | - | 73.5 | 4.1 | 45.4 | 35.3 | 25.2 | - | - | - | | |
| | 72 | 72.4 | 3.6 | 54.1 | 45.2 | 36.3 | 27.4 | - | - | 68.9 | 4.0 | 53.1 | 44.0 | 34.9 | 25.9 | - | - | | |
| | 67 | 67.8 | 3.5 | 62.4 | 54.3 | 46.2 | 37.0 | 27.9 | - | 64.3 | 3.9 | 60.7 | 52.7 | 44.7 | 35.4 | 26.2 | - | | |
| | 62 | 65.7 | 3.5 | 63.5 | 61.0 | 56.1 | 45.9 | 37.3 | 28.0 | 62.7 | 3.9 | 60.8 | 58.7 | 54.4 | 44.6 | 35.6 | 26.1 | | |
| 2000 | 77 | 78.0 | 3.7 | 49.5 | 37.8 | 26.1 | - | - | - | 74.2 | 4.1 | 49.7 | 37.3 | 24.9 | - | - | - | | |
| | 72 | 73.9 | 3.6 | 57.9 | 47.8 | 37.7 | 27.6 | - | - | 70.4 | 4.0 | 57.0 | 46.7 | 36.4 | 26.1 | - | - | | |
| | 67 | 69.9 | 3.5 | 66.2 | 57.7 | 49.2 | 38.8 | 28.4 | - | 66.6 | 4.0 | 64.0 | 56.1 | 47.8 | 37.2 | 26.7 | - | | |
| | 62 | 68.4 | 3.5 | 66.5 | 64.6 | 60.8 | 49.6 | 39.3 | 28.5 | 65.5 | 3.9 | 64.3 | 62.5 | 59.2 | 48.2 | 37.6 | 26.7 | | |
| 2250 | 77 | 75.5 | 3.6 | 61.6 | 50.3 | 39.1 | 27.8 | - | - | 71.8 | 4.0 | 60.9 | 49.4 | 37.8 | 26.2 | - | - | | |
| | 72 | 72.0 | 3.6 | 69.9 | 61.1 | 52.3 | 40.6 | 28.9 | - | 68.8 | 4.0 | 67.8 | 59.4 | 50.9 | 39.0 | 27.1 | - | | |
| | 67 | 71.1 | 3.6 | 70.0 | 68.3 | 65.6 | 53.2 | 41.3 | 29.1 | 68.3 | 4.0 | 67.8 | 66.2 | 64.1 | 51.7 | 39.6 | 27.4 | | |
| | 62 | 70.3 | 3.5 | 70.3 | 70.3 | 70.3 | 66.2 | 53.6 | 41.0 | 67.9 | 4.0 | 67.9 | 67.9 | 67.9 | 64.6 | 52.0 | 39.5 | | |
| 2500 | 77 | 77.0 | 3.6 | 65.4 | 52.9 | 40.5 | 28.0 | - | - | 73.2 | 4.1 | 64.9 | 52.0 | 39.2 | 26.4 | - | - | | |
| | 72 | 74.1 | 3.6 | 73.6 | 64.5 | 55.4 | 42.4 | 29.4 | - | 71.0 | 4.0 | 70.8 | 62.7 | 54.0 | 40.8 | 27.6 | - | | |
| | 67 | 73.9 | 3.6 | 73.6 | 72.0 | 70.3 | 56.8 | 43.2 | 29.7 | 71.1 | 4.0 | 70.9 | 69.9 | 68.9 | 55.2 | 41.6 | 28.0 | | |
| | 62 | 73.6 | 3.6 | 73.6 | 73.6 | 73.6 | 71.1 | 57.0 | 42.9 | 71.3 | 4.0 | 71.3 | 71.3 | 71.3 | 69.6 | 55.6 | 41.6 | | |
| | | 95°F | | | | | | | | | 105°F | | | | | | | | |
| 1250 | 77 | 69.0 | 4.5 | 35.2 | 29.9 | 24.5 | - | - | - | 64.1 | 5.1 | 33.4 | 28.1 | 22.8 | - | - | - | | |
| | 72 | 62.6 | 4.4 | 43.8 | 37.2 | 30.7 | 24.2 | - | - | 57.9 | 5.0 | 42.0 | 35.3 | 28.5 | 21.8 | - | - | | |
| | 67 | 56.3 | 4.3 | 52.3 | 44.6 | 36.9 | 30.3 | 23.7 | - | 51.7 | 4.9 | 50.6 | 42.4 | 34.3 | 27.8 | 21.2 | - | | |
| | 62 | 54.0 | 4.3 | 54.0 | 49.0 | 43.1 | 36.4 | 29.7 | 23.0 | 50.8 | 4.9 | 50.8 | 45.9 | 40.1 | 33.7 | 27.4 | 21.0 | | |
| 1500 | 77 | 69.4 | 4.5 | 40.1 | 32.2 | 24.3 | - | - | - | 64.5 | 5.1 | 38.4 | 30.3 | 22.3 | - | - | - | | |
| | 72 | 64.0 | 4.4 | 47.9 | 40.0 | 32.2 | 24.3 | - | - | 59.3 | 5.0 | 45.9 | 37.9 | 29.9 | 21.9 | - | - | | |
| | 67 | 58.6 | 4.3 | 54.9 | 47.9 | 40.1 | 32.1 | 24.1 | - | 54.2 | 4.9 | 52.0 | 45.5 | 37.6 | 29.6 | 21.7 | - | | |
| | 62 | 56.9 | 4.3 | 55.0 | 52.8 | 48.0 | 39.9 | 31.8 | 23.7 | 53.5 | 4.9 | 52.5 | 49.7 | 45.3 | 37.3 | 29.4 | 21.4 | | |
| 1750 | 77 | 69.8 | 4.5 | 45.0 | 34.5 | 24.0 | - | - | - | 64.9 | 5.1 | 43.3 | 32.5 | 21.7 | - | - | - | | |
| | 72 | 65.4 | 4.4 | 52.0 | 42.8 | 33.6 | 24.4 | - | - | 60.7 | 5.0 | 49.8 | 40.5 | 31.3 | 22.1 | - | - | | |
| | 67 | 60.9 | 4.3 | 58.3 | 51.1 | 43.2 | 33.9 | 24.5 | - | 56.6 | 5.0 | 54.9 | 48.5 | 40.9 | 31.5 | 22.1 | - | | |
| | 62 | 59.8 | 4.3 | 58.5 | 56.5 | 52.8 | 43.3 | 33.8 | 24.3 | 56.1 | 5.0 | 55.5 | 53.5 | 50.4 | 40.9 | 31.4 | 21.8 | | |
| 2000 | 77 | 70.3 | 4.5 | 49.8 | 36.8 | 23.8 | - | - | - | 65.2 | 5.1 | 48.3 | 34.8 | 21.2 | - | - | - | | |
| | 72 | 66.8 | 4.4 | 56.1 | 45.6 | 35.1 | 24.5 | - | - | 62.1 | 5.1 | 53.6 | 43.2 | 32.7 | 22.2 | - | - | | |
| | 67 | 63.2 | 4.4 | 61.8 | 54.4 | 46.4 | 35.7 | 24.9 | - | 59.0 | 5.0 | 58.5 | 51.6 | 44.1 | 33.3 | 22.5 | - | | |
| | 62 | 62.6 | 4.4 | 61.9 | 60.3 | 57.7 | 46.8 | 35.9 | 25.0 | 58.8 | 5.0 | 58.6 | 57.3 | 55.6 | 44.5 | 33.4 | 22.3 | | |
| 2250 | 77 | 68.1 | 4.5 | 60.2 | 48.4 | 36.5 | 24.7 | - | - | 63.5 | 5.1 | 57.5 | 45.8 | 34.1 | 22.3 | - | - | | |
| | 72 | 65.6 | 4.4 | 65.2 | 57.7 | 49.5 | 37.5 | 25.4 | - | 61.7 | 5.1 | 61.2 | 54.6 | 47.4 | 35.2 | 23.0 | - | | |
| | 67 | 65.5 | 4.4 | 65.5 | 64.0 | 62.5 | 50.2 | 37.9 | 25.6 | 61.6 | 5.1 | 61.4 | 61.1 | 60.7 | 48.0 | 35.4 | 22.7 | | |
| | 62 | 65.5 | 4.4 | 65.5 | 65.5 | 65.5 | 63.0 | 50.5 | 38.0 | 61.5 | 5.1 | 61.5 | 61.5 | 61.5 | 60.9 | 47.7 | 34.6 | | |
| 2500 | 77 | 69.5 | 4.5 | 64.4 | 51.2 | 38.0 | 24.8 | - | - | 64.9 | 5.1 | 61.4 | 48.4 | 35.5 | 22.5 | - | - | | |
| | 72 | 69.2 | 4.4 | 68.0 | 60.9 | 52.7 | 39.2 | 25.8 | - | 64.4 | 5.1 | 63.7 | 57.7 | 50.7 | 37.1 | 23.4 | - | | |
| | 67 | 69.0 | 4.4 | 68.2 | 67.8 | 67.4 | 53.7 | 40.0 | 26.3 | 64.1 | 5.1 | 63.9 | 63.9 | 63.9 | 51.6 | 37.4 | 23.1 | | |
| | 62 | 68.9 | 4.5 | 68.8 | 68.8 | 68.8 | 68.1 | 54.2 | 40.2 | 64.0 | 5.1 | 63.9 | 63.9 | 63.9 | 63.9 | 51.3 | 36.3 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 35: ZQ06 (5.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | | Return dry bulb (°F) | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | 90 | | | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | 125°F | | | | | | | | |
| 1250 | 77 | 59.3 | 5.7 | 31.6 | 26.3 | 21.0 | - | - | - | 54.5 | 6.4 | 29.9 | 24.6 | 19.2 | - | - | - |
| | 72 | 53.3 | 5.6 | 40.2 | 33.3 | 26.4 | 19.4 | - | - | 48.6 | 6.2 | 38.5 | 31.3 | 24.2 | 17.1 | - | - |
| | 67 | 48.2 | 5.5 | 47.5 | 40.3 | 31.7 | 25.3 | 18.8 | - | 45.0 | 6.1 | 44.2 | 38.1 | 29.2 | 22.7 | 16.3 | - |
| | 62 | 47.7 | 5.5 | 47.7 | 42.8 | 37.1 | 31.1 | 25.1 | 19.0 | 44.5 | 6.2 | 44.5 | 39.7 | 34.1 | 28.4 | 22.8 | 17.1 |
| 1500 | 77 | 59.6 | 5.7 | 36.7 | 28.5 | 20.2 | - | - | - | 54.7 | 6.4 | 35.0 | 26.6 | 18.2 | - | - | - |
| | 72 | 54.6 | 5.7 | 43.9 | 35.8 | 27.7 | 19.6 | - | - | 50.0 | 6.3 | 41.9 | 33.7 | 25.4 | 17.2 | - | - |
| | 67 | 51.2 | 5.6 | 50.0 | 43.1 | 35.1 | 27.2 | 19.2 | - | 48.2 | 6.2 | 45.4 | 40.7 | 32.7 | 24.7 | 16.8 | - |
| | 62 | 50.8 | 5.6 | 50.1 | 46.6 | 42.6 | 34.8 | 27.0 | 19.2 | 46.7 | 6.2 | 46.0 | 43.6 | 39.9 | 32.2 | 24.6 | 17.0 |
| 1750 | 77 | 59.9 | 5.8 | 41.7 | 30.6 | 19.5 | - | - | - | 54.9 | 6.4 | 40.1 | 28.6 | 17.2 | - | - | - |
| | 72 | 56.0 | 5.7 | 47.5 | 38.3 | 29.0 | 19.7 | - | - | 51.4 | 6.3 | 45.3 | 36.0 | 26.7 | 17.4 | - | - |
| | 67 | 52.9 | 5.6 | 51.9 | 45.9 | 38.5 | 29.1 | 19.7 | - | 50.7 | 6.2 | 49.0 | 43.3 | 36.2 | 26.7 | 17.3 | - |
| | 62 | 52.5 | 5.6 | 52.0 | 50.5 | 48.0 | 38.5 | 28.9 | 19.4 | 50.2 | 6.3 | 49.3 | 47.5 | 45.6 | 36.1 | 26.5 | 16.9 |
| 2000 | 77 | 60.1 | 5.8 | 46.7 | 32.7 | 18.7 | - | - | - | 55.1 | 6.4 | 45.2 | 30.7 | 16.2 | - | - | - |
| | 72 | 57.4 | 5.7 | 51.2 | 40.7 | 30.3 | 19.9 | - | - | 52.8 | 6.3 | 48.7 | 38.3 | 27.9 | 17.5 | - | - |
| | 67 | 54.7 | 5.7 | 54.7 | 48.7 | 41.9 | 31.0 | 20.1 | - | 51.8 | 6.3 | 50.2 | 45.9 | 39.7 | 28.7 | 17.7 | - |
| | 62 | 55.2 | 5.7 | 54.8 | 54.3 | 53.5 | 42.2 | 30.9 | 19.5 | 51.1 | 6.3 | 50.3 | 50.3 | 50.3 | 39.9 | 28.4 | 16.8 |
| 2250 | 77 | 60.1 | 5.8 | 46.7 | 32.7 | 18.7 | - | - | - | 55.1 | 6.4 | 45.2 | 30.7 | 16.2 | - | - | - |
| | 72 | 57.4 | 5.7 | 51.2 | 40.7 | 30.3 | 19.9 | - | - | 52.8 | 6.3 | 48.7 | 38.3 | 27.9 | 17.5 | - | - |
| | 67 | 54.7 | 5.7 | 54.7 | 48.7 | 41.9 | 31.0 | 20.1 | - | 51.8 | 6.3 | 50.2 | 45.9 | 39.7 | 28.7 | 17.7 | - |
| | 62 | 55.2 | 5.7 | 54.8 | 54.3 | 53.5 | 42.2 | 30.9 | 19.5 | 51.1 | 6.3 | 50.3 | 50.3 | 50.3 | 39.9 | 28.4 | 16.8 |
| 2500 | 77 | 60.1 | 5.8 | 46.7 | 32.7 | 18.7 | - | - | - | 55.1 | 6.4 | 45.2 | 30.7 | 16.2 | - | - | - |
| | 72 | 57.4 | 5.7 | 51.2 | 40.7 | 30.3 | 19.9 | - | - | 52.8 | 6.3 | 48.7 | 38.3 | 27.9 | 17.5 | - | - |
| | 67 | 54.7 | 5.7 | 54.7 | 48.7 | 41.9 | 31.0 | 20.1 | - | 51.8 | 6.3 | 50.2 | 45.9 | 39.7 | 28.7 | 17.7 | - |
| | 62 | 55.2 | 5.7 | 54.8 | 54.3 | 53.5 | 42.2 | 30.9 | 19.5 | 51.1 | 6.3 | 50.3 | 50.3 | 50.3 | 39.9 | 28.4 | 16.8 |
| 2500 | 72 | 58.8 | 5.7 | 54.8 | 43.2 | 31.6 | 20.0 | - | - | 54.1 | 6.4 | 52.1 | 40.6 | 29.1 | 17.7 | - | - |
| | 67 | 57.6 | 5.7 | 57.0 | 51.6 | 45.3 | 32.9 | 20.6 | - | 53.6 | 6.3 | 52.4 | 48.5 | 43.2 | 30.7 | 18.2 | - |
| | 62 | 57.4 | 5.7 | 57.2 | 57.2 | 57.2 | 45.9 | 32.8 | 19.7 | 53.3 | 6.4 | 52.6 | 52.6 | 52.6 | 43.7 | 30.2 | 16.8 |
| | 57 | 57.2 | 5.7 | 57.2 | 57.2 | 57.2 | 45.0 | 31.2 | - | 53.0 | 6.4 | 52.9 | 52.9 | 52.9 | 52.9 | 42.2 | 27.8 |
| 2500 | 72 | 60.2 | 5.8 | 58.4 | 45.7 | 32.9 | 20.2 | - | - | 55.7 | 6.4 | 55.2 | 42.9 | 30.4 | 17.8 | - | - |
| | 67 | 59.9 | 5.7 | 59.0 | 54.4 | 48.7 | 34.9 | 21.1 | - | 55.6 | 6.4 | 55.3 | 51.1 | 46.7 | 32.7 | 18.7 | - |
| | 62 | 59.8 | 5.8 | 59.4 | 59.4 | 59.4 | 49.6 | 34.7 | 19.9 | 55.5 | 6.4 | 55.4 | 55.4 | 55.4 | 47.5 | 32.1 | 16.7 |
| | 57 | 59.7 | 5.8 | 59.6 | 59.6 | 59.6 | 48.4 | 32.5 | - | 55.4 | 6.4 | 55.4 | 55.4 | 55.4 | 45.5 | 28.6 | - |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

ZXA7, 08 to 14 cooling capacities

Table 36: ZXA7 (6 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity (MBh) ¹ | Total input (kW) ² | Sensible capacity (MBh) | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | 85°F | | | | | | | |
| 1500 | 77 | 89.8 | 4.1 | 45.1 | 37.4 | 29.8 | - | - | - | 84.7 | 4.6 | 41.2 | 34.3 | 27.5 | - | - | - |
| | 72 | 82.1 | 4.0 | 55.6 | 47.1 | 38.5 | 30.0 | - | - | 76.7 | 4.5 | 52.7 | 44.4 | 36.1 | 27.9 | - | - |
| | 67 | 74.3 | 3.9 | 66.1 | 56.7 | 47.3 | 38.1 | 30.4 | - | 68.8 | 4.4 | 64.2 | 54.5 | 44.8 | 36.2 | 28.4 | - |
| | 62 | 74.4 | 3.9 | 72.9 | 63.5 | 56.0 | 45.6 | 39.4 | 31.1 | 70.8 | 4.4 | 68.1 | 60.3 | 53.5 | 44.3 | 37.2 | 29.0 |
| 1800 | 77 | 91.0 | 4.1 | 51.6 | 40.8 | 29.9 | - | - | - | 85.5 | 4.6 | 48.6 | 38.0 | 27.4 | - | - | - |
| | 72 | 84.1 | 4.0 | 59.7 | 50.0 | 40.3 | 30.5 | - | - | 78.8 | 4.5 | 57.1 | 47.5 | 37.8 | 28.2 | - | - |
| | 67 | 77.2 | 4.0 | 67.8 | 59.2 | 50.6 | 40.3 | 31.1 | - | 72.1 | 4.5 | 65.5 | 56.9 | 48.3 | 38.3 | 28.9 | - |
| | 62 | 74.7 | 4.0 | 73.8 | 67.4 | 60.9 | 49.4 | 41.3 | 31.5 | 71.2 | 4.5 | 69.9 | 64.3 | 58.7 | 48.0 | 39.1 | 29.3 |
| 2100 | 57 | 60.7 | 3.9 | 60.7 | 60.7 | 60.7 | 60.7 | 51.6 | 41.7 | 59.4 | 4.5 | 59.4 | 59.4 | 59.4 | 59.2 | 49.3 | 39.5 |
| | 77 | 92.2 | 4.1 | 58.1 | 44.1 | 30.1 | - | - | - | 86.4 | 4.6 | 56.0 | 41.7 | 27.4 | - | - | - |
| | 72 | 86.2 | 4.1 | 63.9 | 52.9 | 42.0 | 31.1 | - | - | 80.9 | 4.6 | 61.5 | 50.5 | 39.5 | 28.6 | - | - |
| | 67 | 80.1 | 4.0 | 69.6 | 61.8 | 54.0 | 42.4 | 31.7 | - | 75.4 | 4.5 | 66.9 | 59.3 | 51.7 | 40.3 | 29.3 | - |
| 2400 | 62 | 75.1 | 4.0 | 74.6 | 71.2 | 65.9 | 53.3 | 43.2 | 31.9 | 71.6 | 4.5 | 71.6 | 68.3 | 63.8 | 51.8 | 41.1 | 29.7 |
| | 57 | 61.4 | 4.0 | 61.4 | 61.4 | 61.4 | 61.4 | 54.7 | 43.2 | 59.6 | 4.5 | 59.6 | 59.6 | 59.6 | 59.6 | 52.8 | 41.2 |
| | 77 | 93.4 | 4.1 | 64.7 | 47.5 | 30.3 | - | - | - | 87.2 | 4.6 | 63.5 | 45.4 | 27.4 | - | - | - |
| | 72 | 88.2 | 4.1 | 68.0 | 55.9 | 43.8 | 31.7 | - | - | 83.0 | 4.6 | 65.9 | 53.5 | 41.2 | 28.9 | - | - |
| 2700 | 67 | 83.0 | 4.0 | 71.3 | 64.3 | 57.3 | 44.5 | 32.3 | - | 78.7 | 4.5 | 68.2 | 61.7 | 55.1 | 42.3 | 29.8 | - |
| | 62 | 75.4 | 4.0 | 75.4 | 75.1 | 70.8 | 57.1 | 45.1 | 32.3 | 72.0 | 4.5 | 72.0 | 72.0 | 69.0 | 55.6 | 43.0 | 30.0 |
| | 57 | 62.1 | 4.0 | 62.1 | 62.1 | 62.1 | 62.1 | 57.9 | 44.7 | 59.7 | 4.5 | 59.7 | 59.7 | 59.7 | 59.7 | 56.2 | 42.8 |
| | 72 | 90.2 | 4.1 | 72.1 | 58.8 | 45.5 | 32.3 | - | - | 85.1 | 4.6 | 70.3 | 56.6 | 42.9 | 29.3 | - | - |
| 3000 | 67 | 85.9 | 4.0 | 73.1 | 66.8 | 60.6 | 46.7 | 33.0 | - | 82.1 | 4.6 | 69.6 | 64.1 | 58.6 | 44.4 | 30.3 | - |
| | 62 | 75.8 | 4.0 | 75.8 | 75.8 | 75.7 | 61.0 | 47.0 | 32.7 | 72.3 | 4.6 | 72.3 | 72.3 | 72.3 | 59.4 | 45.0 | 30.4 |
| | 57 | 62.8 | 4.1 | 62.8 | 62.8 | 62.8 | 62.8 | 61.0 | 46.1 | 59.9 | 4.6 | 59.9 | 59.9 | 59.9 | 59.9 | 59.6 | 44.5 |
| | 72 | 92.3 | 4.1 | 76.2 | 61.8 | 47.3 | 32.8 | - | - | 87.2 | 4.6 | 74.7 | 59.6 | 44.6 | 29.6 | - | - |
| 3000 | 67 | 88.8 | 4.1 | 74.8 | 69.4 | 64.0 | 48.8 | 33.6 | - | 85.4 | 4.6 | 71.0 | 66.5 | 62.0 | 46.4 | 30.8 | - |
| | 62 | 76.2 | 4.1 | 76.2 | 76.2 | 76.2 | 64.8 | 48.9 | 33.0 | 72.7 | 4.6 | 72.7 | 72.7 | 72.7 | 63.1 | 46.9 | 30.7 |
| | 57 | 63.5 | 4.1 | 63.5 | 63.5 | 63.5 | 63.5 | 63.5 | 47.6 | 60.0 | 4.6 | 60.0 | 60.0 | 60.0 | 60.0 | 60.0 | 46.2 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 37: ZXA7 (6 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity (MBh) ¹ | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| 95°F | | | | | | | | | | 105°F | | | | | | | | | |
| 1500 | 77 | 79.5 | 5.1 | 37.2 | 31.2 | 25.1 | - | - | - | 76.5 | 5.8 | 35.3 | 29.1 | 23.0 | - | - | - | | |
| | 72 | 71.4 | 5.0 | 49.7 | 41.7 | 33.8 | 25.8 | - | - | 67.1 | 5.7 | 47.4 | 39.5 | 31.6 | 23.6 | - | - | | |
| | 67 | 63.2 | 4.9 | 62.2 | 52.3 | 42.4 | 34.4 | 26.4 | - | 57.7 | 5.7 | 57.7 | 49.9 | 40.2 | 32.1 | 24.1 | - | | |
| | 62 | 67.3 | 4.9 | 63.3 | 57.2 | 51.0 | 43.0 | 34.9 | 26.8 | 63.8 | 5.7 | 59.9 | 54.3 | 48.7 | 40.6 | 32.4 | 24.3 | | |
| 1800 | 77 | 80.0 | 5.1 | 45.6 | 35.2 | 24.9 | - | - | - | 75.3 | 5.8 | 43.6 | 33.2 | 22.7 | - | - | - | | |
| | 72 | 73.5 | 5.0 | 54.4 | 44.9 | 35.4 | 25.9 | - | - | 68.5 | 5.8 | 52.0 | 42.5 | 33.1 | 23.7 | - | - | | |
| | 67 | 67.0 | 5.0 | 63.2 | 54.6 | 45.9 | 36.3 | 26.7 | - | 61.6 | 5.7 | 60.3 | 51.9 | 43.5 | 33.9 | 24.4 | - | | |
| | 62 | 67.7 | 5.0 | 66.1 | 61.3 | 56.4 | 46.7 | 36.9 | 27.1 | 64.0 | 5.7 | 62.4 | 58.2 | 53.9 | 44.2 | 34.5 | 24.7 | | |
| 2100 | 77 | 80.5 | 5.1 | 53.9 | 39.3 | 24.7 | - | - | - | 74.2 | 5.8 | 52.0 | 37.2 | 22.5 | - | - | - | | |
| | 72 | 75.6 | 5.1 | 59.1 | 48.1 | 37.1 | 26.1 | - | - | 69.8 | 5.8 | 56.5 | 45.6 | 34.7 | 23.8 | - | - | | |
| | 67 | 70.7 | 5.0 | 64.2 | 56.8 | 49.4 | 38.2 | 27.0 | - | 65.4 | 5.7 | 61.0 | 54.0 | 46.9 | 35.8 | 24.7 | - | | |
| | 62 | 68.1 | 5.0 | 68.1 | 65.4 | 61.8 | 50.4 | 38.9 | 27.4 | 64.3 | 5.7 | 64.3 | 62.0 | 59.1 | 47.8 | 36.5 | 25.1 | | |
| 2400 | 77 | 81.1 | 5.1 | 62.3 | 43.4 | 24.4 | - | - | - | 73.0 | 5.8 | 60.3 | 41.3 | 22.2 | - | - | - | | |
| | 72 | 77.8 | 5.1 | 63.7 | 51.2 | 38.7 | 26.2 | - | - | 71.2 | 5.8 | 61.0 | 48.6 | 36.2 | 23.9 | - | - | | |
| | 67 | 74.5 | 5.0 | 65.2 | 59.1 | 53.0 | 40.1 | 27.3 | - | 69.3 | 5.8 | 61.7 | 56.0 | 50.3 | 37.6 | 25.0 | - | | |
| | 62 | 68.5 | 5.0 | 68.5 | 68.5 | 67.2 | 54.1 | 40.9 | 27.7 | 64.5 | 5.7 | 64.5 | 64.5 | 64.3 | 51.4 | 38.5 | 25.6 | | |
| 2700 | 72 | 79.9 | 5.1 | 68.4 | 54.4 | 40.3 | 26.3 | - | - | 72.5 | 5.8 | 65.5 | 51.7 | 37.8 | 23.9 | - | - | | |
| | 67 | 78.2 | 5.1 | 66.1 | 61.3 | 56.5 | 42.0 | 27.6 | - | 73.2 | 5.8 | 62.4 | 58.0 | 53.6 | 39.5 | 25.3 | - | | |
| | 62 | 68.9 | 5.1 | 68.9 | 68.9 | 68.9 | 57.8 | 42.9 | 28.0 | 64.8 | 5.8 | 64.8 | 64.8 | 64.8 | 55.0 | 40.5 | 26.0 | | |
| | 57 | 57.0 | 5.1 | 57.0 | 57.0 | 57.0 | 57.0 | 57.0 | 42.9 | 54.7 | 5.8 | 54.7 | 54.7 | 54.7 | 54.7 | 53.6 | 37.8 | | |
| 3000 | 72 | 82.0 | 5.1 | 73.1 | 57.5 | 42.0 | 26.4 | - | - | 73.8 | 5.8 | 70.1 | 54.7 | 39.4 | 24.0 | - | - | | |
| | 67 | 81.9 | 5.1 | 67.1 | 63.5 | 60.0 | 43.9 | 27.9 | - | 77.0 | 5.8 | 63.1 | 60.1 | 57.0 | 41.3 | 25.6 | - | | |
| | 62 | 69.3 | 5.1 | 69.3 | 69.3 | 69.3 | 61.5 | 44.9 | 28.4 | 65.0 | 5.8 | 65.0 | 65.0 | 65.0 | 58.6 | 42.5 | 26.5 | | |
| | 57 | 56.6 | 5.1 | 56.6 | 56.6 | 56.6 | 56.6 | 56.6 | 44.9 | 53.1 | 5.8 | 53.1 | 53.1 | 53.1 | 53.1 | 53.1 | 38.8 | | |
| 115°F | | | | | | | | | | 125°F | | | | | | | | | |
| 1500 | 77 | 73.4 | 6.5 | 33.3 | 27.1 | 20.8 | - | - | - | 70.4 | 7.2 | 31.4 | 25.0 | 18.6 | - | - | - | | |
| | 72 | 62.9 | 6.5 | 45.2 | 37.3 | 29.4 | 21.5 | - | - | 58.6 | 7.2 | 42.9 | 35.0 | 27.2 | 19.3 | - | - | | |
| | 67 | 52.3 | 6.4 | 52.3 | 47.4 | 37.9 | 29.8 | 21.8 | - | 46.8 | 7.2 | 46.8 | 45.0 | 35.7 | 27.6 | 19.5 | - | | |
| | 62 | 60.3 | 6.4 | 56.4 | 51.5 | 46.5 | 38.2 | 30.0 | 21.7 | 56.8 | 7.1 | 53.0 | 48.6 | 44.2 | 35.9 | 27.5 | 19.2 | | |
| 1800 | 77 | 70.6 | 6.5 | 41.7 | 31.1 | 20.6 | - | - | - | 65.9 | 7.2 | 39.7 | 29.0 | 18.4 | - | - | - | | |
| | 72 | 63.4 | 6.5 | 49.5 | 40.2 | 30.8 | 21.5 | - | - | 58.4 | 7.2 | 47.1 | 37.8 | 28.6 | 19.3 | - | - | | |
| | 67 | 56.2 | 6.5 | 56.2 | 49.3 | 41.1 | 31.6 | 22.1 | - | 50.9 | 7.2 | 50.9 | 46.6 | 38.7 | 29.3 | 19.8 | - | | |
| | 62 | 60.4 | 6.4 | 58.7 | 55.0 | 51.4 | 41.7 | 32.0 | 22.3 | 56.7 | 7.1 | 54.9 | 51.9 | 48.9 | 39.2 | 29.6 | 19.9 | | |
| 2100 | 77 | 61.1 | 6.4 | 59.9 | 59.9 | 59.9 | 51.8 | 41.9 | 32.0 | 62.6 | 7.1 | 55.3 | 55.3 | 55.3 | 49.2 | 39.3 | 29.5 | | |
| | 72 | 67.8 | 6.5 | 50.0 | 35.1 | 20.3 | - | - | - | 61.4 | 7.2 | 48.0 | 33.0 | 18.1 | - | - | - | | |
| | 67 | 64.0 | 6.5 | 53.9 | 43.1 | 32.3 | 21.5 | - | - | 58.2 | 7.2 | 51.3 | 40.6 | 30.0 | 19.3 | - | - | | |
| | 62 | 60.2 | 6.5 | 57.9 | 51.1 | 44.3 | 33.4 | 22.4 | - | 54.9 | 7.2 | 54.7 | 48.2 | 41.8 | 30.9 | 20.1 | - | | |
| 2400 | 77 | 64.9 | 6.5 | 58.3 | 39.2 | 20.0 | - | - | - | 56.9 | 7.2 | 56.3 | 37.0 | 17.8 | - | - | - | | |
| | 72 | 64.5 | 6.5 | 58.3 | 46.0 | 33.8 | 21.6 | - | - | 57.9 | 7.2 | 55.6 | 43.5 | 31.4 | 19.2 | - | - | | |
| | 67 | 64.1 | 6.5 | 58.3 | 52.9 | 47.6 | 35.1 | 22.7 | - | 59.0 | 7.2 | 54.9 | 49.9 | 44.9 | 32.6 | 20.4 | - | | |
| | 62 | 60.6 | 6.5 | 60.6 | 60.6 | 60.6 | 48.7 | 36.1 | 23.4 | 56.7 | 7.2 | 56.7 | 56.7 | 56.7 | 46.0 | 33.6 | 21.3 | | |
| 2700 | 77 | 55.3 | 6.4 | 55.3 | 55.3 | 55.3 | 55.3 | 46.6 | 32.4 | 54.3 | 7.1 | 54.3 | 54.3 | 54.3 | 54.3 | 42.7 | 28.1 | | |
| | 72 | 65.1 | 6.5 | 62.7 | 49.0 | 35.3 | 21.6 | - | - | 57.7 | 7.2 | 57.7 | 46.3 | 32.8 | 19.2 | - | - | | |
| | 67 | 68.1 | 6.5 | 58.7 | 54.8 | 50.8 | 36.9 | 23.0 | - | 63.1 | 7.2 | 55.1 | 51.5 | 47.9 | 34.3 | 20.7 | - | | |
| | 62 | 60.7 | 6.5 | 60.7 | 60.7 | 60.7 | 52.2 | 38.1 | 24.0 | 56.6 | 7.2 | 56.6 | 56.6 | 56.6 | 49.4 | 35.7 | 22.0 | | |
| 3000 | 77 | 52.5 | 6.5 | 52.5 | 52.5 | 52.5 | 52.5 | 49.0 | 32.6 | 50.2 | 7.2 | 50.2 | 50.2 | 50.2 | 50.2 | 44.4 | 27.4 | | |
| | 72 | 65.7 | 6.5 | 65.7 | 51.9 | 36.8 | 21.6 | - | - | 57.5 | 7.2 | 57.5 | 49.1 | 34.1 | 19.2 | - | - | | |
| | 67 | 72.1 | 6.5 | 59.2 | 56.6 | 54.0 | 38.6 | 23.3 | - | 67.1 | 7.2 | 55.2 | 53.1 | 51.0 | 36.0 | 21.0 | - | | |
| | 62 | 60.8 | 6.5 | 60.8 | 60.8 | 60.8 | 55.7 | 40.1 | 24.6 | 56.6 | 7.2 | 56.6 | 56.6 | 56.6 | 52.8 | 37.7 | 22.7 | | |
| 57 | 49.6 | 6.5 | 49.6 | 49.6 | 49.6 | 49.6 | 49.6 | 32.8 | 46.1 | 7.2 | 46.1 | 46.1 | 46.1 | 46.1 | 46.1 | 26.8 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 38: ZX08 (7.5 ton, 75°F to 105°F)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | |
|------------------------|----|--------------------------------------|---------|-----------------------------------|-------------------------------|-------------------------|------|------|------|-------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|
| | | CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | |
| | | | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | |
| | | | | | | 90 | 85 | 80 | 75 | 70 | | | 65 | 90 | 85 | 80 | 75 |
| 75°F | | | | | | | | | | 85°F | | | | | | | |
| 1875 | 77 | 104.9 | 5.3 | 56.2 | 45.5 | 34.8 | - | - | - | 102.8 | 5.6 | 54.2 | 44.6 | 35.0 | - | - | - |
| | 72 | 99.3 | 5.2 | 68.2 | 57.7 | 47.2 | 36.7 | - | - | 95.9 | 5.6 | 66.7 | 56.4 | 46.2 | 35.9 | - | - |
| | 67 | 93.7 | 5.2 | 80.3 | 70.0 | 59.6 | 47.7 | 37.8 | - | 89.0 | 5.5 | 79.2 | 68.3 | 57.3 | 46.3 | 36.2 | - |
| | 62 | 89.5 | 5.1 | 89.5 | 80.9 | 72.0 | 57.4 | 49.4 | 38.2 | 85.5 | 5.5 | 85.5 | 77.3 | 68.5 | 56.0 | 46.8 | 35.9 |
| 2250 | 77 | 105.7 | 5.3 | 60.4 | 47.4 | 34.5 | - | - | - | 103.0 | 5.7 | 58.9 | 46.5 | 34.1 | - | - | - |
| | 72 | 100.3 | 5.3 | 72.2 | 60.5 | 48.7 | 37.0 | - | - | 96.9 | 5.6 | 70.9 | 59.2 | 47.6 | 35.9 | - | - |
| | 67 | 94.9 | 5.2 | 84.1 | 73.5 | 63.0 | 49.9 | 38.5 | - | 90.7 | 5.5 | 82.9 | 71.9 | 61.0 | 48.5 | 36.8 | - |
| | 62 | 91.5 | 5.2 | 91.5 | 84.6 | 77.2 | 61.8 | 51.8 | 39.0 | 87.8 | 5.5 | 87.8 | 81.5 | 74.4 | 60.6 | 49.4 | 36.9 |
| 2625 | 77 | 106.5 | 5.3 | 64.6 | 49.3 | 34.1 | - | - | - | 103.3 | 5.7 | 63.6 | 48.5 | 33.3 | - | - | - |
| | 72 | 101.3 | 5.3 | 76.2 | 63.2 | 50.2 | 37.2 | - | - | 97.8 | 5.6 | 75.2 | 62.1 | 49.0 | 35.9 | - | - |
| | 67 | 96.1 | 5.2 | 87.9 | 77.1 | 66.3 | 52.1 | 39.2 | - | 92.4 | 5.5 | 86.7 | 75.6 | 64.6 | 50.7 | 37.4 | - |
| | 62 | 93.6 | 5.2 | 93.6 | 88.4 | 82.4 | 66.3 | 54.1 | 39.9 | 90.1 | 5.5 | 90.1 | 85.8 | 80.3 | 65.1 | 52.0 | 37.8 |
| 3000 | 77 | 107.3 | 5.3 | 68.8 | 51.3 | 33.8 | - | - | - | 103.6 | 5.7 | 68.4 | 50.4 | 32.4 | - | - | - |
| | 72 | 102.3 | 5.3 | 80.2 | 66.0 | 51.7 | 37.5 | - | - | 98.8 | 5.6 | 79.4 | 64.9 | 50.4 | 35.8 | - | - |
| | 67 | 97.2 | 5.2 | 91.7 | 80.7 | 69.6 | 54.3 | 39.8 | - | 94.1 | 5.6 | 90.4 | 79.3 | 68.3 | 52.9 | 37.9 | - |
| | 62 | 95.6 | 5.2 | 95.6 | 92.2 | 87.6 | 70.7 | 56.4 | 40.8 | 92.4 | 5.6 | 92.4 | 90.0 | 86.2 | 69.7 | 54.6 | 38.8 |
| 3375 | 77 | 103.3 | 5.3 | 84.2 | 68.7 | 53.2 | 37.7 | - | - | 99.8 | 5.6 | 83.6 | 67.7 | 51.8 | 35.8 | - | - |
| | 72 | 98.4 | 5.2 | 95.5 | 84.2 | 73.0 | 56.5 | 40.5 | - | 95.8 | 5.6 | 94.2 | 83.0 | 71.9 | 55.1 | 38.5 | - |
| | 67 | 97.7 | 5.2 | 97.7 | 95.9 | 92.8 | 75.1 | 58.7 | 41.7 | 94.7 | 5.6 | 94.7 | 94.2 | 92.1 | 74.3 | 57.2 | 39.7 |
| | 62 | 97.0 | 5.3 | 97.0 | 97.0 | 94.8 | 77.0 | 59.3 | - | 93.6 | 5.6 | 93.6 | 93.6 | 93.6 | 93.6 | 75.8 | 57.6 |
| 3750 | 77 | 104.3 | 5.3 | 88.2 | 71.4 | 54.7 | 37.9 | - | - | 100.8 | 5.7 | 87.9 | 70.5 | 53.2 | 35.8 | - | - |
| | 72 | 99.5 | 5.3 | 99.2 | 87.8 | 76.3 | 58.7 | 41.1 | - | 97.4 | 5.6 | 97.4 | 86.7 | 75.6 | 57.3 | 39.1 | - |
| | 67 | 99.7 | 5.3 | 99.7 | 99.7 | 98.0 | 79.5 | 61.1 | 42.6 | 97.0 | 5.6 | 97.0 | 97.0 | 97.0 | 78.9 | 59.8 | 40.7 |
| | 62 | 99.9 | 5.3 | 99.9 | 99.9 | 99.9 | 81.0 | 61.7 | - | 96.5 | 5.6 | 96.5 | 96.5 | 96.5 | 96.5 | 80.5 | 60.5 |
| 95°F | | | | | | | | | | 105°F | | | | | | | |
| 1875 | 77 | 100.6 | 6.0 | 52.2 | 43.7 | 35.1 | - | - | - | 93.5 | 6.5 | 51.0 | 41.9 | 32.9 | - | - | - |
| | 72 | 92.5 | 5.9 | 65.1 | 55.1 | 45.1 | 35.1 | - | - | 86.0 | 6.4 | 62.7 | 52.6 | 42.4 | 32.3 | - | - |
| | 67 | 84.3 | 5.8 | 78.1 | 66.6 | 55.0 | 44.8 | 34.6 | - | 78.5 | 6.3 | 74.4 | 63.2 | 52.0 | 41.8 | 31.6 | - |
| | 62 | 81.6 | 5.8 | 81.6 | 73.7 | 65.0 | 54.6 | 44.2 | 33.7 | 76.2 | 6.3 | 76.2 | 69.3 | 61.6 | 51.3 | 41.0 | 30.8 |
| 2250 | 77 | 100.4 | 6.0 | 57.5 | 45.6 | 33.8 | - | - | - | 93.5 | 6.5 | 56.7 | 44.1 | 31.6 | - | - | - |
| | 72 | 93.4 | 5.9 | 69.6 | 58.0 | 46.4 | 34.8 | - | - | 87.2 | 6.4 | 67.3 | 55.6 | 43.8 | 32.1 | - | - |
| | 67 | 86.5 | 5.9 | 81.8 | 70.4 | 59.0 | 47.0 | 35.1 | - | 80.8 | 6.3 | 77.8 | 67.0 | 56.1 | 44.1 | 32.2 | - |
| | 62 | 84.1 | 5.8 | 84.1 | 78.4 | 71.6 | 59.3 | 47.0 | 34.7 | 78.8 | 6.3 | 78.8 | 74.2 | 68.4 | 56.1 | 43.9 | 31.7 |
| 2625 | 77 | 100.1 | 6.0 | 62.7 | 47.6 | 32.5 | - | - | - | 93.5 | 6.5 | 62.3 | 46.3 | 30.3 | - | - | - |
| | 72 | 94.4 | 5.9 | 74.1 | 60.9 | 47.7 | 34.5 | - | - | 88.3 | 6.4 | 71.8 | 58.5 | 45.2 | 32.0 | - | - |
| | 67 | 88.7 | 5.9 | 85.5 | 74.2 | 62.9 | 49.3 | 35.6 | - | 83.1 | 6.4 | 81.3 | 70.7 | 60.2 | 46.5 | 32.8 | - |
| | 62 | 86.6 | 5.9 | 86.6 | 83.1 | 78.2 | 64.0 | 49.9 | 35.7 | 81.3 | 6.4 | 81.3 | 79.0 | 75.1 | 61.0 | 46.8 | 32.7 |
| 3000 | 77 | 99.8 | 6.0 | 68.0 | 49.6 | 31.1 | - | - | - | 93.5 | 6.5 | 68.0 | 48.5 | 29.1 | - | - | - |
| | 72 | 95.4 | 6.0 | 78.6 | 63.8 | 49.0 | 34.2 | - | - | 89.5 | 6.4 | 76.3 | 61.5 | 46.6 | 31.8 | - | - |
| | 67 | 90.9 | 5.9 | 89.2 | 78.0 | 66.9 | 51.5 | 36.1 | - | 85.4 | 6.4 | 84.7 | 74.5 | 64.2 | 48.8 | 33.3 | - |
| | 62 | 89.2 | 5.9 | 89.2 | 87.8 | 84.8 | 68.8 | 52.7 | 36.7 | 83.9 | 6.4 | 83.9 | 83.8 | 81.8 | 65.8 | 49.7 | 33.6 |
| 3375 | 77 | 87.4 | 5.9 | 87.4 | 87.4 | 87.4 | 86.0 | 69.4 | 52.8 | 82.3 | 6.4 | 82.3 | 82.3 | 82.3 | 82.3 | 66.1 | 49.4 |
| | 72 | 96.3 | 6.0 | 83.1 | 66.7 | 50.3 | 33.9 | - | - | 90.7 | 6.4 | 80.9 | 64.5 | 48.0 | 31.6 | - | - |
| | 67 | 93.1 | 5.9 | 92.9 | 81.8 | 70.8 | 53.7 | 36.6 | - | 87.8 | 6.4 | 87.8 | 78.2 | 68.3 | 51.1 | 33.9 | - |
| | 62 | 91.7 | 5.9 | 91.7 | 91.7 | 91.4 | 73.5 | 55.6 | 37.7 | 86.4 | 6.4 | 86.4 | 86.4 | 86.4 | 70.6 | 52.6 | 34.6 |
| 3750 | 77 | 90.3 | 5.9 | 90.3 | 90.3 | 90.3 | 90.3 | 74.6 | 56.0 | 85.1 | 6.4 | 85.1 | 85.1 | 85.1 | 85.1 | 71.3 | 52.5 |
| | 72 | 97.3 | 6.0 | 87.6 | 69.6 | 51.6 | 33.6 | - | - | 91.8 | 6.4 | 85.4 | 67.4 | 49.4 | 31.5 | - | - |
| | 67 | 95.3 | 6.0 | 95.3 | 85.7 | 74.8 | 55.9 | 37.1 | - | 90.1 | 6.4 | 90.1 | 81.9 | 72.4 | 53.4 | 34.5 | - |
| | 62 | 94.2 | 5.9 | 94.2 | 94.2 | 94.2 | 78.2 | 58.5 | 38.7 | 89.0 | 6.4 | 89.0 | 89.0 | 89.0 | 75.4 | 55.5 | 35.6 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 39: ZX08 (7.5 ton, 115°F to 125°F)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 1875 | 77 | 86.4 | 6.9 | 49.9 | 40.2 | 30.6 | - | - | - | 79.3 | 7.4 | 48.7 | 38.5 | 28.3 | - | - | - |
| | 72 | 79.5 | 6.9 | 60.3 | 50.1 | 39.8 | 29.5 | - | - | 73.0 | 7.3 | 57.9 | 47.5 | 37.2 | 26.8 | - | - |
| | 67 | 72.6 | 6.8 | 70.8 | 59.9 | 49.0 | 38.8 | 28.6 | - | 66.7 | 7.3 | 66.7 | 56.6 | 46.0 | 35.8 | 25.6 | - |
| | 62 | 70.9 | 6.8 | 70.9 | 65.0 | 58.3 | 48.1 | 37.9 | 27.8 | 65.5 | 7.3 | 65.5 | 60.7 | 54.9 | 44.9 | 34.8 | 24.8 |
| 2250 | 77 | 86.7 | 6.9 | 55.9 | 42.6 | 29.4 | - | - | - | 79.8 | 7.4 | 55.1 | 41.1 | 27.2 | - | - | - |
| | 72 | 80.9 | 6.9 | 64.9 | 53.1 | 41.3 | 29.5 | - | - | 74.6 | 7.4 | 62.6 | 50.7 | 38.8 | 26.8 | - | - |
| | 67 | 75.0 | 6.8 | 73.9 | 63.6 | 53.2 | 41.2 | 29.3 | - | 69.3 | 7.3 | 69.3 | 60.2 | 50.3 | 38.3 | 26.3 | - |
| | 62 | 73.5 | 6.8 | 73.5 | 69.9 | 65.1 | 53.0 | 40.8 | 28.7 | 68.1 | 7.3 | 68.1 | 65.7 | 61.9 | 49.8 | 37.8 | 25.7 |
| 2625 | 77 | 87.0 | 6.9 | 62.0 | 45.1 | 28.2 | - | - | - | 80.4 | 7.4 | 61.6 | 43.8 | 26.0 | - | - | - |
| | 72 | 82.2 | 6.9 | 69.5 | 56.1 | 42.8 | 29.4 | - | - | 76.1 | 7.4 | 67.2 | 53.8 | 40.3 | 26.9 | - | - |
| | 67 | 77.5 | 6.8 | 77.1 | 67.2 | 57.4 | 43.7 | 29.9 | - | 71.9 | 7.3 | 71.9 | 63.7 | 54.6 | 40.9 | 27.1 | - |
| | 62 | 76.0 | 6.8 | 76.0 | 74.8 | 72.0 | 57.9 | 43.8 | 29.6 | 70.7 | 7.3 | 70.7 | 70.7 | 68.9 | 54.8 | 40.7 | 26.6 |
| 3000 | 77 | 87.2 | 6.9 | 68.0 | 47.5 | 27.0 | - | - | - | 81.0 | 7.4 | 68.0 | 46.4 | 24.9 | - | - | - |
| | 72 | 83.6 | 6.9 | 74.1 | 59.2 | 44.3 | 29.4 | - | - | 77.7 | 7.4 | 71.8 | 56.9 | 41.9 | 27.0 | - | - |
| | 67 | 80.0 | 6.9 | 80.0 | 70.9 | 61.6 | 46.1 | 30.6 | - | 74.5 | 7.3 | 74.5 | 67.3 | 58.9 | 43.4 | 27.8 | - |
| | 62 | 78.6 | 6.9 | 78.6 | 78.6 | 78.6 | 62.8 | 46.7 | 30.6 | 73.3 | 7.4 | 73.3 | 73.3 | 73.3 | 59.8 | 43.6 | 27.5 |
| 3375 | 77 | 87.2 | 6.9 | 77.2 | 77.2 | 77.2 | 77.2 | 62.8 | 46.0 | 72.1 | 7.4 | 72.1 | 72.1 | 72.1 | 72.1 | 59.4 | 42.7 |
| | 72 | 85.0 | 6.9 | 78.7 | 62.2 | 45.8 | 29.3 | - | - | 79.3 | 7.4 | 76.5 | 60.0 | 43.5 | 27.0 | - | - |
| | 67 | 82.4 | 6.9 | 82.4 | 74.5 | 65.8 | 48.5 | 31.2 | - | 77.1 | 7.4 | 77.1 | 70.9 | 63.2 | 45.9 | 28.5 | - |
| | 62 | 81.2 | 6.9 | 81.2 | 81.2 | 81.2 | 67.7 | 49.6 | 31.5 | 75.9 | 7.4 | 75.9 | 75.9 | 75.9 | 64.8 | 46.6 | 28.4 |
| 3750 | 77 | 86.3 | 6.9 | 83.3 | 65.3 | 47.3 | 29.3 | - | - | 80.9 | 7.4 | 80.9 | 63.1 | 45.1 | 27.1 | - | - |
| | 72 | 84.9 | 6.9 | 84.9 | 78.2 | 69.9 | 50.9 | 31.9 | - | 79.7 | 7.4 | 79.7 | 74.5 | 67.5 | 48.4 | 29.3 | - |
| | 67 | 83.7 | 6.9 | 83.7 | 83.7 | 83.7 | 72.6 | 52.5 | 32.4 | 78.5 | 7.4 | 78.5 | 78.5 | 78.5 | 69.7 | 49.5 | 29.2 |
| | 62 | 82.6 | 6.9 | 82.6 | 82.6 | 82.6 | 82.6 | 73.1 | 52.0 | 77.3 | 7.4 | 77.3 | 77.3 | 77.3 | 77.3 | 69.7 | 48.3 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 40: ZX09 (8.5 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 2125 | 77 | 117.2 | 6.2 | 62.3 | 51.0 | 39.8 | - | - | - | 114.4 | 6.7 | 61.4 | 50.1 | 38.8 | - | - | - | | |
| | 72 | 109.9 | 6.2 | 75.1 | 64.1 | 53.1 | 42.1 | - | - | 106.6 | 6.6 | 73.7 | 62.6 | 51.5 | 40.3 | - | - | | |
| | 67 | 102.7 | 6.1 | 87.9 | 77.1 | 66.4 | 53.6 | 43.2 | - | 98.8 | 6.5 | 86.0 | 75.1 | 64.1 | 51.9 | 40.8 | - | | |
| | 62 | 102.4 | 6.0 | 102.4 | 92.8 | 79.6 | 65.5 | 55.2 | 43.0 | 98.4 | 6.4 | 98.4 | 88.0 | 76.8 | 63.7 | 52.5 | 40.3 | | |
| 2550 | 77 | 119.3 | 6.2 | 66.5 | 52.8 | 39.2 | - | - | - | 115.7 | 6.6 | 65.6 | 51.8 | 38.0 | - | - | - | | |
| | 72 | 113.1 | 6.2 | 79.5 | 67.0 | 54.6 | 42.1 | - | - | 109.0 | 6.6 | 78.1 | 65.5 | 53.0 | 40.5 | - | - | | |
| | 67 | 106.8 | 6.1 | 92.4 | 81.2 | 70.0 | 56.1 | 44.0 | - | 102.3 | 6.5 | 90.6 | 79.3 | 68.0 | 54.4 | 41.7 | - | | |
| | 62 | 106.4 | 6.0 | 105.4 | 96.0 | 85.5 | 70.3 | 58.2 | 44.6 | 101.8 | 6.4 | 100.9 | 92.0 | 83.1 | 68.6 | 55.6 | 41.8 | | |
| 2975 | 77 | 121.3 | 6.2 | 70.8 | 54.6 | 38.5 | - | - | - | 116.9 | 6.6 | 69.9 | 53.5 | 37.2 | - | - | - | | |
| | 72 | 116.2 | 6.2 | 83.9 | 70.0 | 56.1 | 42.2 | - | - | 111.4 | 6.6 | 82.5 | 68.5 | 54.6 | 40.6 | - | - | | |
| | 67 | 111.0 | 6.1 | 96.9 | 85.3 | 73.7 | 58.5 | 44.8 | - | 105.8 | 6.5 | 95.2 | 83.5 | 71.9 | 56.9 | 42.6 | - | | |
| | 62 | 110.4 | 6.1 | 107.2 | 99.2 | 91.3 | 75.1 | 61.2 | 46.2 | 105.2 | 6.5 | 102.7 | 96.0 | 89.3 | 73.4 | 58.7 | 43.4 | | |
| 3400 | 77 | 123.4 | 6.2 | 75.1 | 56.4 | 37.8 | - | - | - | 118.1 | 6.6 | 74.1 | 55.3 | 36.4 | - | - | - | | |
| | 72 | 119.3 | 6.1 | 88.3 | 72.9 | 57.6 | 42.2 | - | - | 113.7 | 6.6 | 86.9 | 71.5 | 56.1 | 40.7 | - | - | | |
| | 67 | 115.2 | 6.1 | 101.4 | 89.4 | 77.4 | 61.0 | 45.6 | - | 109.3 | 6.5 | 99.8 | 87.8 | 75.8 | 59.5 | 43.5 | - | | |
| | 62 | 114.3 | 6.1 | 107.7 | 102.4 | 97.1 | 79.9 | 64.2 | 47.8 | 108.7 | 6.5 | 104.6 | 100.1 | 95.6 | 78.3 | 61.8 | 44.9 | | |
| 3825 | 77 | 122.4 | 6.1 | 92.6 | 75.9 | 59.1 | 42.3 | - | - | 116.1 | 6.5 | 91.4 | 74.5 | 57.7 | 40.8 | - | - | | |
| | 72 | 119.4 | 6.1 | 106.0 | 93.5 | 81.0 | 63.5 | 46.4 | - | 112.8 | 6.5 | 104.4 | 92.0 | 79.7 | 62.0 | 44.4 | - | | |
| | 67 | 118.3 | 6.1 | 108.3 | 105.6 | 103.0 | 84.7 | 67.2 | 49.4 | 112.1 | 6.5 | 106.4 | 104.1 | 101.8 | 83.2 | 64.9 | 46.5 | | |
| | 62 | 117.2 | 6.1 | 110.3 | 110.3 | 110.3 | 106.5 | 88.1 | 69.7 | 111.3 | 6.5 | 108.3 | 108.3 | 104.6 | 85.4 | 66.1 | - | | |
| 4250 | 77 | 125.5 | 6.1 | 97.0 | 78.8 | 60.6 | 42.3 | - | - | 118.4 | 6.5 | 95.8 | 77.5 | 59.2 | 40.9 | - | - | | |
| | 72 | 123.6 | 6.1 | 110.5 | 97.6 | 84.7 | 65.9 | 47.2 | - | 116.3 | 6.5 | 108.9 | 96.3 | 83.6 | 64.5 | 45.3 | - | | |
| | 67 | 122.3 | 6.1 | 108.8 | 108.8 | 108.8 | 89.5 | 70.2 | 51.0 | 115.5 | 6.5 | 108.2 | 108.1 | 108.0 | 88.0 | 68.0 | 48.0 | | |
| | 62 | 121.0 | 6.2 | 107.2 | 107.2 | 107.2 | 107.2 | 93.3 | 73.5 | 114.7 | 6.6 | 107.4 | 107.4 | 107.4 | 107.4 | 90.7 | 69.8 | | |
| | | 95°F | | | | | | | | | 105°F | | | | | | | | |
| 2125 | 77 | 111.7 | 7.1 | 60.5 | 49.1 | 37.7 | - | - | - | 103.6 | 7.7 | 56.5 | 45.9 | 35.4 | - | - | - | | |
| | 72 | 103.3 | 7.0 | 72.3 | 61.0 | 49.8 | 38.6 | - | - | 96.3 | 7.6 | 69.0 | 58.0 | 46.9 | 35.8 | - | - | | |
| | 67 | 95.0 | 6.9 | 84.0 | 73.0 | 61.9 | 50.2 | 38.5 | - | 89.0 | 7.5 | 81.6 | 70.0 | 58.4 | 46.9 | 35.5 | - | | |
| | 62 | 94.3 | 6.8 | 92.2 | 83.1 | 74.1 | 61.9 | 49.7 | 37.5 | 88.5 | 7.4 | 86.9 | 78.4 | 69.8 | 58.1 | 46.3 | 34.6 | | |
| 2550 | 77 | 112.1 | 7.1 | 64.7 | 50.7 | 36.8 | - | - | - | 104.2 | 7.7 | 61.8 | 48.1 | 34.5 | - | - | - | | |
| | 72 | 104.9 | 7.0 | 76.7 | 64.1 | 51.4 | 38.8 | - | - | 98.0 | 7.6 | 73.6 | 61.1 | 48.5 | 35.9 | - | - | | |
| | 67 | 97.8 | 6.9 | 88.7 | 77.4 | 66.1 | 52.8 | 39.5 | - | 91.8 | 7.5 | 85.5 | 74.0 | 62.4 | 49.4 | 36.4 | - | | |
| | 62 | 97.2 | 6.9 | 95.3 | 88.0 | 80.7 | 66.8 | 52.9 | 39.0 | 91.3 | 7.4 | 89.8 | 83.1 | 76.4 | 62.9 | 49.5 | 36.0 | | |
| 2975 | 77 | 112.5 | 7.0 | 69.0 | 52.4 | 35.9 | - | - | - | 104.8 | 7.6 | 67.1 | 50.3 | 33.6 | - | - | - | | |
| | 72 | 106.5 | 7.0 | 81.2 | 67.1 | 53.0 | 39.0 | - | - | 99.7 | 7.6 | 78.3 | 64.2 | 50.1 | 36.0 | - | - | | |
| | 67 | 100.6 | 6.9 | 93.4 | 81.8 | 70.2 | 55.3 | 40.5 | - | 94.6 | 7.5 | 89.4 | 78.0 | 66.5 | 51.9 | 37.2 | - | | |
| | 62 | 100.1 | 6.9 | 98.3 | 92.8 | 87.3 | 71.7 | 56.1 | 40.5 | 94.1 | 7.5 | 92.6 | 87.8 | 83.0 | 67.8 | 52.6 | 37.4 | | |
| 3400 | 77 | 112.9 | 7.0 | 73.2 | 54.1 | 35.0 | - | - | - | 105.4 | 7.6 | 72.4 | 52.5 | 32.7 | - | - | - | | |
| | 72 | 108.1 | 7.0 | 85.6 | 70.1 | 54.6 | 39.1 | - | - | 101.4 | 7.5 | 82.9 | 67.3 | 51.7 | 36.1 | - | - | | |
| | 67 | 103.4 | 6.9 | 98.1 | 86.2 | 74.3 | 57.9 | 41.5 | - | 97.4 | 7.5 | 93.4 | 82.0 | 70.6 | 54.4 | 38.1 | - | | |
| | 62 | 103.0 | 6.9 | 101.4 | 97.7 | 94.0 | 76.7 | 59.3 | 42.0 | 96.9 | 7.5 | 95.5 | 92.6 | 89.6 | 72.6 | 55.7 | 38.7 | | |
| 3825 | 77 | 109.8 | 7.0 | 90.1 | 73.2 | 56.2 | 39.3 | - | - | 103.1 | 7.5 | 87.5 | 70.4 | 53.3 | 36.2 | - | - | | |
| | 72 | 106.2 | 6.9 | 102.7 | 90.6 | 78.4 | 60.5 | 42.5 | - | 100.2 | 7.5 | 97.3 | 86.0 | 74.7 | 56.8 | 38.9 | - | | |
| | 67 | 105.8 | 6.9 | 104.5 | 102.6 | 100.6 | 81.6 | 62.6 | 43.5 | 99.8 | 7.5 | 98.4 | 97.3 | 96.2 | 77.5 | 58.8 | 40.1 | | |
| | 62 | 105.4 | 7.0 | 105.4 | 105.4 | 105.4 | 102.7 | 82.7 | 62.6 | 99.3 | 7.5 | 99.3 | 99.3 | 99.3 | 98.2 | 78.7 | 59.2 | | |
| 4250 | 77 | 111.4 | 6.9 | 94.5 | 76.2 | 57.9 | 39.5 | - | - | 104.8 | 7.5 | 92.1 | 73.5 | 54.9 | 36.2 | - | - | | |
| | 72 | 109.1 | 6.9 | 107.4 | 95.0 | 82.6 | 63.0 | 43.5 | - | 103.0 | 7.5 | 101.2 | 90.0 | 78.8 | 59.3 | 39.8 | - | | |
| | 67 | 108.7 | 7.0 | 107.5 | 107.4 | 107.3 | 86.5 | 65.8 | 45.1 | 102.6 | 7.5 | 101.3 | 101.3 | 101.3 | 82.3 | 61.9 | 41.5 | | |
| | 62 | 108.4 | 7.0 | 107.6 | 107.6 | 107.6 | 107.6 | 88.1 | 66.2 | 102.1 | 7.6 | 101.3 | 101.3 | 101.3 | 101.3 | 84.1 | 62.7 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 41: ZX09 (8.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | | Return dry bulb (°F) | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | 90 | | | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | 125°F | | | | | | | | |
| 2125 | 77 | 95.5 | 8.3 | 52.5 | 42.8 | 33.1 | - | - | - | 87.4 | 8.9 | 48.5 | 39.6 | 30.7 | - | - | - |
| | 72 | 89.2 | 8.2 | 65.8 | 54.9 | 43.9 | 33.0 | - | - | 82.2 | 8.8 | 62.6 | 51.8 | 41.0 | 30.2 | - | - |
| | 67 | 83.0 | 8.0 | 79.2 | 67.0 | 54.8 | 43.7 | 32.5 | - | 77.0 | 8.6 | 76.7 | 64.0 | 51.2 | 40.4 | 29.5 | - |
| | 62 | 82.6 | 8.0 | 81.6 | 73.6 | 65.6 | 54.3 | 43.0 | 31.7 | 76.7 | 8.6 | 76.3 | 68.9 | 61.4 | 50.6 | 39.7 | 28.8 |
| 2550 | 77 | 96.3 | 8.3 | 58.8 | 45.5 | 32.2 | - | - | - | 88.4 | 8.9 | 55.9 | 42.9 | 29.9 | - | - | - |
| | 72 | 91.0 | 8.2 | 70.6 | 58.0 | 45.5 | 33.0 | - | - | 84.1 | 8.8 | 67.5 | 55.0 | 42.6 | 30.1 | - | - |
| | 67 | 85.8 | 8.1 | 82.3 | 70.6 | 58.8 | 46.0 | 33.2 | - | 79.8 | 8.6 | 79.1 | 67.2 | 55.2 | 42.7 | 30.1 | - |
| | 62 | 85.3 | 8.0 | 84.3 | 78.2 | 72.2 | 59.1 | 46.0 | 33.0 | 79.4 | 8.6 | 78.8 | 73.3 | 67.9 | 55.2 | 42.6 | 29.9 |
| 2975 | 57 | 84.9 | 8.0 | 84.9 | 84.9 | 84.9 | 72.2 | 58.8 | 45.5 | 79.0 | 8.6 | 78.4 | 78.4 | 78.4 | 67.8 | 55.1 | 42.4 |
| | 77 | 97.1 | 8.2 | 65.2 | 48.3 | 31.3 | - | - | - | 89.4 | 8.8 | 63.3 | 46.2 | 29.0 | - | - | - |
| | 72 | 92.8 | 8.1 | 75.3 | 61.2 | 47.1 | 33.0 | - | - | 86.0 | 8.7 | 72.4 | 58.3 | 44.1 | 30.0 | - | - |
| | 67 | 88.6 | 8.1 | 85.5 | 74.2 | 62.9 | 48.4 | 33.9 | - | 82.6 | 8.7 | 81.5 | 70.4 | 59.2 | 45.0 | 30.7 | - |
| | 62 | 88.1 | 8.1 | 86.9 | 82.8 | 78.7 | 63.9 | 49.0 | 34.2 | 82.1 | 8.6 | 81.2 | 77.8 | 74.4 | 59.9 | 45.5 | 31.0 |
| 3400 | 57 | 87.6 | 8.0 | 87.6 | 87.6 | 87.6 | 79.3 | 64.1 | 48.9 | 81.7 | 8.6 | 81.0 | 81.0 | 81.0 | 74.9 | 60.3 | 45.7 |
| | 77 | 97.9 | 8.2 | 71.6 | 51.0 | 30.4 | - | - | - | 90.4 | 8.8 | 70.7 | 49.4 | 28.2 | - | - | - |
| | 72 | 94.7 | 8.1 | 80.1 | 64.4 | 48.7 | 33.0 | - | - | 87.9 | 8.7 | 77.3 | 61.5 | 45.7 | 29.9 | - | - |
| | 67 | 91.4 | 8.1 | 88.6 | 77.8 | 66.9 | 50.8 | 34.7 | - | 85.4 | 8.7 | 83.9 | 73.6 | 63.3 | 47.2 | 31.2 | - |
| | 62 | 90.9 | 8.1 | 89.6 | 87.4 | 85.2 | 68.6 | 52.0 | 35.4 | 84.9 | 8.7 | 83.7 | 82.3 | 80.8 | 64.6 | 48.4 | 32.1 |
| 3825 | 57 | 90.4 | 8.1 | 90.4 | 90.4 | 90.4 | 86.4 | 69.4 | 52.4 | 84.3 | 8.7 | 83.5 | 83.5 | 83.5 | 82.0 | 65.5 | 49.1 |
| | 72 | 96.5 | 8.1 | 84.9 | 67.6 | 50.3 | 33.0 | - | - | 89.8 | 8.7 | 82.2 | 64.8 | 47.3 | 29.8 | - | - |
| | 67 | 94.2 | 8.1 | 91.8 | 81.4 | 71.0 | 53.2 | 35.4 | - | 88.2 | 8.7 | 86.3 | 76.8 | 67.3 | 49.5 | 31.8 | - |
| | 62 | 93.7 | 8.1 | 92.3 | 92.0 | 91.7 | 73.4 | 55.0 | 36.7 | 87.6 | 8.7 | 86.2 | 86.2 | 86.2 | 69.3 | 51.3 | 33.2 |
| 4250 | 57 | 93.1 | 8.1 | 92.8 | 92.8 | 92.8 | 74.7 | 55.8 | - | 87.0 | 8.7 | 86.1 | 86.1 | 86.1 | 86.1 | 70.7 | 52.4 |
| | 72 | 98.3 | 8.1 | 89.6 | 70.7 | 51.9 | 33.0 | - | - | 91.7 | 8.7 | 87.2 | 68.0 | 48.9 | 29.7 | - | - |
| | 67 | 97.0 | 8.1 | 95.0 | 85.0 | 75.1 | 55.6 | 36.1 | - | 91.0 | 8.7 | 88.7 | 80.0 | 71.3 | 51.8 | 32.4 | - |
| | 62 | 96.5 | 8.1 | 95.0 | 95.0 | 95.0 | 78.1 | 58.0 | 37.9 | 90.3 | 8.7 | 88.7 | 88.7 | 88.7 | 73.9 | 54.1 | 34.3 |
| 57 | 95.9 | 8.1 | 95.0 | 95.0 | 95.0 | 80.0 | 59.3 | - | 89.6 | 8.7 | 88.7 | 88.7 | 88.7 | 88.7 | 75.9 | 55.8 | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 42: ZX12 (10 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|----|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | 85°F | | | | | | | |
| 2500 | 77 | 157.9 | 7.4 | 79.5 | 66.4 | 53.4 | - | - | - | 150.5 | 8.3 | 76.6 | 63.8 | 51.0 | - | - | - |
| | 72 | 143.4 | 7.2 | 94.4 | 80.9 | 67.3 | 53.8 | - | - | 136.1 | 8.1 | 91.6 | 77.8 | 64.0 | 50.2 | - | - |
| | 67 | 128.9 | 7.0 | 109.3 | 95.3 | 81.3 | 66.2 | 53.5 | - | 121.7 | 7.9 | 106.5 | 91.8 | 77.0 | 62.8 | 49.9 | - |
| | 62 | 121.9 | 6.9 | 120.8 | 108.0 | 95.2 | 76.9 | 66.8 | 52.5 | 116.9 | 7.9 | 115.3 | 102.6 | 90.0 | 74.6 | 63.3 | 50.0 |
| 3000 | 77 | 159.6 | 7.4 | 88.3 | 70.7 | 53.2 | - | - | - | 151.7 | 8.4 | 85.6 | 68.1 | 50.6 | - | - | - |
| | 72 | 147.0 | 7.3 | 102.6 | 86.5 | 70.5 | 54.4 | - | - | 139.3 | 8.2 | 99.6 | 83.4 | 67.1 | 50.8 | - | - |
| | 67 | 134.4 | 7.1 | 117.0 | 102.4 | 87.8 | 70.3 | 54.7 | - | 126.9 | 8.0 | 113.7 | 98.7 | 83.6 | 66.8 | 51.0 | - |
| | 62 | 129.0 | 7.0 | 123.1 | 115.6 | 105.1 | 84.8 | 71.1 | 54.1 | 123.3 | 8.0 | 119.3 | 110.3 | 100.2 | 82.2 | 67.4 | 51.0 |
| 3500 | 77 | 161.3 | 7.5 | 97.1 | 75.0 | 53.0 | - | - | - | 152.8 | 8.4 | 94.6 | 72.4 | 50.1 | - | - | - |
| | 72 | 150.6 | 7.3 | 110.9 | 92.2 | 73.6 | 55.0 | - | - | 142.4 | 8.3 | 107.7 | 89.0 | 70.2 | 51.5 | - | - |
| | 67 | 139.9 | 7.2 | 124.6 | 109.5 | 94.3 | 74.4 | 55.9 | - | 132.0 | 8.1 | 120.9 | 105.6 | 90.3 | 70.8 | 52.1 | - |
| | 62 | 136.2 | 7.1 | 131.4 | 123.2 | 115.0 | 92.7 | 75.4 | 55.6 | 129.7 | 8.1 | 125.7 | 118.0 | 110.4 | 89.7 | 71.5 | 52.1 |
| 4000 | 77 | 163.0 | 7.5 | 105.9 | 79.4 | 52.8 | - | - | - | 154.0 | 8.4 | 103.6 | 76.7 | 49.7 | - | - | - |
| | 72 | 154.2 | 7.4 | 119.1 | 97.9 | 76.8 | 55.6 | - | - | 145.6 | 8.3 | 115.8 | 94.6 | 73.3 | 52.1 | - | - |
| | 67 | 145.5 | 7.2 | 132.3 | 116.5 | 100.8 | 78.5 | 57.1 | - | 137.2 | 8.2 | 128.0 | 112.5 | 97.0 | 74.9 | 53.2 | - |
| | 62 | 143.4 | 7.2 | 136.7 | 130.8 | 124.8 | 100.6 | 79.7 | 57.2 | 136.1 | 8.2 | 130.8 | 125.7 | 120.6 | 97.3 | 75.6 | 53.1 |
| 4500 | 77 | 163.0 | 7.5 | 105.9 | 79.4 | 52.8 | - | - | - | 154.0 | 8.4 | 103.6 | 76.7 | 49.7 | - | - | - |
| | 72 | 154.2 | 7.4 | 119.1 | 97.9 | 76.8 | 55.6 | - | - | 145.6 | 8.3 | 115.8 | 94.6 | 73.3 | 52.1 | - | - |
| | 67 | 145.5 | 7.2 | 132.3 | 116.5 | 100.8 | 78.5 | 57.1 | - | 137.2 | 8.2 | 128.0 | 112.5 | 97.0 | 74.9 | 53.2 | - |
| | 62 | 143.4 | 7.2 | 136.7 | 130.8 | 124.8 | 100.6 | 79.7 | 57.2 | 136.1 | 8.2 | 130.8 | 125.7 | 120.6 | 97.3 | 75.6 | 53.1 |
| 5000 | 77 | 163.0 | 7.5 | 105.9 | 79.4 | 52.8 | - | - | - | 154.0 | 8.4 | 103.6 | 76.7 | 49.7 | - | - | - |
| | 72 | 154.2 | 7.4 | 119.1 | 97.9 | 76.8 | 55.6 | - | - | 145.6 | 8.3 | 115.8 | 94.6 | 73.3 | 52.1 | - | - |
| | 67 | 145.5 | 7.2 | 132.3 | 116.5 | 100.8 | 78.5 | 57.1 | - | 137.2 | 8.2 | 128.0 | 112.5 | 97.0 | 74.9 | 53.2 | - |
| | 62 | 143.4 | 7.2 | 136.7 | 130.8 | 124.8 | 100.6 | 79.7 | 57.2 | 136.1 | 8.2 | 130.8 | 125.7 | 120.6 | 97.3 | 75.6 | 53.1 |
| 2500 | 77 | 143.1 | 9.3 | 73.7 | 61.1 | 48.6 | - | - | - | 130.6 | 10.7 | 70.3 | 57.7 | 45.2 | - | - | - |
| | 72 | 128.8 | 9.1 | 88.7 | 74.7 | 60.6 | 46.6 | - | - | 118.4 | 10.5 | 85.2 | 71.2 | 57.1 | 43.1 | - | - |
| | 67 | 114.5 | 8.9 | 103.8 | 88.2 | 72.7 | 59.4 | 46.2 | - | 107.5 | 10.2 | 100.1 | 84.6 | 69.0 | 55.7 | 42.3 | - |
| | 62 | 112.0 | 8.8 | 109.8 | 97.3 | 84.8 | 72.3 | 59.8 | 47.4 | 106.4 | 10.2 | 102.8 | 91.9 | 81.0 | 68.3 | 55.6 | 43.0 |
| 3000 | 77 | 143.8 | 9.3 | 82.9 | 65.4 | 47.9 | - | - | - | 131.6 | 10.7 | 79.7 | 61.9 | 44.1 | - | - | - |
| | 72 | 131.5 | 9.1 | 96.7 | 80.2 | 63.7 | 47.2 | - | - | 121.3 | 10.5 | 92.7 | 76.3 | 59.9 | 43.5 | - | - |
| | 67 | 119.3 | 9.0 | 110.4 | 95.0 | 79.5 | 63.4 | 47.3 | - | 112.0 | 10.3 | 105.8 | 90.7 | 75.7 | 59.5 | 43.3 | - |
| | 62 | 117.6 | 8.9 | 114.9 | 105.1 | 95.3 | 79.5 | 63.7 | 48.0 | 111.3 | 10.3 | 107.6 | 99.5 | 91.5 | 75.5 | 59.5 | 43.5 |
| 3500 | 77 | 144.4 | 9.4 | 92.1 | 69.7 | 47.3 | - | - | - | 132.7 | 10.7 | 89.0 | 66.1 | 43.1 | - | - | - |
| | 72 | 134.2 | 9.2 | 104.6 | 85.7 | 66.8 | 47.9 | - | - | 124.2 | 10.5 | 100.2 | 81.5 | 62.7 | 44.0 | - | - |
| | 67 | 124.1 | 9.1 | 117.1 | 101.7 | 86.3 | 67.3 | 48.3 | - | 116.5 | 10.4 | 111.4 | 96.9 | 82.3 | 63.3 | 44.3 | - |
| | 62 | 123.1 | 9.0 | 119.9 | 112.9 | 105.8 | 86.7 | 67.6 | 48.5 | 116.1 | 10.4 | 112.5 | 107.2 | 102.0 | 82.6 | 63.3 | 44.0 |
| 4000 | 77 | 145.0 | 9.4 | 101.3 | 74.0 | 46.6 | - | - | - | 133.7 | 10.7 | 98.4 | 70.2 | 42.1 | - | - | - |
| | 72 | 136.9 | 9.3 | 112.5 | 91.2 | 69.9 | 48.6 | - | - | 127.1 | 10.6 | 107.7 | 86.6 | 65.5 | 44.4 | - | - |
| | 67 | 128.9 | 9.1 | 123.8 | 108.4 | 93.1 | 71.2 | 49.4 | - | 122.2 | 10.5 | 117.1 | 103.0 | 89.0 | 67.1 | 45.2 | - |
| | 62 | 128.7 | 9.1 | 125.0 | 120.7 | 116.4 | 93.9 | 71.5 | 49.1 | 121.4 | 10.5 | 117.3 | 114.9 | 112.4 | 89.8 | 67.2 | 44.5 |
| 4500 | 77 | 139.6 | 9.3 | 120.5 | 96.7 | 73.0 | 49.2 | - | - | 130.0 | 10.6 | 115.2 | 91.8 | 68.3 | 44.9 | - | - |
| | 72 | 135.2 | 9.2 | 130.4 | 115.2 | 99.9 | 75.2 | 50.4 | - | 127.2 | 10.6 | 122.2 | 109.2 | 95.6 | 70.9 | 46.2 | - |
| | 67 | 134.9 | 9.2 | 130.8 | 128.5 | 126.9 | 101.1 | 75.4 | 49.7 | 126.5 | 10.6 | 122.7 | 122.5 | 122.7 | 97.0 | 71.0 | 45.1 |
| | 62 | 134.3 | 9.2 | 131.1 | 131.1 | 131.1 | 127.1 | 100.4 | 73.6 | 126.3 | 10.6 | 123.1 | 123.1 | 123.1 | 123.0 | 95.8 | 68.6 |
| 5000 | 77 | 142.3 | 9.4 | 128.4 | 102.2 | 76.0 | 49.9 | - | - | 133.0 | 10.7 | 122.7 | 96.9 | 71.1 | 45.3 | - | - |
| | 72 | 141.5 | 9.3 | 137.1 | 121.9 | 106.7 | 79.1 | 51.5 | - | 132.2 | 10.6 | 125.9 | 115.3 | 102.3 | 74.7 | 47.2 | - |
| | 67 | 140.9 | 9.3 | 138.2 | 136.2 | 137.4 | 108.4 | 79.3 | 50.2 | 131.5 | 10.7 | 126.7 | 126.7 | 126.7 | 104.1 | 74.9 | 45.6 |
| | 62 | 140.6 | 9.3 | 139.2 | 139.2 | 139.2 | 137.6 | 107.1 | 76.6 | 131.2 | 10.7 | 128.2 | 128.2 | 128.2 | 128.2 | 102.6 | 71.5 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 43: ZX12 (10 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 2500 | 77 | 118.1 | 12.1 | 66.9 | 54.3 | 41.8 | - | - | - | 105.5 | 13.5 | 63.5 | 50.9 | 38.3 | - | - | - |
| | 72 | 107.9 | 11.8 | 81.7 | 67.6 | 53.6 | 39.5 | - | - | 97.5 | 13.2 | 78.2 | 64.1 | 50.0 | 36.0 | - | - |
| | 67 | 101.8 | 11.6 | 96.5 | 80.9 | 65.4 | 51.9 | 38.4 | - | 96.6 | 12.9 | 92.8 | 77.3 | 61.7 | 48.2 | 34.6 | - |
| | 62 | 100.8 | 11.6 | 97.5 | 86.4 | 77.2 | 64.3 | 51.4 | 38.6 | 95.1 | 13.0 | 93.1 | 81.0 | 73.4 | 60.3 | 47.2 | 34.1 |
| 3000 | 77 | 119.5 | 12.1 | 76.4 | 58.4 | 40.3 | - | - | - | 107.4 | 13.4 | 73.2 | 54.9 | 36.5 | - | - | - |
| | 72 | 111.1 | 11.9 | 88.8 | 72.4 | 56.1 | 39.8 | - | - | 102.8 | 13.2 | 84.8 | 68.6 | 52.3 | 36.0 | - | - |
| | 67 | 107.2 | 11.7 | 99.8 | 86.5 | 71.9 | 55.6 | 39.3 | - | 98.6 | 13.0 | 92.4 | 82.2 | 68.1 | 51.7 | 35.4 | - |
| | 62 | 104.9 | 11.7 | 100.3 | 94.0 | 87.6 | 71.4 | 55.2 | 39.0 | 97.8 | 13.0 | 93.1 | 88.4 | 83.8 | 67.4 | 51.0 | 34.6 |
| 3500 | 57 | 102.9 | 11.7 | 101.1 | 101.1 | 101.1 | 87.3 | 71.1 | 55.0 | 96.9 | 13.0 | 96.4 | 94.7 | 96.4 | 83.1 | 66.6 | 50.1 |
| | 77 | 120.9 | 12.0 | 86.0 | 62.4 | 38.9 | - | - | - | 109.2 | 13.4 | 82.9 | 58.8 | 34.7 | - | - | - |
| | 72 | 114.2 | 11.9 | 95.9 | 77.2 | 58.6 | 40.0 | - | - | 104.9 | 13.2 | 91.5 | 73.0 | 54.5 | 36.1 | - | - |
| | 67 | 110.7 | 11.7 | 104.6 | 92.1 | 78.4 | 59.3 | 40.2 | - | 104.2 | 13.1 | 95.0 | 87.2 | 74.4 | 55.3 | 36.2 | - |
| 4000 | 62 | 109.1 | 11.7 | 105.0 | 101.5 | 98.1 | 78.6 | 59.0 | 39.5 | 103.5 | 13.1 | 97.5 | 95.9 | 94.2 | 74.5 | 54.8 | 35.0 |
| | 57 | 107.9 | 11.7 | 105.7 | 105.7 | 105.7 | 97.8 | 77.9 | 57.9 | 101.5 | 13.1 | 100.1 | 100.1 | 100.1 | 93.7 | 73.3 | 53.0 |
| | 77 | 122.4 | 12.0 | 95.5 | 66.5 | 37.5 | - | - | - | 111.1 | 13.3 | 92.6 | 62.7 | 32.9 | - | - | - |
| | 72 | 117.3 | 11.9 | 102.9 | 82.1 | 61.2 | 40.3 | - | - | 107.5 | 13.3 | 98.2 | 77.5 | 56.8 | 36.1 | - | - |
| 4500 | 67 | 114.2 | 11.8 | 108.5 | 97.6 | 84.8 | 63.0 | 41.1 | - | 107.0 | 13.2 | 100.2 | 92.2 | 80.7 | 58.8 | 37.0 | - |
| | 62 | 113.2 | 11.8 | 109.6 | 109.1 | 108.5 | 85.7 | 62.8 | 40.0 | 105.5 | 13.2 | 102.0 | 102.0 | 102.0 | 81.6 | 58.5 | 35.5 |
| | 57 | 112.6 | 11.8 | 110.4 | 110.4 | 110.4 | 108.4 | 84.6 | 60.8 | 104.5 | 13.2 | 103.7 | 103.7 | 103.7 | 103.7 | 80.1 | 55.8 |
| | 72 | 120.5 | 12.0 | 110.0 | 86.9 | 63.7 | 40.5 | - | - | 110.9 | 13.3 | 104.8 | 81.9 | 59.1 | 36.2 | - | - |
| 5000 | 67 | 117.7 | 11.9 | 113.8 | 103.2 | 91.3 | 66.7 | 42.0 | - | 109.5 | 13.2 | 105.5 | 97.2 | 87.0 | 62.4 | 37.8 | - |
| | 62 | 117.4 | 11.9 | 114.3 | 114.3 | 114.3 | 92.8 | 66.7 | 40.5 | 109.0 | 13.2 | 106.4 | 106.4 | 106.4 | 88.6 | 62.3 | 35.9 |
| | 57 | 117.1 | 11.9 | 115.0 | 115.0 | 115.0 | 115.0 | 91.3 | 63.6 | 108.9 | 13.3 | 107.3 | 107.3 | 107.3 | 107.3 | 86.8 | 58.7 |
| | 72 | 123.6 | 12.0 | 117.1 | 91.7 | 66.2 | 40.8 | - | - | 114.2 | 13.3 | 110.5 | 86.4 | 61.3 | 36.2 | - | - |
| 5000 | 67 | 122.0 | 12.0 | 118.2 | 108.7 | 97.8 | 70.4 | 42.9 | - | 113.7 | 13.3 | 110.9 | 102.2 | 93.4 | 66.0 | 38.6 | - |
| | 62 | 121.6 | 12.0 | 118.9 | 118.9 | 118.9 | 99.9 | 70.5 | 41.0 | 112.4 | 13.3 | 111.0 | 111.0 | 111.0 | 95.7 | 66.0 | 36.3 |
| | 57 | 121.2 | 12.0 | 119.7 | 119.7 | 119.7 | 119.7 | 98.0 | 66.5 | 111.2 | 13.3 | 111.5 | 111.5 | 111.5 | 93.5 | 61.5 | - |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 45: ZX14 (12.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | 125°F | | | | | | | | | |
| 3200 | 77 | 138.8 | 13.9 | 87.3 | 69.0 | 50.7 | - | - | - | 125.4 | 15.4 | 85.7 | 66.5 | 47.3 | - | - | - | | |
| | 72 | 129.3 | 13.8 | 102.2 | 84.2 | 66.2 | 48.2 | - | - | 118.7 | 15.3 | 98.4 | 80.3 | 62.3 | 44.3 | - | - | | |
| | 67 | 119.7 | 13.7 | 117.0 | 99.3 | 81.7 | 64.2 | 46.7 | - | 118.4 | 15.2 | 111.9 | 94.2 | 77.4 | 59.8 | 42.2 | - | | |
| | 62 | 118.2 | 13.8 | 118.1 | 107.6 | 97.1 | 80.2 | 63.2 | 46.2 | 117.6 | 15.3 | 112.4 | 101.6 | 92.4 | 75.3 | 58.2 | 41.0 | | |
| 3750 | 77 | 139.8 | 14.0 | 96.6 | 72.7 | 48.7 | - | - | - | 126.6 | 15.5 | 95.0 | 69.9 | 44.9 | - | - | - | | |
| | 72 | 132.0 | 13.9 | 109.3 | 89.0 | 68.6 | 48.2 | - | - | 121.4 | 15.4 | 105.1 | 84.9 | 64.6 | 44.3 | - | - | | |
| | 67 | 124.3 | 13.8 | 121.8 | 105.3 | 88.5 | 68.1 | 47.7 | - | 117.5 | 15.3 | 113.8 | 99.8 | 84.3 | 63.8 | 43.4 | - | | |
| | 62 | 123.2 | 13.8 | 122.0 | 115.7 | 108.4 | 88.0 | 67.6 | 47.2 | 115.3 | 15.3 | 114.0 | 109.5 | 103.9 | 83.4 | 62.8 | 42.2 | | |
| 4300 | 77 | 140.8 | 14.0 | 106.0 | 76.3 | 46.6 | - | - | - | 127.7 | 15.5 | 104.2 | 73.4 | 42.5 | - | - | - | | |
| | 72 | 134.8 | 13.9 | 116.5 | 93.8 | 71.0 | 48.2 | - | - | 124.1 | 15.4 | 111.9 | 89.4 | 66.8 | 44.3 | - | - | | |
| | 67 | 128.8 | 13.8 | 127.0 | 111.2 | 95.3 | 72.1 | 48.8 | - | 121.4 | 15.3 | 116.8 | 105.4 | 91.2 | 67.9 | 44.6 | - | | |
| | 62 | 128.3 | 13.8 | 127.7 | 123.7 | 119.7 | 95.9 | 72.1 | 48.3 | 120.0 | 15.3 | 118.0 | 117.5 | 115.5 | 91.4 | 67.4 | 43.3 | | |
| 4775 | 77 | 141.8 | 14.1 | 115.3 | 80.0 | 44.6 | - | - | - | 128.8 | 15.5 | 113.5 | 76.8 | 40.1 | - | - | - | | |
| | 72 | 137.6 | 14.0 | 123.7 | 98.5 | 73.4 | 48.3 | - | - | 126.8 | 15.4 | 118.7 | 93.9 | 69.1 | 44.3 | - | - | | |
| | 67 | 133.4 | 13.9 | 132.0 | 117.1 | 102.2 | 76.0 | 49.8 | - | 124.8 | 15.4 | 123.9 | 111.0 | 98.1 | 71.9 | 45.7 | - | | |
| | 62 | 133.3 | 13.8 | 132.5 | 131.7 | 130.9 | 103.7 | 76.5 | 49.3 | 124.7 | 15.3 | 123.9 | 123.9 | 123.9 | 99.5 | 72.0 | 44.4 | | |
| 5300 | 77 | 140.4 | 14.0 | 130.9 | 103.3 | 75.8 | 48.3 | - | - | 130.1 | 15.5 | 125.5 | 98.4 | 71.4 | 44.3 | - | - | | |
| | 72 | 138.7 | 13.9 | 137.1 | 123.0 | 109.0 | 79.9 | 50.9 | - | 129.8 | 15.4 | 128.2 | 116.6 | 105.0 | 75.9 | 46.9 | - | | |
| | 67 | 138.3 | 13.9 | 137.4 | 137.4 | 137.4 | 111.6 | 81.0 | 50.4 | 129.4 | 15.3 | 128.3 | 128.3 | 128.3 | 107.6 | 76.6 | 45.6 | | |
| | 62 | 138.0 | 13.8 | 137.7 | 137.7 | 137.7 | 111.1 | 78.9 | - | 129.1 | 15.2 | 128.4 | 128.4 | 128.4 | 128.4 | 106.2 | 73.3 | | |
| 5800 | 77 | 144.2 | 14.1 | 138.0 | 108.1 | 78.2 | 48.3 | - | - | 134.9 | 15.5 | 128.7 | 102.9 | 73.6 | 44.3 | - | - | | |
| | 72 | 143.4 | 14.0 | 139.1 | 129.0 | 115.9 | 83.9 | 51.9 | - | 134.2 | 15.5 | 131.8 | 122.2 | 111.9 | 80.0 | 48.1 | - | | |
| | 67 | 142.7 | 13.9 | 140.2 | 140.2 | 140.2 | 119.5 | 85.4 | 51.4 | 133.5 | 15.3 | 132.0 | 132.0 | 132.0 | 115.6 | 81.2 | 46.7 | | |
| | 62 | 140.8 | 13.8 | 140.5 | 140.5 | 140.5 | 118.9 | 82.8 | - | 132.4 | 15.2 | 132.4 | 132.4 | 132.4 | 132.4 | 114.3 | 77.2 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate Blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

ZY04 to 12 cooling capacities

Table 46: ZY04 (3.0 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 750 | 77 | 47.1 | 2.1 | 23.2 | 19.7 | 16.3 | - | - | - | 45.3 | 2.4 | 22.2 | 18.7 | 15.1 | - | - | - | | |
| | 72 | 43.9 | 2.1 | 28.3 | 24.1 | 19.9 | 15.8 | - | - | 41.7 | 2.4 | 27.4 | 23.1 | 18.9 | 14.7 | - | - | | |
| | 67 | 40.8 | 2.1 | 33.3 | 28.5 | 23.6 | 19.9 | 15.7 | - | 38.1 | 2.4 | 32.5 | 27.6 | 22.7 | 18.8 | 14.6 | - | | |
| | 62 | 36.2 | 2.1 | 34.8 | 31.0 | 27.2 | 22.8 | 19.8 | 16.2 | 35.0 | 2.4 | 33.6 | 30.1 | 26.6 | 22.3 | 18.7 | 14.8 | | |
| 900 | 77 | 47.9 | 2.1 | 26.0 | 21.3 | 16.7 | - | - | - | 46.0 | 2.4 | 25.2 | 20.5 | 15.7 | - | - | - | | |
| | 72 | 45.1 | 2.1 | 31.0 | 26.1 | 21.2 | 16.4 | - | - | 42.8 | 2.4 | 30.0 | 25.1 | 20.3 | 15.4 | - | - | | |
| | 67 | 42.2 | 2.1 | 35.9 | 30.8 | 25.8 | 21.2 | 16.4 | - | 39.7 | 2.4 | 34.8 | 29.8 | 24.8 | 20.1 | 15.3 | - | | |
| | 62 | 38.3 | 2.1 | 37.1 | 33.7 | 30.4 | 25.2 | 21.2 | 16.6 | 37.0 | 2.4 | 35.8 | 32.6 | 29.4 | 24.4 | 20.0 | 15.3 | | |
| 1050 | 57 | 38.3 | 2.1 | 38.3 | 36.6 | 34.9 | 30.5 | 26.0 | 21.5 | 36.6 | 2.4 | 36.6 | 35.4 | 34.0 | 29.4 | 24.8 | 20.2 | | |
| | 77 | 48.7 | 2.1 | 28.9 | 23.0 | 17.0 | - | - | - | 46.6 | 2.4 | 28.2 | 22.3 | 16.3 | - | - | - | | |
| | 72 | 46.2 | 2.1 | 33.7 | 28.1 | 22.5 | 17.0 | - | - | 44.0 | 2.4 | 32.7 | 27.1 | 21.6 | 16.1 | - | - | | |
| | 67 | 43.6 | 2.1 | 38.4 | 33.2 | 28.0 | 22.6 | 17.0 | - | 41.3 | 2.4 | 37.1 | 32.0 | 26.9 | 21.5 | 15.9 | - | | |
| | 62 | 40.4 | 2.1 | 39.4 | 36.5 | 33.5 | 27.6 | 22.5 | 17.0 | 39.0 | 2.4 | 37.9 | 35.1 | 32.2 | 26.5 | 21.3 | 15.9 | | |
| 1200 | 57 | 40.1 | 2.1 | 40.1 | 39.3 | 38.5 | 33.5 | 28.1 | 22.6 | 38.6 | 2.4 | 38.6 | 37.9 | 37.2 | 32.1 | 26.7 | 21.3 | | |
| | 77 | 49.6 | 2.1 | 31.7 | 24.6 | 17.4 | - | - | - | 47.3 | 2.4 | 31.2 | 24.1 | 16.9 | - | - | - | | |
| | 72 | 47.3 | 2.1 | 36.4 | 30.1 | 23.8 | 17.6 | - | - | 45.1 | 2.4 | 35.3 | 29.1 | 23.0 | 16.8 | - | - | | |
| | 67 | 45.0 | 2.1 | 41.0 | 35.6 | 30.2 | 24.0 | 17.6 | - | 42.8 | 2.4 | 39.4 | 34.2 | 29.0 | 22.8 | 16.6 | - | | |
| | 62 | 42.5 | 2.1 | 41.7 | 39.2 | 36.7 | 30.0 | 23.9 | 17.5 | 41.0 | 2.3 | 40.1 | 37.5 | 35.0 | 28.7 | 22.6 | 16.5 | | |
| 1350 | 57 | 42.0 | 2.1 | 42.0 | 42.0 | 42.0 | 36.6 | 30.1 | 23.7 | 40.5 | 2.3 | 40.5 | 40.5 | 40.5 | 34.9 | 28.7 | 22.5 | | |
| | 72 | 48.4 | 2.1 | 39.1 | 32.1 | 25.1 | 18.2 | - | - | 46.2 | 2.4 | 38.0 | 31.1 | 24.3 | 17.5 | - | - | | |
| | 67 | 46.4 | 2.1 | 43.5 | 38.0 | 32.5 | 25.4 | 18.2 | - | 44.4 | 2.3 | 41.7 | 36.4 | 31.1 | 24.2 | 17.3 | - | | |
| | 62 | 44.6 | 2.1 | 44.0 | 41.9 | 39.8 | 32.3 | 25.2 | 17.9 | 43.0 | 2.3 | 42.2 | 40.0 | 37.8 | 30.8 | 24.0 | 17.0 | | |
| 1500 | 57 | 43.8 | 2.1 | 43.8 | 43.8 | 43.8 | 39.7 | 32.2 | 24.7 | 42.4 | 2.3 | 42.4 | 42.4 | 42.4 | 37.6 | 30.6 | 23.6 | | |
| | 72 | 49.5 | 2.1 | 41.8 | 34.1 | 26.4 | 18.7 | - | - | 47.4 | 2.4 | 40.6 | 33.1 | 25.7 | 18.2 | - | - | | |
| | 67 | 47.8 | 2.1 | 46.1 | 40.4 | 34.7 | 26.7 | 18.8 | - | 46.0 | 2.3 | 44.0 | 38.6 | 33.1 | 25.6 | 18.0 | - | | |
| | 62 | 46.7 | 2.1 | 46.3 | 44.6 | 43.0 | 34.7 | 26.5 | 18.3 | 45.0 | 2.3 | 44.4 | 42.5 | 40.6 | 33.0 | 25.3 | 17.6 | | |
| 57 | 45.7 | 2.1 | 45.7 | 45.7 | 45.7 | 42.7 | 34.3 | 25.8 | 44.3 | 2.3 | 44.3 | 44.3 | 44.3 | 40.3 | 32.6 | 24.8 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 47: ZY04 (3.0 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|-------|------|------|------|------|------|------|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| 95°F | | | | | | | | | | 105°F | | | | | | | | | |
| 750 | 77 | 43.5 | 2.6 | 21.3 | 17.6 | 13.8 | - | - | - | 39.8 | 3.1 | 20.9 | 16.8 | 12.8 | - | - | - | | |
| | 72 | 39.4 | 2.6 | 26.5 | 22.2 | 17.9 | 13.6 | - | - | 36.7 | 3.1 | 25.1 | 20.9 | 16.7 | 12.5 | - | - | | |
| | 67 | 35.4 | 2.6 | 31.7 | 26.8 | 21.9 | 17.7 | 13.4 | - | 33.6 | 3.1 | 29.4 | 25.0 | 20.7 | 16.5 | 12.3 | - | | |
| | 62 | 33.8 | 2.6 | 32.4 | 29.2 | 25.9 | 21.8 | 17.6 | 13.4 | 32.1 | 3.0 | 30.7 | 27.7 | 24.6 | 20.5 | 16.3 | 12.2 | | |
| 900 | 77 | 44.0 | 2.6 | 24.5 | 19.6 | 14.7 | - | - | - | 40.2 | 3.1 | 23.9 | 18.6 | 13.3 | - | - | - | | |
| | 72 | 40.6 | 2.6 | 29.1 | 24.2 | 19.3 | 14.4 | - | - | 37.6 | 3.1 | 27.6 | 22.8 | 17.9 | 13.1 | - | - | | |
| | 67 | 37.1 | 2.6 | 33.7 | 28.8 | 23.9 | 19.0 | 14.2 | - | 35.0 | 3.0 | 31.3 | 26.9 | 22.5 | 17.7 | 12.9 | - | | |
| | 62 | 35.7 | 2.6 | 34.5 | 31.4 | 28.4 | 23.6 | 18.9 | 14.1 | 33.6 | 3.0 | 32.5 | 29.8 | 27.2 | 22.3 | 17.5 | 12.7 | | |
| 1050 | 57 | 35.0 | 2.6 | 35.0 | 34.1 | 33.0 | 28.3 | 23.6 | 18.9 | 32.8 | 3.0 | 32.8 | 32.7 | 31.8 | 27.0 | 22.2 | 17.4 | | |
| | 77 | 44.6 | 2.6 | 27.6 | 21.6 | 15.6 | - | - | - | 40.7 | 3.1 | 26.9 | 20.3 | 13.8 | - | - | - | | |
| | 72 | 41.7 | 2.6 | 31.7 | 26.2 | 20.7 | 15.2 | - | - | 38.5 | 3.1 | 30.1 | 24.6 | 19.1 | 13.6 | - | - | | |
| | 67 | 38.9 | 2.6 | 35.8 | 30.8 | 25.8 | 20.3 | 14.9 | - | 36.4 | 3.0 | 33.3 | 28.9 | 24.4 | 18.9 | 13.4 | - | | |
| 1200 | 62 | 37.5 | 2.6 | 36.5 | 33.7 | 30.9 | 25.5 | 20.2 | 14.8 | 35.2 | 3.0 | 34.2 | 32.0 | 29.7 | 24.2 | 18.8 | 13.3 | | |
| | 57 | 37.0 | 2.6 | 37.0 | 36.6 | 36.0 | 30.7 | 25.4 | 20.1 | 34.6 | 3.0 | 34.6 | 34.6 | 34.6 | 29.5 | 24.1 | 18.6 | | |
| | 77 | 45.1 | 2.6 | 30.8 | 23.6 | 16.4 | - | - | - | 41.1 | 3.1 | 29.9 | 22.1 | 14.3 | - | - | - | | |
| | 72 | 42.9 | 2.6 | 34.3 | 28.2 | 22.1 | 16.0 | - | - | 39.4 | 3.1 | 32.6 | 26.4 | 20.3 | 14.2 | - | - | | |
| 1350 | 67 | 40.7 | 2.6 | 37.8 | 32.8 | 27.7 | 21.7 | 15.7 | - | 37.8 | 3.0 | 35.3 | 30.8 | 26.3 | 20.1 | 14.0 | - | | |
| | 62 | 39.4 | 2.6 | 38.5 | 35.9 | 33.4 | 27.4 | 21.4 | 15.5 | 36.8 | 3.0 | 36.0 | 34.1 | 32.2 | 26.1 | 20.0 | 13.8 | | |
| | 57 | 39.0 | 2.6 | 39.0 | 39.0 | 39.0 | 33.1 | 27.2 | 21.3 | 36.3 | 3.0 | 36.3 | 36.3 | 36.3 | 32.1 | 25.9 | 19.8 | | |
| | 72 | 44.0 | 2.6 | 36.9 | 30.2 | 23.5 | 16.8 | - | - | 40.4 | 3.1 | 35.0 | 28.3 | 21.5 | 14.7 | - | - | | |
| 1500 | 67 | 42.4 | 2.6 | 39.9 | 34.8 | 29.7 | 23.0 | 16.4 | - | 39.2 | 3.0 | 37.2 | 32.7 | 28.1 | 21.3 | 14.6 | - | | |
| | 62 | 41.3 | 2.6 | 40.5 | 38.2 | 35.8 | 29.3 | 22.7 | 16.2 | 38.4 | 3.0 | 37.7 | 36.3 | 34.8 | 28.0 | 21.2 | 14.4 | | |
| | 57 | 41.0 | 2.6 | 41.0 | 41.0 | 41.0 | 35.5 | 29.0 | 22.6 | 38.1 | 3.0 | 38.1 | 38.1 | 38.1 | 34.6 | 27.8 | 21.0 | | |
| | 72 | 45.2 | 2.6 | 39.5 | 32.2 | 24.9 | 17.6 | - | - | 41.3 | 3.1 | 37.5 | 30.1 | 22.7 | 15.3 | - | - | | |
| 115°F | 750 | 67 | 44.2 | 2.6 | 42.0 | 36.8 | 31.6 | 24.4 | 17.1 | - | 40.6 | 3.0 | 39.2 | 34.6 | 30.0 | 22.6 | 15.1 | - | |
| | | 62 | 43.2 | 2.6 | 42.5 | 40.4 | 38.3 | 31.2 | 24.0 | 16.8 | 40.0 | 3.0 | 39.5 | 38.4 | 37.3 | 29.9 | 22.4 | 15.0 | |
| | | 57 | 43.0 | 2.6 | 43.0 | 43.0 | 43.0 | 37.9 | 30.9 | 23.8 | 39.8 | 3.0 | 39.8 | 39.8 | 39.8 | 37.2 | 29.7 | 22.2 | |
| | | 115°F | | | | | | | | | | 125°F | | | | | | | |
| 750 | 77 | 36.2 | 3.6 | 20.4 | 16.1 | 11.7 | - | - | - | 32.5 | 4.2 | 20.0 | 15.3 | 10.7 | - | - | - | | |
| | 72 | 34.0 | 3.5 | 23.8 | 19.7 | 15.6 | 11.5 | - | - | 31.2 | 4.0 | 22.4 | 18.4 | 14.4 | 10.4 | - | - | | |
| | 67 | 31.7 | 3.5 | 27.1 | 23.3 | 19.4 | 15.3 | 11.2 | - | 29.9 | 3.9 | 24.9 | 21.5 | 18.2 | 14.2 | 10.1 | - | | |
| | 62 | 30.3 | 3.5 | 29.0 | 26.2 | 23.3 | 19.2 | 15.1 | 10.9 | 28.6 | 3.9 | 27.3 | 24.6 | 22.0 | 17.9 | 13.8 | 9.7 | | |
| 900 | 77 | 36.5 | 3.6 | 23.3 | 17.6 | 11.9 | - | - | - | 32.7 | 4.1 | 22.7 | 16.6 | 10.5 | - | - | - | | |
| | 72 | 34.6 | 3.5 | 26.1 | 21.3 | 16.6 | 11.8 | - | - | 31.7 | 4.0 | 24.6 | 19.9 | 15.2 | 10.5 | - | - | | |
| | 67 | 32.8 | 3.5 | 29.0 | 25.1 | 21.2 | 16.4 | 11.6 | - | 30.7 | 3.9 | 26.6 | 23.3 | 19.9 | 15.1 | 10.3 | - | | |
| | 62 | 31.6 | 3.5 | 30.5 | 28.2 | 25.9 | 21.1 | 16.2 | 11.4 | 29.6 | 3.9 | 28.5 | 26.6 | 24.6 | 19.8 | 14.9 | 10.0 | | |
| 1050 | 57 | 30.7 | 3.4 | 30.7 | 30.6 | 25.7 | 20.8 | 16.0 | - | 28.5 | 3.9 | 28.5 | 28.5 | 24.4 | 19.4 | 14.5 | - | | |
| | 77 | 36.8 | 3.5 | 26.1 | 19.1 | 12.0 | - | - | - | 32.9 | 4.0 | 25.4 | 17.8 | 10.3 | - | - | - | | |
| | 72 | 35.3 | 3.5 | 28.5 | 23.0 | 17.5 | 12.1 | - | - | 32.1 | 4.0 | 26.8 | 21.4 | 16.0 | 10.5 | - | - | | |
| | 67 | 33.9 | 3.5 | 30.8 | 26.9 | 23.0 | 17.5 | 12.0 | - | 31.4 | 3.9 | 28.3 | 25.0 | 21.6 | 16.1 | 10.5 | - | | |
| 1200 | 62 | 32.9 | 3.4 | 32.0 | 30.2 | 28.5 | 22.9 | 17.4 | 11.8 | 30.6 | 3.9 | 29.8 | 28.5 | 27.3 | 21.6 | 16.0 | 10.3 | | |
| | 57 | 32.2 | 3.4 | 32.2 | 32.2 | 28.4 | 22.7 | 17.1 | - | 29.8 | 3.8 | 29.8 | 29.8 | 29.8 | 27.2 | 21.4 | 15.7 | | |
| | 77 | 37.1 | 3.5 | 29.0 | 20.6 | 12.2 | - | - | - | 33.0 | 3.9 | 28.0 | 19.1 | 10.1 | - | - | - | | |
| | 72 | 36.0 | 3.5 | 30.8 | 24.7 | 18.5 | 12.4 | - | - | 32.6 | 4.0 | 29.1 | 22.9 | 16.7 | 10.5 | - | - | | |
| 1350 | 67 | 35.0 | 3.4 | 32.7 | 28.7 | 24.8 | 18.6 | 12.4 | - | 32.1 | 3.8 | 30.1 | 26.7 | 23.3 | 17.0 | 10.7 | - | | |
| | 62 | 34.2 | 3.4 | 33.5 | 32.3 | 31.1 | 24.8 | 18.5 | 12.2 | 31.5 | 3.8 | 31.0 | 30.5 | 29.9 | 23.5 | 17.1 | 10.6 | | |
| | 57 | 33.7 | 3.4 | 33.7 | 33.7 | 33.7 | 31.0 | 24.7 | 18.3 | 31.0 | 3.8 | 31.0 | 31.0 | 31.0 | 30.0 | 23.4 | 16.8 | | |
| | 72 | 36.7 | 3.5 | 33.2 | 26.3 | 19.5 | 12.6 | - | - | 33.0 | 4.0 | 31.3 | 24.4 | 17.5 | 10.6 | - | - | | |
| 1500 | 67 | 36.0 | 3.4 | 34.5 | 30.5 | 26.6 | 19.7 | 12.7 | - | 32.8 | 3.8 | 31.8 | 28.4 | 25.0 | 18.0 | 10.9 | - | | |
| | 62 | 35.5 | 3.4 | 35.0 | 34.3 | 33.7 | 26.7 | 19.7 | 12.7 | 32.5 | 3.8 | 32.3 | 32.3 | 32.3 | 25.4 | 18.1 | 10.9 | | |
| | 57 | 35.1 | 3.4 | 35.1 | 35.1 | 35.1 | 33.7 | 26.6 | 19.5 | 32.2 | 3.8 | 32.2 | 32.2 | 32.2 | 25.4 | 18.0 | - | | |
| | 72 | 37.4 | 3.5 | 35.5 | 28.0 | 20.5 | 12.9 | - | - | 33.5 | 3.9 | 33.5 | 25.9 | 18.2 | 10.6 | - | - | | |
| 1500 | 67 | 37.1 | 3.4 | 36.4 | 32.4 | 28.4 | 20.7 | 13.1 | - | 33.5 | 3.8 | 33.5 | 30.1 | 26.7 | 18.9 | 11.1 | - | | |
| | 62 | 36.7 | 3.4 | 36.5 | 36.4 | 36.3 | 28.6 | 20.8 | 13.1 | 33.5 | 3.8 | 33.5 | 33.5 | 33.5 | 27.2 | 19.2 | 11.2 | | |
| 57 | 36.6 | 3.4 | 36.6 | 36.6 | 36.6 | 36.4 | 28.5 | 20.7 | - | 33.5 | 3.8 | 33.5 | 33.5 | 33.5 | 33.5 | 27.4 | 19.1 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 48: ZY05 (4.0 ton, 75°F to 105°F)

| Air on Evaporator Coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|----|----|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | | | |
| CFM | WB (°F) | 75°F | | | | | | | | | | 85°F | | | | | | | | | |
| | | 90 | 85 | 80 | 75 | 70 | 65 | 90 | 85 | 80 | 75 | 70 | 65 | 90 | 85 | 80 | 75 | 70 | 65 | | |
| 1000 | 77 | 64.9 | 2.8 | 32.3 | 27.2 | 22.1 | - | - | - | 59.9 | 3.1 | 30.9 | 26.2 | 21.5 | - | - | - | | | | |
| | 72 | 58.5 | 2.8 | 38.1 | 32.7 | 27.3 | 21.9 | - | - | 55.5 | 3.1 | 36.9 | 31.7 | 26.5 | 21.2 | - | - | | | | |
| | 67 | 52.1 | 2.8 | 44.0 | 38.3 | 32.6 | 26.9 | 21.8 | - | 51.2 | 3.1 | 43.0 | 37.2 | 31.5 | 26.0 | 20.8 | - | | | | |
| | 62 | 49.9 | 2.7 | 49.3 | 43.6 | 37.9 | 31.5 | 27.1 | 21.7 | 48.9 | 3.1 | 47.3 | 41.9 | 36.5 | 30.6 | 25.7 | 20.3 | | | | |
| 1200 | 77 | 65.4 | 2.8 | 35.9 | 29.1 | 22.4 | - | - | - | 60.6 | 3.1 | 34.8 | 28.2 | 21.5 | - | - | - | | | | |
| | 72 | 59.9 | 2.8 | 41.6 | 35.3 | 28.9 | 22.5 | - | - | 56.8 | 3.1 | 40.4 | 34.1 | 27.8 | 21.6 | - | - | | | | |
| | 67 | 54.4 | 2.8 | 47.4 | 41.4 | 35.4 | 28.7 | 22.5 | - | 53.1 | 3.1 | 45.9 | 40.1 | 34.2 | 27.7 | 21.4 | - | | | | |
| | 62 | 52.5 | 2.7 | 51.8 | 46.9 | 42.0 | 34.6 | 28.9 | 22.3 | 51.1 | 3.1 | 49.7 | 45.1 | 40.6 | 33.6 | 27.5 | 20.9 | | | | |
| 1400 | 57 | 51.8 | 2.7 | 51.8 | 51.8 | 48.5 | 41.9 | 35.2 | 28.6 | 49.7 | 3.1 | 49.7 | 49.7 | 47.0 | 40.3 | 33.5 | 26.8 | | | | |
| | 77 | 66.0 | 2.8 | 39.5 | 31.1 | 22.7 | - | - | - | 61.3 | 3.2 | 38.8 | 30.1 | 21.5 | - | - | - | | | | |
| | 72 | 61.3 | 2.8 | 45.1 | 37.8 | 30.5 | 23.1 | - | - | 58.1 | 3.2 | 43.8 | 36.5 | 29.2 | 21.9 | - | - | | | | |
| | 67 | 56.7 | 2.8 | 50.8 | 44.5 | 38.3 | 30.6 | 23.2 | - | 55.0 | 3.1 | 48.9 | 42.9 | 37.0 | 29.4 | 21.9 | - | | | | |
| 1600 | 62 | 55.1 | 2.8 | 54.4 | 50.2 | 46.1 | 37.8 | 30.7 | 22.9 | 53.3 | 3.1 | 52.0 | 48.4 | 44.7 | 36.7 | 29.3 | 21.5 | | | | |
| | 57 | 54.4 | 2.7 | 54.4 | 54.4 | 52.8 | 46.0 | 38.1 | 30.2 | 52.1 | 3.1 | 52.1 | 52.1 | 51.9 | 44.5 | 36.6 | 28.6 | | | | |
| | 77 | 66.6 | 2.8 | 43.1 | 33.0 | 22.9 | - | - | - | 62.0 | 3.2 | 42.7 | 32.1 | 21.4 | - | - | - | | | | |
| | 72 | 62.8 | 2.8 | 48.6 | 40.3 | 32.0 | 23.7 | - | - | 59.4 | 3.2 | 47.3 | 38.9 | 30.6 | 22.2 | - | - | | | | |
| 1800 | 67 | 58.9 | 2.8 | 54.2 | 47.6 | 41.1 | 32.4 | 23.9 | - | 56.9 | 3.2 | 51.8 | 45.8 | 39.7 | 31.0 | 22.5 | - | | | | |
| | 62 | 57.7 | 2.8 | 56.9 | 53.5 | 50.2 | 40.9 | 32.4 | 23.6 | 55.6 | 3.2 | 54.4 | 51.6 | 48.9 | 39.8 | 31.0 | 22.1 | | | | |
| | 57 | 57.0 | 2.8 | 57.0 | 57.0 | 57.0 | 50.1 | 40.9 | 31.8 | 54.6 | 3.1 | 54.6 | 54.6 | 54.6 | 48.8 | 39.6 | 30.4 | | | | |
| | 72 | 64.2 | 2.8 | 52.1 | 42.9 | 33.6 | 24.3 | - | - | 60.7 | 3.2 | 50.7 | 41.3 | 32.0 | 22.6 | - | - | | | | |
| 2000 | 67 | 61.2 | 2.8 | 57.6 | 50.7 | 43.9 | 34.2 | 24.6 | - | 58.8 | 3.2 | 54.8 | 48.6 | 42.5 | 32.7 | 23.0 | - | | | | |
| | 62 | 60.3 | 2.8 | 59.4 | 56.9 | 54.3 | 44.0 | 34.2 | 24.2 | 57.8 | 3.2 | 56.8 | 54.9 | 53.0 | 42.8 | 32.8 | 22.8 | | | | |
| | 57 | 59.6 | 2.8 | 59.6 | 59.6 | 59.6 | 54.2 | 43.8 | 33.4 | 57.0 | 3.2 | 57.0 | 57.0 | 57.0 | 53.1 | 42.7 | 32.2 | | | | |
| | 72 | 65.6 | 2.8 | 55.7 | 45.4 | 35.1 | 24.9 | - | - | 62.0 | 3.2 | 54.2 | 43.8 | 33.3 | 22.9 | - | - | | | | |
| 95°F | 67 | 63.5 | 2.8 | 61.0 | 53.9 | 46.8 | 36.0 | 25.3 | - | 60.7 | 3.2 | 57.7 | 51.5 | 45.3 | 34.4 | 23.6 | - | | | | |
| | 62 | 62.9 | 2.8 | 62.0 | 60.2 | 58.4 | 47.2 | 36.0 | 24.8 | 60.0 | 3.2 | 59.2 | 58.2 | 57.2 | 45.9 | 34.6 | 23.4 | | | | |
| | 57 | 62.2 | 2.8 | 62.2 | 62.2 | 62.2 | 58.3 | 46.6 | 35.0 | 59.4 | 3.2 | 59.4 | 59.4 | 59.4 | 57.4 | 45.7 | 34.0 | | | | |
| | 1000 | 77 | 55.0 | 3.5 | 29.5 | 25.2 | 20.9 | - | - | - | 51.7 | 4.1 | 28.6 | 24.4 | 20.3 | - | - | - | | | |
| 72 | | 52.6 | 3.5 | 35.8 | 30.7 | 25.6 | 20.5 | - | - | 48.7 | 4.1 | 34.4 | 29.4 | 24.5 | 19.6 | - | - | | | | |
| 67 | | 50.2 | 3.5 | 42.0 | 36.2 | 30.3 | 25.1 | 19.8 | - | 46.1 | 4.1 | 40.2 | 34.5 | 28.8 | 23.7 | 18.7 | - | | | | |
| 62 | | 47.8 | 3.5 | 45.3 | 40.2 | 35.0 | 29.6 | 24.2 | 18.8 | 44.5 | 4.1 | 42.8 | 37.9 | 33.0 | 27.9 | 22.7 | 17.6 | | | | |
| 1200 | 77 | 55.8 | 3.5 | 33.8 | 27.2 | 20.6 | - | - | - | 52.2 | 4.1 | 32.7 | 26.2 | 19.7 | - | - | - | | | | |
| | 72 | 53.8 | 3.5 | 39.1 | 33.0 | 26.8 | 20.6 | - | - | 50.0 | 4.1 | 37.6 | 31.6 | 25.6 | 19.5 | - | - | | | | |
| | 67 | 51.8 | 3.5 | 44.5 | 38.8 | 33.0 | 26.6 | 20.2 | - | 47.7 | 4.1 | 42.5 | 36.9 | 31.4 | 25.2 | 19.0 | - | | | | |
| | 62 | 49.7 | 3.5 | 47.5 | 43.4 | 39.2 | 32.6 | 26.0 | 19.4 | 46.3 | 4.1 | 44.8 | 41.0 | 37.2 | 30.8 | 24.5 | 18.1 | | | | |
| 1400 | 57 | 47.6 | 3.6 | 47.6 | 47.6 | 45.4 | 38.6 | 31.8 | 25.0 | 44.9 | 4.1 | 44.9 | 44.9 | 43.0 | 36.5 | 29.9 | 23.4 | | | | |
| | 77 | 56.6 | 3.5 | 38.1 | 29.2 | 20.3 | - | - | - | 52.7 | 4.1 | 36.9 | 28.0 | 19.2 | - | - | - | | | | |
| | 72 | 54.9 | 3.5 | 42.5 | 35.3 | 28.0 | 20.7 | - | - | 51.2 | 4.1 | 40.8 | 33.7 | 26.6 | 19.5 | - | - | | | | |
| | 67 | 53.3 | 3.5 | 47.0 | 41.3 | 35.7 | 28.2 | 20.6 | - | 49.3 | 4.1 | 44.8 | 39.4 | 34.0 | 26.6 | 19.3 | - | | | | |
| 1600 | 62 | 51.6 | 3.5 | 49.7 | 46.6 | 43.4 | 35.6 | 27.9 | 20.1 | 48.1 | 4.1 | 46.9 | 44.1 | 41.3 | 33.8 | 26.2 | 18.6 | | | | |
| | 57 | 49.9 | 3.5 | 49.9 | 49.9 | 49.9 | 43.1 | 35.1 | 27.1 | 47.0 | 4.1 | 47.0 | 47.0 | 47.0 | 40.9 | 33.1 | 25.3 | | | | |
| | 77 | 57.4 | 3.5 | 42.3 | 31.1 | 19.9 | - | - | - | 53.3 | 4.1 | 41.0 | 29.9 | 18.7 | - | - | - | | | | |
| | 72 | 56.1 | 3.5 | 45.9 | 37.5 | 29.2 | 20.8 | - | - | 52.4 | 4.1 | 44.1 | 35.8 | 27.6 | 19.4 | - | - | | | | |
| 1800 | 67 | 54.8 | 3.5 | 49.5 | 43.9 | 38.4 | 29.7 | 21.0 | - | 50.9 | 4.1 | 47.1 | 41.8 | 36.6 | 28.1 | 19.5 | - | | | | |
| | 62 | 53.4 | 3.5 | 51.9 | 49.8 | 47.6 | 38.6 | 29.7 | 20.7 | 50.0 | 4.1 | 48.9 | 47.2 | 45.5 | 36.7 | 27.9 | 19.1 | | | | |
| | 57 | 52.1 | 3.5 | 52.1 | 52.1 | 52.1 | 47.6 | 38.3 | 29.1 | 49.1 | 4.1 | 49.1 | 49.1 | 49.1 | 45.4 | 36.3 | 27.2 | | | | |
| | 72 | 57.3 | 3.5 | 49.3 | 39.8 | 30.3 | 20.9 | - | - | 53.6 | 4.1 | 47.3 | 38.0 | 28.7 | 19.3 | - | - | | | | |
| 2000 | 67 | 56.3 | 3.5 | 52.0 | 46.5 | 41.1 | 31.2 | 21.4 | - | 52.5 | 4.1 | 49.5 | 44.3 | 39.2 | 29.5 | 19.8 | - | | | | |
| | 62 | 55.3 | 3.5 | 54.1 | 53.0 | 51.8 | 41.6 | 31.5 | 21.3 | 51.8 | 4.1 | 51.0 | 50.3 | 49.7 | 39.6 | 29.6 | 19.6 | | | | |
| | 57 | 54.3 | 3.5 | 54.3 | 54.3 | 54.3 | 52.0 | 41.5 | 31.1 | 51.2 | 4.1 | 51.2 | 51.2 | 51.2 | 49.8 | 39.5 | 29.1 | | | | |
| | 72 | 58.4 | 3.5 | 52.7 | 42.1 | 31.5 | 20.9 | - | - | 54.8 | 4.1 | 50.5 | 40.1 | 29.7 | 19.3 | - | - | | | | |
| 2000 | 67 | 57.8 | 3.5 | 54.5 | 49.1 | 43.8 | 32.8 | 21.8 | - | 54.1 | 4.2 | 51.8 | 46.8 | 41.8 | 30.9 | 20.1 | - | | | | |
| | 62 | 57.2 | 3.5 | 56.3 | 56.2 | 56.0 | 44.6 | 33.3 | 22.0 | 53.7 | 4.1 | 53.1 | 53.1 | 53.1 | 42.6 | 31.4 | 20.2 | | | | |
| 57 | 56.6 | 3.5 | 56.6 | 56.6 | 56.6 | 56.5 | 44.8 | 33.1 | 53.2 | 4.1 | 53.2 | 53.2 | 53.2 | 53.2 | 42.6 | 31.0 | | | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 49: ZY05 (4.0 ton, 115°F to 125°F)

| Air on Evaporator Coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | 125°F | | | | | | | | | |
| 1000 | 77 | 48.4 | 4.8 | 27.7 | 23.6 | 19.6 | - | - | - | 45.1 | 5.4 | 26.7 | 22.9 | 19.0 | - | - | - | | |
| | 72 | 44.9 | 4.7 | 33.0 | 28.2 | 23.4 | 18.7 | - | - | 41.0 | 5.3 | 31.6 | 27.0 | 22.4 | 17.7 | - | - | | |
| | 67 | 41.9 | 4.7 | 38.3 | 32.8 | 27.2 | 22.4 | 17.6 | - | 37.8 | 5.2 | 36.5 | 31.1 | 25.7 | 21.1 | 16.4 | - | | |
| | 62 | 41.1 | 4.6 | 40.3 | 35.6 | 31.0 | 26.1 | 21.2 | 16.3 | 37.8 | 5.2 | 37.8 | 33.4 | 29.0 | 24.4 | 19.7 | 15.1 | | |
| 1200 | 77 | 48.6 | 4.8 | 31.7 | 25.3 | 18.9 | - | - | - | 45.1 | 5.4 | 30.6 | 24.3 | 18.1 | - | - | - | | |
| | 72 | 46.1 | 4.7 | 36.1 | 30.2 | 24.3 | 18.4 | - | - | 42.3 | 5.3 | 34.5 | 28.8 | 23.1 | 17.4 | - | - | | |
| | 67 | 43.6 | 4.7 | 40.5 | 35.1 | 29.7 | 23.7 | 17.7 | - | 39.5 | 5.3 | 38.4 | 33.3 | 28.1 | 22.3 | 16.5 | - | | |
| | 62 | 42.9 | 4.7 | 42.2 | 38.7 | 35.1 | 29.0 | 22.9 | 16.7 | 39.5 | 5.2 | 39.5 | 36.3 | 33.1 | 27.2 | 21.3 | 15.4 | | |
| 1400 | 77 | 48.9 | 4.7 | 35.7 | 26.9 | 18.2 | - | - | - | 45.0 | 5.3 | 34.5 | 25.8 | 17.1 | - | - | - | | |
| | 72 | 47.4 | 4.7 | 39.1 | 32.2 | 25.2 | 18.2 | - | - | 43.6 | 5.3 | 37.5 | 30.6 | 23.8 | 17.0 | - | - | | |
| | 67 | 45.3 | 4.7 | 42.6 | 37.4 | 32.2 | 25.1 | 17.9 | - | 41.3 | 5.3 | 40.4 | 35.5 | 30.5 | 23.5 | 16.5 | - | | |
| | 62 | 44.7 | 4.7 | 44.1 | 41.7 | 39.3 | 31.9 | 24.5 | 17.1 | 41.3 | 5.2 | 41.2 | 39.2 | 37.2 | 30.0 | 22.8 | 15.7 | | |
| 1600 | 77 | 49.1 | 4.7 | 39.7 | 28.6 | 17.4 | - | - | - | 44.9 | 5.3 | 38.4 | 27.3 | 16.2 | - | - | - | | |
| | 72 | 48.7 | 4.7 | 42.2 | 34.2 | 26.1 | 18.0 | - | - | 44.9 | 5.3 | 40.4 | 32.5 | 24.6 | 16.6 | - | - | | |
| | 67 | 47.0 | 4.7 | 44.8 | 39.8 | 34.7 | 26.4 | 18.1 | - | 43.1 | 5.3 | 42.4 | 37.7 | 32.9 | 24.7 | 16.6 | - | | |
| | 62 | 46.5 | 4.7 | 46.0 | 44.7 | 43.4 | 34.8 | 26.2 | 17.5 | 43.1 | 5.2 | 43.0 | 42.1 | 41.3 | 32.9 | 24.4 | 16.0 | | |
| 1800 | 77 | 49.9 | 4.7 | 45.3 | 36.1 | 27.0 | 17.8 | - | - | 46.3 | 5.3 | 43.3 | 34.3 | 25.3 | 16.3 | - | - | | |
| | 72 | 48.7 | 4.7 | 46.9 | 42.1 | 37.2 | 27.7 | 18.2 | - | 44.9 | 5.3 | 44.4 | 39.9 | 35.3 | 26.0 | 16.6 | - | | |
| | 67 | 48.3 | 4.7 | 47.9 | 47.7 | 47.5 | 37.7 | 27.8 | 17.9 | 44.8 | 5.3 | 44.7 | 44.7 | 44.7 | 35.7 | 26.0 | 16.2 | | |
| | 62 | 48.0 | 4.6 | 48.0 | 48.0 | 48.0 | 47.6 | 37.4 | 27.2 | 44.8 | 5.2 | 44.8 | 44.8 | 44.8 | 44.8 | 35.3 | 25.2 | | |
| 2000 | 72 | 51.2 | 4.7 | 48.4 | 38.1 | 27.9 | 17.6 | - | - | 47.6 | 5.3 | 46.2 | 36.1 | 26.0 | 15.9 | - | - | | |
| | 67 | 50.4 | 4.8 | 49.1 | 44.4 | 39.8 | 29.1 | 18.4 | - | 46.7 | 5.4 | 46.4 | 42.1 | 37.8 | 27.2 | 16.7 | - | | |
| | 62 | 50.1 | 4.7 | 49.8 | 49.8 | 49.8 | 40.5 | 29.4 | 18.3 | 46.6 | 5.3 | 46.5 | 46.5 | 46.5 | 38.5 | 27.5 | 16.5 | | |
| | 57 | 49.9 | 4.6 | 49.9 | 49.9 | 49.9 | 40.5 | 29.0 | - | 46.5 | 5.2 | 46.5 | 46.5 | 46.5 | 46.5 | 38.4 | 26.9 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 50: ZY06 (5.0 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 1250 | 77 | 78.9 | 3.4 | 37.6 | 31.8 | 26.0 | - | - | - | 75.5 | 4.1 | 39.5 | 32.5 | 25.4 | - | - | - | | |
| | 72 | 71.2 | 3.4 | 46.4 | 39.6 | 32.9 | 26.1 | - | - | 67.9 | 3.8 | 46.5 | 39.2 | 31.8 | 24.5 | - | - | | |
| | 67 | 63.4 | 3.4 | 55.1 | 47.4 | 39.8 | 33.1 | 26.3 | - | 60.2 | 3.5 | 53.5 | 45.9 | 38.3 | 31.4 | 24.5 | - | | |
| | 62 | 60.2 | 3.3 | 56.9 | 51.8 | 46.7 | 38.1 | 33.2 | 26.5 | 57.8 | 3.7 | 54.7 | 49.7 | 44.7 | 37.3 | 31.8 | 25.3 | | |
| 1500 | 77 | 79.2 | 3.4 | 43.0 | 34.9 | 26.9 | - | - | - | 75.3 | 3.9 | 43.0 | 33.7 | 24.4 | - | - | - | | |
| | 72 | 72.7 | 3.4 | 51.1 | 43.0 | 34.9 | 26.9 | - | - | 69.0 | 3.8 | 49.4 | 41.2 | 33.0 | 24.8 | - | - | | |
| | 67 | 66.3 | 3.4 | 59.1 | 51.1 | 43.0 | 35.1 | 27.0 | - | 62.8 | 3.8 | 55.8 | 48.7 | 41.6 | 33.4 | 25.2 | - | | |
| | 62 | 63.6 | 3.3 | 60.8 | 55.9 | 51.0 | 41.7 | 35.3 | 27.4 | 60.7 | 3.8 | 58.2 | 54.2 | 50.2 | 41.2 | 33.7 | 25.4 | | |
| 1750 | 77 | 79.5 | 3.5 | 48.4 | 38.1 | 27.8 | - | - | - | 75.1 | 3.6 | 46.6 | 35.0 | 23.4 | - | - | - | | |
| | 72 | 74.3 | 3.4 | 55.8 | 46.4 | 37.0 | 27.6 | - | - | 70.2 | 3.8 | 52.3 | 43.3 | 34.2 | 25.1 | - | - | | |
| | 67 | 69.2 | 3.4 | 63.1 | 54.7 | 46.2 | 37.0 | 27.8 | - | 65.3 | 4.0 | 58.1 | 51.5 | 44.9 | 35.4 | 25.8 | - | | |
| | 62 | 67.1 | 3.4 | 64.7 | 60.1 | 55.4 | 45.3 | 37.3 | 28.3 | 63.7 | 3.8 | 61.6 | 58.6 | 55.7 | 45.1 | 35.6 | 25.6 | | |
| 2000 | 77 | 79.7 | 3.5 | 53.8 | 41.2 | 28.7 | - | - | - | 74.9 | 3.4 | 50.1 | 36.3 | 22.4 | - | - | - | | |
| | 72 | 75.9 | 3.4 | 60.5 | 49.8 | 39.1 | 28.3 | - | - | 71.4 | 3.9 | 55.2 | 45.3 | 35.4 | 25.4 | - | - | | |
| | 67 | 72.0 | 3.4 | 67.2 | 58.3 | 49.4 | 39.0 | 28.5 | - | 67.8 | 4.3 | 60.4 | 54.3 | 48.3 | 37.4 | 26.5 | - | | |
| | 62 | 70.5 | 3.4 | 68.7 | 64.2 | 59.8 | 48.8 | 39.4 | 29.1 | 66.6 | 3.8 | 65.0 | 63.1 | 61.2 | 49.0 | 37.5 | 25.7 | | |
| 2250 | 77 | 79.5 | 3.5 | 53.8 | 41.2 | 28.7 | - | - | - | 74.9 | 3.4 | 50.1 | 36.3 | 22.4 | - | - | - | | |
| | 72 | 75.9 | 3.4 | 60.5 | 49.8 | 39.1 | 28.3 | - | - | 71.4 | 3.9 | 55.2 | 45.3 | 35.4 | 25.4 | - | - | | |
| | 67 | 72.0 | 3.4 | 67.2 | 58.3 | 49.4 | 39.0 | 28.5 | - | 67.8 | 4.3 | 60.4 | 54.3 | 48.3 | 37.4 | 26.5 | - | | |
| | 62 | 70.5 | 3.4 | 68.7 | 64.2 | 59.8 | 48.8 | 39.4 | 29.1 | 66.6 | 3.8 | 65.0 | 63.1 | 61.2 | 49.0 | 37.5 | 25.7 | | |
| 2500 | 77 | 79.5 | 3.5 | 53.8 | 41.2 | 28.7 | - | - | - | 74.9 | 3.4 | 50.1 | 36.3 | 22.4 | - | - | - | | |
| | 72 | 75.9 | 3.4 | 60.5 | 49.8 | 39.1 | 28.3 | - | - | 71.4 | 3.9 | 55.2 | 45.3 | 35.4 | 25.4 | - | - | | |
| | 67 | 72.0 | 3.4 | 67.2 | 58.3 | 49.4 | 39.0 | 28.5 | - | 67.8 | 4.3 | 60.4 | 54.3 | 48.3 | 37.4 | 26.5 | - | | |
| | 62 | 70.5 | 3.4 | 68.7 | 64.2 | 59.8 | 48.8 | 39.4 | 29.1 | 66.6 | 3.8 | 65.0 | 63.1 | 61.2 | 49.0 | 37.5 | 25.7 | | |
| 2250 | 72 | 77.5 | 3.5 | 65.2 | 53.1 | 41.1 | 29.1 | - | - | 72.5 | 3.9 | 58.1 | 47.3 | 36.5 | 25.7 | - | - | | |
| | 67 | 74.9 | 3.4 | 71.2 | 61.9 | 52.7 | 41.0 | 29.2 | - | 70.4 | 4.5 | 62.6 | 57.1 | 51.6 | 39.4 | 27.2 | - | | |
| | 62 | 74.0 | 3.4 | 72.6 | 68.4 | 64.2 | 52.4 | 41.4 | 30.0 | 69.6 | 3.8 | 68.4 | 67.6 | 66.7 | 52.9 | 39.5 | 25.8 | | |
| | 57 | 73.4 | 3.4 | 73.4 | 73.4 | 73.4 | 64.7 | 53.6 | 42.5 | 68.9 | 3.1 | 68.9 | 68.9 | 68.9 | 66.8 | 51.7 | 36.7 | | |
| 2500 | 72 | 79.0 | 3.5 | 69.9 | 56.5 | 43.2 | 29.8 | - | - | 73.7 | 3.9 | 61.0 | 49.4 | 37.7 | 26.1 | - | - | | |
| | 67 | 77.8 | 3.4 | 75.2 | 65.5 | 55.9 | 42.9 | 30.0 | - | 72.9 | 4.8 | 64.9 | 60.0 | 55.0 | 41.4 | 27.9 | - | | |
| | 62 | 77.4 | 3.4 | 76.5 | 72.6 | 68.6 | 56.0 | 43.5 | 30.9 | 72.5 | 3.8 | 71.9 | 71.9 | 71.9 | 56.8 | 41.4 | 26.0 | | |
| | 57 | 77.0 | 3.4 | 77.0 | 77.0 | 77.0 | 69.1 | 56.9 | 44.8 | 72.1 | 2.9 | 72.1 | 72.1 | 72.1 | 72.1 | 54.9 | 37.6 | | |
| | | 95°F | | | | | | | | | 105°F | | | | | | | | |
| 1250 | 77 | 72.1 | 4.7 | 41.5 | 33.1 | 24.8 | - | - | - | 65.0 | 5.3 | 38.6 | 30.7 | 22.7 | - | - | - | | |
| | 72 | 64.6 | 4.2 | 46.6 | 38.7 | 30.8 | 22.9 | - | - | 59.3 | 4.9 | 43.9 | 36.3 | 28.7 | 21.2 | - | - | | |
| | 67 | 57.0 | 3.7 | 51.8 | 44.3 | 36.8 | 29.7 | 22.6 | - | 53.9 | 4.6 | 49.2 | 42.0 | 34.8 | 27.8 | 20.8 | - | | |
| | 62 | 55.3 | 4.1 | 52.6 | 47.7 | 42.7 | 36.5 | 30.3 | 24.1 | 52.2 | 4.8 | 49.7 | 45.3 | 40.8 | 34.4 | 28.0 | 21.6 | | |
| 1500 | 77 | 71.4 | 4.3 | 43.1 | 32.5 | 22.0 | - | - | - | 65.0 | 5.0 | 41.1 | 30.9 | 20.6 | - | - | - | | |
| | 72 | 65.3 | 4.2 | 47.8 | 39.4 | 31.1 | 22.8 | - | - | 60.5 | 4.9 | 45.8 | 37.6 | 29.4 | 21.2 | - | - | | |
| | 67 | 59.2 | 4.2 | 52.4 | 46.3 | 40.2 | 31.7 | 23.3 | - | 55.9 | 4.9 | 50.4 | 44.3 | 38.1 | 29.8 | 21.4 | - | | |
| | 62 | 57.8 | 4.2 | 55.5 | 52.4 | 49.4 | 40.7 | 32.1 | 23.5 | 54.5 | 4.8 | 52.5 | 49.7 | 46.9 | 38.4 | 29.8 | 21.2 | | |
| 1750 | 77 | 70.8 | 3.8 | 44.8 | 31.9 | 19.1 | - | - | - | 65.0 | 4.7 | 43.7 | 31.1 | 18.5 | - | - | - | | |
| | 72 | 66.1 | 4.3 | 48.9 | 40.1 | 31.4 | 22.6 | - | - | 61.6 | 4.9 | 47.6 | 38.8 | 30.0 | 21.2 | - | - | | |
| | 67 | 61.4 | 4.7 | 53.0 | 48.3 | 43.7 | 33.8 | 23.9 | - | 58.0 | 5.2 | 51.6 | 46.5 | 41.5 | 31.7 | 22.0 | - | | |
| | 62 | 60.2 | 4.2 | 58.4 | 57.2 | 56.0 | 44.9 | 33.9 | 22.9 | 56.9 | 4.8 | 55.3 | 54.1 | 53.0 | 42.3 | 31.6 | 20.9 | | |
| 2000 | 77 | 70.1 | 3.4 | 46.4 | 31.3 | 16.2 | - | - | - | 65.1 | 4.3 | 46.2 | 31.3 | 16.3 | - | - | - | | |
| | 72 | 66.8 | 4.3 | 50.0 | 40.8 | 31.7 | 22.5 | - | - | 62.7 | 4.9 | 49.5 | 40.0 | 30.6 | 21.2 | - | - | | |
| | 67 | 63.6 | 5.2 | 53.6 | 50.3 | 47.1 | 35.8 | 24.5 | - | 60.0 | 5.5 | 52.8 | 48.8 | 44.9 | 33.7 | 22.6 | - | | |
| | 62 | 62.7 | 4.2 | 61.4 | 61.4 | 61.4 | 49.2 | 35.7 | 22.3 | 59.2 | 4.8 | 58.0 | 58.0 | 58.0 | 46.3 | 33.5 | 20.6 | | |
| 2250 | 77 | 67.6 | 4.3 | 51.1 | 41.5 | 32.0 | 22.4 | - | - | 63.8 | 4.9 | 51.4 | 41.3 | 31.2 | 21.1 | - | - | | |
| | 67 | 65.8 | 5.6 | 54.1 | 52.4 | 50.6 | 37.9 | 25.2 | - | 62.0 | 5.8 | 54.0 | 51.1 | 48.2 | 35.7 | 23.2 | - | | |
| | 62 | 65.1 | 4.2 | 64.3 | 64.3 | 64.3 | 53.4 | 37.5 | 21.7 | 61.5 | 4.9 | 60.8 | 60.8 | 60.8 | 50.3 | 35.3 | 20.3 | | |
| | 57 | 64.5 | 2.8 | 64.5 | 64.5 | 64.5 | 64.5 | 49.9 | 30.9 | 60.9 | 3.9 | 60.9 | 60.9 | 60.9 | 60.9 | 47.4 | 29.9 | | |
| 2500 | 72 | 68.3 | 4.3 | 52.2 | 42.2 | 32.3 | 22.3 | - | - | 64.9 | 4.9 | 53.2 | 42.5 | 31.8 | 21.1 | - | - | | |
| | 67 | 68.0 | 6.1 | 54.7 | 54.4 | 54.1 | 39.9 | 25.8 | - | 64.1 | 6.1 | 55.2 | 53.4 | 51.6 | 37.7 | 23.8 | - | | |
| | 62 | 67.6 | 4.3 | 67.2 | 67.2 | 67.2 | 57.6 | 39.3 | 21.1 | 63.8 | 4.9 | 63.5 | 63.5 | 63.5 | 54.2 | 37.1 | 20.0 | | |
| | 57 | 67.2 | 2.4 | 67.2 | 67.2 | 67.2 | 52.9 | 30.5 | | 63.5 | 3.6 | 63.5 | 63.5 | 63.5 | 50.4 | 30.1 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 51: ZY06 (5.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| | | 115°F | | | | | | | | | | 125°F | | | | | |
| | | 90 | 85 | 80 | 75 | 70 | 65 | 90 | 85 | 80 | 75 | 70 | 65 | | | | |
| 1250 | 77 | 57.8 | 5.9 | 35.8 | 28.2 | 20.6 | - | - | - | 50.6 | 6.4 | 33.0 | 25.7 | 18.5 | - | - | - |
| | 72 | 54.1 | 5.7 | 41.2 | 33.9 | 26.7 | 19.5 | - | - | 48.9 | 6.4 | 38.4 | 31.5 | 24.6 | 17.8 | - | - |
| | 67 | 50.8 | 5.4 | 46.5 | 39.7 | 32.8 | 25.9 | 18.9 | - | 47.6 | 6.3 | 43.9 | 37.3 | 30.8 | 23.9 | 17.1 | - |
| | 62 | 49.1 | 5.5 | 46.9 | 42.9 | 38.9 | 32.3 | 25.6 | 19.0 | 46.0 | 6.2 | 44.1 | 40.5 | 36.9 | 30.1 | 23.3 | 16.5 |
| 1500 | 77 | 58.5 | 5.7 | 39.2 | 29.2 | 19.2 | - | - | - | 52.1 | 6.4 | 37.2 | 27.5 | 17.9 | - | - | - |
| | 72 | 55.6 | 5.6 | 43.8 | 35.7 | 27.6 | 19.6 | - | - | 50.7 | 6.3 | 41.8 | 33.9 | 25.9 | 18.0 | - | - |
| | 67 | 52.6 | 5.6 | 48.4 | 42.2 | 36.1 | 27.8 | 19.5 | - | 49.4 | 6.2 | 46.4 | 40.2 | 34.0 | 25.8 | 17.6 | - |
| | 62 | 51.3 | 5.5 | 49.5 | 47.0 | 44.5 | 36.0 | 27.5 | 19.0 | 48.0 | 6.2 | 46.5 | 44.3 | 42.0 | 33.6 | 25.2 | 16.8 |
| 1750 | 77 | 59.3 | 5.5 | 42.6 | 30.2 | 17.8 | - | - | - | 53.6 | 6.3 | 41.5 | 29.4 | 17.2 | - | - | - |
| | 72 | 57.1 | 5.6 | 46.4 | 37.5 | 28.6 | 19.7 | - | - | 52.5 | 6.2 | 45.2 | 36.2 | 27.2 | 18.2 | - | - |
| | 67 | 54.5 | 5.7 | 50.2 | 44.8 | 39.3 | 29.7 | 20.0 | - | 51.1 | 6.2 | 48.8 | 43.0 | 37.1 | 27.6 | 18.1 | - |
| | 62 | 53.5 | 5.5 | 52.1 | 51.1 | 50.1 | 39.7 | 29.3 | 19.0 | 50.1 | 6.1 | 48.9 | 48.0 | 47.1 | 37.1 | 27.0 | 17.0 |
| 2000 | 77 | 60.1 | 5.3 | 46.0 | 31.2 | 16.4 | - | - | - | 55.0 | 6.2 | 45.8 | 31.2 | 16.6 | - | - | - |
| | 72 | 58.5 | 5.5 | 49.0 | 39.3 | 29.5 | 19.8 | - | - | 54.4 | 6.2 | 48.5 | 38.5 | 28.4 | 18.4 | - | - |
| | 67 | 56.4 | 5.8 | 52.0 | 47.3 | 42.6 | 31.6 | 20.6 | - | 52.8 | 6.2 | 51.3 | 45.8 | 40.3 | 29.5 | 18.6 | - |
| | 62 | 55.6 | 5.5 | 54.7 | 54.7 | 54.7 | 43.4 | 31.2 | 18.9 | 52.1 | 6.1 | 51.4 | 51.4 | 51.4 | 40.6 | 28.9 | 17.2 |
| 2250 | 77 | 60.0 | 5.5 | 51.6 | 41.0 | 30.5 | 19.9 | - | - | 56.2 | 6.1 | 51.9 | 40.8 | 29.7 | 18.6 | - | - |
| | 72 | 58.3 | 6.0 | 53.9 | 49.9 | 45.9 | 33.5 | 21.2 | - | 54.5 | 6.1 | 53.7 | 48.6 | 43.5 | 31.3 | 19.2 | - |
| | 67 | 57.8 | 5.5 | 57.3 | 57.3 | 57.3 | 47.1 | 33.0 | 18.9 | 54.2 | 6.1 | 53.8 | 53.8 | 53.8 | 44.0 | 30.8 | 17.5 |
| | 62 | 57.4 | 5.0 | 57.4 | 57.4 | 57.4 | 44.9 | 29.0 | - | 53.8 | 6.1 | 53.8 | 53.8 | 53.8 | 53.8 | 42.4 | 28.0 |
| 2500 | 72 | 61.4 | 5.5 | 54.2 | 42.8 | 31.4 | 20.0 | - | - | 58.0 | 6.0 | 55.3 | 43.1 | 31.0 | 18.8 | - | - |
| | 67 | 60.1 | 6.1 | 55.7 | 52.4 | 49.1 | 35.4 | 21.7 | - | 56.2 | 6.1 | 56.2 | 51.4 | 46.7 | 33.2 | 19.7 | - |
| | 62 | 60.0 | 5.5 | 59.9 | 59.9 | 59.9 | 50.9 | 34.9 | 18.9 | 56.2 | 6.1 | 56.2 | 56.2 | 56.2 | 47.5 | 32.6 | 17.7 |
| | 57 | 59.9 | 4.8 | 59.9 | 59.9 | 59.9 | 59.9 | 48.0 | 29.7 | 56.2 | 6.1 | 56.2 | 56.2 | 56.2 | 56.2 | 45.6 | 29.3 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 52: ZY07 (6.0 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 1500 | 77 | 94.4 | 4.6 | 47.9 | 40.7 | 33.4 | - | - | - | 89.8 | 5.0 | 40.1 | 35.9 | 31.7 | - | - | - | | |
| | 72 | 86.8 | 4.5 | 57.2 | 49.3 | 41.5 | 33.6 | - | - | 82.6 | 5.0 | 55.0 | 47.1 | 39.3 | 31.4 | - | - | | |
| | 67 | 79.1 | 4.4 | 66.6 | 58.0 | 49.5 | 41.0 | 33.2 | - | 75.4 | 4.9 | 69.8 | 58.3 | 46.8 | 38.8 | 31.1 | - | | |
| | 62 | 72.8 | 4.4 | 72.8 | 65.7 | 57.5 | 47.0 | 40.7 | 32.3 | 71.6 | 4.9 | 70.5 | 61.5 | 54.4 | 45.5 | 38.6 | 30.7 | | |
| 1800 | 77 | 95.6 | 4.6 | 52.2 | 42.7 | 33.2 | - | - | - | 90.7 | 5.1 | 46.3 | 38.9 | 31.5 | - | - | - | | |
| | 72 | 88.7 | 4.5 | 62.2 | 52.8 | 43.4 | 34.0 | - | - | 84.4 | 5.0 | 60.0 | 50.6 | 41.1 | 31.6 | - | - | | |
| | 67 | 81.7 | 4.5 | 70.5 | 62.9 | 53.5 | 43.5 | 33.9 | - | 78.0 | 4.9 | 70.0 | 62.2 | 50.7 | 41.1 | 31.6 | - | | |
| | 62 | 76.6 | 4.4 | 71.2 | 70.6 | 63.7 | 51.8 | 43.3 | 33.1 | 74.9 | 4.9 | 70.4 | 66.4 | 60.4 | 49.9 | 41.0 | 31.4 | | |
| 2100 | 57 | 71.5 | 4.4 | 71.5 | 71.5 | 71.5 | 63.2 | 52.6 | 42.0 | 71.7 | 4.9 | 71.7 | 71.7 | 70.0 | 60.2 | 50.5 | 40.7 | | |
| | 77 | 96.9 | 4.6 | 56.4 | 44.7 | 33.0 | - | - | - | 91.7 | 5.1 | 52.5 | 41.9 | 31.2 | - | - | - | | |
| | 72 | 90.6 | 4.6 | 67.1 | 56.2 | 45.3 | 34.3 | - | - | 86.1 | 5.0 | 65.1 | 54.0 | 42.9 | 31.9 | - | - | | |
| | 67 | 84.4 | 4.5 | 75.5 | 67.7 | 57.6 | 45.9 | 34.6 | - | 80.5 | 4.9 | 74.1 | 66.1 | 54.6 | 43.3 | 32.2 | - | | |
| 2400 | 62 | 80.4 | 4.5 | 76.1 | 75.4 | 69.9 | 56.6 | 45.9 | 33.8 | 78.2 | 4.9 | 74.6 | 71.3 | 66.3 | 54.3 | 43.5 | 32.0 | | |
| | 57 | 76.5 | 4.4 | 76.5 | 76.5 | 76.5 | 69.6 | 57.1 | 44.5 | 75.8 | 4.9 | 75.2 | 75.2 | 75.2 | 66.4 | 54.8 | 43.2 | | |
| | 77 | 98.1 | 4.7 | 60.7 | 46.7 | 32.7 | - | - | - | 92.7 | 5.1 | 58.6 | 44.8 | 31.0 | - | - | - | | |
| | 72 | 92.6 | 4.6 | 72.1 | 59.6 | 47.2 | 34.7 | - | - | 87.9 | 5.0 | 70.1 | 57.4 | 44.8 | 32.1 | - | - | | |
| 2700 | 67 | 87.0 | 4.5 | 80.4 | 72.5 | 61.6 | 48.4 | 35.4 | - | 83.1 | 5.0 | 77.8 | 70.1 | 58.6 | 45.6 | 32.7 | - | | |
| | 62 | 84.2 | 4.5 | 81.1 | 80.3 | 76.1 | 61.4 | 48.4 | 34.6 | 81.4 | 5.0 | 78.4 | 76.2 | 72.3 | 58.7 | 45.9 | 32.7 | | |
| | 57 | 81.5 | 4.5 | 81.5 | 81.5 | 81.5 | 76.0 | 61.5 | 47.0 | 79.8 | 5.0 | 79.1 | 79.1 | 79.1 | 72.6 | 59.1 | 45.7 | | |
| | 72 | 94.5 | 4.6 | 77.0 | 63.0 | 49.1 | 35.1 | - | - | 89.7 | 5.1 | 75.1 | 60.9 | 46.6 | 32.4 | - | - | | |
| 3000 | 67 | 89.6 | 4.5 | 84.9 | 77.4 | 65.7 | 50.8 | 36.1 | - | 85.7 | 5.0 | 82.7 | 74.0 | 62.5 | 47.8 | 33.3 | - | | |
| | 62 | 88.1 | 4.5 | 85.2 | 85.1 | 82.3 | 66.3 | 51.0 | 35.4 | 84.7 | 5.0 | 83.0 | 81.1 | 78.3 | 63.1 | 48.4 | 33.4 | | |
| | 57 | 86.5 | 4.5 | 85.9 | 85.9 | 85.9 | 82.4 | 65.9 | 49.4 | 83.8 | 5.0 | 83.5 | 83.5 | 83.5 | 78.8 | 63.5 | 48.2 | | |
| | 72 | 96.4 | 4.6 | 82.0 | 66.5 | 51.0 | 35.5 | - | - | 91.4 | 5.1 | 80.2 | 64.3 | 48.5 | 32.6 | - | - | | |
| 95°F | 67 | 92.2 | 4.6 | 91.0 | 82.2 | 69.8 | 53.3 | 36.8 | - | 88.2 | 5.0 | 87.0 | 77.9 | 66.4 | 50.1 | 33.8 | - | | |
| | 62 | 91.9 | 4.6 | 91.3 | 89.9 | 88.6 | 71.1 | 53.6 | 36.1 | 88.0 | 5.0 | 87.2 | 86.1 | 84.3 | 67.5 | 50.8 | 34.1 | | |
| | 57 | 91.6 | 4.6 | 91.5 | 91.5 | 91.5 | 88.8 | 70.4 | 51.9 | 87.8 | 5.0 | 87.4 | 87.4 | 87.4 | 85.0 | 67.8 | 50.7 | | |
| | | | 95°F | | | | | | | | | 105°F | | | | | | | |
| 1500 | 77 | 85.1 | 5.5 | 32.4 | 31.2 | 29.9 | - | - | - | 79.1 | 6.3 | 33.5 | 30.5 | 27.4 | - | - | - | | |
| | 72 | 78.4 | 5.4 | 52.7 | 44.9 | 37.1 | 29.2 | - | - | 72.6 | 6.2 | 50.4 | 42.6 | 34.7 | 26.8 | - | - | | |
| | 67 | 71.7 | 5.4 | 64.9 | 58.6 | 44.2 | 36.6 | 28.9 | - | 66.0 | 6.2 | 61.0 | 54.7 | 42.0 | 34.2 | 26.4 | - | | |
| | 62 | 70.4 | 5.4 | 65.5 | 57.2 | 51.3 | 43.9 | 36.5 | 29.0 | 65.5 | 6.2 | 63.5 | 55.1 | 49.3 | 41.5 | 33.8 | 26.1 | | |
| 1800 | 77 | 85.8 | 5.5 | 40.4 | 35.1 | 29.7 | - | - | - | 79.8 | 6.3 | 41.3 | 34.2 | 27.2 | - | - | - | | |
| | 72 | 80.0 | 5.4 | 57.9 | 48.3 | 38.8 | 29.3 | - | - | 74.2 | 6.2 | 55.5 | 46.0 | 36.5 | 27.0 | - | - | | |
| | 67 | 74.2 | 5.4 | 66.8 | 61.6 | 47.9 | 38.6 | 29.3 | - | 68.6 | 6.2 | 62.1 | 57.7 | 45.8 | 36.3 | 26.8 | - | | |
| | 62 | 73.1 | 5.4 | 67.4 | 62.2 | 57.0 | 47.9 | 38.8 | 29.7 | 68.2 | 6.2 | 64.5 | 59.8 | 55.0 | 45.5 | 36.1 | 26.6 | | |
| 2100 | 57 | 72.0 | 5.4 | 70.5 | 68.3 | 66.2 | 57.2 | 48.3 | 39.3 | 67.7 | 6.1 | 66.5 | 65.4 | 64.3 | 54.8 | 45.4 | 35.9 | | |
| | 77 | 86.5 | 5.5 | 48.5 | 39.0 | 29.5 | - | - | - | 80.6 | 6.3 | 49.0 | 38.0 | 27.0 | - | - | - | | |
| | 72 | 81.6 | 5.5 | 63.0 | 51.8 | 40.6 | 29.4 | - | - | 75.9 | 6.2 | 60.5 | 49.4 | 38.3 | 27.1 | - | - | | |
| | 67 | 76.7 | 5.4 | 71.0 | 64.6 | 51.7 | 40.7 | 29.7 | - | 71.2 | 6.2 | 67.4 | 60.8 | 49.5 | 38.3 | 27.2 | - | | |
| 2400 | 62 | 75.9 | 5.4 | 71.6 | 67.2 | 62.8 | 51.9 | 41.1 | 30.3 | 70.8 | 6.2 | 68.1 | 64.5 | 60.8 | 49.6 | 38.3 | 27.1 | | |
| | 57 | 75.0 | 5.5 | 74.0 | 73.9 | 73.9 | 63.2 | 52.5 | 41.9 | 70.5 | 6.1 | 69.7 | 69.7 | 69.7 | 60.8 | 49.5 | 38.3 | | |
| | 77 | 87.2 | 5.5 | 56.5 | 42.9 | 29.3 | - | - | - | 81.3 | 6.3 | 56.8 | 41.8 | 26.8 | - | - | - | | |
| | 72 | 83.2 | 5.5 | 68.1 | 55.3 | 42.4 | 29.5 | - | - | 77.5 | 6.2 | 65.6 | 52.8 | 40.0 | 27.3 | - | - | | |
| 2700 | 67 | 79.3 | 5.4 | 75.1 | 67.6 | 55.5 | 42.8 | 30.0 | - | 73.7 | 6.2 | 71.3 | 63.9 | 53.3 | 40.4 | 27.5 | - | | |
| | 62 | 78.6 | 5.5 | 75.9 | 72.2 | 68.5 | 56.0 | 43.4 | 30.9 | 73.5 | 6.2 | 71.7 | 69.1 | 66.5 | 53.6 | 40.6 | 27.6 | | |
| | 57 | 78.0 | 5.5 | 77.4 | 77.4 | 77.4 | 69.2 | 56.8 | 44.4 | 73.3 | 6.2 | 72.7 | 72.7 | 72.7 | 66.7 | 53.7 | 40.6 | | |
| | 72 | 84.8 | 5.5 | 73.3 | 58.7 | 44.2 | 29.6 | - | - | 79.2 | 6.2 | 70.6 | 56.2 | 41.8 | 27.4 | - | - | | |
| 3000 | 67 | 81.8 | 5.5 | 79.4 | 70.6 | 59.2 | 44.8 | 30.4 | - | 76.3 | 6.2 | 74.9 | 66.9 | 57.1 | 42.5 | 27.9 | - | | |
| | 62 | 81.4 | 5.5 | 80.1 | 77.2 | 74.3 | 60.0 | 45.7 | 31.5 | 76.2 | 6.2 | 75.4 | 73.8 | 72.3 | 57.6 | 42.9 | 28.2 | | |
| | 57 | 81.0 | 5.5 | 80.9 | 80.9 | 80.9 | 75.2 | 61.0 | 46.9 | 76.0 | 6.2 | 75.8 | 75.8 | 75.8 | 72.7 | 57.8 | 42.9 | | |
| | 72 | 86.5 | 5.5 | 78.4 | 62.2 | 46.0 | 29.7 | - | - | 80.8 | 6.3 | 75.7 | 59.6 | 43.6 | 27.5 | - | - | | |
| 3000 | 67 | 84.3 | 5.5 | 83.9 | 73.6 | 63.0 | 46.9 | 30.8 | - | 78.9 | 6.2 | 78.1 | 70.0 | 60.8 | 44.6 | 28.3 | - | | |
| | 62 | 84.2 | 5.5 | 84.0 | 82.2 | 80.0 | 64.0 | 48.0 | 32.1 | 78.8 | 6.2 | 78.4 | 78.4 | 78.1 | 61.6 | 45.1 | 28.7 | | |
| | 57 | 84.1 | 5.5 | 84.1 | 84.1 | 84.1 | 81.2 | 65.3 | 49.5 | 78.6 | 6.2 | 78.6 | 78.6 | 78.6 | 78.6 | 62.0 | 45.3 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 53: ZY07 (6.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|-------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | | | | | 125°F | | | | | |
| 1500 | 77 | 73.1 | 7.1 | 34.6 | 29.8 | 24.9 | - | - | - | 67.1 | 7.8 | 35.8 | 29.1 | 22.4 | - | - | - | | |
| | 72 | 66.7 | 7.0 | 48.2 | 40.3 | 32.4 | 24.5 | - | - | 60.9 | 7.8 | 45.9 | 38.0 | 30.0 | 22.1 | - | - | | |
| | 67 | 61.2 | 7.0 | 58.6 | 50.7 | 39.8 | 31.8 | 23.9 | - | 56.0 | 7.8 | 55.4 | 46.8 | 37.6 | 29.5 | 21.3 | - | | |
| | 62 | 60.6 | 6.9 | 60.0 | 52.9 | 47.2 | 39.2 | 31.2 | 23.1 | 55.7 | 7.7 | 55.7 | 50.7 | 45.2 | 36.8 | 28.5 | 20.2 | | |
| 1800 | 77 | 73.9 | 7.1 | 42.1 | 33.4 | 24.7 | - | - | - | 67.9 | 7.8 | 42.9 | 32.6 | 22.2 | - | - | - | | |
| | 72 | 68.4 | 7.0 | 53.1 | 43.6 | 34.1 | 24.6 | - | - | 62.6 | 7.8 | 50.8 | 41.3 | 31.8 | 22.3 | - | - | | |
| | 67 | 63.4 | 7.0 | 61.2 | 53.9 | 43.6 | 33.9 | 24.2 | - | 59.3 | 7.7 | 57.2 | 50.0 | 41.4 | 31.5 | 21.7 | - | | |
| | 62 | 63.2 | 6.9 | 61.6 | 57.3 | 53.0 | 43.2 | 33.4 | 23.6 | 58.2 | 7.6 | 57.8 | 54.8 | 51.0 | 40.8 | 30.7 | 20.5 | | |
| 2100 | 77 | 74.6 | 7.1 | 49.6 | 37.0 | 24.5 | - | - | - | 68.6 | 7.8 | 50.1 | 36.0 | 21.9 | - | - | - | | |
| | 72 | 70.1 | 7.0 | 58.1 | 47.0 | 35.9 | 24.8 | - | - | 64.3 | 7.8 | 55.6 | 44.6 | 33.5 | 22.5 | - | - | | |
| | 67 | 66.4 | 6.9 | 64.0 | 57.0 | 47.3 | 36.0 | 24.6 | - | 62.4 | 7.7 | 60.2 | 53.2 | 45.2 | 33.6 | 22.1 | - | | |
| | 62 | 65.8 | 6.9 | 64.6 | 61.7 | 58.8 | 47.2 | 35.6 | 24.0 | 61.4 | 7.6 | 60.5 | 58.9 | 56.8 | 44.8 | 32.8 | 20.8 | | |
| 2400 | 77 | 75.4 | 7.1 | 57.0 | 40.6 | 24.2 | - | - | - | 69.4 | 7.8 | 57.3 | 39.5 | 21.7 | - | - | - | | |
| | 72 | 71.8 | 7.0 | 63.1 | 50.4 | 37.7 | 25.0 | - | - | 66.1 | 7.7 | 60.5 | 47.9 | 35.3 | 22.7 | - | - | | |
| | 67 | 68.9 | 6.9 | 67.5 | 60.1 | 51.1 | 38.1 | 25.0 | - | 63.9 | 7.7 | 62.6 | 56.3 | 48.9 | 35.7 | 22.5 | - | | |
| | 62 | 68.5 | 6.9 | 67.6 | 66.1 | 64.6 | 51.2 | 37.8 | 24.4 | 63.7 | 7.6 | 63.0 | 63.0 | 62.6 | 48.8 | 35.0 | 21.2 | | |
| 2700 | 77 | 76.3 | 6.9 | 68.0 | 68.0 | 68.0 | 64.3 | 50.5 | 36.8 | 63.2 | 7.6 | 63.2 | 63.2 | 63.2 | 61.8 | 47.4 | 33.0 | | |
| | 72 | 73.5 | 7.0 | 68.0 | 53.7 | 39.4 | 25.2 | - | - | 67.8 | 7.7 | 65.0 | 51.2 | 37.1 | 22.9 | - | - | | |
| | 67 | 71.5 | 6.9 | 70.2 | 63.2 | 54.9 | 40.2 | 25.4 | - | 67.6 | 7.6 | 65.3 | 59.5 | 52.7 | 37.8 | 22.9 | - | | |
| | 62 | 71.0 | 6.9 | 70.5 | 70.5 | 70.3 | 55.2 | 40.0 | 24.8 | 66.0 | 7.6 | 65.4 | 65.4 | 65.4 | 52.8 | 37.1 | 21.5 | | |
| 3000 | 77 | 70.9 | 6.9 | 70.6 | 70.6 | 70.6 | 70.2 | 54.6 | 39.0 | 65.9 | 7.6 | 65.5 | 65.5 | 65.5 | 65.5 | 51.3 | 35.0 | | |
| | 72 | 75.2 | 7.0 | 73.0 | 57.1 | 41.2 | 25.3 | - | - | 70.2 | 7.7 | 67.0 | 54.5 | 38.8 | 23.1 | - | - | | |
| | 67 | 74.1 | 6.9 | 72.9 | 66.3 | 58.7 | 42.2 | 25.8 | - | 69.1 | 7.6 | 67.1 | 62.7 | 56.5 | 39.9 | 23.4 | - | | |
| | 62 | 73.8 | 6.9 | 73.0 | 73.0 | 73.0 | 59.2 | 42.2 | 25.3 | 68.5 | 7.6 | 67.6 | 67.6 | 67.6 | 56.7 | 39.3 | 21.9 | | |
| 57 | 73.6 | 6.9 | 73.3 | 73.3 | 73.3 | 73.3 | 58.6 | 41.1 | 68.3 | 7.6 | 67.8 | 67.8 | 67.8 | 67.8 | 55.3 | 37.0 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 55: ZYA7 (6.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|-------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | | | | | 125°F | | | | | |
| 1500 | 77 | 81.1 | 6.4 | 37.2 | 30.5 | 23.8 | - | - | - | 79.5 | 7.1 | 37.5 | 29.9 | 22.3 | - | - | - | | |
| | 72 | 67.5 | 6.4 | 48.7 | 40.2 | 31.7 | 23.3 | - | - | 63.4 | 7.1 | 47.4 | 38.8 | 30.1 | 21.4 | - | - | | |
| | 67 | 53.9 | 6.4 | 53.9 | 49.9 | 39.7 | 31.0 | 22.4 | - | 47.3 | 7.1 | 47.3 | 47.3 | 37.9 | 29.0 | 20.0 | - | | |
| | 62 | 60.8 | 6.4 | 58.9 | 53.3 | 47.7 | 38.8 | 30.0 | 21.1 | 57.1 | 7.2 | 55.3 | 50.5 | 45.6 | 36.5 | 27.4 | 18.2 | | |
| 1800 | 77 | 77.0 | 6.4 | 46.1 | 34.9 | 23.7 | - | - | - | 73.5 | 7.1 | 45.1 | 33.3 | 21.5 | - | - | - | | |
| | 72 | 67.1 | 6.4 | 53.0 | 43.2 | 33.4 | 23.7 | - | - | 62.2 | 7.1 | 51.0 | 41.2 | 31.3 | 21.4 | - | - | | |
| | 67 | 57.3 | 6.4 | 57.3 | 51.6 | 43.1 | 33.1 | 23.1 | - | 50.9 | 7.1 | 50.9 | 49.0 | 41.1 | 30.9 | 20.7 | - | | |
| | 62 | 60.8 | 6.5 | 60.8 | 57.0 | 52.8 | 42.6 | 32.4 | 22.1 | 57.0 | 7.2 | 57.0 | 54.1 | 50.8 | 40.3 | 29.8 | 19.3 | | |
| 2100 | 77 | 72.8 | 6.4 | 55.0 | 39.3 | 23.7 | - | - | - | 67.6 | 7.1 | 52.6 | 36.7 | 20.8 | - | - | - | | |
| | 72 | 66.8 | 6.4 | 57.4 | 46.3 | 35.2 | 24.0 | - | - | 61.0 | 7.1 | 54.6 | 43.5 | 32.5 | 21.5 | - | - | | |
| | 67 | 60.8 | 6.4 | 59.8 | 53.2 | 46.6 | 35.2 | 23.9 | - | 54.4 | 7.1 | 54.4 | 50.4 | 44.2 | 32.8 | 21.3 | - | | |
| | 62 | 60.8 | 6.5 | 60.8 | 60.8 | 58.0 | 46.4 | 34.8 | 23.1 | 56.9 | 7.2 | 56.9 | 56.9 | 56.0 | 44.1 | 32.2 | 20.3 | | |
| 2400 | 77 | 68.7 | 6.5 | 63.8 | 43.8 | 23.7 | - | - | - | 61.7 | 7.1 | 60.1 | 40.1 | 20.0 | - | - | - | | |
| | 72 | 66.5 | 6.5 | 61.7 | 49.3 | 36.9 | 24.4 | - | - | 59.8 | 7.1 | 58.1 | 45.9 | 33.7 | 21.5 | - | - | | |
| | 67 | 64.2 | 6.5 | 59.6 | 54.8 | 50.0 | 37.3 | 24.6 | - | 58.0 | 7.1 | 56.1 | 51.8 | 47.4 | 34.7 | 22.0 | - | | |
| | 62 | 60.8 | 6.5 | 60.8 | 60.8 | 60.8 | 50.2 | 37.2 | 24.2 | 56.8 | 7.2 | 56.8 | 56.8 | 56.8 | 47.9 | 34.6 | 21.3 | | |
| 2700 | 77 | 66.1 | 6.5 | 66.1 | 52.3 | 38.6 | 24.8 | - | - | 58.7 | 7.1 | 58.7 | 48.3 | 34.9 | 21.6 | - | - | | |
| | 72 | 67.6 | 6.5 | 59.4 | 56.4 | 53.5 | 39.4 | 25.3 | - | 61.6 | 7.1 | 55.7 | 53.2 | 50.6 | 36.6 | 22.6 | - | | |
| | 67 | 60.8 | 6.5 | 60.8 | 60.8 | 60.8 | 54.0 | 39.6 | 25.2 | 56.7 | 7.2 | 56.7 | 56.7 | 56.7 | 51.7 | 37.0 | 22.3 | | |
| | 62 | 60.8 | 6.5 | 60.8 | 60.8 | 60.8 | 57.8 | 42.0 | 26.2 | 56.6 | 7.2 | 56.6 | 56.6 | 56.6 | 55.5 | 39.4 | 23.3 | | |
| 3000 | 77 | 65.8 | 6.5 | 65.8 | 55.3 | 40.3 | 25.2 | - | - | 57.5 | 7.1 | 57.5 | 50.7 | 36.1 | 21.6 | - | - | | |
| | 72 | 65.8 | 6.5 | 65.8 | 55.3 | 40.3 | 25.2 | - | - | 57.5 | 7.1 | 57.5 | 50.7 | 36.1 | 21.6 | - | - | | |
| | 67 | 71.0 | 6.5 | 59.2 | 58.0 | 56.9 | 41.5 | 26.1 | - | 65.2 | 7.2 | 55.2 | 54.5 | 53.8 | 38.5 | 23.2 | - | | |
| | 62 | 60.8 | 6.5 | 60.8 | 60.8 | 60.8 | 57.8 | 42.0 | 26.2 | 56.6 | 7.2 | 56.6 | 56.6 | 56.6 | 55.5 | 39.4 | 23.3 | | |
| 57 | 50.6 | 6.5 | 50.6 | 50.6 | 50.6 | 50.6 | 50.6 | 34.2 | 48.0 | 7.2 | 48.0 | 48.0 | 48.0 | 48.0 | 48.0 | 27.4 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 56: ZY08 (7.5 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | 85°F | | | | | | | |
| 1875 | 77 | 110.1 | 5.0 | 54.4 | 45.7 | 37.0 | - | - | - | 104.3 | 5.7 | 50.7 | 42.7 | 34.8 | - | - | - |
| | 72 | 103.8 | 5.0 | 68.9 | 58.4 | 47.9 | 37.4 | - | - | 97.8 | 5.7 | 66.6 | 56.1 | 45.6 | 35.1 | - | - |
| | 67 | 97.5 | 5.1 | 83.4 | 71.1 | 58.9 | 48.8 | 38.5 | - | 91.3 | 5.7 | 82.4 | 69.4 | 56.4 | 46.3 | 36.1 | - |
| | 62 | 95.1 | 5.1 | 95.1 | 84.5 | 69.8 | 59.6 | 50.0 | 40.1 | 89.2 | 5.7 | 89.2 | 79.5 | 67.2 | 57.2 | 47.5 | 37.6 |
| 2250 | 77 | 113.0 | 5.0 | 62.1 | 49.9 | 37.8 | - | - | - | 106.4 | 5.7 | 59.4 | 47.3 | 35.3 | - | - | - |
| | 72 | 106.7 | 5.0 | 75.9 | 63.5 | 51.1 | 38.7 | - | - | 100.5 | 5.7 | 73.4 | 61.0 | 48.6 | 36.2 | - | - |
| | 67 | 100.4 | 5.1 | 89.7 | 77.1 | 64.5 | 52.3 | 39.8 | - | 94.5 | 5.7 | 87.4 | 74.6 | 61.9 | 49.6 | 37.2 | - |
| | 62 | 98.4 | 5.1 | 94.8 | 89.6 | 77.8 | 65.3 | 53.3 | 41.0 | 92.8 | 5.7 | 90.5 | 84.8 | 75.2 | 62.8 | 50.7 | 38.4 |
| 2625 | 57 | 96.4 | 5.1 | 96.4 | 96.4 | 91.2 | 79.0 | 66.7 | 54.5 | 91.1 | 5.8 | 91.1 | 91.1 | 88.5 | 76.3 | 64.1 | 52.0 |
| | 77 | 116.0 | 5.0 | 69.8 | 54.2 | 38.5 | - | - | - | 108.6 | 5.7 | 68.1 | 51.9 | 35.8 | - | - | - |
| | 72 | 109.7 | 5.1 | 82.9 | 68.6 | 54.3 | 40.0 | - | - | 103.1 | 5.7 | 80.3 | 65.9 | 51.6 | 37.2 | - | - |
| | 67 | 103.4 | 5.1 | 95.9 | 83.0 | 70.1 | 55.7 | 41.2 | - | 97.7 | 5.7 | 92.4 | 79.9 | 67.4 | 52.9 | 38.4 | - |
| 3000 | 62 | 101.8 | 5.1 | 99.8 | 94.6 | 85.9 | 71.0 | 56.6 | 41.9 | 96.4 | 5.7 | 94.8 | 90.1 | 83.2 | 68.4 | 53.9 | 39.2 |
| | 57 | 100.2 | 5.1 | 100.2 | 100.2 | 97.6 | 86.8 | 72.0 | 57.1 | 95.0 | 5.8 | 95.0 | 95.0 | 95.0 | 84.2 | 69.4 | 54.6 |
| | 77 | 119.0 | 5.0 | 77.5 | 58.4 | 39.3 | - | - | - | 110.7 | 5.7 | 76.9 | 56.5 | 36.2 | - | - | - |
| | 72 | 112.7 | 5.1 | 89.9 | 73.7 | 57.5 | 41.3 | - | - | 105.8 | 5.7 | 87.1 | 70.8 | 54.5 | 38.2 | - | - |
| 3375 | 67 | 106.3 | 5.1 | 102.2 | 89.0 | 75.7 | 59.2 | 42.5 | - | 100.9 | 5.7 | 97.3 | 85.1 | 72.8 | 56.2 | 39.5 | - |
| | 62 | 105.1 | 5.1 | 103.6 | 99.6 | 93.9 | 76.7 | 59.8 | 42.8 | 99.9 | 5.7 | 98.8 | 95.4 | 91.1 | 74.0 | 57.1 | 40.0 |
| | 57 | 104.0 | 5.1 | 104.0 | 104.0 | 104.0 | 94.6 | 77.2 | 59.7 | 99.0 | 5.8 | 99.0 | 99.0 | 99.0 | 92.0 | 74.6 | 57.2 |
| | 72 | 115.6 | 5.1 | 96.9 | 78.8 | 60.7 | 42.6 | - | - | 108.5 | 5.7 | 94.0 | 75.7 | 57.5 | 39.3 | - | - |
| 3750 | 67 | 109.2 | 5.1 | 105.5 | 94.9 | 81.3 | 62.6 | 43.8 | - | 104.1 | 5.7 | 102.1 | 90.3 | 78.3 | 59.5 | 40.7 | - |
| | 62 | 108.5 | 5.1 | 106.7 | 104.6 | 101.9 | 82.4 | 63.1 | 43.7 | 103.5 | 5.7 | 102.2 | 100.7 | 99.1 | 79.6 | 60.2 | 40.8 |
| | 57 | 107.7 | 5.1 | 107.0 | 107.0 | 107.0 | 102.5 | 82.4 | 62.3 | 102.9 | 5.7 | 102.8 | 102.8 | 102.8 | 99.9 | 79.8 | 59.8 |
| | 72 | 118.6 | 5.1 | 103.9 | 83.9 | 63.9 | 44.0 | - | - | 111.2 | 5.7 | 100.8 | 80.6 | 60.5 | 40.3 | - | - |
| 3750 | 67 | 112.2 | 5.1 | 108.9 | 100.8 | 86.9 | 66.1 | 45.2 | - | 107.3 | 5.7 | 104.8 | 95.5 | 83.8 | 62.8 | 41.8 | - |
| | 62 | 111.8 | 5.1 | 109.4 | 109.4 | 109.4 | 88.2 | 66.4 | 44.6 | 107.1 | 5.7 | 104.9 | 104.9 | 104.9 | 85.3 | 63.4 | 41.6 |
| | 57 | 111.5 | 5.1 | 111.3 | 111.3 | 111.3 | 110.3 | 87.6 | 64.9 | 106.9 | 5.7 | 106.8 | 106.8 | 106.8 | 106.8 | 85.1 | 62.4 |
| | | | 95°F | | | | | | | | 105°F | | | | | | |
| 1875 | 77 | 98.5 | 6.4 | 47.0 | 39.8 | 32.6 | - | - | - | 91.5 | 7.4 | 45.3 | 38.5 | 31.8 | - | - | - |
| | 72 | 91.8 | 6.4 | 64.2 | 53.8 | 43.3 | 32.8 | - | - | 85.3 | 7.4 | 62.3 | 52.0 | 41.6 | 31.2 | - | - |
| | 67 | 85.1 | 6.4 | 81.5 | 67.7 | 53.9 | 43.8 | 33.6 | - | 79.2 | 7.4 | 77.2 | 65.4 | 51.4 | 41.4 | 31.3 | - |
| | 62 | 83.4 | 6.4 | 83.4 | 74.5 | 64.6 | 54.8 | 45.0 | 35.2 | 77.7 | 7.4 | 77.7 | 69.8 | 61.2 | 51.5 | 41.8 | 32.1 |
| 2250 | 77 | 99.8 | 6.4 | 56.7 | 44.8 | 32.8 | - | - | - | 92.9 | 7.4 | 54.4 | 42.8 | 31.1 | - | - | - |
| | 72 | 94.2 | 6.4 | 70.9 | 58.5 | 46.0 | 33.6 | - | - | 87.8 | 7.4 | 68.3 | 56.1 | 43.9 | 31.7 | - | - |
| | 67 | 88.6 | 6.4 | 85.1 | 72.2 | 59.3 | 46.9 | 34.6 | - | 82.7 | 7.4 | 79.8 | 69.4 | 56.6 | 44.4 | 32.2 | - |
| | 62 | 87.2 | 6.4 | 85.4 | 80.1 | 72.5 | 60.3 | 48.1 | 35.9 | 81.5 | 7.4 | 80.0 | 75.4 | 69.4 | 57.2 | 44.9 | 32.7 |
| 2625 | 57 | 85.7 | 6.5 | 85.7 | 85.7 | 85.7 | 73.6 | 61.5 | 49.4 | 80.3 | 7.4 | 80.3 | 80.3 | 80.3 | 69.9 | 57.6 | 45.4 |
| | 77 | 101.1 | 6.4 | 66.5 | 49.7 | 33.0 | - | - | - | 94.3 | 7.4 | 63.6 | 47.0 | 30.5 | - | - | - |
| | 72 | 96.6 | 6.4 | 77.6 | 63.2 | 48.8 | 34.4 | - | - | 90.2 | 7.4 | 74.3 | 60.3 | 46.2 | 32.1 | - | - |
| | 67 | 92.1 | 6.4 | 88.8 | 76.7 | 64.6 | 50.1 | 35.6 | - | 86.2 | 7.4 | 83.9 | 73.5 | 61.9 | 47.5 | 33.1 | - |
| 3000 | 62 | 91.0 | 6.4 | 89.7 | 85.7 | 80.4 | 65.8 | 51.2 | 36.5 | 85.3 | 7.4 | 84.0 | 81.1 | 77.6 | 62.8 | 48.0 | 33.3 |
| | 57 | 89.9 | 6.5 | 89.9 | 89.9 | 89.9 | 81.5 | 66.8 | 52.1 | 84.3 | 7.4 | 84.1 | 84.1 | 84.1 | 78.1 | 63.0 | 47.9 |
| | 77 | 102.4 | 6.4 | 76.2 | 54.7 | 33.1 | - | - | - | 95.7 | 7.4 | 72.7 | 51.3 | 29.9 | - | - | - |
| | 72 | 99.0 | 6.4 | 84.3 | 67.9 | 51.5 | 35.1 | - | - | 92.7 | 7.4 | 80.3 | 64.4 | 48.5 | 32.6 | - | - |
| 3375 | 67 | 95.5 | 6.4 | 92.5 | 81.2 | 70.0 | 53.2 | 36.5 | - | 89.7 | 7.4 | 86.9 | 77.5 | 67.1 | 50.5 | 33.9 | - |
| | 62 | 94.8 | 6.4 | 94.0 | 91.2 | 88.4 | 71.3 | 54.3 | 37.2 | 89.0 | 7.4 | 87.7 | 86.7 | 85.7 | 68.5 | 51.2 | 33.9 |
| | 57 | 94.0 | 6.5 | 94.0 | 94.0 | 94.0 | 89.4 | 72.0 | 54.7 | 88.4 | 7.4 | 88.4 | 88.4 | 88.4 | 86.4 | 68.4 | 50.4 |
| | 72 | 101.4 | 6.4 | 91.0 | 72.7 | 54.3 | 35.9 | - | - | 95.2 | 7.4 | 86.3 | 68.6 | 50.8 | 33.1 | - | - |
| 3750 | 67 | 99.0 | 6.4 | 96.2 | 85.7 | 75.3 | 56.4 | 37.5 | - | 93.2 | 7.4 | 90.8 | 81.6 | 72.4 | 53.6 | 34.8 | - |
| | 62 | 98.6 | 6.4 | 97.2 | 96.8 | 96.3 | 76.8 | 57.4 | 37.9 | 92.8 | 7.4 | 90.9 | 90.9 | 90.9 | 74.1 | 54.3 | 34.5 |
| | 57 | 98.1 | 6.4 | 98.1 | 98.1 | 98.1 | 97.3 | 77.3 | 57.3 | 92.4 | 7.4 | 92.4 | 92.4 | 92.4 | 92.4 | 73.8 | 52.9 |
| | 72 | 103.8 | 6.4 | 97.7 | 77.4 | 57.1 | 36.7 | - | - | 97.6 | 7.4 | 92.3 | 72.7 | 53.1 | 33.5 | - | - |
| 3750 | 67 | 102.5 | 6.4 | 99.8 | 90.2 | 80.6 | 59.5 | 38.4 | - | 96.7 | 7.4 | 93.6 | 85.6 | 77.6 | 56.6 | 35.7 | - |
| | 62 | 102.4 | 6.4 | 100.4 | 100.4 | 100.4 | 82.4 | 60.5 | 38.6 | 96.6 | 7.4 | 94.0 | 94.0 | 94.0 | 79.7 | 57.4 | 35.1 |
| | 57 | 102.2 | 6.4 | 102.1 | 102.1 | 102.1 | 102.1 | 82.5 | 59.9 | 96.5 | 7.4 | 94.3 | 94.3 | 94.3 | 79.2 | 55.5 | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 57: ZY08 (7.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 1875 | 77 | 84.4 | 8.5 | 43.5 | 37.2 | 30.9 | - | - | - | 77.4 | 9.6 | 41.7 | 35.9 | 30.0 | - | - | - |
| | 72 | 78.8 | 8.5 | 60.4 | 50.1 | 39.9 | 29.6 | - | - | 72.3 | 9.5 | 58.5 | 48.3 | 38.2 | 28.0 | - | - |
| | 67 | 73.2 | 8.5 | 71.8 | 63.1 | 48.9 | 38.9 | 29.0 | - | 67.3 | 9.5 | 66.0 | 60.8 | 46.3 | 36.5 | 26.6 | - |
| | 62 | 72.0 | 8.5 | 72.0 | 65.1 | 57.9 | 48.2 | 38.6 | 29.0 | 66.4 | 9.5 | 66.4 | 60.3 | 54.5 | 44.9 | 35.4 | 25.9 |
| 2250 | 77 | 85.9 | 8.5 | 52.1 | 40.8 | 29.5 | - | - | - | 79.0 | 9.5 | 49.7 | 38.8 | 27.8 | - | - | - |
| | 72 | 81.4 | 8.5 | 65.7 | 53.7 | 41.7 | 29.8 | - | - | 74.9 | 9.5 | 63.1 | 51.3 | 39.6 | 27.9 | - | - |
| | 67 | 76.8 | 8.4 | 74.3 | 66.7 | 54.0 | 41.9 | 29.8 | - | 70.9 | 9.5 | 69.0 | 63.9 | 51.4 | 39.4 | 27.3 | - |
| | 62 | 75.8 | 8.4 | 74.7 | 70.8 | 66.3 | 54.0 | 41.7 | 29.5 | 70.1 | 9.4 | 69.1 | 66.1 | 63.2 | 50.9 | 38.6 | 26.3 |
| 2625 | 57 | 74.8 | 8.4 | 74.8 | 74.8 | 74.8 | 66.1 | 53.7 | 41.3 | 69.4 | 9.4 | 69.4 | 69.4 | 69.4 | 62.4 | 49.8 | 37.2 |
| | 77 | 87.5 | 8.4 | 60.6 | 44.3 | 28.1 | - | - | - | 80.6 | 9.5 | 57.7 | 41.7 | 25.6 | - | - | - |
| | 72 | 83.9 | 8.4 | 71.0 | 57.3 | 43.6 | 29.9 | - | - | 77.5 | 9.5 | 67.7 | 54.3 | 41.0 | 27.7 | - | - |
| | 67 | 80.3 | 8.4 | 78.0 | 70.3 | 59.2 | 44.8 | 30.5 | - | 74.4 | 9.4 | 72.0 | 67.0 | 56.4 | 42.2 | 28.0 | - |
| | 62 | 79.5 | 8.4 | 78.4 | 76.5 | 74.7 | 59.8 | 44.9 | 30.0 | 73.8 | 9.4 | 72.1 | 72.0 | 71.8 | 56.8 | 41.7 | 26.7 |
| 3000 | 57 | 78.8 | 8.4 | 78.8 | 78.8 | 78.8 | 74.7 | 59.2 | 43.7 | 73.2 | 9.4 | 73.2 | 73.2 | 73.2 | 71.3 | 55.5 | 39.6 |
| | 77 | 89.0 | 8.4 | 69.2 | 47.9 | 26.6 | - | - | - | 82.2 | 9.4 | 65.7 | 44.6 | 23.4 | - | - | - |
| | 72 | 86.4 | 8.4 | 76.3 | 60.9 | 45.5 | 30.0 | - | - | 80.1 | 9.4 | 72.3 | 57.4 | 42.4 | 27.5 | - | - |
| | 67 | 83.9 | 8.4 | 81.8 | 73.8 | 64.3 | 47.8 | 31.3 | - | 78.0 | 9.4 | 76.6 | 70.2 | 61.5 | 45.1 | 28.7 | - |
| | 62 | 83.3 | 8.4 | 82.0 | 82.0 | 82.0 | 65.6 | 48.0 | 30.5 | 77.6 | 9.4 | 76.9 | 76.9 | 76.9 | 62.7 | 44.9 | 27.1 |
| 3375 | 57 | 82.7 | 8.4 | 82.7 | 82.7 | 82.7 | 64.8 | 46.2 | - | 77.1 | 9.3 | 77.1 | 77.1 | 77.1 | 77.1 | 61.1 | 41.9 |
| | 72 | 88.9 | 8.4 | 81.6 | 64.5 | 47.3 | 30.2 | - | - | 82.7 | 9.4 | 76.9 | 60.4 | 43.8 | 27.3 | - | - |
| | 67 | 87.4 | 8.4 | 85.4 | 77.4 | 69.4 | 50.8 | 32.1 | - | 81.6 | 9.4 | 80.0 | 73.3 | 66.5 | 48.0 | 29.4 | - |
| | 62 | 87.1 | 8.4 | 85.9 | 85.9 | 85.9 | 71.4 | 51.2 | 31.0 | 81.3 | 9.3 | 80.5 | 80.5 | 80.5 | 68.6 | 48.1 | 27.6 |
| 3750 | 57 | 86.7 | 8.3 | 86.7 | 86.7 | 86.7 | 70.3 | 48.6 | - | 81.0 | 9.3 | 81.0 | 81.0 | 81.0 | 81.0 | 66.8 | 44.2 |
| | 72 | 91.5 | 8.4 | 86.9 | 68.0 | 49.2 | 30.3 | - | - | 85.3 | 9.3 | 81.5 | 63.4 | 45.2 | 27.1 | - | - |
| | 67 | 90.9 | 8.4 | 89.9 | 81.0 | 74.6 | 53.7 | 32.9 | - | 85.2 | 9.3 | 84.4 | 76.4 | 71.5 | 50.8 | 30.1 | - |
| | 62 | 90.8 | 8.3 | 90.5 | 90.5 | 90.5 | 77.1 | 54.3 | 31.5 | 85.0 | 9.3 | 84.8 | 84.8 | 84.8 | 74.5 | 51.3 | 28.0 |
| 57 | 90.7 | 8.3 | 90.7 | 90.7 | 90.7 | 75.8 | 51.0 | - | 84.9 | 9.3 | 84.9 | 84.9 | 84.9 | 84.9 | 72.4 | 46.6 | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 58: ZY09 (8.5 ton, 75°F to 105°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 2125 | 77 | 129.6 | 5.9 | 67.0 | 57.1 | 47.1 | - | - | - | 123.8 | 6.5 | 64.6 | 54.4 | 44.2 | - | - | - | | |
| | 72 | 121.7 | 5.8 | 83.1 | 71.2 | 59.2 | 47.2 | - | - | 116.0 | 6.5 | 80.7 | 68.5 | 56.3 | 44.1 | - | - | | |
| | 67 | 113.7 | 5.8 | 99.3 | 85.3 | 71.2 | 58.7 | 46.8 | - | 108.2 | 6.5 | 96.7 | 82.6 | 68.4 | 56.0 | 43.9 | - | | |
| | 62 | 112.3 | 5.7 | 107.4 | 95.3 | 83.3 | 67.6 | 58.5 | 46.0 | 106.3 | 6.5 | 102.3 | 91.4 | 80.6 | 66.6 | 55.9 | 43.6 | | |
| 2550 | 77 | 132.2 | 5.9 | 75.2 | 60.8 | 46.4 | - | - | - | 125.7 | 6.6 | 73.3 | 58.6 | 43.9 | - | - | - | | |
| | 72 | 124.6 | 5.9 | 90.1 | 75.9 | 61.6 | 47.3 | - | - | 118.6 | 6.5 | 87.7 | 73.3 | 58.9 | 44.6 | - | - | | |
| | 67 | 117.1 | 5.8 | 105.1 | 90.9 | 76.8 | 61.9 | 47.6 | - | 111.5 | 6.5 | 102.0 | 88.0 | 74.0 | 59.3 | 44.8 | - | | |
| | 62 | 115.5 | 5.8 | 111.5 | 101.8 | 92.1 | 74.4 | 62.1 | 47.1 | 109.8 | 6.5 | 106.5 | 97.8 | 89.1 | 72.9 | 59.4 | 44.5 | | |
| 2975 | 77 | 134.7 | 6.0 | 83.4 | 64.5 | 45.6 | - | - | - | 127.6 | 6.6 | 82.0 | 62.8 | 43.6 | - | - | - | | |
| | 72 | 127.6 | 5.9 | 97.1 | 80.6 | 64.0 | 47.5 | - | - | 121.3 | 6.6 | 94.6 | 78.1 | 61.6 | 45.1 | - | - | | |
| | 67 | 120.5 | 5.8 | 110.8 | 96.6 | 82.4 | 65.2 | 48.3 | - | 114.9 | 6.5 | 107.2 | 93.4 | 79.6 | 62.5 | 45.7 | - | | |
| | 62 | 118.7 | 5.8 | 115.7 | 108.3 | 100.8 | 81.3 | 65.7 | 48.1 | 113.2 | 6.5 | 110.6 | 104.1 | 97.6 | 79.2 | 62.8 | 45.3 | | |
| 3400 | 77 | 137.3 | 6.0 | 91.5 | 68.2 | 44.8 | - | - | - | 129.5 | 6.6 | 90.7 | 67.0 | 43.3 | - | - | - | | |
| | 72 | 130.6 | 5.9 | 104.1 | 85.2 | 66.4 | 47.6 | - | - | 123.9 | 6.6 | 101.6 | 82.9 | 64.2 | 45.6 | - | - | | |
| | 67 | 123.9 | 5.8 | 116.6 | 102.3 | 88.0 | 68.4 | 49.0 | - | 118.3 | 6.6 | 112.4 | 98.8 | 85.2 | 65.8 | 46.5 | - | | |
| | 62 | 121.9 | 5.8 | 119.9 | 114.7 | 109.6 | 88.1 | 69.3 | 49.1 | 116.7 | 6.5 | 114.8 | 110.4 | 106.1 | 85.5 | 66.2 | 46.2 | | |
| 3825 | 77 | 133.6 | 6.0 | 111.0 | 89.9 | 68.8 | 47.7 | - | - | 126.5 | 6.6 | 108.5 | 87.7 | 66.9 | 46.1 | - | - | | |
| | 72 | 127.3 | 5.9 | 122.4 | 108.0 | 93.6 | 71.6 | 49.7 | - | 121.6 | 6.6 | 117.6 | 104.2 | 90.7 | 69.0 | 47.4 | - | | |
| | 67 | 125.1 | 5.9 | 124.1 | 121.2 | 118.3 | 94.9 | 72.8 | 50.1 | 120.1 | 6.6 | 118.9 | 116.8 | 114.6 | 91.7 | 69.6 | 47.1 | | |
| | 62 | 124.6 | 5.9 | 124.6 | 124.6 | 124.6 | 119.5 | 96.0 | 72.4 | 119.5 | 6.5 | 119.5 | 119.5 | 119.5 | 115.1 | 91.7 | 68.4 | | |
| 4250 | 77 | 136.6 | 6.0 | 118.0 | 94.6 | 71.2 | 47.8 | - | - | 129.2 | 6.6 | 115.5 | 92.5 | 69.5 | 46.5 | - | - | | |
| | 72 | 130.7 | 5.9 | 128.2 | 113.6 | 99.1 | 74.8 | 50.4 | - | 125.0 | 6.6 | 122.8 | 109.6 | 96.3 | 72.3 | 48.3 | - | | |
| | 67 | 128.2 | 5.9 | 128.2 | 127.6 | 127.0 | 101.7 | 76.4 | 51.1 | 123.5 | 6.6 | 123.1 | 123.1 | 123.1 | 98.0 | 73.0 | 47.9 | | |
| | 62 | 128.2 | 5.9 | 128.2 | 128.2 | 128.2 | 128.2 | 102.4 | 76.2 | 123.3 | 6.6 | 123.3 | 123.3 | 123.3 | 123.3 | 97.7 | 71.6 | | |
| | | 95°F | | | | | | | | | 105°F | | | | | | | | |
| 2125 | 77 | 118.0 | 7.2 | 62.3 | 51.7 | 41.2 | - | - | - | 110.3 | 8.4 | 62.5 | 50.8 | 39.2 | - | - | - | | |
| | 72 | 110.3 | 7.2 | 78.2 | 65.8 | 53.4 | 41.0 | - | - | 103.8 | 8.4 | 76.1 | 63.6 | 51.0 | 38.4 | - | - | | |
| | 67 | 102.6 | 7.3 | 94.2 | 79.9 | 65.6 | 53.3 | 41.0 | - | 97.2 | 8.4 | 89.8 | 76.3 | 62.8 | 50.4 | 38.0 | - | | |
| | 62 | 100.4 | 7.2 | 97.3 | 87.6 | 77.9 | 65.7 | 53.4 | 41.2 | 94.8 | 8.3 | 91.9 | 83.2 | 74.6 | 62.4 | 50.3 | 38.1 | | |
| 2550 | 77 | 119.2 | 7.2 | 71.5 | 56.4 | 41.4 | - | - | - | 111.4 | 8.4 | 70.7 | 54.7 | 38.6 | - | - | - | | |
| | 72 | 112.6 | 7.2 | 85.2 | 70.7 | 56.3 | 41.8 | - | - | 105.7 | 8.4 | 82.3 | 67.8 | 53.4 | 38.9 | - | - | | |
| | 67 | 106.0 | 7.3 | 98.9 | 85.0 | 71.2 | 56.6 | 42.0 | - | 100.1 | 8.4 | 93.9 | 81.0 | 68.1 | 53.5 | 38.9 | - | | |
| | 62 | 104.1 | 7.2 | 101.4 | 93.8 | 86.1 | 71.4 | 56.7 | 41.9 | 98.1 | 8.3 | 95.7 | 89.3 | 82.9 | 68.1 | 53.4 | 38.6 | | |
| 2975 | 77 | 120.5 | 7.2 | 80.7 | 61.1 | 41.6 | - | - | - | 112.5 | 8.4 | 78.9 | 58.5 | 38.1 | - | - | - | | |
| | 72 | 114.9 | 7.3 | 92.1 | 75.6 | 59.2 | 42.7 | - | - | 107.7 | 8.4 | 88.5 | 72.1 | 55.8 | 39.5 | - | - | | |
| | 67 | 109.3 | 7.3 | 103.5 | 90.2 | 76.8 | 59.9 | 43.0 | - | 102.9 | 8.4 | 98.0 | 85.7 | 73.5 | 56.7 | 39.8 | - | | |
| | 62 | 107.8 | 7.2 | 105.5 | 99.9 | 94.4 | 77.1 | 59.9 | 42.6 | 101.4 | 8.3 | 99.4 | 95.3 | 91.2 | 73.8 | 56.5 | 39.2 | | |
| 3400 | 77 | 121.8 | 7.3 | 89.9 | 65.8 | 41.8 | - | - | - | 113.6 | 8.4 | 87.2 | 62.4 | 37.6 | - | - | - | | |
| | 72 | 117.2 | 7.3 | 99.1 | 80.6 | 62.1 | 43.5 | - | - | 109.7 | 8.4 | 94.6 | 76.4 | 58.2 | 40.0 | - | - | | |
| | 67 | 112.6 | 7.3 | 108.2 | 95.3 | 82.3 | 63.2 | 44.1 | - | 105.8 | 8.4 | 102.1 | 90.5 | 78.8 | 59.8 | 40.7 | - | | |
| | 62 | 111.4 | 7.2 | 109.7 | 106.1 | 102.6 | 82.8 | 63.1 | 43.3 | 104.6 | 8.4 | 103.1 | 101.3 | 99.5 | 79.6 | 59.7 | 39.7 | | |
| 3825 | 77 | 110.3 | 7.2 | 110.2 | 110.2 | 110.2 | 102.5 | 82.1 | 61.7 | 103.5 | 8.3 | 103.5 | 103.5 | 103.5 | 99.3 | 78.6 | 57.8 | | |
| | 72 | 119.5 | 7.3 | 106.0 | 85.5 | 64.9 | 44.4 | - | - | 111.6 | 8.4 | 100.8 | 80.7 | 60.6 | 40.6 | - | - | | |
| | 67 | 116.0 | 7.3 | 112.9 | 100.4 | 87.9 | 66.5 | 45.1 | - | 108.6 | 8.4 | 106.2 | 95.2 | 84.2 | 62.9 | 41.6 | - | | |
| | 62 | 115.1 | 7.3 | 113.8 | 112.3 | 110.8 | 88.6 | 66.3 | 44.0 | 107.9 | 8.4 | 106.8 | 106.8 | 106.8 | 85.3 | 62.8 | 40.3 | | |
| 4250 | 77 | 114.3 | 7.2 | 114.3 | 114.3 | 114.3 | 110.7 | 87.5 | 64.4 | 107.2 | 8.3 | 107.2 | 107.2 | 107.2 | 107.2 | 83.9 | 60.2 | | |
| | 72 | 121.8 | 7.3 | 112.9 | 90.4 | 67.8 | 45.3 | - | - | 113.6 | 8.4 | 107.0 | 85.0 | 63.1 | 41.1 | - | - | | |
| | 67 | 119.3 | 7.3 | 117.5 | 105.5 | 93.5 | 69.8 | 46.1 | - | 111.5 | 8.4 | 110.3 | 99.9 | 89.6 | 66.1 | 42.6 | - | | |
| | 62 | 118.8 | 7.3 | 117.9 | 117.9 | 117.9 | 94.3 | 69.5 | 44.7 | 111.2 | 8.4 | 110.6 | 110.6 | 110.6 | 91.0 | 65.9 | 40.8 | | |
| 57 | 118.4 | 7.2 | 118.4 | 118.4 | 118.4 | 118.4 | 92.9 | 67.0 | 110.8 | 8.3 | 110.8 | 110.8 | 110.8 | 89.3 | 62.6 | - | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 59: ZY09 (8.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|-------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | | | | | 125°F | | | | | |
| 2125 | 77 | 102.7 | 9.5 | 62.7 | 49.9 | 37.1 | - | - | - | 95.1 | 10.7 | 62.9 | 49.0 | 35.1 | - | - | - | | |
| | 72 | 97.3 | 9.5 | 74.1 | 61.3 | 48.5 | 35.7 | - | - | 90.7 | 10.6 | 72.0 | 59.0 | 46.1 | 33.1 | - | - | | |
| | 67 | 91.8 | 9.5 | 85.4 | 72.7 | 59.9 | 47.5 | 35.0 | - | 86.4 | 10.6 | 81.0 | 69.0 | 57.0 | 44.5 | 32.0 | - | | |
| | 62 | 89.3 | 9.4 | 86.6 | 78.9 | 71.3 | 59.2 | 47.1 | 35.0 | 83.7 | 10.6 | 81.3 | 74.6 | 67.9 | 55.9 | 43.9 | 31.9 | | |
| 2550 | 77 | 103.6 | 9.5 | 69.9 | 52.9 | 35.9 | - | - | - | 95.8 | 10.7 | 69.1 | 51.2 | 33.2 | - | - | - | | |
| | 72 | 98.9 | 9.5 | 79.4 | 65.0 | 50.5 | 36.0 | - | - | 92.0 | 10.6 | 76.6 | 62.1 | 47.6 | 33.1 | - | - | | |
| | 67 | 94.1 | 9.5 | 89.0 | 77.0 | 65.0 | 50.4 | 35.8 | - | 88.2 | 10.6 | 84.0 | 73.0 | 62.0 | 47.3 | 32.7 | - | | |
| | 62 | 92.1 | 9.4 | 89.9 | 84.8 | 79.6 | 64.9 | 50.1 | 35.4 | 86.2 | 10.6 | 84.2 | 80.3 | 76.4 | 61.6 | 46.9 | 32.1 | | |
| 2975 | 77 | 104.5 | 9.5 | 77.2 | 55.9 | 34.7 | - | - | - | 96.5 | 10.6 | 75.4 | 53.3 | 31.2 | - | - | - | | |
| | 72 | 100.5 | 9.5 | 84.8 | 68.6 | 52.4 | 36.2 | - | - | 93.3 | 10.6 | 81.2 | 65.1 | 49.1 | 33.0 | - | - | | |
| | 67 | 96.5 | 9.5 | 92.5 | 81.3 | 70.2 | 53.4 | 36.6 | - | 90.1 | 10.6 | 87.0 | 76.9 | 66.9 | 50.2 | 33.4 | - | | |
| | 62 | 95.0 | 9.5 | 93.2 | 90.6 | 88.0 | 70.6 | 53.2 | 35.8 | 88.6 | 10.6 | 87.1 | 85.9 | 84.8 | 67.3 | 49.8 | 32.3 | | |
| 3400 | 77 | 105.4 | 9.5 | 84.4 | 58.9 | 33.4 | - | - | - | 97.1 | 10.6 | 81.7 | 55.5 | 29.3 | - | - | - | | |
| | 72 | 102.1 | 9.5 | 90.2 | 72.3 | 54.4 | 36.5 | - | - | 94.6 | 10.6 | 85.8 | 68.2 | 50.6 | 33.0 | - | - | | |
| | 67 | 98.9 | 9.5 | 96.0 | 85.7 | 75.4 | 56.4 | 37.4 | - | 92.0 | 10.6 | 89.9 | 80.9 | 71.9 | 53.0 | 34.1 | - | | |
| | 62 | 97.8 | 9.5 | 96.5 | 96.4 | 96.3 | 76.3 | 56.2 | 36.2 | 91.0 | 10.6 | 90.0 | 90.0 | 90.0 | 73.0 | 52.8 | 32.6 | | |
| 3825 | 77 | 103.8 | 9.5 | 95.6 | 76.0 | 56.4 | 36.8 | - | - | 95.9 | 10.6 | 90.4 | 71.2 | 52.1 | 32.9 | - | - | | |
| | 72 | 101.3 | 9.5 | 99.5 | 90.0 | 80.5 | 59.4 | 38.2 | - | 93.9 | 10.6 | 92.9 | 84.8 | 76.8 | 55.8 | 34.8 | - | | |
| | 67 | 100.6 | 9.5 | 99.9 | 99.9 | 99.9 | 82.0 | 59.3 | 36.6 | 93.4 | 10.6 | 92.9 | 92.9 | 92.9 | 78.7 | 55.7 | 32.8 | | |
| | 62 | 100.0 | 9.4 | 100.0 | 100.0 | 100.0 | 80.3 | 56.1 | 36.9 | 92.9 | 10.5 | 92.9 | 92.9 | 92.9 | 92.9 | 76.7 | 51.9 | | |
| 4250 | 77 | 105.4 | 9.5 | 101.0 | 79.7 | 58.3 | 37.0 | - | - | 97.2 | 10.6 | 95.0 | 74.3 | 53.6 | 32.9 | - | - | | |
| | 72 | 103.6 | 9.5 | 103.0 | 94.4 | 85.7 | 62.3 | 39.0 | - | 95.8 | 10.6 | 95.8 | 88.8 | 81.8 | 58.6 | 35.4 | - | | |
| | 67 | 103.5 | 9.5 | 103.2 | 103.2 | 103.2 | 87.7 | 62.3 | 36.9 | 95.8 | 10.6 | 95.8 | 95.8 | 95.8 | 84.4 | 58.7 | 33.0 | | |
| | 62 | 103.3 | 9.4 | 103.3 | 103.3 | 103.3 | 85.6 | 58.2 | 36.9 | 95.8 | 10.5 | 95.8 | 95.8 | 95.8 | 95.8 | 82.0 | 53.8 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 61: ZY12 (10 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 2500 | 77 | 123.9 | 11.4 | 67.3 | 54.6 | 41.8 | - | - | - | 113.8 | 12.7 | 64.8 | 51.4 | 38.0 | - | - | - |
| | 72 | 113.0 | 11.4 | 82.4 | 68.4 | 54.4 | 40.5 | - | - | 104.2 | 12.6 | 79.2 | 64.9 | 50.6 | 36.3 | - | - |
| | 67 | 102.9 | 11.3 | 97.5 | 82.3 | 67.1 | 53.9 | 40.7 | - | 95.8 | 12.6 | 93.5 | 78.3 | 63.2 | 50.1 | 37.0 | - |
| | 62 | 102.2 | 11.4 | 99.8 | 89.7 | 79.7 | 67.3 | 55.0 | 42.7 | 95.8 | 12.7 | 93.7 | 84.7 | 75.7 | 63.9 | 52.0 | 40.1 |
| 3000 | 77 | 123.6 | 11.4 | 77.2 | 59.1 | 40.9 | - | - | - | 113.3 | 12.7 | 74.6 | 55.8 | 37.0 | - | - | - |
| | 72 | 115.4 | 11.4 | 89.8 | 73.4 | 57.1 | 40.8 | - | - | 106.6 | 12.6 | 86.1 | 69.6 | 53.1 | 36.6 | - | - |
| | 67 | 107.2 | 11.3 | 102.3 | 87.8 | 73.3 | 57.4 | 41.5 | - | 99.9 | 12.6 | 97.6 | 83.4 | 69.3 | 53.5 | 37.7 | - |
| | 62 | 106.4 | 11.3 | 104.2 | 96.8 | 89.4 | 74.0 | 58.5 | 43.1 | 99.8 | 12.6 | 97.8 | 91.6 | 85.4 | 70.3 | 55.2 | 40.1 |
| 3500 | 77 | 123.3 | 11.4 | 87.2 | 63.6 | 40.0 | - | - | - | 112.9 | 12.6 | 84.4 | 60.2 | 36.0 | - | - | - |
| | 72 | 117.8 | 11.3 | 97.1 | 78.4 | 59.7 | 41.1 | - | - | 109.0 | 12.6 | 93.1 | 74.4 | 55.7 | 37.0 | - | - |
| | 67 | 111.4 | 11.3 | 107.1 | 93.3 | 79.5 | 60.8 | 42.2 | - | 103.9 | 12.5 | 101.7 | 88.5 | 75.3 | 56.8 | 38.3 | - |
| | 62 | 110.7 | 11.3 | 108.6 | 103.9 | 99.2 | 80.6 | 62.0 | 43.5 | 103.8 | 12.6 | 101.9 | 98.5 | 95.0 | 76.7 | 58.4 | 40.1 |
| 4000 | 77 | 123.0 | 11.4 | 97.1 | 68.1 | 39.2 | - | - | - | 112.5 | 12.6 | 94.3 | 64.6 | 35.0 | - | - | - |
| | 72 | 120.1 | 11.3 | 104.5 | 83.5 | 62.4 | 41.4 | - | - | 111.3 | 12.6 | 100.1 | 79.1 | 58.2 | 37.3 | - | - |
| | 67 | 115.7 | 11.3 | 111.9 | 98.8 | 85.7 | 64.3 | 42.9 | - | 107.9 | 12.5 | 105.9 | 93.6 | 81.4 | 60.2 | 39.0 | - |
| | 62 | 115.0 | 11.3 | 113.1 | 111.0 | 108.9 | 87.2 | 65.6 | 43.9 | 107.8 | 12.5 | 106.0 | 105.3 | 104.6 | 83.1 | 61.7 | 40.2 |
| 4500 | 77 | 122.5 | 11.3 | 111.9 | 88.5 | 65.1 | 41.6 | - | - | 113.7 | 12.5 | 107.0 | 83.9 | 60.7 | 37.6 | - | - |
| | 72 | 119.9 | 11.3 | 116.8 | 104.3 | 91.9 | 67.8 | 43.7 | - | 111.9 | 12.5 | 110.0 | 98.7 | 87.5 | 63.6 | 39.6 | - |
| | 67 | 119.3 | 11.3 | 117.5 | 117.5 | 117.5 | 93.9 | 69.1 | 44.3 | 111.7 | 12.5 | 110.1 | 110.1 | 110.1 | 89.6 | 64.9 | 40.2 |
| | 62 | 118.6 | 11.3 | 117.8 | 117.8 | 117.8 | 117.8 | 94.5 | 69.0 | 111.6 | 12.5 | 110.2 | 110.2 | 110.2 | 110.2 | 90.1 | 64.7 |
| 5000 | 72 | 124.9 | 11.3 | 119.3 | 93.5 | 67.7 | 41.9 | - | - | 116.1 | 12.5 | 114.0 | 88.6 | 63.2 | 37.9 | - | - |
| | 67 | 124.2 | 11.2 | 121.6 | 109.8 | 98.1 | 71.2 | 44.4 | - | 115.9 | 12.4 | 114.1 | 103.8 | 93.6 | 66.9 | 40.3 | - |
| | 62 | 123.6 | 11.2 | 121.9 | 121.9 | 121.9 | 100.5 | 72.6 | 44.7 | 115.7 | 12.4 | 114.2 | 114.2 | 114.2 | 96.0 | 68.1 | 40.2 |
| | 57 | 122.9 | 11.2 | 122.2 | 122.2 | 122.2 | 100.8 | 71.9 | - | 115.6 | 12.4 | 114.3 | 114.3 | 114.3 | 114.3 | 95.9 | 66.8 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

ZL04 to 06 cooling capacities

Table 62: ZL04 (3.0 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | | 85°F | | | | | | |
| 750 | 77 | 47.2 | 2 | 20.4 | 17.2 | 13.9 | - | - | - | 44.6 | 2.3 | 19.4 | 16.1 | 12.9 | - | - | - |
| | 72 | 42.9 | 1.9 | 25.3 | 22 | 18.7 | 15.5 | - | - | 40.6 | 2.2 | 24.2 | 20.9 | 17.7 | 14.5 | - | - |
| | 67 | 38.5 | 1.9 | 30.1 | 26.8 | 23.6 | 20.3 | 17.1 | - | 36.5 | 2.2 | 29 | 25.7 | 22.5 | 19.3 | 16 | - |
| | 62 | 35 | 1.9 | 35 | 32.7 | 28 | 24.8 | 21.5 | 18.3 | 33.3 | 2.2 | 33.3 | 32.1 | 27.2 | 23.9 | 20.7 | 17.5 |
| 900 | 77 | 48.9 | 2 | 22.9 | 19.1 | 15.3 | - | - | - | 46 | 2.3 | 21.7 | 17.9 | 14.1 | - | - | - |
| | 72 | 44.4 | 1.9 | 28.2 | 24.4 | 20.6 | 16.7 | - | - | 41.8 | 2.2 | 27 | 23.2 | 19.4 | 15.6 | - | - |
| | 67 | 39.9 | 1.9 | 33.5 | 29.7 | 25.8 | 22 | 18.2 | - | 37.7 | 2.2 | 32.2 | 28.4 | 24.6 | 20.8 | 17.1 | - |
| | 62 | 36.3 | 1.9 | 36.3 | 34.7 | 30.8 | 26.9 | 23.1 | 19.3 | 34.3 | 2.2 | 34.3 | 33.5 | 29.7 | 26 | 22.2 | 18.4 |
| 1050 | 57 | 33.1 | 1.9 | 33.1 | 33.1 | 30.1 | 26.3 | 22.5 | 18.7 | 32.7 | 2.2 | 32.7 | 32.7 | 29.5 | 25.8 | 22 | 18.2 |
| | 77 | 50.6 | 2 | 25.4 | 21 | 16.6 | - | - | - | 47.4 | 2.3 | 24 | 19.7 | 15.4 | - | - | - |
| | 72 | 45.9 | 2 | 31.2 | 26.8 | 22.4 | 18 | - | - | 43.1 | 2.2 | 29.7 | 25.4 | 21.1 | 16.7 | - | - |
| | 67 | 41.3 | 1.9 | 36.9 | 32.5 | 28.1 | 23.7 | 19.3 | - | 38.8 | 2.2 | 35.4 | 31.1 | 26.8 | 22.4 | 18.1 | - |
| | 62 | 37.5 | 1.9 | 37.5 | 36.8 | 33.5 | 29.1 | 24.7 | 20.3 | 35.3 | 2.2 | 35.3 | 34.9 | 32.3 | 28 | 23.6 | 19.3 |
| 1200 | 57 | 34.3 | 1.9 | 34.3 | 34.3 | 32.8 | 28.4 | 24 | 19.6 | 33.7 | 2.2 | 33.7 | 33.7 | 32.1 | 27.8 | 23.4 | 19.1 |
| | 77 | 52.3 | 2 | 27.9 | 23 | 18 | - | - | - | 48.8 | 2.3 | 26.4 | 21.5 | 16.6 | - | - | - |
| | 72 | 47.5 | 2 | 34.1 | 29.2 | 24.2 | 19.2 | - | - | 44.3 | 2.2 | 32.5 | 27.6 | 22.7 | 17.9 | - | - |
| | 67 | 42.7 | 1.9 | 40.4 | 35.4 | 30.4 | 25.4 | 20.5 | - | 39.9 | 2.2 | 38.7 | 33.8 | 28.9 | 24 | 19.1 | - |
| | 62 | 38.8 | 1.9 | 38.8 | 38.8 | 36.2 | 31.2 | 26.3 | 21.3 | 36.4 | 2.2 | 36.4 | 36.4 | 34.9 | 30 | 25.1 | 20.2 |
| 1350 | 57 | 35.5 | 1.9 | 35.5 | 35.5 | 35.5 | 30.5 | 25.5 | 20.6 | 34.7 | 2.2 | 34.7 | 34.7 | 34.7 | 29.8 | 24.9 | 20 |
| | 72 | 48.4 | 2 | 36.5 | 31.1 | 25.7 | 20.3 | - | - | 45.1 | 2.3 | 35 | 29.6 | 24.3 | 18.9 | - | - |
| | 67 | 43.5 | 1.9 | 42.3 | 37.7 | 32.3 | 26.8 | 21.4 | - | 40.6 | 2.2 | 40 | 36.2 | 30.8 | 25.5 | 20.1 | - |
| | 62 | 39.6 | 1.9 | 39.6 | 39.6 | 38.3 | 32.8 | 27.4 | 22 | 37 | 2.2 | 37 | 37 | 36.3 | 30.9 | 25.6 | 20.2 |
| 1500 | 57 | 36.2 | 1.9 | 36.2 | 36.2 | 30.8 | 25.3 | 19.9 | - | 35.3 | 2.2 | 35.3 | 35.3 | 35.3 | 29.9 | 24.6 | 19.2 |
| | 72 | 49.3 | 2 | 38.8 | 33 | 27.1 | 21.3 | - | - | 45.9 | 2.3 | 37.4 | 31.6 | 25.8 | 20 | - | - |
| | 67 | 44.3 | 2 | 44.3 | 39.9 | 34.1 | 28.3 | 22.4 | - | 41.4 | 2.2 | 41.4 | 38.6 | 32.8 | 26.9 | 21.1 | - |
| | 62 | 40.3 | 1.9 | 40.3 | 40.3 | 40.3 | 34.5 | 28.6 | 22.8 | 37.7 | 2.2 | 37.7 | 37.7 | 37.7 | 31.9 | 26 | 20.2 |
| 57 | 36.8 | 1.9 | 36.8 | 36.8 | 36.8 | 31 | 25.2 | 19.3 | 35.9 | 2.2 | 35.9 | 35.9 | 35.9 | 30.1 | 24.3 | 18.5 | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 63: ZL04 (3.0 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 95°F | | | | | | 105°F | | | | | | | |
| 750 | 77 | 42 | 2.5 | 18.3 | 15.1 | 11.9 | - | - | - | 39 | 2.9 | 16.4 | 13.9 | 10.7 | - | - | - |
| | 72 | 38.3 | 2.5 | 23.1 | 19.9 | 16.7 | 13.4 | - | - | 35.5 | 2.9 | 21.8 | 18.6 | 15.5 | 12.3 | - | - |
| | 67 | 34.6 | 2.5 | 27.9 | 24.6 | 21.4 | 18.2 | 15 | - | 32.1 | 2.8 | 27.1 | 23.4 | 20.2 | 17 | 13.9 | - |
| | 62 | 31.5 | 2.5 | 31.5 | 31.5 | 26.3 | 23.1 | 19.9 | 16.6 | 29.3 | 2.8 | 29.3 | 29.3 | 24.2 | 21 | 17.9 | 14.7 |
| 900 | 77 | 43.1 | 2.5 | 20.5 | 16.7 | 13 | - | - | - | 39.9 | 2.9 | 19.2 | 15.5 | 11.8 | - | - | - |
| | 72 | 39.3 | 2.5 | 25.7 | 21.9 | 18.2 | 14.5 | - | - | 36.4 | 2.9 | 24.4 | 20.7 | 17 | 13.3 | - | - |
| | 67 | 35.4 | 2.5 | 30.9 | 27.2 | 23.4 | 19.7 | 15.9 | - | 32.9 | 2.9 | 29.6 | 25.9 | 22.2 | 18.5 | 14.8 | - |
| | 62 | 32.3 | 2.5 | 32.3 | 32.3 | 28.7 | 25 | 21.2 | 17.5 | 30 | 2.8 | 30 | 30 | 26.5 | 22.8 | 19.2 | 15.5 |
| 1050 | 77 | 44.1 | 2.6 | 22.6 | 18.4 | 14.1 | - | - | - | 40.9 | 2.9 | 21.9 | 17.1 | 12.8 | - | - | - |
| | 72 | 40.2 | 2.5 | 28.3 | 24 | 19.7 | 15.5 | - | - | 37.3 | 2.9 | 26.9 | 22.7 | 18.5 | 14.3 | - | - |
| | 67 | 36.3 | 2.5 | 34 | 29.7 | 25.4 | 21.1 | 16.8 | - | 33.7 | 2.9 | 32 | 28.4 | 24.1 | 19.9 | 15.7 | - |
| | 62 | 33.1 | 2.5 | 33.1 | 33.1 | 31.2 | 26.9 | 22.6 | 18.3 | 30.7 | 2.9 | 30.7 | 30.7 | 28.9 | 24.7 | 20.4 | 16.2 |
| 1200 | 77 | 45.2 | 2.6 | 24.8 | 20 | 15.2 | - | - | - | 41.8 | 2.9 | 24.7 | 18.6 | 13.9 | - | - | - |
| | 72 | 41.2 | 2.5 | 30.9 | 26.1 | 21.3 | 16.5 | - | - | 38.1 | 2.9 | 29.5 | 24.8 | 20 | 15.2 | - | - |
| | 67 | 37.2 | 2.5 | 37 | 32.2 | 27.4 | 22.6 | 17.8 | - | 34.4 | 2.9 | 34.4 | 30.9 | 26.1 | 21.3 | 16.6 | - |
| | 62 | 33.9 | 2.5 | 33.9 | 33.9 | 33.6 | 28.8 | 24 | 19.2 | 31.4 | 2.9 | 31.4 | 31.4 | 31.2 | 26.5 | 21.7 | 16.9 |
| 1350 | 77 | 41.9 | 2.5 | 33.5 | 28.2 | 22.9 | 17.5 | - | - | 38.6 | 2.9 | 32 | 26.7 | 21.5 | 16.2 | - | - |
| | 72 | 37.8 | 2.5 | 37.7 | 34.7 | 29.4 | 24.1 | 18.8 | - | 34.9 | 2.9 | 34.9 | 32.8 | 28.1 | 22.8 | 17.5 | - |
| | 67 | 34.5 | 2.5 | 34.5 | 34.5 | 34.3 | 29 | 23.7 | 18.4 | 31.8 | 2.9 | 31.8 | 31.8 | 31.7 | 26.5 | 21.2 | 16 |
| | 62 | 34.4 | 2.5 | 34.4 | 34.4 | 34.4 | 29.1 | 23.8 | 18.5 | 32.2 | 2.9 | 32.2 | 32.2 | 32.2 | 27 | 21.7 | 16.4 |
| 1500 | 72 | 42.6 | 2.5 | 36 | 30.2 | 24.4 | 18.6 | - | - | 39.2 | 2.9 | 34.5 | 28.7 | 23 | 17.2 | - | - |
| | 67 | 38.4 | 2.5 | 38.4 | 37.2 | 31.4 | 25.6 | 19.8 | - | 35.4 | 2.9 | 35.4 | 34.8 | 30 | 24.3 | 18.5 | - |
| | 62 | 35 | 2.5 | 35 | 35 | 35 | 29.2 | 23.4 | 17.7 | 32.2 | 2.9 | 32.2 | 32.2 | 32.2 | 26.5 | 20.7 | 15 |
| | 57 | 35 | 2.5 | 35 | 35 | 35 | 29.2 | 23.4 | 17.6 | 32.6 | 2.9 | 32.6 | 32.6 | 32.6 | 26.9 | 21.1 | 15.4 |
| | | | | 115°F | | | | | | 125°F | | | | | | | |
| 750 | 77 | 35.9 | 3.3 | 14.5 | 12.7 | 9.6 | - | - | - | 32.9 | 3.6 | 12.6 | 11.5 | 8.5 | - | - | - |
| | 72 | 32.8 | 3.2 | 20.5 | 17.4 | 14.3 | 11.2 | - | - | 30 | 3.6 | 19.2 | 16.1 | 13.1 | 10.1 | - | - |
| | 67 | 29.6 | 3.2 | 26.4 | 22.1 | 19 | 15.9 | 12.8 | - | 27.2 | 3.6 | 25.7 | 20.8 | 17.7 | 14.7 | 11.7 | - |
| | 62 | 27 | 3.2 | 27 | 27 | 22.1 | 19 | 15.9 | 12.8 | 24.7 | 3.6 | 24.7 | 24.7 | 20 | 16.9 | 13.9 | 10.9 |
| 900 | 77 | 36.8 | 3.3 | 17.9 | 14.2 | 10.6 | - | - | - | 33.6 | 3.6 | 16.6 | 13 | 9.4 | - | - | - |
| | 72 | 33.5 | 3.2 | 23 | 19.4 | 15.8 | 12.1 | - | - | 30.7 | 3.6 | 21.7 | 18.1 | 14.5 | 11 | - | - |
| | 67 | 30.3 | 3.2 | 28.2 | 24.6 | 20.9 | 17.3 | 13.6 | - | 27.8 | 3.6 | 26.8 | 23.2 | 19.7 | 16.1 | 12.5 | - |
| | 62 | 27.6 | 3.2 | 27.6 | 27.6 | 24.4 | 20.7 | 17.1 | 13.4 | 25.3 | 3.6 | 25.3 | 25.3 | 22.2 | 18.6 | 15 | 11.4 |
| 1050 | 77 | 37.6 | 3.3 | 21.2 | 15.8 | 11.6 | - | - | - | 34.3 | 3.6 | 20.5 | 14.5 | 10.3 | - | - | - |
| | 72 | 34.3 | 3.3 | 25.6 | 21.4 | 17.2 | 13 | - | - | 31.4 | 3.6 | 24.2 | 20.1 | 16 | 11.8 | - | - |
| | 67 | 31 | 3.2 | 29.9 | 27 | 22.9 | 18.7 | 14.5 | - | 28.4 | 3.6 | 27.9 | 25.7 | 21.6 | 17.5 | 13.4 | - |
| | 62 | 28.3 | 3.2 | 28.3 | 28.3 | 26.6 | 22.4 | 18.3 | 14.1 | 25.8 | 3.6 | 25.8 | 25.8 | 24.3 | 20.2 | 16.1 | 12 |
| 1200 | 77 | 38.4 | 3.3 | 24.6 | 17.3 | 12.6 | - | - | - | 35.1 | 3.6 | 24.5 | 15.9 | 11.3 | - | - | - |
| | 72 | 35.1 | 3.3 | 28.1 | 23.4 | 18.7 | 14 | - | - | 32 | 3.6 | 26.7 | 22.1 | 17.4 | 12.7 | - | - |
| | 67 | 31.7 | 3.2 | 31.7 | 29.5 | 24.8 | 20.1 | 15.4 | - | 29 | 3.6 | 29 | 28.2 | 23.5 | 18.9 | 14.2 | - |
| | 62 | 28.9 | 3.2 | 28.9 | 28.9 | 28.9 | 24.2 | 19.5 | 14.7 | 26.4 | 3.6 | 26.4 | 26.4 | 26.4 | 21.9 | 17.2 | 12.5 |
| 1350 | 77 | 35.4 | 3.3 | 30.5 | 25.3 | 20.1 | 14.9 | - | - | 32.2 | 3.6 | 29.1 | 23.9 | 18.8 | 13.6 | - | - |
| | 72 | 32 | 3.2 | 32 | 30.9 | 26.7 | 21.5 | 16.3 | - | 29.1 | 3.6 | 29.1 | 29 | 25.4 | 20.2 | 15.1 | - |
| | 67 | 29.2 | 3.2 | 29.2 | 29.2 | 29.2 | 24 | 18.8 | 13.5 | 26.5 | 3.6 | 26.5 | 26.5 | 26.5 | 21.4 | 16.3 | 11.1 |
| | 62 | 30 | 3.2 | 30 | 30 | 30 | 24.8 | 19.6 | 14.4 | 27.8 | 3.6 | 27.8 | 27.8 | 27.8 | 22.6 | 17.5 | 12.3 |
| 1500 | 72 | 35.7 | 3.3 | 33 | 27.3 | 21.6 | 15.9 | - | - | 32.3 | 3.6 | 31.4 | 25.8 | 20.1 | 14.5 | - | - |
| | 67 | 32.3 | 3.3 | 32.3 | 32.3 | 28.6 | 22.9 | 17.2 | - | 29.3 | 3.6 | 29.3 | 29.3 | 27.2 | 21.6 | 15.9 | - |
| | 62 | 29.5 | 3.2 | 29.5 | 29.5 | 29.5 | 23.8 | 18.1 | 12.4 | 26.7 | 3.6 | 26.7 | 26.7 | 26.7 | 21 | 15.4 | 9.7 |
| | 57 | 30.3 | 3.2 | 30.3 | 30.3 | 30.3 | 24.6 | 18.9 | 13.2 | 27.9 | 3.6 | 27.9 | 27.9 | 27.9 | 22.3 | 16.6 | 11 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 64: ZL05 (4.0 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|--|--|
| | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 | | |
| | | 75°F | | | | | | | | | 85°F | | | | | | | | |
| 1000 | 77 | 59.6 | 2.9 | 27.1 | 21.8 | 17.1 | - | - | - | 57.1 | 3.2 | 25.5 | 20.8 | 16.1 | - | - | - | | |
| | 72 | 56.0 | 2.8 | 34.4 | 29.7 | 25.0 | 20.3 | - | - | 53.2 | 3.1 | 33.0 | 28.3 | 23.7 | 19.0 | - | - | | |
| | 67 | 52.5 | 2.6 | 41.8 | 37.7 | 33.0 | 28.3 | 23.6 | - | 49.2 | 3.0 | 40.5 | 35.9 | 31.2 | 26.5 | 21.9 | - | | |
| | 62 | 48.2 | 2.6 | 48.2 | 48.2 | 40.6 | 35.9 | 31.2 | 26.5 | 44.8 | 2.9 | 44.8 | 44.8 | 37.8 | 33.1 | 28.5 | 23.8 | | |
| 1200 | 77 | 60.8 | 2.9 | 28.7 | 23.5 | 18.3 | - | - | - | 58.4 | 3.2 | 27.9 | 22.7 | 17.4 | - | - | - | | |
| | 72 | 57.2 | 2.8 | 37.2 | 32.0 | 26.8 | 21.6 | - | - | 54.4 | 3.1 | 36.0 | 30.8 | 25.5 | 20.3 | - | - | | |
| | 67 | 53.6 | 2.6 | 45.7 | 40.5 | 35.3 | 30.1 | 24.9 | - | 50.3 | 3.0 | 44.1 | 38.9 | 33.6 | 28.4 | 23.1 | - | | |
| | 62 | 49.3 | 2.5 | 49.3 | 49.3 | 43.4 | 38.2 | 33.0 | 27.8 | 45.8 | 2.9 | 45.8 | 45.8 | 40.8 | 35.5 | 30.2 | 25.0 | | |
| 1400 | 57 | 48.9 | 2.5 | 48.9 | 48.9 | 45.0 | 39.8 | 34.6 | 29.4 | 45.5 | 2.9 | 45.5 | 45.5 | 41.5 | 36.2 | 31.0 | 25.7 | | |
| | 77 | 62.1 | 2.9 | 30.3 | 25.2 | 19.4 | - | - | - | 59.7 | 3.2 | 30.4 | 24.5 | 18.7 | - | - | - | | |
| | 72 | 58.4 | 2.8 | 39.9 | 34.2 | 28.5 | 22.8 | - | - | 55.6 | 3.1 | 39.1 | 33.2 | 27.4 | 21.5 | - | - | | |
| | 67 | 54.7 | 2.6 | 49.6 | 43.3 | 37.6 | 31.9 | 26.2 | - | 51.4 | 3.0 | 47.8 | 41.9 | 36.1 | 30.2 | 24.4 | - | | |
| | 62 | 50.3 | 2.5 | 50.3 | 50.3 | 46.3 | 40.6 | 34.9 | 29.1 | 46.8 | 2.9 | 46.8 | 46.8 | 43.7 | 37.9 | 32.0 | 26.2 | | |
| 1600 | 57 | 49.9 | 2.5 | 49.9 | 49.9 | 48.0 | 42.3 | 36.6 | 30.9 | 46.5 | 2.9 | 46.5 | 46.5 | 44.5 | 38.6 | 32.8 | 26.9 | | |
| | 77 | 63.4 | 2.9 | 31.9 | 26.9 | 20.6 | - | - | - | 61.0 | 3.2 | 32.8 | 26.4 | 19.9 | - | - | - | | |
| | 72 | 59.6 | 2.8 | 42.7 | 36.5 | 30.3 | 24.0 | - | - | 56.8 | 3.1 | 42.1 | 35.7 | 29.2 | 22.8 | - | - | | |
| | 67 | 55.8 | 2.6 | 53.5 | 46.1 | 39.9 | 33.7 | 27.4 | - | 52.5 | 3.0 | 51.4 | 45.0 | 38.5 | 32.1 | 25.6 | - | | |
| | 62 | 51.3 | 2.5 | 51.3 | 51.3 | 49.1 | 42.9 | 36.7 | 30.5 | 47.8 | 2.9 | 47.8 | 47.8 | 46.7 | 40.2 | 33.8 | 27.4 | | |
| 1800 | 57 | 51.0 | 2.5 | 51.0 | 51.0 | 51.0 | 44.8 | 38.5 | 32.3 | 47.5 | 2.9 | 47.5 | 47.5 | 47.5 | 41.1 | 34.6 | 28.2 | | |
| | 72 | 61.5 | 2.8 | 46.3 | 39.4 | 32.5 | 25.7 | - | - | 58.2 | 3.1 | 45.6 | 38.5 | 31.4 | 24.2 | - | - | | |
| | 67 | 57.6 | 2.6 | 56.4 | 49.8 | 42.9 | 36.0 | 29.1 | - | 53.9 | 3.0 | 53.3 | 48.4 | 41.3 | 34.2 | 27.1 | - | | |
| | 62 | 52.9 | 2.6 | 52.9 | 52.9 | 51.8 | 44.9 | 38.1 | 31.2 | 49.0 | 2.9 | 49.0 | 49.0 | 48.5 | 41.3 | 34.2 | 27.1 | | |
| 2000 | 57 | 52.6 | 2.5 | 52.6 | 52.6 | 52.6 | 45.7 | 38.8 | 31.9 | 48.7 | 2.9 | 48.7 | 48.7 | 48.7 | 41.6 | 34.5 | 27.4 | | |
| | 72 | 63.3 | 2.8 | 49.9 | 42.4 | 34.8 | 27.3 | - | - | 59.7 | 3.1 | 49.1 | 41.3 | 33.5 | 25.7 | - | - | | |
| | 67 | 59.3 | 2.7 | 59.3 | 53.4 | 45.9 | 38.4 | 30.8 | - | 55.3 | 3.0 | 55.3 | 51.9 | 44.1 | 36.4 | 28.6 | - | | |
| | 62 | 54.5 | 2.6 | 54.5 | 54.5 | 54.5 | 47.0 | 39.4 | 31.9 | 50.2 | 3.0 | 50.2 | 50.2 | 50.2 | 42.4 | 34.7 | 26.9 | | |
| 57 | 54.1 | 2.6 | 54.1 | 54.1 | 54.1 | 46.6 | 39.0 | 31.5 | 49.9 | 2.9 | 49.9 | 49.9 | 49.9 | 42.2 | 34.4 | 26.6 | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 65: ZL05 (4.0 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--|--|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|----|----|
| CFM | WB (°F) | ¹ Total capacity ¹ (MBh) | ² Total input ² (kW) | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 95°F | | | | | | 105°F | | | | | | | | | |
| 1000 | 77 | 54.7 | 3.4 | 23.9 | 19.9 | 15.2 | - | - | - | 50.0 | 3.8 | 21.4 | 18.3 | 13.6 | - | - | - | | |
| | 72 | 50.4 | 3.4 | 31.6 | 26.9 | 22.3 | 17.7 | - | - | 45.7 | 3.8 | 29.7 | 25.0 | 20.4 | 15.7 | - | - | | |
| | 67 | 46.0 | 3.3 | 39.2 | 34.0 | 29.4 | 24.8 | 20.2 | - | 41.4 | 3.7 | 38.0 | 31.8 | 27.2 | 22.5 | 17.9 | - | | |
| | 62 | 41.3 | 3.2 | 41.3 | 41.3 | 35.0 | 30.4 | 25.8 | 21.1 | 37.5 | 3.6 | 37.5 | 37.5 | 31.2 | 26.6 | 21.9 | 17.3 | | |
| 1200 | 77 | 56.0 | 3.5 | 27.2 | 21.9 | 16.6 | - | - | - | 51.4 | 3.9 | 25.8 | 20.3 | 15.0 | - | - | - | | |
| | 72 | 51.5 | 3.4 | 34.9 | 29.6 | 24.3 | 19.0 | - | - | 47.0 | 3.8 | 33.1 | 27.8 | 22.4 | 17.1 | - | - | | |
| | 67 | 47.1 | 3.3 | 42.6 | 37.3 | 32.0 | 26.7 | 21.4 | - | 42.5 | 3.7 | 40.3 | 35.2 | 29.9 | 24.6 | 19.3 | - | | |
| | 62 | 42.3 | 3.3 | 42.3 | 42.3 | 38.1 | 32.8 | 27.5 | 22.2 | 38.5 | 3.7 | 38.5 | 38.5 | 34.3 | 29.0 | 23.7 | 18.4 | | |
| 1400 | 77 | 57.3 | 3.5 | 30.5 | 23.9 | 17.9 | - | - | - | 52.8 | 3.9 | 30.3 | 22.3 | 16.3 | - | - | - | | |
| | 72 | 52.7 | 3.4 | 38.2 | 32.2 | 26.2 | 20.3 | - | - | 48.2 | 3.8 | 36.4 | 30.5 | 24.5 | 18.5 | - | - | | |
| | 67 | 48.2 | 3.3 | 45.9 | 40.5 | 34.6 | 28.6 | 22.6 | - | 43.7 | 3.8 | 42.5 | 38.6 | 32.7 | 26.7 | 20.7 | - | | |
| | 62 | 43.3 | 3.3 | 43.3 | 43.3 | 41.2 | 35.2 | 29.2 | 23.2 | 39.6 | 3.7 | 39.6 | 39.6 | 37.5 | 31.5 | 25.5 | 19.6 | | |
| 1600 | 77 | 58.5 | 3.5 | 33.7 | 25.9 | 19.2 | - | - | - | 54.1 | 3.9 | 34.8 | 24.3 | 17.7 | - | - | - | | |
| | 72 | 53.9 | 3.4 | 41.5 | 34.8 | 28.2 | 21.5 | - | - | 49.5 | 3.9 | 39.8 | 33.2 | 26.5 | 19.9 | - | - | | |
| | 67 | 49.3 | 3.3 | 49.3 | 43.8 | 37.1 | 30.5 | 23.8 | - | 44.8 | 3.8 | 44.8 | 42.0 | 35.4 | 28.8 | 22.2 | - | | |
| | 62 | 44.2 | 3.3 | 44.2 | 44.2 | 44.2 | 37.6 | 30.9 | 24.3 | 40.6 | 3.7 | 40.6 | 40.6 | 34.0 | 27.3 | 20.7 | - | | |
| 1800 | 77 | 55.0 | 3.4 | 44.9 | 37.5 | 30.2 | 22.8 | - | - | 50.5 | 3.9 | 43.2 | 35.9 | 28.5 | 21.2 | - | - | | |
| | 72 | 50.2 | 3.4 | 50.2 | 47.1 | 39.8 | 32.4 | 25.1 | - | 45.7 | 3.8 | 45.7 | 44.2 | 38.0 | 30.7 | 23.3 | - | | |
| | 67 | 45.1 | 3.3 | 45.1 | 45.1 | 45.1 | 37.8 | 30.4 | 23.1 | 41.5 | 3.8 | 41.5 | 41.5 | 34.1 | 26.8 | 19.4 | - | | |
| | 62 | 44.9 | 3.3 | 44.9 | 44.9 | 44.9 | 37.5 | 30.2 | 22.8 | 42.0 | 3.8 | 42.0 | 42.0 | 34.6 | 27.3 | 19.9 | - | | |
| 2000 | 77 | 56.0 | 3.4 | 48.3 | 40.2 | 32.2 | 24.1 | - | - | 51.6 | 3.9 | 46.6 | 38.5 | 30.5 | 22.4 | - | - | | |
| | 72 | 51.2 | 3.4 | 51.2 | 50.4 | 42.4 | 34.4 | 26.3 | - | 46.7 | 3.8 | 46.7 | 46.3 | 36.6 | 28.6 | 21.5 | - | | |
| | 67 | 46.0 | 3.3 | 46.0 | 46.0 | 46.0 | 37.9 | 29.9 | 21.9 | 42.3 | 3.8 | 42.3 | 42.3 | 34.2 | 26.2 | 18.1 | - | | |
| | 62 | 45.8 | 3.3 | 45.8 | 45.8 | 45.8 | 37.7 | 29.7 | 21.6 | 42.9 | 3.8 | 42.9 | 42.9 | 34.8 | 26.7 | 18.6 | - | | |
| | | | | 115°F | | | | | | 125°F | | | | | | | | | |
| 1000 | 77 | 45.4 | 4.2 | 18.9 | 16.7 | 12.0 | - | - | - | 40.8 | 4.6 | 19.7 | 13.7 | 10.3 | - | - | - | | |
| | 72 | 41.1 | 4.1 | 27.8 | 23.2 | 18.5 | 13.8 | - | - | 36.5 | 4.5 | 26.0 | 21.3 | 16.6 | 11.9 | - | - | | |
| | 67 | 36.8 | 4.1 | 36.8 | 29.7 | 25.0 | 20.3 | 15.6 | - | 32.2 | 4.5 | 32.2 | 27.6 | 22.8 | 18.1 | 13.4 | - | | |
| | 62 | 33.7 | 4.0 | 33.7 | 33.7 | 27.4 | 22.7 | 18.1 | 13.4 | 29.9 | 4.4 | 29.9 | 29.9 | 23.6 | 18.9 | 14.2 | 9.5 | | |
| 1200 | 77 | 46.9 | 4.3 | 24.5 | 18.7 | 13.4 | - | - | - | 42.3 | 4.7 | 25.4 | 17.1 | 11.8 | - | - | - | | |
| | 72 | 42.4 | 4.2 | 31.2 | 25.9 | 20.6 | 15.3 | - | - | 37.9 | 4.6 | 29.4 | 24.1 | 18.8 | 13.5 | - | - | | |
| | 67 | 38.0 | 4.1 | 38.0 | 33.2 | 27.9 | 22.6 | 17.2 | - | 33.4 | 4.6 | 33.4 | 31.1 | 25.8 | 20.5 | 15.2 | - | | |
| | 62 | 34.8 | 4.1 | 34.8 | 34.8 | 30.6 | 25.3 | 20.0 | 14.7 | 31.1 | 4.5 | 31.1 | 31.1 | 26.9 | 21.5 | 16.2 | 10.9 | | |
| 1400 | 77 | 48.3 | 4.3 | 30.2 | 20.7 | 14.8 | - | - | - | 43.8 | 4.7 | 31.2 | 20.4 | 13.2 | - | - | - | | |
| | 72 | 43.7 | 4.3 | 34.7 | 28.7 | 22.8 | 16.8 | - | - | 39.2 | 4.7 | 32.9 | 27.0 | 21.0 | 15.1 | - | - | | |
| | 67 | 39.1 | 4.2 | 39.1 | 36.7 | 30.8 | 24.8 | 18.9 | - | 34.6 | 4.6 | 34.6 | 34.6 | 28.9 | 22.9 | 17.0 | - | | |
| | 62 | 35.9 | 4.1 | 35.9 | 35.9 | 33.8 | 27.8 | 21.9 | 15.9 | 32.2 | 4.6 | 32.2 | 32.2 | 30.1 | 24.2 | 18.2 | 12.3 | | |
| 1600 | 77 | 49.7 | 4.4 | 35.8 | 22.7 | 16.1 | - | - | - | 45.3 | 4.8 | 36.9 | 23.8 | 14.6 | - | - | - | | |
| | 72 | 45.0 | 4.3 | 38.1 | 31.5 | 24.9 | 18.3 | - | - | 40.6 | 4.8 | 36.4 | 29.8 | 23.3 | 16.7 | - | - | | |
| | 67 | 40.3 | 4.3 | 40.3 | 40.2 | 33.7 | 27.1 | 20.5 | - | 35.8 | 4.7 | 35.8 | 35.8 | 31.9 | 25.4 | 18.8 | - | | |
| | 62 | 37.0 | 4.2 | 37.0 | 37.0 | 37.0 | 30.4 | 23.8 | 17.2 | 33.3 | 4.6 | 33.3 | 33.3 | 33.3 | 26.8 | 20.2 | 13.7 | | |
| 1800 | 77 | 46.1 | 4.3 | 41.5 | 34.2 | 26.8 | 19.5 | - | - | 41.6 | 4.8 | 39.8 | 32.5 | 25.1 | 17.8 | - | - | | |
| | 72 | 41.3 | 4.3 | 41.3 | 41.2 | 36.3 | 28.9 | 21.6 | - | 36.8 | 4.7 | 36.8 | 36.8 | 34.5 | 27.2 | 19.8 | - | | |
| | 67 | 37.8 | 4.2 | 37.8 | 37.8 | 37.8 | 30.5 | 23.1 | 15.8 | 34.2 | 4.6 | 34.2 | 34.2 | 34.2 | 26.8 | 19.5 | 12.1 | | |
| | 62 | 39.1 | 4.2 | 39.1 | 39.1 | 39.1 | 31.7 | 24.4 | 17.0 | 36.2 | 4.6 | 36.2 | 36.2 | 36.1 | 28.8 | 21.4 | 14.1 | | |
| 2000 | 77 | 47.1 | 4.3 | 45.0 | 36.9 | 28.7 | 20.6 | - | - | 42.7 | 4.8 | 42.7 | 35.2 | 27.0 | 18.9 | - | - | | |
| | 72 | 42.2 | 4.3 | 42.2 | 42.2 | 38.9 | 30.7 | 22.6 | - | 37.7 | 4.7 | 37.7 | 37.7 | 37.1 | 28.9 | 20.8 | - | | |
| | 67 | 38.7 | 4.2 | 38.7 | 38.7 | 38.7 | 30.6 | 22.4 | 14.3 | 35.0 | 4.6 | 35.0 | 35.0 | 35.0 | 26.9 | 18.7 | 10.6 | | |
| | 62 | 40.0 | 4.2 | 40.0 | 40.0 | 40.0 | 31.8 | 23.7 | 15.6 | 37.1 | 4.7 | 37.1 | 37.1 | 37.1 | 28.9 | 20.8 | 12.6 | | |

1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.

2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 67: ZL06 (5.0 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|------|------|------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input ² (kW) | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | 125°F | | | | | | | | | |
| 1250 | 77 | 61.6 | 5.4 | 26.1 | 23.0 | 17.3 | - | - | - | 56.3 | 5.9 | 24.7 | 21.7 | 16.0 | - | - | - | | |
| | 72 | 56.3 | 5.3 | 37.1 | 31.4 | 25.7 | 20.0 | - | - | 51.5 | 5.8 | 35.7 | 30.0 | 24.3 | 18.6 | - | - | | |
| | 67 | 50.9 | 5.2 | 48.1 | 39.9 | 34.2 | 28.5 | 22.8 | - | 46.6 | 5.8 | 46.6 | 38.3 | 32.6 | 26.9 | 21.3 | - | | |
| | 62 | 47.9 | 5.2 | 47.9 | 47.9 | 40.4 | 34.7 | 29.0 | 23.3 | 44.8 | 5.7 | 44.8 | 44.8 | 37.9 | 32.2 | 26.5 | 20.9 | | |
| 1500 | 77 | 63.1 | 5.4 | 31.9 | 25.4 | 18.8 | - | - | - | 57.8 | 6.0 | 31.1 | 23.9 | 17.4 | - | - | - | | |
| | 72 | 57.7 | 5.3 | 41.1 | 34.6 | 28.0 | 21.5 | - | - | 52.8 | 5.9 | 39.5 | 33.0 | 26.5 | 19.9 | - | - | | |
| | 67 | 52.2 | 5.3 | 50.3 | 43.8 | 37.2 | 30.7 | 24.1 | - | 47.9 | 5.8 | 47.9 | 42.0 | 35.5 | 29.0 | 22.5 | - | | |
| | 62 | 49.1 | 5.2 | 49.1 | 49.1 | 44.0 | 37.5 | 30.9 | 24.4 | 46.0 | 5.8 | 46.0 | 46.0 | 41.3 | 34.8 | 28.3 | 21.7 | | |
| 1750 | 77 | 64.6 | 5.4 | 37.7 | 27.8 | 20.4 | - | - | - | 59.3 | 6.0 | 37.5 | 26.1 | 18.8 | - | - | - | | |
| | 72 | 59.1 | 5.4 | 45.1 | 37.7 | 30.3 | 22.9 | - | - | 54.2 | 5.9 | 43.3 | 36.0 | 28.6 | 21.3 | - | - | | |
| | 67 | 53.5 | 5.3 | 52.6 | 47.7 | 40.3 | 32.9 | 25.5 | - | 49.1 | 5.8 | 49.1 | 45.8 | 38.4 | 31.1 | 23.8 | - | | |
| | 62 | 50.3 | 5.3 | 50.3 | 50.3 | 47.6 | 40.2 | 32.8 | 25.4 | 47.2 | 5.8 | 47.2 | 47.2 | 44.6 | 37.3 | 30.0 | 22.6 | | |
| 2000 | 77 | 66.2 | 5.4 | 43.6 | 30.2 | 21.9 | - | - | - | 60.8 | 6.0 | 43.9 | 28.4 | 20.2 | - | - | - | | |
| | 72 | 60.5 | 5.4 | 49.2 | 40.9 | 32.7 | 24.4 | - | - | 55.6 | 5.9 | 47.1 | 38.9 | 30.8 | 22.6 | - | - | | |
| | 67 | 54.8 | 5.3 | 54.8 | 51.6 | 43.4 | 35.1 | 26.9 | - | 50.3 | 5.8 | 50.3 | 49.5 | 41.3 | 33.2 | 25.0 | - | | |
| | 62 | 51.5 | 5.3 | 51.5 | 51.5 | 51.3 | 43.0 | 34.8 | 26.5 | 48.3 | 5.8 | 48.3 | 48.3 | 48.0 | 39.9 | 31.7 | 23.5 | | |
| 2250 | 77 | 60.8 | 5.4 | 53.0 | 43.9 | 34.9 | 25.9 | - | - | 55.7 | 5.9 | 50.7 | 41.8 | 32.9 | 24.0 | - | - | | |
| | 72 | 55.1 | 5.3 | 55.1 | 53.5 | 46.4 | 37.4 | 28.3 | - | 50.4 | 5.9 | 50.4 | 50.3 | 44.2 | 35.3 | 26.3 | - | | |
| | 67 | 51.9 | 5.3 | 51.9 | 51.9 | 51.7 | 42.7 | 33.7 | 24.7 | 48.4 | 5.8 | 48.4 | 48.4 | 48.3 | 39.4 | 30.4 | 21.5 | | |
| | 62 | 51.9 | 5.3 | 51.9 | 51.9 | 51.7 | 42.7 | 33.7 | 24.7 | 48.2 | 5.9 | 48.2 | 48.2 | 48.0 | 39.1 | 30.2 | 21.2 | | |
| 2500 | 77 | 61.2 | 5.4 | 56.8 | 47.0 | 37.2 | 27.4 | - | - | 55.8 | 6.0 | 54.4 | 44.7 | 35.0 | 25.3 | - | - | | |
| | 72 | 55.4 | 5.3 | 55.4 | 55.4 | 49.4 | 39.6 | 29.8 | - | 50.5 | 5.9 | 50.5 | 50.5 | 47.0 | 37.3 | 27.7 | - | | |
| | 67 | 52.2 | 5.3 | 52.2 | 52.2 | 52.2 | 42.4 | 32.6 | 22.8 | 48.5 | 5.9 | 48.5 | 48.5 | 48.5 | 38.9 | 29.2 | 19.5 | | |
| | 62 | 52.2 | 5.3 | 52.2 | 52.2 | 52.2 | 42.4 | 32.6 | 22.8 | 48.3 | 5.9 | 48.3 | 48.3 | 48.3 | 38.7 | 29.0 | 19.3 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

ZL08 to 14 cooling capacities

Table 68: ZL08 (7.5 ton, 75°F to 85°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|--------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|
| | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| CFM | WB (°F) | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 75°F | | | | | | | | | 85°F | | | | | | |
| 1875 | 77 | 120.1 | 5.3 | 61.8 | 51.4 | 41.1 | - | - | - | 114.6 | 5.6 | 59.1 | 49.2 | 39.3 | - | - | - |
| | 72 | 108.3 | 5.3 | 71.0 | 61.1 | 51.3 | 41.4 | - | - | 104.2 | 5.6 | 69.9 | 59.6 | 49.2 | 38.9 | - | - |
| | 67 | 96.5 | 5.3 | 80.3 | 70.9 | 61.4 | 50.1 | 41.0 | - | 93.8 | 5.6 | 80.7 | 69.9 | 59.2 | 48.2 | 38.3 | - |
| | 62 | 88.7 | 5.2 | 88.7 | 80.6 | 71.6 | 58.1 | 50.6 | 40.1 | 84.9 | 5.6 | 84.9 | 77.9 | 69.1 | 57.1 | 48.0 | 37.5 |
| 2250 | 77 | 121.3 | 5.3 | 67.9 | 54.5 | 41.1 | - | - | - | 115.6 | 5.6 | 65.1 | 52.1 | 39.2 | - | - | - |
| | 72 | 111.0 | 5.3 | 77.5 | 65.6 | 53.6 | 41.8 | - | - | 106.4 | 5.6 | 75.8 | 63.7 | 51.6 | 39.4 | - | - |
| | 67 | 100.7 | 5.3 | 87.0 | 76.6 | 66.3 | 53.2 | 41.9 | - | 97.1 | 5.6 | 85.2 | 75.2 | 63.9 | 51.1 | 39.3 | - |
| | 62 | 94.4 | 5.2 | 92.9 | 86.6 | 78.8 | 64.0 | 53.9 | 41.4 | 90.5 | 5.6 | 85.9 | 83.8 | 76.3 | 62.6 | 51.2 | 38.6 |
| 2625 | 57 | 88.2 | 5.2 | 93.4 | 93.4 | 91.4 | 78.6 | 65.8 | 53.1 | 86.1 | 5.6 | 86.1 | 86.1 | 86.1 | 75.9 | 63.1 | 50.3 |
| | 77 | 122.4 | 5.3 | 74.1 | 57.6 | 41.1 | - | - | - | 116.5 | 5.6 | 71.1 | 55.1 | 39.0 | - | - | - |
| | 72 | 113.7 | 5.3 | 83.9 | 70.0 | 56.1 | 42.2 | - | - | 108.5 | 5.6 | 81.6 | 67.7 | 53.9 | 40.0 | - | - |
| | 67 | 105.0 | 5.3 | 93.7 | 82.4 | 71.1 | 56.2 | 42.7 | - | 100.5 | 5.6 | 92.1 | 80.4 | 68.7 | 54.1 | 40.2 | - |
| 3000 | 62 | 100.2 | 5.3 | 95.5 | 92.7 | 86.1 | 69.9 | 57.2 | 42.7 | 96.1 | 5.6 | 93.1 | 89.6 | 83.6 | 68.1 | 54.3 | 39.7 |
| | 57 | 97.8 | 5.2 | 97.8 | 97.8 | 97.1 | 86.4 | 71.6 | 56.8 | 94.5 | 5.6 | 94.5 | 94.5 | 94.5 | 83.4 | 68.5 | 53.5 |
| | 77 | 123.6 | 5.3 | 80.2 | 60.6 | 41.1 | - | - | - | 117.5 | 5.6 | 77.2 | 58.0 | 38.8 | - | - | - |
| | 72 | 116.4 | 5.3 | 90.3 | 74.4 | 58.5 | 42.6 | - | - | 110.7 | 5.6 | 87.5 | 71.8 | 56.2 | 40.5 | - | - |
| 3375 | 67 | 109.2 | 5.3 | 100.4 | 88.2 | 75.9 | 59.3 | 43.6 | - | 103.9 | 5.6 | 97.8 | 85.6 | 73.5 | 57.1 | 41.2 | - |
| | 62 | 106.0 | 5.3 | 102.4 | 98.7 | 93.4 | 75.7 | 60.5 | 44.0 | 101.6 | 5.6 | 99.1 | 95.5 | 90.8 | 73.6 | 57.5 | 40.8 |
| | 57 | 102.8 | 5.3 | 102.8 | 102.8 | 102.8 | 94.1 | 77.3 | 60.6 | 99.4 | 5.6 | 99.4 | 99.4 | 99.4 | 91.0 | 73.8 | 56.6 |
| | 72 | 119.1 | 5.3 | 96.7 | 78.8 | 60.9 | 43.0 | - | - | 112.8 | 5.6 | 93.3 | 75.9 | 58.5 | 41.0 | - | - |
| 3750 | 67 | 113.5 | 5.3 | 107.1 | 94.0 | 80.8 | 62.4 | 44.4 | - | 107.2 | 5.6 | 103.4 | 90.9 | 78.3 | 60.1 | 42.1 | - |
| | 62 | 111.8 | 5.3 | 108.2 | 104.8 | 100.7 | 81.6 | 63.8 | 45.3 | 107.2 | 5.6 | 104.7 | 101.4 | 98.1 | 79.1 | 60.6 | 41.9 |
| | 57 | 110.1 | 5.3 | 108.9 | 108.9 | 108.9 | 101.8 | 83.1 | 64.4 | 107.2 | 5.6 | 104.7 | 104.7 | 104.7 | 98.5 | 79.2 | 59.8 |
| | 72 | 121.8 | 5.3 | 103.2 | 83.3 | 63.332 | 43.4 | - | - | 115.0 | 5.6 | 99.2 | 80.0 | 60.8 | 41.6 | - | - |
| 3750 | 67 | 117.7 | 5.3 | 113.5 | 99.7 | 85.6 | 65.4 | 45.3 | - | 113.9 | 5.6 | 109.1 | 96.1 | 83.0 | 63.1 | 43.1 | - |
| | 62 | 117.6 | 5.3 | 113.7 | 110.8 | 107.9 | 87.5 | 67.1 | 46.6 | 112.8 | 5.6 | 109.2 | 107.2 | 105.3 | 84.5 | 63.8 | 43.0 |
| | 57 | 117.4 | 5.3 | 113.7 | 113.7 | 113.7 | 109.5 | 88.8 | 68.1 | 112.7 | 5.6 | 109.2 | 109.2 | 109.2 | 106.0 | 84.5 | 63.0 |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 69: ZL08 (7.5 ton, 95°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|--------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|------|------|------|------|------|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | 95°F | | | | | | | | | 105°F | | | | | | |
| 1875 | 77 | 109.2 | 5.9 | 56.4 | 47.0 | 37.6 | - | - | - | 100.5 | 6.4 | 54.3 | 44.6 | 34.9 | - | - | - |
| | 72 | 100.1 | 5.9 | 68.8 | 58.0 | 47.2 | 36.5 | - | - | 92.6 | 6.4 | 66.0 | 55.2 | 44.4 | 33.6 | - | - |
| | 67 | 91.1 | 5.9 | 81.1 | 69.0 | 56.9 | 46.3 | 35.6 | - | 84.7 | 6.4 | 77.7 | 65.8 | 54.0 | 43.4 | 32.8 | - |
| | 62 | 82.2 | 5.9 | 82.2 | 75.2 | 66.6 | 56.0 | 45.5 | 35.0 | 80.1 | 6.4 | 79.8 | 71.6 | 63.5 | 53.2 | 42.8 | 32.5 |
| 2250 | 77 | 109.9 | 5.9 | 62.3 | 49.8 | 37.2 | - | - | - | 101.4 | 6.4 | 60.8 | 47.6 | 34.4 | - | - | - |
| | 72 | 101.7 | 5.9 | 74.1 | 61.7 | 49.431 | 37.1 | - | - | 94.4 | 6.4 | 71.3 | 58.9 | 46.6 | 34.2 | - | - |
| | 67 | 93.6 | 5.9 | 84.9 | 73.7 | 61.6 | 49.1 | 36.7 | - | 87.5 | 6.4 | 79.7 | 70.2 | 58.7 | 46.2 | 33.8 | - |
| | 62 | 86.5 | 5.9 | 85.1 | 80.9 | 73.8 | 61.2 | 48.5 | 35.9 | 82.1 | 6.4 | 80.0 | 77.1 | 70.8 | 58.3 | 45.8 | 33.3 |
| 2625 | 77 | 110.6 | 5.9 | 68.2 | 52.6 | 36.9 | - | - | - | 102.2 | 6.4 | 67.3 | 50.6 | 34.0 | - | - | - |
| | 72 | 103.3 | 5.9 | 79.3 | 65.5 | 51.6 | 37.8 | - | - | 96.3 | 6.4 | 76.6 | 62.6 | 48.7 | 34.7 | - | - |
| | 67 | 96.0 | 5.9 | 88.0 | 78.4 | 66.3 | 52.0 | 37.7 | - | 90.3 | 6.4 | 85.0 | 74.7 | 63.4 | 49.1 | 34.8 | - |
| | 62 | 91.9 | 5.9 | 88.5 | 86.6 | 81.0 | 66.3 | 51.5 | 36.8 | 87.0 | 6.4 | 85.9 | 82.7 | 78.1 | 63.4 | 48.7 | 34.1 |
| 3000 | 77 | 111.4 | 5.9 | 74.1 | 55.4 | 36.6 | - | - | - | 103.0 | 6.4 | 73.8 | 53.6 | 33.5 | - | - | - |
| | 72 | 104.9 | 5.9 | 84.6 | 69.2 | 53.8 | 38.4 | - | - | 98.1 | 6.4 | 81.9 | 66.4 | 50.8 | 35.3 | - | - |
| | 67 | 98.5 | 5.9 | 95.1 | 83.1 | 71.0 | 54.9 | 38.8 | - | 93.1 | 6.4 | 90.0 | 79.1 | 68.1 | 51.9 | 35.7 | - |
| | 62 | 97.3 | 5.9 | 96.3 | 92.3 | 88.3 | 71.4 | 54.5 | 37.6 | 92.0 | 6.4 | 90.6 | 88.2 | 85.4 | 68.6 | 51.7 | 34.8 |
| 3375 | 77 | 106.6 | 5.9 | 89.9 | 73.0 | 56.0 | 39.1 | - | - | 99.9 | 6.4 | 87.2 | 70.1 | 52.9 | 35.8 | - | - |
| | 72 | 104.3 | 5.9 | 99.8 | 87.8 | 75.7 | 57.8 | 39.8 | - | 97.8 | 6.4 | 94.1 | 83.5 | 72.8 | 54.8 | 36.7 | - |
| | 67 | 102.7 | 5.9 | 100.5 | 98.0 | 95.5 | 76.5 | 57.5 | 38.5 | 96.9 | 6.4 | 94.7 | 93.7 | 92.7 | 73.7 | 54.6 | 35.6 |
| | 62 | 101.9 | 5.9 | 101.3 | 101.3 | 101.3 | 95.2 | 75.2 | 55.2 | 96.5 | 6.4 | 95.2 | 95.2 | 95.2 | 92.6 | 72.6 | 52.6 |
| 3750 | 77 | 112.6 | 5.9 | 95.2 | 76.7 | 58.208 | 39.7 | - | - | 104.8 | 6.4 | 92.5 | 73.8 | 55.1 | 36.4 | - | - |
| | 72 | 108.2 | 5.9 | 104.4 | 92.4 | 80.5 | 60.7 | 40.9 | - | 101.8 | 6.4 | 98.2 | 87.9 | 77.5 | 57.6 | 37.6 | - |
| | 67 | 108.0 | 5.9 | 104.7 | 103.7 | 102.7 | 81.6 | 60.5 | 39.4 | 101.0 | 6.4 | 98.4 | 98.4 | 98.4 | 78.8 | 57.6 | 36.4 |
| | 62 | 106.0 | 5.9 | 105.0 | 105.0 | 105.0 | 102.6 | 80.2 | 57.8 | 98.8 | 6.4 | 98.6 | 98.6 | 98.6 | 98.6 | 77.6 | 55.1 |
| | | 115°F | | | | | | | | | 125°F | | | | | | |
| 1875 | 77 | 91.9 | 6.8 | 52.2 | 42.2 | 32.2 | - | - | - | 83.3 | 7.3 | 50.1 | 39.8 | 29.5 | - | - | - |
| | 72 | 85.1 | 6.8 | 63.2 | 52.4 | 41.6 | 30.8 | - | - | 77.6 | 7.3 | 60.5 | 49.6 | 38.8 | 27.9 | - | - |
| | 67 | 78.2 | 6.8 | 74.3 | 62.6 | 51.0 | 40.5 | 30.1 | - | 71.8 | 7.3 | 68.8 | 59.5 | 48.1 | 37.7 | 27.3 | - |
| | 62 | 74.5 | 6.8 | 74.5 | 68.1 | 60.4 | 50.3 | 40.1 | 30.0 | 69.3 | 7.3 | 69.3 | 64.5 | 57.4 | 47.4 | 37.5 | 27.5 |
| 2250 | 77 | 92.8 | 6.8 | 59.3 | 45.4 | 31.6 | - | - | - | 84.3 | 7.3 | 57.7 | 43.2 | 28.8 | - | - | - |
| | 72 | 87.1 | 6.8 | 68.5 | 56.1 | 43.7 | 31.2 | - | - | 79.8 | 7.3 | 65.8 | 53.3 | 40.8 | 28.3 | - | - |
| | 67 | 81.4 | 6.8 | 75.6 | 66.8 | 55.7 | 43.3 | 30.9 | - | 75.3 | 7.3 | 72.5 | 63.3 | 52.8 | 40.4 | 28.1 | - |
| | 62 | 77.7 | 6.8 | 76.0 | 73.4 | 67.8 | 55.4 | 43.1 | 30.7 | 73.3 | 7.3 | 72.7 | 69.7 | 64.8 | 52.6 | 40.3 | 28.1 |
| 2625 | 77 | 98.8 | 6.8 | 66.3 | 48.7 | 31.0 | - | - | - | 85.3 | 7.3 | 65.4 | 46.7 | 28.1 | - | - | - |
| | 72 | 89.2 | 6.8 | 73.8 | 59.8 | 45.7 | 31.7 | - | - | 82.1 | 7.3 | 71.1 | 57.0 | 42.8 | 28.6 | - | - |
| | 67 | 84.6 | 6.8 | 81.4 | 70.9 | 60.5 | 46.1 | 31.8 | - | 78.9 | 7.3 | 76.2 | 67.2 | 57.5 | 43.2 | 28.8 | - |
| | 62 | 82.2 | 6.8 | 81.6 | 78.7 | 75.2 | 60.6 | 46.0 | 31.3 | 77.3 | 7.3 | 76.4 | 74.8 | 72.3 | 57.7 | 43.2 | 28.6 |
| 3000 | 77 | 94.7 | 6.8 | 73.4 | 51.9 | 30.4 | - | - | - | 86.4 | 7.3 | 73.0 | 50.2 | 27.3 | - | - | - |
| | 72 | 91.2 | 6.8 | 79.2 | 63.5 | 47.8 | 32.1 | - | - | 84.4 | 7.3 | 76.4 | 60.6 | 44.8 | 29.0 | - | - |
| | 67 | 87.8 | 6.8 | 84.9 | 75.1 | 65.2 | 48.9 | 32.7 | - | 82.4 | 7.3 | 79.8 | 71.1 | 62.3 | 45.9 | 29.6 | - |
| | 62 | 86.7 | 6.8 | 85.5 | 84.1 | 82.6 | 65.7 | 48.9 | 32.0 | 81.3 | 7.3 | 80.1 | 79.9 | 79.7 | 62.9 | 46.0 | 29.2 |
| 3375 | 77 | 95.5 | 6.8 | 85.5 | 85.5 | 85.5 | 82.5 | 65.1 | 47.6 | 80.3 | 7.3 | 80.3 | 80.3 | 80.3 | 79.8 | 62.5 | 45.1 |
| | 72 | 93.3 | 6.8 | 84.5 | 67.2 | 49.9 | 32.6 | - | - | 86.7 | 7.3 | 81.7 | 64.3 | 46.8 | 29.4 | - | - |
| | 67 | 91.3 | 6.8 | 88.5 | 79.2 | 69.9 | 51.7 | 33.5 | - | 85.9 | 7.3 | 82.9 | 74.9 | 67.0 | 48.7 | 30.4 | - |
| | 62 | 91.1 | 6.8 | 88.8 | 88.8 | 88.8 | 70.9 | 51.8 | 32.7 | 85.4 | 7.3 | 83.0 | 83.0 | 83.0 | 68.0 | 48.9 | 29.8 |
| 3750 | 77 | 90.9 | 6.8 | 89.1 | 89.1 | 89.1 | 89.1 | 70.0 | 50.0 | 84.8 | 7.3 | 83.1 | 83.1 | 83.1 | 83.1 | 67.4 | 47.4 |
| | 72 | 97.1 | 6.9 | 89.8 | 70.9 | 52.0 | 33.0 | - | - | 90.3 | 7.3 | 85.5 | 67.9 | 48.8 | 29.7 | - | - |
| | 67 | 95.6 | 6.8 | 92.0 | 83.3 | 74.6 | 54.5 | 34.4 | - | 89.4 | 7.3 | 85.7 | 78.8 | 71.7 | 51.5 | 31.2 | - |
| | 62 | 95.3 | 6.8 | 92.1 | 92.1 | 92.1 | 76.0 | 54.7 | 33.4 | 89.4 | 7.3 | 85.8 | 85.8 | 85.8 | 73.2 | 51.8 | 30.3 |
| 62 | 95.0 | 6.8 | 92.2 | 92.2 | 92.2 | 92.2 | 75.0 | 52.4 | 89.3 | 7.3 | 85.9 | 85.9 | 85.9 | 85.9 | 72.4 | 49.8 | |

1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.

2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 71: ZL09 (8.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|-----------------------------------|-------------------------------|-------------------------|------|-------|------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | | | | | 125°F | | | | | |
| 2125 | 77 | 95.8 | 7.7 | 53.4 | 43.3 | 33.2 | - | - | - | 86.6 | 8.3 | 52.5 | 41.2 | 29.8 | - | - | - | | |
| | 72 | 90.7 | 7.7 | 69.3 | 57.4 | 45.4 | 33.5 | - | - | 82.9 | 8.3 | 66.7 | 54.6 | 42.5 | 30.4 | - | - | | |
| | 67 | 86.3 | 7.7 | 83.5 | 71.4 | 57.7 | 45.6 | 33.6 | - | 79.1 | 8.3 | 77.5 | 68.0 | 55.2 | 42.9 | 30.7 | - | | |
| | 62 | 84.1 | 7.7 | 84.1 | 76.6 | 70.0 | 57.8 | 45.6 | 33.5 | 77.9 | 8.3 | 77.9 | 73.0 | 67.9 | 55.5 | 43.0 | 30.6 | | |
| 2550 | 77 | 97.8 | 7.7 | 62.7 | 47.9 | 33.0 | - | - | - | 89.1 | 8.3 | 62.4 | 46.1 | 29.7 | - | - | - | | |
| | 72 | 93.5 | 7.7 | 75.7 | 61.8 | 47.8 | 33.9 | - | - | 85.9 | 8.3 | 73.0 | 58.9 | 44.8 | 30.6 | - | - | | |
| | 67 | 89.2 | 7.7 | 85.0 | 75.6 | 62.6 | 48.4 | 34.2 | - | 82.7 | 8.3 | 79.8 | 71.7 | 59.9 | 45.5 | 31.1 | - | | |
| | 62 | 87.5 | 7.7 | 85.4 | 82.1 | 77.4 | 63.0 | 48.5 | 34.1 | 81.6 | 8.3 | 80.1 | 78.0 | 75.0 | 60.3 | 45.7 | 31.1 | | |
| 2975 | 77 | 99.8 | 7.7 | 72.1 | 52.5 | 32.9 | - | - | - | 91.6 | 8.3 | 72.4 | 51.0 | 29.6 | - | - | - | | |
| | 72 | 96.3 | 7.7 | 82.1 | 66.1 | 50.2 | 34.3 | - | - | 89.0 | 8.3 | 79.4 | 63.2 | 47.1 | 30.9 | - | - | | |
| | 67 | 92.8 | 7.7 | 89.0 | 79.8 | 67.5 | 51.2 | 34.9 | - | 86.3 | 8.3 | 83.6 | 75.5 | 64.5 | 48.1 | 31.6 | - | | |
| | 62 | 91.4 | 7.7 | 89.4 | 87.5 | 84.8 | 68.1 | 51.4 | 34.7 | 85.3 | 8.3 | 84.1 | 83.0 | 82.0 | 65.2 | 48.4 | 31.6 | | |
| 3400 | 77 | 101.8 | 7.7 | 81.4 | 57.1 | 32.7 | - | - | - | 94.1 | 8.3 | 82.3 | 55.9 | 29.5 | - | - | - | | |
| | 72 | 99.1 | 7.7 | 88.5 | 70.5 | 52.6 | 34.6 | - | - | 92.0 | 8.3 | 85.7 | 67.5 | 49.3 | 31.2 | - | - | | |
| | 67 | 96.4 | 7.7 | 93.3 | 84.0 | 72.4 | 54.0 | 35.5 | - | 89.9 | 8.3 | 87.6 | 79.2 | 69.2 | 50.6 | 32.0 | - | | |
| | 62 | 95.3 | 7.7 | 93.6 | 92.9 | 92.3 | 73.3 | 54.3 | 35.3 | 89.0 | 8.3 | 87.8 | 87.8 | 87.8 | 70.1 | 51.1 | 32.1 | | |
| 3825 | 77 | 104.7 | 7.7 | 94.1 | 94.1 | 94.1 | 92.6 | 73.1 | 53.5 | 88.1 | 8.3 | 88.1 | 88.1 | 88.1 | 88.1 | 70.2 | 50.8 | | |
| | 72 | 102.4 | 7.7 | 94.9 | 74.9 | 55.0 | 35.0 | - | - | 95.1 | 8.3 | 91.0 | 71.8 | 51.6 | 31.4 | - | - | | |
| | 67 | 100.1 | 7.7 | 96.7 | 88.2 | 77.4 | 56.7 | 36.1 | - | 93.5 | 8.3 | 91.4 | 82.9 | 73.9 | 53.2 | 32.5 | - | | |
| | 62 | 99.2 | 7.7 | 97.0 | 97.0 | 97.0 | 78.4 | 57.2 | 35.9 | 92.7 | 8.3 | 91.7 | 91.7 | 91.7 | 75.0 | 53.8 | 32.6 | | |
| 4250 | 77 | 104.7 | 7.7 | 98.2 | 98.2 | 98.2 | 98.2 | 78.2 | 56.3 | 91.9 | 8.3 | 91.9 | 91.9 | 91.9 | 91.9 | 75.1 | 53.4 | | |
| | 72 | 104.7 | 7.7 | 101.3 | 79.3 | 57.4 | 35.4 | - | - | 98.1 | 8.3 | 94.1 | 76.2 | 53.9 | 31.7 | - | - | | |
| | 67 | 103.7 | 7.7 | 102.0 | 92.4 | 82.3 | 59.5 | 36.7 | - | 97.1 | 8.3 | 94.7 | 86.7 | 78.6 | 55.8 | 33.0 | - | | |
| | 62 | 103.1 | 7.7 | 102.1 | 102.1 | 102.1 | 83.6 | 60.0 | 36.5 | 96.4 | 8.3 | 95.4 | 95.4 | 95.4 | 79.9 | 56.5 | 33.1 | | |
| | 57 | 102.5 | 7.7 | 102.5 | 102.5 | 102.5 | 102.5 | 83.3 | 59.0 | 95.8 | 8.3 | 95.8 | 95.8 | 95.8 | 95.8 | 80.0 | 56.1 | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 73: ZL12 (10 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|------|--|--|--|--|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | | Return dry bulb (°F) | | | | | | | | | |
| | | 115°F | | | | | | | | | | 125°F | | | | | | | | | |
| | | 90 | 85 | 80 | 75 | 70 | 65 | 90 | 85 | 80 | 75 | 70 | 65 | | | | | | | | |
| 2500 | 77 | 118.7 | 9.3 | 69.5 | 55.8 | 42.2 | - | - | - | 109.2 | 9.8 | 67.5 | 53.3 | 39.0 | - | - | - | | | | |
| | 72 | 110.3 | 9.2 | 83.6 | 69.3 | 54.9 | 40.5 | - | - | 101.4 | 9.8 | 79.5 | 65.3 | 51.1 | 37.0 | - | - | | | | |
| | 67 | 102.6 | 9.1 | 97.8 | 82.7 | 67.6 | 53.6 | 39.6 | - | 94.5 | 9.7 | 91.4 | 77.3 | 63.3 | 49.6 | 36.0 | - | | | | |
| | 62 | 102.3 | 9.1 | 99.0 | 89.6 | 80.2 | 66.6 | 53.1 | 39.5 | 93.5 | 9.7 | 91.9 | 83.0 | 75.4 | 62.3 | 49.2 | 36.1 | | | | |
| 3000 | 77 | 119.5 | 9.3 | 78.3 | 59.3 | 40.4 | - | - | - | 110.2 | 9.8 | 76.1 | 56.4 | 36.7 | - | - | - | | | | |
| | 72 | 112.8 | 9.2 | 90.2 | 73.6 | 57.0 | 40.5 | - | - | 103.9 | 9.8 | 85.7 | 69.3 | 53.0 | 36.7 | - | - | | | | |
| | 67 | 107.2 | 9.1 | 102.1 | 87.9 | 73.7 | 57.1 | 40.5 | - | 99.3 | 9.8 | 95.2 | 82.3 | 69.3 | 53.0 | 36.7 | - | | | | |
| | 62 | 106.8 | 9.1 | 103.0 | 96.6 | 90.3 | 73.7 | 57.1 | 40.5 | 99.0 | 9.8 | 95.6 | 90.1 | 85.6 | 69.4 | 53.2 | 36.9 | | | | |
| 3500 | 57 | 106.6 | 9.1 | 103.8 | 103.8 | 103.8 | 90.3 | 73.7 | 57.1 | 98.8 | 9.8 | 95.9 | 95.9 | 95.9 | 85.8 | 69.6 | 53.4 | | | | |
| | 77 | 120.4 | 9.3 | 87.1 | 62.8 | 38.5 | - | - | - | 111.1 | 9.9 | 84.8 | 59.5 | 34.3 | - | - | - | | | | |
| | 72 | 115.2 | 9.2 | 96.8 | 78.0 | 59.2 | 40.4 | - | - | 106.4 | 9.8 | 91.9 | 73.4 | 54.9 | 36.3 | - | - | | | | |
| | 67 | 110.5 | 9.2 | 106.5 | 93.1 | 79.8 | 60.6 | 41.4 | - | 103.9 | 9.8 | 99.9 | 87.2 | 75.4 | 56.4 | 37.5 | - | | | | |
| 4000 | 62 | 110.3 | 9.2 | 107.0 | 103.7 | 100.4 | 80.8 | 61.1 | 41.5 | 103.5 | 9.8 | 100.5 | 97.2 | 95.9 | 76.5 | 57.2 | 37.8 | | | | |
| | 57 | 110.0 | 9.1 | 107.5 | 107.5 | 107.5 | 101.0 | 80.9 | 60.8 | 103.3 | 9.8 | 101.2 | 101.2 | 101.2 | 96.6 | 76.9 | 57.1 | | | | |
| | 77 | 121.3 | 9.3 | 95.8 | 66.3 | 36.7 | - | - | - | 112.0 | 9.9 | 93.4 | 62.7 | 32.0 | - | - | - | | | | |
| | 72 | 117.6 | 9.2 | 103.3 | 82.3 | 61.3 | 40.3 | - | - | 108.9 | 9.9 | 98.1 | 77.4 | 56.7 | 36.0 | - | - | | | | |
| 4500 | 67 | 115.0 | 9.2 | 110.8 | 98.4 | 85.9 | 64.1 | 42.2 | - | 108.2 | 9.8 | 102.9 | 92.2 | 81.4 | 59.8 | 38.3 | - | | | | |
| | 62 | 114.7 | 9.2 | 111.0 | 110.8 | 110.5 | 87.9 | 65.2 | 42.5 | 107.6 | 9.8 | 103.3 | 103.3 | 103.3 | 83.7 | 61.2 | 38.7 | | | | |
| | 57 | 114.5 | 9.2 | 111.2 | 111.2 | 111.2 | 111.2 | 88.1 | 64.6 | 107.2 | 9.8 | 104.2 | 104.2 | 104.2 | 104.2 | 84.1 | 60.7 | | | | |
| | 72 | 120.0 | 9.3 | 109.9 | 86.7 | 63.5 | 40.2 | - | - | 113.4 | 9.9 | 104.3 | 81.5 | 58.6 | 35.7 | - | - | | | | |
| 5000 | 67 | 118.6 | 9.2 | 115.1 | 103.6 | 92.0 | 67.6 | 43.1 | - | 111.7 | 9.9 | 106.7 | 97.1 | 87.5 | 63.3 | 39.0 | - | | | | |
| | 62 | 118.5 | 9.2 | 115.5 | 115.5 | 115.5 | 94.9 | 69.2 | 43.5 | 111.4 | 9.9 | 107.5 | 107.5 | 107.5 | 90.8 | 65.2 | 39.6 | | | | |
| | 57 | 118.2 | 9.2 | 116.2 | 116.2 | 116.2 | 116.2 | 95.3 | 68.3 | 111.1 | 9.8 | 108.2 | 108.2 | 108.2 | 108.2 | 91.4 | 64.4 | | | | |
| | 72 | 123.1 | 9.3 | 116.4 | 91.0 | 65.6 | 40.2 | - | - | 115.9 | 9.9 | 110.6 | 85.5 | 60.4 | 35.4 | - | - | | | | |
| 5000 | 67 | 122.3 | 9.3 | 118.5 | 108.8 | 98.2 | 71.1 | 44.0 | - | 115.6 | 9.9 | 112.7 | 102.0 | 93.6 | 66.7 | 39.8 | - | | | | |
| | 62 | 122.1 | 9.3 | 119.0 | 119.0 | 119.0 | 102.0 | 73.3 | 44.5 | 115.4 | 9.9 | 113.1 | 113.1 | 113.1 | 97.9 | 69.2 | 40.5 | | | | |
| | 57 | 121.9 | 9.2 | 119.5 | 119.5 | 119.5 | 119.5 | 102.5 | 72.1 | 115.0 | 9.9 | 113.1 | 113.1 | 113.1 | 113.1 | 98.6 | 68.0 | | | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Table 75: ZL14 (12.5 ton, 115°F to 125°F)

| Air on evaporator coil | | Temperature of air on condenser coil | | | | | | | | | | | | | | | | | |
|------------------------|---------|--------------------------------------|-------------------------------|-------------------------|-------|-------|-------|------|-----------------------------------|-------------------------------|-------------------------|-------|-------|-------|-------|------|------|----|----|
| CFM | WB (°F) | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | Total capacity ¹ (MBh) | Total input (kW) ² | Sensible capacity (MBh) | | | | | | | | |
| | | | | Return dry bulb (°F) | | | | | | | Return dry bulb (°F) | | | | | | | | |
| | | | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| | | | | 115°F | | | | | | | | | | 125°F | | | | | |
| 3200 | 77 | 134.4 | 10.6 | 84.5 | 66.5 | 48.5 | - | - | - | 122.4 | 11.3 | 85.4 | 64.9 | 44.4 | - | - | - | | |
| | 72 | 129.0 | 10.6 | 100.9 | 83.4 | 65.9 | 48.5 | - | - | 118.7 | 11.3 | 97.3 | 79.8 | 62.3 | 44.8 | - | - | | |
| | 67 | 123.6 | 10.6 | 117.3 | 100.3 | 83.4 | 65.7 | 47.9 | - | 115.3 | 11.3 | 109.1 | 94.6 | 80.2 | 62.1 | 44.0 | - | | |
| | 62 | 122.4 | 10.6 | 117.4 | 108.6 | 100.9 | 82.9 | 64.8 | 46.8 | 115.1 | 11.3 | 109.2 | 103.4 | 98.1 | 79.4 | 60.7 | 42.0 | | |
| 3750 | 77 | 136.1 | 10.7 | 93.7 | 69.9 | 46.1 | - | - | - | 124.4 | 11.3 | 93.4 | 67.5 | 41.7 | - | - | - | | |
| | 72 | 131.8 | 10.6 | 107.2 | 87.3 | 67.3 | 47.4 | - | - | 121.4 | 11.3 | 102.8 | 83.0 | 63.1 | 43.3 | - | - | | |
| | 67 | 127.4 | 10.6 | 119.8 | 104.7 | 88.6 | 68.3 | 47.9 | - | 118.4 | 11.3 | 112.3 | 98.4 | 84.6 | 64.2 | 43.8 | - | | |
| | 62 | 126.7 | 10.6 | 120.0 | 114.9 | 109.8 | 89.1 | 68.4 | 47.8 | 118.2 | 11.3 | 112.5 | 109.0 | 106.0 | 85.1 | 64.1 | 43.2 | | |
| 4300 | 57 | 125.9 | 10.6 | 120.9 | 120.9 | 120.9 | 110.0 | 88.9 | 67.9 | 118.1 | 11.3 | 112.6 | 112.6 | 112.6 | 105.9 | 84.5 | 63.0 | | |
| | 77 | 137.7 | 10.7 | 102.8 | 73.3 | 43.8 | - | - | - | 126.4 | 11.3 | 101.4 | 70.2 | 39.0 | - | - | - | | |
| | 72 | 134.5 | 10.6 | 113.6 | 91.2 | 68.8 | 46.3 | - | - | 124.2 | 11.3 | 108.4 | 86.2 | 64.0 | 41.8 | - | - | | |
| | 67 | 131.2 | 10.6 | 123.6 | 109.0 | 93.7 | 70.8 | 48.0 | - | 122.4 | 11.3 | 115.4 | 102.2 | 89.0 | 66.3 | 43.6 | - | | |
| 4900 | 62 | 131.0 | 10.6 | 124.4 | 121.2 | 118.7 | 95.3 | 72.0 | 48.7 | 122.2 | 11.3 | 115.6 | 114.6 | 113.9 | 90.7 | 67.5 | 44.3 | | |
| | 57 | 130.7 | 10.6 | 124.6 | 124.6 | 124.6 | 119.8 | 96.0 | 72.2 | 121.9 | 11.3 | 115.9 | 115.9 | 115.9 | 115.2 | 91.5 | 67.8 | | |
| | 77 | 139.4 | 10.7 | 111.9 | 76.7 | 41.4 | - | - | - | 128.3 | 11.3 | 109.3 | 72.8 | 36.3 | - | - | - | | |
| | 72 | 137.2 | 10.7 | 119.9 | 95.0 | 70.2 | 45.3 | - | - | 126.9 | 11.3 | 114.0 | 89.4 | 64.8 | 40.3 | - | - | | |
| 5400 | 67 | 135.4 | 10.6 | 127.2 | 113.4 | 98.9 | 73.4 | 48.0 | - | 125.9 | 11.3 | 118.3 | 106.0 | 93.4 | 68.3 | 43.3 | - | | |
| | 62 | 135.3 | 10.6 | 127.4 | 127.4 | 127.4 | 101.6 | 75.6 | 49.6 | 125.7 | 11.3 | 118.4 | 118.4 | 118.4 | 96.4 | 71.0 | 45.5 | | |
| | 57 | 135.1 | 10.6 | 127.5 | 127.5 | 127.5 | 103.2 | 76.6 | - | 125.5 | 11.3 | 118.6 | 118.6 | 118.6 | 98.6 | 72.7 | - | | |
| | 72 | 139.9 | 10.7 | 126.2 | 98.9 | 71.6 | 44.2 | - | - | 129.6 | 11.3 | 119.5 | 92.6 | 65.7 | 38.8 | - | - | | |
| 6000 | 67 | 138.8 | 10.7 | 130.8 | 117.7 | 104.0 | 76.0 | 48.0 | - | 129.4 | 11.3 | 121.7 | 109.8 | 97.7 | 70.4 | 43.1 | - | | |
| | 62 | 138.5 | 10.7 | 131.1 | 131.1 | 131.1 | 107.8 | 79.2 | 50.5 | 129.2 | 11.3 | 121.9 | 121.9 | 121.9 | 102.1 | 74.4 | 46.7 | | |
| | 57 | 138.4 | 10.7 | 131.3 | 131.3 | 131.3 | 110.3 | 81.0 | - | 129.1 | 11.3 | 122.0 | 122.0 | 122.0 | 105.6 | 77.5 | - | | |
| | 72 | 145.1 | 10.7 | 132.6 | 102.8 | 73.0 | 43.2 | - | - | 132.9 | 11.3 | 125.1 | 95.8 | 66.5 | 37.3 | - | - | | |
| 6000 | 67 | 144.2 | 10.7 | 135.0 | 122.1 | 109.2 | 78.6 | 48.1 | - | 132.7 | 11.3 | 125.3 | 113.6 | 102.1 | 72.5 | 42.9 | - | | |
| | 62 | 143.8 | 10.7 | 135.8 | 135.8 | 135.8 | 114.1 | 82.8 | 51.4 | 132.5 | 11.3 | 125.4 | 125.4 | 125.4 | 107.8 | 77.8 | 47.8 | | |
| | 57 | 143.5 | 10.7 | 136.0 | 136.0 | 136.0 | 117.4 | 85.4 | - | 132.2 | 11.3 | 125.5 | 125.5 | 125.5 | 112.7 | 82.4 | - | | |

- 1 These capacities are gross ratings. For net capacity, deduct the supply air blower motor heat (MBh = 3.415 x kW). Refer to the appropriate blower performance table for the kW of the supply air blower motor.
- 2 These ratings include the condenser fan motors (total 1 kW) and the compressor motors but not the supply air blower motor.

Drive selection

1. Determine the side or bottom supply duct application.
2. Determine the required airflow.
3. Calculate or measure the amount of external static pressure.
 - Add or deduct any additional static resistance from [Additional static resistance](#).
4. Using the operating point determined from Steps 1, 2, and 3, locate this point on the appropriate supply air blower performance table. (Linear interpolation may be necessary.)
5. Noting the RPM and BHP from Step 4, locate the appropriate motor and, or drive on the RPM selection table.
6. Review the BHP compared to the motor options available. Select the appropriate motor and, or drive.
7. Review the RPM range for the motor options available. Select the appropriate drive if multiple drives are available for the chosen motor.
8. Determine the number of turns required open to obtain the required operation point.

Example

1. 3200 SCFM, bottom supply duct application
2. 1.8 IWG
3. Using the airflow performance table below, the following data point was located: 1071 RPM and 2.52 BHP.
4. Using the RPM selection table below, model ZY and size 08 (7.5 tons) is found.
5. 2.52 BHP exceeds the maximum continuous BHP rating of the 2.4 HP motor. The 3.7 HP motor is required.
6. 1071 RPM is within the range of the 3.7 HP motor.
7. Using the 3.7-HP motor and high-static drive, 0.5 turns open achieves the required 1071 RPM.

Airflow performance

Example supply air blower performance

Table 76: ZY08 (7.5 ton) bottom duct

| CFM | Available external static, IWG | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 556 | 0.45 | 621 | 0.65 | 683 | 0.83 | 742 | 1.00 | 798 | 1.18 | 852 | 1.34 | 904 | 1.51 | 954 | 1.69 | 1003 | 1.87 | 1050 | 2.06 |
| 2400 | 567 | 0.53 | 632 | 0.73 | 694 | 0.91 | 753 | 1.09 | 809 | 1.26 | 863 | 1.43 | 914 | 1.60 | 964 | 1.77 | 1013 | 1.95 | 1060 | 2.14 |
| 2600 | 580 | 0.65 | 646 | 0.85 | 707 | 1.03 | 766 | 1.21 | 823 | 1.38 | 876 | 1.55 | 928 | 1.72 | 978 | 1.89 | 1027 | 2.07 | 1074 | 2.27 |
| 2800 | 595 | 0.79 | 660 | 0.99 | 722 | 1.17 | 780 | 1.35 | 837 | 1.52 | 890 | 1.69 | 942 | 1.86 | 992 | 2.03 | 1041 | 2.21 | 1088 | 2.40 |
| 3000 | 609 | 0.94 | 674 | 1.14 | 736 | 1.32 | 795 | 1.50 | 851 | 1.67 | 905 | 1.83 | 957 | 2.00 | 1007 | 2.18 | 1056 | 2.36 | 1100 | 2.55 |
| 3200 | 625 | 1.10 | 690 | 1.30 | 752 | 1.48 | 810 | 1.66 | 867 | 1.83 | 921 | 2.00 | 972 | 2.17 | 1022 | 2.34 | 1071 | 2.52 | -- | -- |
| 3400 | 641 | 1.28 | 706 | 1.47 | 768 | 1.66 | 827 | 1.83 | 883 | 2.00 | 937 | 2.17 | 989 | 2.34 | 1039 | 2.52 | 1087 | 2.70 | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

Table 77: Example RPM Selection

| Model | Size (ton) | Airflow Option | Phase | Max BHP | Blower Sheave | Motor Sheave | 6 Turns open | 5 Turns open | 4 Turns open | 3 Turns open | 2 Turns open | 1 Turns open | Fully closed |
|-------|------------|----------------|-------|---------|---------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| ZY | 08 (7.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |

Table 78: Example additional static resistance

| Model | Size (ton) | CFM | Cooling only ¹ | Economizer ^{2,3} | 4 in. filters ² | Electric heat kW ² | | | | | | | |
|-------|-------------------------------------|------|---------------------------|---------------------------|----------------------------|-------------------------------|-------------|------------|------------|------|----------------|----------|-----------|
| | | | | | | 6/6.5 | 9.2/10.5/11 | 13.8/14/16 | 16/16.5/17 | 23 | 24.8/25.5/27.8 | 32/33/34 | 41.7/42.4 |
| ZY | 08 (7.5), 09 (8.5), 12 (10.0) | 2200 | 0.04 | 0.11 | --- | --- | --- | --- | 0.07 | --- | 0.09 | 0.10 | 0.12 |
| | | 2600 | 0.06 | 0.13 | --- | --- | --- | --- | 0.09 | --- | 0.11 | 0.12 | 0.15 |
| | | 3000 | 0.10 | 0.17 | --- | --- | --- | --- | 0.12 | --- | 0.14 | 0.15 | 0.19 |
| | | 3400 | 0.13 | 0.20 | --- | --- | --- | --- | 0.15 | --- | 0.18 | 0.19 | 0.23 |
| | | 3800 | 0.16 | 0.25 | --- | --- | --- | --- | 0.19 | --- | 0.22 | 0.23 | 0.27 |
| | | 4000 | 0.17 | 0.28 | --- | --- | --- | --- | 0.21 | --- | 0.24 | 0.25 | 0.30 |
| | | 4400 | 0.20 | 0.33 | --- | --- | --- | --- | 0.25 | --- | 0.29 | 0.30 | 0.35 |
| | | 4800 | 0.22 | 0.38 | --- | --- | --- | --- | 0.30 | --- | 0.34 | 0.35 | 0.41 |
| | | 5200 | 0.24 | 0.43 | --- | --- | --- | --- | 0.35 | --- | 0.39 | 0.41 | 0.47 |
| | | 5600 | 0.26 | 0.46 | --- | --- | --- | --- | 0.41 | --- | 0.45 | 0.47 | 0.54 |
| 6000 | 0.28 | 0.50 | --- | --- | --- | --- | 0.48 | --- | 0.52 | 0.54 | 0.60 | | |

Altitude and temperature correction for cfm, static pressure, and power

Use the following information to assist in application of product when being applied at altitudes at or exceeding 1000 ft above sea level.


The air flow rates listed in the standard blower performance tables are based on standard air at sea level. As the altitude or temperature increases, the density of air decreases. In order to use the indoor blower tables for high altitude applications, certain corrections are necessary.

A centrifugal fan is a "constant volume" device. This means that, if the RPM remains constant, the CFM delivered is the same regardless of the density of the air. However, because the air at high altitude is less dense, less static pressure is generated and less power is required than a similar application at sea level. See [Altitude/temperature correction factors](#) for air density correction factors.

Altitude/temperature correction factors

Table 79: Altitude/temperature correction factors

| Air temp. | Altitude (ft) | | | | | | | | | | |
|-----------|---------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| | 0 | 1000 | 2000 | 3000 | 4000 | 5000 | 6000 | 7000 | 8000 | 9000 | 10000 |
| 40 | 1.060 | 1.022 | 0.986 | 0.950 | 0.916 | 0.882 | 0.849 | 0.818 | 0.788 | 0.758 | 0.729 |
| 50 | 1.039 | 1.002 | 0.966 | 0.931 | 0.898 | 0.864 | 0.832 | 0.802 | 0.772 | 0.743 | 0.715 |
| 60 | 1.019 | 0.982 | 0.948 | 0.913 | 0.880 | 0.848 | 0.816 | 0.787 | 0.757 | 0.729 | 0.701 |
| 70 | 1.000 | 0.964 | 0.930 | 0.896 | 0.864 | 0.832 | 0.801 | 0.772 | 0.743 | 0.715 | 0.688 |
| 80 | 0.982 | 0.947 | 0.913 | 0.880 | 0.848 | 0.817 | 0.787 | 0.758 | 0.730 | 0.702 | 0.676 |
| 90 | 0.964 | 0.929 | 0.897 | 0.864 | 0.833 | 0.802 | 0.772 | 0.744 | 0.716 | 0.689 | 0.663 |
| 100 | 0.946 | 0.912 | 0.880 | 0.848 | 0.817 | 0.787 | 0.758 | 0.730 | 0.703 | 0.676 | 0.651 |

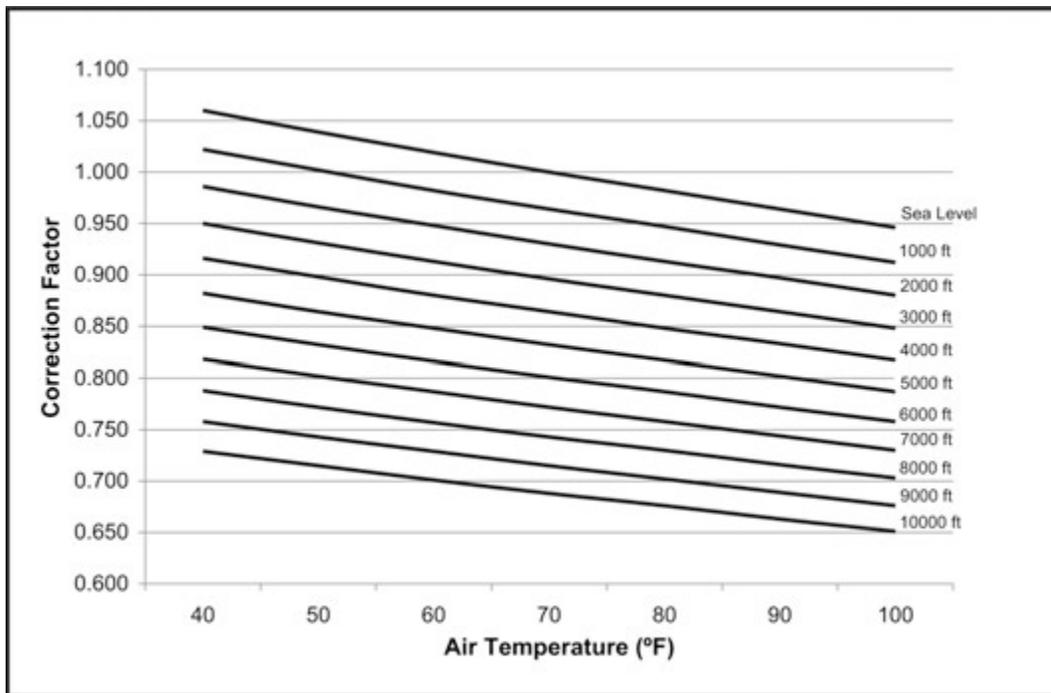

Use the following examples to determine the airflow performance of the product at altitude.

Example 1: What are the corrected CFM, static pressure, and BHP at an elevation of 5,000 ft if the airflow performance data is 3,000 CFM, 1.4 IWC, and 2.0 BHP?

Solution: At an elevation of 5,000 ft, the indoor blower still delivers 3,000 CFM if the rpm is unchanged. However, the Altitude correction must be used to determine the static pressure and BHP. Because no temperature data is given, we assume an air temperature of 70°F. The altitude/temperature factors show the correction factor to be 0.832.

Corrected static pressure = $1.4 \times 0.832 = 1.16$ IWC

Corrected BHP = $2.0 \times 0.832 = 1.66$

Example 2: A system, located at 5,000 feet of elevation, is to deliver 3,000 CFM at a static pressure of 1.4 in. Use the unit blower tables to select the blower speed and the BHP requirement.

Solution: As in the example above, no temperature information is given so 70°F is assumed.

The 1.4 in. static pressure given is at an elevation of 5,000 ft. The first step is to convert this static pressure to equivalent sea level conditions.

Sea level static pressure = $1.4 \text{ in.} / 0.832 = 1.68 \text{ in.}$

Enter the supply air blower performance table at 3,000 CFM and static pressure of 1.68 in. The RPM listed is the same RPM needed at 5,000 ft.

If the corresponding BHP listed in the table is 2.0. Correct this value for elevation.

$$\text{BHP at 5,000 ft.} = 2.0 \times 0.832 = 1.66$$

Indoor blower specifications

Table 80: Indoor blower specifications

| Model | Size (ton) | Airflow option | Motor | | | | | | Motor sheave | | | Blower sheave | | | Belt |
|-------|------------|----------------|--------------|------|------|------|------|-------|------------------|------------|-------|------------------|------------|-------|------|
| | | | Phase | HP | RPM | Eff. | SF | Frame | Datum dia. (in.) | Bore (in.) | Model | Datum Dia. (in.) | Bore (in.) | Model | |
| ZQ | 04 (3) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1725 | 0.79 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZQ | 05 (4) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1725 | 0.79 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZQ | 06 (5) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1725 | 0.79 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A37 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A37 |
| | | H. static | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 4.2 | 3/4 | AK46 | A39 |
| ZX | A7 (6) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.7 | 3/4 | AK51 | A39 |
| | | Med. | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 4.7 | 3/4 | AK51 | A40 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 4.7 | 3/4 | AK51 | A41 |
| ZX | 08 (7.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZX | 09 (8.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZX | 12 (10) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.5 | 1 | AK79 | A50 |
| | | Med. | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.5 | 1 | AK79 | A50 |
| | | H. static | 3 | 5.25 | 1725 | 0.84 | 1.15 | 145TY | 4.3 - 5.3 | 7/8 | 1VP56 | 7.9 | 1 | BK85 | BX52 |
| ZX | 14 (12.5) | Std. | 3 | 2.9 | 1750 | 0.87 | 1.15 | 56Z | 2.8 - 3.8 | 7/8 | 1VL44 | 7.5 | 1 | AK79 | A50 |
| | | Med. | 3 | 3.7 | 1750 | 0.90 | 1.15 | 184TZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.5 | 1 | AK79 | A52 |
| | | H. static | 3 | 5.25 | 1750 | 0.90 | 1.15 | 184TZ | 4.3 - 5.3 | 7/8 | 1VP56 | 7.9 | 1 | BK85 | BX54 |
| ZY | 04 (3) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1725 | 0.79 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZY | 05 (4) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1725 | 0.79 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZY | 06 (5) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 1 | 1.5 | 1750 | 0.83 | 1.15 | 56H | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A37 |
| | | Med. | 3 | 2.4 | 1750 | 0.87 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A37 |
| | | H. static | 3 | 2.9 | 1750 | 0.87 | 1.15 | 56Z | 2.8 - 3.8 | 7/8 | 1VL44 | 4.2 | 3/4 | AK46 | A39 |
| ZY | 07 (6) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A48 |
| ZY | A7 (6) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.9 | 1725 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A48 |
| ZY | 08 (7.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZY | 09 (8.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZY | 12 (10) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.5 | 1 | AK79 | A50 |
| | | Med. | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.5 | 1 | AK79 | A50 |
| | | H. static | 3 | 5.25 | 1725 | 0.84 | 1.15 | 145TY | 4.3 - 5.3 | 7/8 | 1VP56 | 7.9 | 1 | BK85 | BX52 |

Table 80: Indoor blower specifications

| Model | Size (ton) | Airflow option | Motor | | | | | Motor sheave | | | Blower sheave | | | Belt | |
|-------|------------|----------------|--------------|------|------|------|------|--------------|------------------|------------|---------------|------------------|------------|------|-------|
| | | | Phase | HP | RPM | Eff. | SF | Frame | Datum dia. (in.) | Bore (in.) | Model | Datum Dia. (in.) | Bore (in.) | | Model |
| ZL | 04 (3) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 3 | 2.4 | 1750 | 0.87 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.4 | 1750 | 0.87 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZL | 05 (4) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 3 | 2.4 | 1750 | 0.87 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A39 |
| | | H. static | 3 | 2.9 | 1750 | 0.81 | 1.15 | 56Y | 2.8 - 3.8 | 7/8 | 1VL44 | 4.2 | 3/4 | AK46 | A40 |
| ZL | 06 (5) | Std. | Direct Drive | | | | | | | | | | | | |
| | | Med. | 3 | 2.4 | 1750 | 0.87 | 1.15 | 56HZ | 1.9 - 2.9 | 5/8 | 1VL34 | 4.2 | 3/4 | AK46 | A37 |
| | | H. static | 3 | 2.9 | 1750 | 0.87 | 1.15 | 56Z | 2.8 - 3.8 | 7/8 | 1VL44 | 4.2 | 3/4 | AK46 | A39 |
| ZL | 08 (7.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZL | 09 (8.5) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 1.9 - 2.9 | 5/8 | 1VL34 | 7.0 | 1 | AK74 | A47 |
| | | Med. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.0 | 1 | AK74 | A48 |
| | | H. static | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.0 | 1 | AK74 | A50 |
| ZL | 12 (10) | Std. | 3 | 2.4 | 1725 | 0.80 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.5 | 1 | AK79 | A50 |
| | | Med. | 3 | 3.7 | 1725 | 0.84 | 1.15 | 56HZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.5 | 1 | AK79 | A50 |
| | | H. static | 3 | 5.25 | 1725 | 0.84 | 1.15 | 145TY | 4.3 - 5.3 | 7/8 | 1VP56 | 7.9 | 1 | BK85 | BX52 |
| ZL | 14 (12.5) | Std. | 3 | 2.9 | 1750 | 0.87 | 1.15 | 56Y | 2.8 - 3.8 | 5/8 | 1VL44 | 7.5 | 1 | AK79 | A50 |
| | | Med. | 3 | 3.7 | 1750 | 0.90 | 1.15 | 184TZ | 3.4 - 4.4 | 7/8 | 1VP50 | 7.5 | 1 | AK79 | A52 |
| | | H. static | 3 | 5.25 | 1750 | 0.90 | 1.15 | 184TZ | 4.3 - 5.3 | 7/8 | 1VP56 | 7.9 | 1 | BK85 | BX54 |

RPM selection

Table 81: RPM selection

| Model | Size (Tons) | Airflow Option | Phase | MAX BHP | Blower Sheave | Motor Sheave | 6 Turns Open | 5 Turns Open | 4 Turns Open | 3 Turns Open | 2 Turns Open | 1 Turns Open | Fully Closed |
|-------|-------------|----------------|--------------|---------|---------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| ZQ | 04 (3) | Std. | Direct Drive | | | | | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.4 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZQ | 05 (4) | Std. | Direct Drive | | | | | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.4 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZQ | 06 (5) | Std. | Direct Drive | | | | | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.9 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZX | A7 (6) | Std. | 3 | 2.4 | AK51 | 1VL34 | N/A | 707 | 782 | 856 | 931 | 1005 | 1080 |
| | | Med. | 3 | 2.9 | AK51 | 1VL44 | N/A | 1043 | 1117 | 1191 | 1266 | 1340 | 1415 |
| | | H. Static | 3 | 3.7 | AK51 | 1VP50 | N/A | 1266 | 1340 | 1415 | 1489 | 1564 | 1638 |
| ZX | 08 (7.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.9 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZX | 09 (8.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZX | 12 (10) | Std. | 3 | 2.4 | AK79 | 1VL44 | N/A | 653 | 700 | 747 | 793 | 840 | 887 |
| | | Med. | 3 | 3.7 | AK79 | 1VP50 | N/A | 793 | 840 | 887 | 933 | 980 | 1027 |
| | | H. Static | 3 | 5.25 | BK85 | 1VP56 | 953 | 997 | 1041 | 1085 | 1130 | 1174 | N/A |
| ZX | 14 (12.5) | Std. | 3 | 2.9 | AK79 | 1VL44 | N/A | 653 | 700 | 747 | 793 | 840 | 887 |
| | | Med. | 3 | 3.7 | AK79 | 1VP50 | N/A | 793 | 840 | 887 | 933 | 980 | 1027 |
| | | H. Static | 3 | 5.25 | BK85 | 1VP56 | 953 | 997 | 1041 | 1085 | 1130 | 1174 | N/A |
| ZY | 04 (3) | Std. | Direct Drive | | | | | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.4 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZY | 05 (4) | Std. | Direct Drive | | | | | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.9 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |

Table 81: RPM selection

| Model | Size (Tons) | Airflow Option | Phase | MAX BHP | Blower Sheave | Motor Sheave | 6 Turns Open | 5 Turns Open | 4 Turns Open | 3 Turns Open | 2 Turns Open | 1 Turns Open | Fully Closed |
|-------|-------------|----------------|-------|---------|---------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| ZY | 06 (5) | Std. | | | | | Direct Drive | | | | | | |
| | | Med. | 1 | 1.5 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.9 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZY | 07 (6) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.9 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZY | A7 (6) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.9 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZY | 08 (7.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZY | 09 (8.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZY | 12 (10) | Std. | 3 | 2.4 | AK79 | 1VL44 | N/A | 653 | 700 | 747 | 793 | 840 | 887 |
| | | Med. | 3 | 3.7 | AK79 | 1VP50 | N/A | 793 | 840 | 887 | 933 | 980 | 1027 |
| | | H. Static | 3 | 5.25 | BK85 | 1VP56 | 953 | 997 | 1041 | 1085 | 1130 | 1174 | N/A |
| ZL | 04 (3) | Std. | | | | | Direct Drive | | | | | | |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.4 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZL | 05 (4) | Std. | | | | | Direct Drive | | | | | | |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.9 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZL | 06 (5) | Std. | | | | | Direct Drive | | | | | | |
| | | Med. | 3 | 2.4 | AK46 | 1VL34 | N/A | 792 | 875 | 958 | 1042 | 1125 | 1208 |
| | | H. Static | 3 | 2.9 | AK46 | 1VL44 | N/A | 1167 | 1250 | 1333 | 1417 | 1500 | 1593 |
| ZL | 08 (7.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZL | 09 (8.5) | Std. | 3 | 2.4 | AK74 | 1VL34 | N/A | 475 | 525 | 575 | 625 | 675 | 725 |
| | | Med. | 3 | 2.4 | AK74 | 1VL44 | N/A | 700 | 750 | 800 | 850 | 900 | 950 |
| | | H. Static | 3 | 3.7 | AK74 | 1VP50 | N/A | 850 | 900 | 950 | 1000 | 1050 | 1100 |
| ZL | 12 (10) | Std. | 3 | 2.4 | AK79 | 1VL44 | N/A | 653 | 700 | 747 | 793 | 840 | 887 |
| | | Med. | 3 | 3.7 | AK79 | 1VP50 | N/A | 793 | 840 | 887 | 933 | 980 | 1027 |
| | | H. Static | 3 | 5.25 | BK85 | 1VP56 | 953 | 997 | 1041 | 1085 | 1130 | 1174 | N/A |
| ZL | 14 (12.5) | Std. | 3 | 2.9 | AK79 | 1VL44 | N/A | 653 | 700 | 747 | 793 | 840 | 887 |
| | | Med. | 3 | 3.7 | AK79 | 1VP50 | N/A | 793 | 840 | 887 | 933 | 980 | 1027 |
| | | H. Static | 3 | 5.25 | BK85 | 1VP56 | 953 | 997 | 1041 | 1085 | 1130 | 1174 | N/A |

Additional static resistance

Table 82: Additional static resistance - ZQ04-06

| Model | Size (ton) | CFM | Cooling only ¹ | Economizer ^{2,3} | 4 in. filter ² | Electric heat kW ² | | | |
|-------|------------------------------|------|---------------------------|---------------------------|---------------------------|-------------------------------|-------------|------------|------|
| | | | | | | 6/6.5 | 9.2/10.5/11 | 13.8/14/16 | 23 |
| ZQ | 04 (3.0), 05 (4.0), | 900 | 0.04 | 0.15 | --- | 0.00 | 0.00 | 0.01 | 0.01 |
| | | 1000 | 0.05 | 0.18 | --- | 0.00 | 0.00 | 0.02 | 0.02 |
| | | 1100 | 0.06 | 0.21 | --- | 0.01 | 0.01 | 0.02 | 0.03 |
| | | 1200 | 0.07 | 0.24 | --- | 0.01 | 0.01 | 0.02 | 0.03 |
| | | 1300 | 0.10 | 0.28 | --- | 0.01 | 0.01 | 0.03 | 0.03 |
| | | 1400 | 0.12 | 0.33 | --- | 0.02 | 0.02 | 0.03 | 0.04 |
| | | 1500 | 0.14 | 0.44 | --- | 0.02 | 0.02 | 0.04 | 0.04 |
| | | 1600 | 0.16 | 0.52 | --- | 0.02 | 0.02 | 0.04 | 0.05 |
| | | 1700 | 0.18 | 0.59 | --- | 0.03 | 0.03 | 0.05 | 0.05 |
| | | 1800 | 0.22 | 0.66 | --- | 0.03 | 0.03 | 0.05 | 0.06 |
| | | 1900 | 0.25 | 0.74 | --- | 0.04 | 0.04 | 0.06 | 0.07 |
| | | 2000 | 0.28 | 0.81 | --- | 0.04 | 0.04 | 0.07 | 0.08 |
| | | 2100 | 0.33 | 0.88 | --- | 0.05 | 0.05 | 0.07 | 0.08 |
| | | 2200 | 0.36 | 0.95 | --- | 0.06 | 0.06 | 0.08 | 0.09 |
| | | 2300 | 0.41 | 1.03 | --- | 0.06 | 0.06 | 0.09 | 0.10 |
| | 2400 | 0.45 | 1.10 | --- | 0.07 | 0.07 | 0.10 | 0.11 | |
| | 2500 | 0.50 | 1.17 | --- | 0.08 | 0.08 | 0.11 | 0.12 | |
| | 06 (5.0) | 1800 | 0.23 | 0.66 | --- | 0.03 | 0.03 | 0.05 | 0.06 |
| | | 2000 | 0.28 | 0.81 | --- | 0.04 | 0.04 | 0.07 | 0.08 |
| | | 2200 | 0.32 | 0.95 | --- | 0.06 | 0.06 | 0.08 | 0.09 |
| | | 2400 | 0.37 | 1.10 | --- | 0.07 | 0.07 | 0.10 | 0.11 |

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Table 83: Additional static resistance - ZXA7, 08-14

| Model | Size (ton) | CFM | Cooling only ¹ | Economizer ^{2,3} | 4 in. filter ² | Electric heat kW ² | | | | | | | |
|-------|---|------|---------------------------|---------------------------|---------------------------|-------------------------------|-------------|------------|------------|------|----------------|----------|-----------|
| | | | | | | 6/6.5 | 9.2/10.5/11 | 13.8/14/16 | 16/16.5/17 | 23 | 24.8/25.5/27.8 | 32/33/34 | 41.7/42.4 |
| ZX | A7 (6) | 1800 | 0.23 | 0.66 | --- | 0.03 | 0.03 | 0.05 | --- | --- | --- | --- | --- |
| | | 2000 | 0.28 | 0.81 | --- | 0.04 | 0.04 | 0.06 | --- | --- | --- | --- | --- |
| | | 2200 | 0.32 | 0.95 | --- | 0.06 | 0.06 | 0.07 | --- | --- | --- | --- | --- |
| | | 2400 | 0.37 | 1.10 | --- | 0.07 | 0.07 | 0.08 | --- | --- | --- | --- | --- |
| | | 2600 | 0.38 | 1.25 | --- | 0.08 | 0.08 | 0.09 | --- | --- | --- | --- | --- |
| | | 2800 | 0.41 | 1.39 | --- | 0.09 | 0.09 | 0.10 | --- | --- | --- | --- | --- |
| | | 3000 | 0.45 | 1.54 | --- | 0.11 | 0.11 | 0.12 | --- | --- | --- | --- | --- |
| ZX | 08 (7.5), 09 (8.5), 12 (10.0), 14 (12.5) | 2200 | 0.04 | 0.18 | --- | --- | --- | --- | 0.07 | --- | 0.09 | 0.10 | 0.12 |
| | | 2600 | 0.06 | 0.24 | --- | --- | --- | --- | 0.09 | --- | 0.11 | 0.12 | 0.15 |
| | | 3000 | 0.10 | 0.35 | --- | --- | --- | --- | 0.12 | --- | 0.14 | 0.15 | 0.19 |
| | | 3400 | 0.13 | 0.47 | --- | --- | --- | --- | 0.15 | --- | 0.18 | 0.19 | 0.23 |
| | | 4800 | 0.22 | 0.91 | --- | --- | --- | --- | 0.30 | --- | 0.34 | 0.35 | 0.41 |
| | | 5200 | 0.24 | 1.04 | --- | --- | --- | --- | 0.35 | --- | 0.39 | 0.41 | 0.47 |
| | | 5600 | 0.26 | 1.17 | --- | --- | --- | --- | 0.41 | --- | 0.45 | 0.47 | 0.54 |
| 6000 | 0.28 | 1.30 | --- | --- | --- | --- | 0.48 | --- | 0.52 | 0.54 | 0.60 | | |

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Table 84: Additional static resistance - ZY04-12

| Model | Size (ton) | CFM | Cooling only ¹ | Economizer ^{2,3} | 4 in. filters ² | Electric heat kW ² | | | | | | | |
|-------|--|------|---------------------------|---------------------------|----------------------------|-------------------------------|-------------|------------|------------|------|----------------|----------|-----------|
| | | | | | | 6/6.5 | 9.2/10.5/11 | 13.8/14/16 | 16/16.5/17 | 23 | 24.8/25.5/27.8 | 32/33/34 | 41.7/42.4 |
| ZY | 04 (3.0) | 900 | 0.04 | 0.15 | --- | 0.00 | 0.00 | 0.01 | --- | 0.01 | --- | --- | --- |
| | | 1000 | 0.05 | 0.18 | --- | 0.00 | 0.00 | 0.02 | --- | 0.02 | --- | --- | --- |
| | | 1100 | 0.06 | 0.21 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1200 | 0.07 | 0.24 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1300 | 0.10 | 0.28 | --- | 0.01 | 0.01 | 0.03 | --- | 0.03 | --- | --- | --- |
| | | 1400 | 0.12 | 0.33 | --- | 0.02 | 0.02 | 0.03 | --- | 0.04 | --- | --- | --- |
| | 05 (4.0) | 1500 | 0.14 | 0.44 | --- | 0.02 | 0.02 | 0.04 | --- | 0.04 | --- | --- | --- |
| | | 1200 | 0.06 | 0.24 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1300 | 0.06 | 0.28 | --- | 0.01 | 0.01 | 0.03 | --- | 0.03 | --- | --- | --- |
| | | 1400 | 0.06 | 0.33 | --- | 0.02 | 0.02 | 0.03 | --- | 0.04 | --- | --- | --- |
| | | 1500 | 0.07 | 0.44 | --- | 0.02 | 0.02 | 0.04 | --- | 0.04 | --- | --- | --- |
| | | 1600 | 0.08 | 0.52 | --- | 0.02 | 0.02 | 0.04 | --- | 0.05 | --- | --- | --- |
| | | 1700 | 0.11 | 0.59 | --- | 0.03 | 0.03 | 0.05 | --- | 0.05 | --- | --- | --- |
| | | 1800 | 0.13 | 0.66 | --- | 0.03 | 0.03 | 0.05 | --- | 0.06 | --- | --- | --- |
| | 06 (5.0) | 1900 | 0.16 | 0.74 | --- | 0.04 | 0.04 | 0.06 | --- | 0.07 | --- | --- | --- |
| | | 2000 | 0.20 | 0.81 | --- | 0.04 | 0.04 | 0.07 | --- | 0.08 | --- | --- | --- |
| | | 1800 | 0.23 | 0.66 | --- | 0.03 | 0.03 | 0.05 | --- | 0.06 | --- | --- | --- |
| | | 2000 | 0.28 | 0.81 | --- | 0.04 | 0.04 | 0.07 | --- | 0.08 | --- | --- | --- |
| | | 2200 | 0.32 | 0.95 | --- | 0.06 | 0.06 | 0.08 | --- | 0.09 | --- | --- | --- |
| | 07 (6.0) | 2400 | 0.37 | 1.10 | --- | 0.07 | 0.07 | 0.10 | --- | 0.11 | --- | --- | --- |
| | | 2500 | 0.50 | 1.17 | --- | 0.08 | 0.08 | 0.11 | --- | 0.12 | --- | --- | --- |
| | | 1800 | 0.23 | 0.13 | --- | 0.03 | --- | --- | 0.05 | --- | 0.06 | --- | --- |
| | | 2000 | 0.28 | 0.15 | --- | 0.04 | --- | --- | 0.06 | --- | 0.07 | --- | --- |
| | | 2200 | 0.32 | 0.18 | --- | 0.06 | --- | --- | 0.07 | --- | 0.09 | --- | --- |
| | | 2400 | 0.37 | 0.21 | --- | 0.07 | --- | --- | 0.08 | --- | 0.1 | --- | --- |
| | | 2600 | 0.38 | 0.24 | --- | 0.08 | --- | --- | 0.09 | --- | 0.11 | --- | --- |
| | | 2800 | 0.41 | 0.29 | --- | 0.09 | --- | --- | 0.10 | --- | 0.12 | --- | --- |
| | A7 (6.0) | 3000 | 0.45 | 0.35 | --- | 0.11 | --- | --- | 0.12 | --- | 0.14 | --- | --- |
| | | 1800 | 0.23 | 0.13 | --- | 0.03 | --- | --- | 0.05 | --- | 0.06 | --- | --- |
| | | 2000 | 0.28 | 0.15 | --- | 0.04 | --- | --- | 0.06 | --- | 0.07 | --- | --- |
| | | 2200 | 0.32 | 0.18 | --- | 0.06 | --- | --- | 0.07 | --- | 0.09 | --- | --- |
| | | 2400 | 0.37 | 0.21 | --- | 0.07 | --- | --- | 0.08 | --- | 0.1 | --- | --- |
| | | 2600 | 0.38 | 0.24 | --- | 0.08 | --- | --- | 0.09 | --- | 0.11 | --- | --- |
| | 08 (7.5), 09 (8.5), 12 (10.0) | 2800 | 0.41 | 0.29 | --- | 0.09 | --- | --- | 0.10 | --- | 0.12 | --- | --- |
| | | 3000 | 0.45 | 0.35 | --- | 0.11 | --- | --- | 0.12 | --- | 0.14 | --- | --- |
| | | 2200 | 0.04 | 0.18 | --- | --- | --- | --- | 0.07 | --- | 0.09 | 0.10 | 0.12 |
| 2600 | | 0.06 | 0.24 | --- | --- | --- | --- | 0.09 | --- | 0.11 | 0.12 | 0.15 | |
| 3000 | | 0.10 | 0.35 | --- | --- | --- | --- | 0.12 | --- | 0.14 | 0.15 | 0.19 | |
| 3400 | | 0.13 | 0.47 | --- | --- | --- | --- | 0.15 | --- | 0.18 | 0.19 | 0.23 | |
| 3800 | | 0.16 | 0.59 | --- | --- | --- | --- | 0.19 | --- | 0.22 | 0.23 | 0.27 | |
| 4000 | | 0.17 | 0.66 | --- | --- | --- | --- | 0.21 | --- | 0.24 | 0.25 | 0.30 | |
| 4400 | | 0.20 | 0.79 | --- | --- | --- | --- | 0.25 | --- | 0.29 | 0.30 | 0.35 | |
| 4800 | | 0.22 | 0.91 | --- | --- | --- | --- | 0.30 | --- | 0.34 | 0.35 | 0.41 | |
| 5200 | | 0.24 | 1.04 | --- | --- | --- | --- | 0.35 | --- | 0.39 | 0.41 | 0.47 | |
| 5600 | | 0.26 | 1.17 | --- | --- | --- | --- | 0.41 | --- | 0.45 | 0.47 | 0.54 | |
| 6000 | 0.28 | 1.30 | --- | --- | --- | --- | 0.48 | --- | 0.52 | 0.54 | 0.60 | | |

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Table 85: Additional static resistance - ZL04-14

| Model | Size (ton) | CFM | Cooling only ¹ | Economizer ^{2,3} | 4 in. filters ² | Electric heat kW ² | | | | | | | |
|-------|---|------|---------------------------|---------------------------|----------------------------|-------------------------------|-------------|------------|------------|------|----------------|----------|-----------|
| | | | | | | 6/6.5 | 9.2/10.5/11 | 13.8/14/16 | 16/16.5/17 | 23 | 24.8/25.5/27.8 | 32/33/34 | 41.7/42.4 |
| ZL | 04 (3.0) | 900 | 0.04 | 0.15 | --- | 0.00 | 0.00 | 0.01 | --- | 0.01 | --- | --- | --- |
| | | 1000 | 0.05 | 0.18 | --- | 0.00 | 0.00 | 0.02 | --- | 0.02 | --- | --- | --- |
| | | 1100 | 0.06 | 0.21 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1200 | 0.07 | 0.24 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1300 | 0.10 | 0.28 | --- | 0.01 | 0.01 | 0.03 | --- | 0.03 | --- | --- | --- |
| | | 1400 | 0.12 | 0.33 | --- | 0.02 | 0.02 | 0.03 | --- | 0.04 | --- | --- | --- |
| | 05 (4.0) | 1500 | 0.14 | 0.44 | --- | 0.02 | 0.02 | 0.04 | --- | 0.04 | --- | --- | --- |
| | | 1200 | 0.06 | 0.24 | --- | 0.01 | 0.01 | 0.02 | --- | 0.03 | --- | --- | --- |
| | | 1300 | 0.06 | 0.28 | --- | 0.01 | 0.01 | 0.03 | --- | 0.03 | --- | --- | --- |
| | | 1400 | 0.06 | 0.33 | --- | 0.02 | 0.02 | 0.03 | --- | 0.04 | --- | --- | --- |
| | | 1500 | 0.07 | 0.44 | --- | 0.02 | 0.02 | 0.04 | --- | 0.04 | --- | --- | --- |
| | | 1600 | 0.08 | 0.52 | --- | 0.02 | 0.02 | 0.04 | --- | 0.05 | --- | --- | --- |
| | | 1700 | 0.11 | 0.59 | --- | 0.03 | 0.03 | 0.05 | --- | 0.05 | --- | --- | --- |
| | | 1800 | 0.13 | 0.66 | --- | 0.03 | 0.03 | 0.05 | --- | 0.06 | --- | --- | --- |
| | 06 (5.0) | 1900 | 0.16 | 0.74 | --- | 0.04 | 0.04 | 0.06 | --- | 0.07 | --- | --- | --- |
| | | 2000 | 0.20 | 0.81 | --- | 0.04 | 0.04 | 0.07 | --- | 0.08 | --- | --- | --- |
| | | 1800 | 0.23 | 0.66 | --- | 0.03 | 0.03 | 0.05 | --- | 0.06 | --- | --- | --- |
| | | 2000 | 0.28 | 0.81 | --- | 0.04 | 0.04 | 0.07 | --- | 0.08 | --- | --- | --- |
| | | 2200 | 0.32 | 0.95 | --- | 0.06 | 0.06 | 0.08 | --- | 0.09 | --- | --- | --- |
| | 08 (7.5), 09 (8.5), 12 (10.0), 14 (12.5) | 2400 | 0.37 | 1.10 | --- | 0.07 | 0.07 | 0.10 | --- | 0.11 | --- | --- | --- |
| | | 2500 | 0.50 | 1.17 | --- | 0.08 | 0.08 | 0.11 | --- | 0.12 | --- | --- | --- |
| | | 2200 | 0.04 | 0.18 | --- | --- | --- | --- | 0.07 | --- | 0.09 | 0.10 | 0.12 |
| | | 2600 | 0.06 | 0.24 | --- | --- | --- | --- | 0.09 | --- | 0.11 | 0.12 | 0.15 |
| | | 3000 | 0.10 | 0.35 | --- | --- | --- | --- | 0.12 | --- | 0.14 | 0.15 | 0.19 |
| | | 3400 | 0.13 | 0.47 | --- | --- | --- | --- | 0.15 | --- | 0.18 | 0.19 | 0.23 |
| | | 3800 | 0.16 | 0.59 | --- | --- | --- | --- | 0.19 | --- | 0.22 | 0.23 | 0.27 |
| | | 4000 | 0.17 | 0.66 | --- | --- | --- | --- | 0.21 | --- | 0.24 | 0.25 | 0.30 |
| | | 4400 | 0.20 | 0.79 | --- | --- | --- | --- | 0.25 | --- | 0.29 | 0.30 | 0.35 |
| | | 4800 | 0.22 | 0.91 | --- | --- | --- | --- | 0.30 | --- | 0.34 | 0.35 | 0.41 |
| | | 5200 | 0.24 | 1.04 | --- | --- | --- | --- | 0.35 | --- | 0.39 | 0.41 | 0.47 |
| 5600 | | 0.26 | 1.17 | --- | --- | --- | --- | 0.41 | --- | 0.45 | 0.47 | 0.54 | |
| 6000 | 0.28 | 1.30 | --- | --- | --- | --- | 0.48 | --- | 0.52 | 0.54 | 0.60 | | |

- 1 Add these values to the available static resistance in the respective blower performance tables.
- 2 Deduct these values from the available external static pressure shown in the respective blower performance tables.
- 3 The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

Airflow performance

ZQ04 to 06 side duct application (belt drive)

Table 86: ZQ04 (3.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | n/a | n/a | 877 | 0.25 | 965 | 0.34 | 1050 | 0.44 | 1133 | 0.54 | 1213 | 0.64 | 1292 | 0.74 | 1371 | 0.83 | 1450 | 0.92 | 1531 | 1.01 |
| 1000 | 795 | 0.21 | 887 | 0.29 | 976 | 0.38 | 1061 | 0.48 | 1143 | 0.58 | 1224 | 0.68 | 1303 | 0.78 | 1382 | 0.87 | 1461 | 0.96 | 1541 | 1.05 |
| 1100 | 806 | 0.25 | 899 | 0.34 | 988 | 0.43 | 1073 | 0.53 | 1155 | 0.63 | 1236 | 0.73 | 1315 | 0.83 | 1394 | 0.92 | 1473 | 1.01 | 1553 | 1.09 |
| 1200 | 820 | 0.31 | 913 | 0.39 | 1002 | 0.48 | 1087 | 0.58 | 1169 | 0.68 | 1249 | 0.78 | 1329 | 0.88 | 1407 | 0.97 | 1487 | 1.06 | 1567 | 1.15 |
| 1300 | 836 | 0.37 | 929 | 0.45 | 1018 | 0.54 | 1103 | 0.64 | 1185 | 0.74 | 1265 | 0.84 | 1345 | 0.94 | 1423 | 1.03 | 1503 | 1.12 | 1583 | 1.21 |
| 1400 | 855 | 0.43 | 948 | 0.52 | 1036 | 0.61 | 1121 | 0.70 | 1204 | 0.80 | 1284 | 0.90 | 1363 | 1.00 | 1442 | 1.10 | 1521 | 1.19 | -- | -- |
| 1500 | 876 | 0.50 | 969 | 0.58 | 1058 | 0.68 | 1143 | 0.77 | 1225 | 0.87 | 1305 | 0.97 | 1385 | 1.07 | 1464 | 1.17 | 1543 | 1.26 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 87: ZQ05 (4.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|--|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 893 | 0.37 | 976 | 0.46 | 1054 | 0.56 | 1128 | 0.66 | 1199 | 0.75 | 1268 | 0.85 | 1336 | 0.94 | 1404 | 1.03 | 1474 | 1.12 | 1545 | 1.20 |
| 1300 | 910 | 0.43 | 993 | 0.52 | 1071 | 0.62 | 1144 | 0.72 | 1216 | 0.81 | 1285 | 0.91 | 1353 | 1.00 | 1421 | 1.09 | 1491 | 1.18 | 1562 | 1.26 |
| 1400 | 931 | 0.49 | 1014 | 0.59 | 1092 | 0.69 | 1166 | 0.78 | 1237 | 0.88 | 1306 | 0.97 | 1374 | 1.06 | 1442 | 1.15 | 1512 | 1.24 | 1583 | 1.33 |
| 1500 | 956 | 0.56 | 1039 | 0.66 | 1117 | 0.76 | 1191 | 0.85 | 1262 | 0.95 | 1331 | 1.04 | 1399 | 1.14 | 1467 | 1.23 | 1537 | 1.31 | 1608 | 1.40 |
| 1600 | 985 | 0.64 | 1067 | 0.74 | 1145 | 0.83 | 1219 | 0.93 | 1290 | 1.03 | 1359 | 1.12 | 1428 | 1.21 | 1496 | 1.30 | 1565 | 1.39 | 1637 | 1.47 |
| 1700 | 1016 | 0.73 | 1099 | 0.82 | 1177 | 0.92 | 1251 | 1.02 | 1322 | 1.11 | 1391 | 1.21 | 1459 | 1.30 | 1528 | 1.39 | 1597 | 1.48 | -- | -- |
| 1800 | 1051 | 0.82 | 1134 | 0.92 | 1212 | 1.02 | 1286 | 1.11 | 1357 | 1.21 | 1426 | 1.30 | 1494 | 1.40 | 1562 | 1.49 | 1632 | 1.57 | -- | -- |
| 1900 | 1088 | 0.93 | 1171 | 1.02 | 1249 | 1.12 | 1323 | 1.22 | 1394 | 1.31 | 1463 | 1.41 | 1532 | 1.50 | 1600 | 1.59 | -- | -- | -- | -- |
| 2000 | 1128 | 1.04 | 1211 | 1.14 | 1289 | 1.23 | 1363 | 1.33 | 1434 | 1.43 | 1503 | 1.52 | 1571 | 1.61 | 1640 | 1.70 | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Field supplied AK41 x ¾ in. fixed blower pulley with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 88: ZQ06 (5.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 806 | 0.35 | 885 | 0.47 | 961 | 0.60 | 1034 | 0.73 | 1104 | 0.86 | 1170 | 1.00 | 1233 | 1.13 | 1292 | 1.26 | 1346 | 1.39 | 1396 | 1.52 |
| 1600 | 825 | 0.44 | 904 | 0.56 | 980 | 0.68 | 1053 | 0.81 | 1123 | 0.95 | 1189 | 1.08 | 1252 | 1.22 | 1311 | 1.35 | 1365 | 1.48 | 1415 | 1.61 |
| 1700 | 846 | 0.52 | 925 | 0.64 | 1001 | 0.76 | 1074 | 0.89 | 1144 | 1.03 | 1210 | 1.16 | 1273 | 1.30 | 1332 | 1.43 | 1386 | 1.56 | 1436 | 1.69 |
| 1800 | 869 | 0.60 | 947 | 0.72 | 1023 | 0.84 | 1096 | 0.97 | 1166 | 1.11 | 1233 | 1.24 | 1295 | 1.38 | 1354 | 1.51 | 1409 | 1.64 | 1459 | 1.77 |
| 1900 | 892 | 0.68 | 971 | 0.80 | 1047 | 0.93 | 1120 | 1.06 | 1190 | 1.19 | 1256 | 1.32 | 1319 | 1.46 | 1378 | 1.59 | 1432 | 1.72 | 1482 | 1.85 |
| 2000 | 916 | 0.77 | 995 | 0.89 | 1071 | 1.01 | 1144 | 1.14 | 1214 | 1.28 | 1280 | 1.41 | 1343 | 1.55 | 1402 | 1.68 | 1456 | 1.81 | 1506 | 1.94 |
| 2100 | 941 | 0.86 | 1019 | 0.98 | 1095 | 1.11 | 1168 | 1.24 | 1238 | 1.37 | 1305 | 1.50 | 1367 | 1.64 | 1426 | 1.77 | 1481 | 1.90 | 1531 | 2.03 |
| 2200 | 966 | 0.96 | 1044 | 1.08 | 1120 | 1.21 | 1193 | 1.34 | 1263 | 1.47 | 1329 | 1.61 | 1392 | 1.74 | 1451 | 1.87 | 1505 | 2.01 | 1555 | 2.13 |
| 2300 | 990 | 1.07 | 1069 | 1.19 | 1145 | 1.32 | 1218 | 1.45 | 1287 | 1.58 | 1354 | 1.72 | 1417 | 1.85 | 1476 | 1.98 | 1530 | 2.11 | 1580 | 2.24 |
| 2400 | 1015 | 1.19 | 1093 | 1.31 | 1169 | 1.44 | 1242 | 1.57 | 1312 | 1.70 | 1379 | 1.83 | 1441 | 1.97 | 1500 | 2.10 | 1555 | 2.23 | -- | -- |
| 2500 | 1039 | 1.32 | 1118 | 1.44 | 1193 | 1.56 | 1266 | 1.69 | 1336 | 1.83 | 1403 | 1.96 | 1466 | 2.10 | 1524 | 2.23 | 1579 | 2.36 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

ZQ04 to 06 bottom duct application (belt drive)

Table 89: ZQ04 (3.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | 792 | 0.14 | 879 | 0.25 | 968 | 0.37 | 1055 | 0.49 | 1141 | 0.61 | 1226 | 0.73 | 1308 | 0.84 | 1388 | 0.93 | 1466 | 1.01 | 1541 | 1.06 |
| 1000 | 804 | 0.18 | 893 | 0.29 | 981 | 0.41 | 1069 | 0.53 | 1155 | 0.66 | 1239 | 0.77 | 1322 | 0.88 | 1402 | 0.98 | 1480 | 1.05 | 1554 | 1.10 |
| 1100 | 819 | 0.23 | 909 | 0.34 | 997 | 0.46 | 1084 | 0.58 | 1171 | 0.71 | 1255 | 0.82 | 1337 | 0.93 | 1418 | 1.03 | 1495 | 1.10 | 1570 | 1.15 |
| 1200 | 837 | 0.29 | 926 | 0.40 | 1015 | 0.52 | 1102 | 0.64 | 1188 | 0.76 | 1273 | 0.88 | 1355 | 0.99 | 1435 | 1.08 | 1513 | 1.16 | 1588 | 1.21 |
| 1300 | 857 | 0.36 | 946 | 0.46 | 1035 | 0.58 | 1122 | 0.70 | 1208 | 0.83 | 1293 | 0.94 | 1375 | 1.05 | 1455 | 1.15 | 1533 | 1.22 | -- | -- |
| 1400 | 880 | 0.43 | 969 | 0.53 | 1058 | 0.65 | 1145 | 0.77 | 1231 | 0.90 | 1315 | 1.02 | 1398 | 1.12 | 1478 | 1.22 | 1556 | 1.29 | -- | -- |
| 1500 | 905 | 0.50 | 994 | 0.61 | 1082 | 0.73 | 1170 | 0.85 | 1256 | 0.97 | 1340 | 1.09 | 1423 | 1.20 | 1503 | 1.30 | 1581 | 1.37 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 90: ZQ05 (4.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|--|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 908 | 0.34 | 994 | 0.45 | 1072 | 0.55 | 1145 | 0.64 | 1214 | 0.74 | 1283 | 0.83 | 1352 | 0.92 | 1424 | 1.01 | 1502 | 1.11 | 1586 | 1.20 |
| 1300 | 921 | 0.40 | 1007 | 0.51 | 1085 | 0.61 | 1158 | 0.70 | 1227 | 0.80 | 1296 | 0.89 | 1365 | 0.98 | 1437 | 1.07 | 1514 | 1.17 | 1599 | 1.26 |
| 1400 | 938 | 0.47 | 1023 | 0.58 | 1101 | 0.68 | 1174 | 0.77 | 1244 | 0.86 | 1312 | 0.96 | 1382 | 1.05 | 1454 | 1.14 | 1531 | 1.23 | 1616 | 1.33 |
| 1500 | 959 | 0.55 | 1044 | 0.65 | 1122 | 0.75 | 1195 | 0.85 | 1265 | 0.94 | 1333 | 1.03 | 1403 | 1.12 | 1475 | 1.21 | 1552 | 1.31 | 1637 | 1.41 |
| 1600 | 985 | 0.63 | 1070 | 0.73 | 1148 | 0.83 | 1221 | 0.93 | 1290 | 1.02 | 1359 | 1.11 | 1428 | 1.20 | 1500 | 1.29 | 1578 | 1.39 | -- | -- |
| 1700 | 1015 | 0.71 | 1100 | 0.82 | 1179 | 0.92 | 1251 | 1.01 | 1321 | 1.11 | 1389 | 1.20 | 1459 | 1.29 | 1531 | 1.38 | 1608 | 1.48 | -- | -- |
| 1800 | 1050 | 0.81 | 1136 | 0.91 | 1214 | 1.01 | 1287 | 1.11 | 1356 | 1.20 | 1425 | 1.29 | 1494 | 1.39 | 1566 | 1.48 | 1644 | 1.57 | -- | -- |
| 1900 | 1091 | 0.91 | 1176 | 1.02 | 1254 | 1.12 | 1327 | 1.21 | 1397 | 1.31 | 1465 | 1.40 | 1534 | 1.49 | 1607 | 1.58 | -- | -- | -- | -- |
| 2000 | 1136 | 1.02 | 1222 | 1.13 | 1300 | 1.23 | 1372 | 1.32 | 1442 | 1.42 | 1510 | 1.51 | 1580 | 1.60 | -- | -- | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Field supplied AK41 x ¾ in. fixed blower pulley with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 91: ZQ06 (5.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 846 | 0.34 | 914 | 0.48 | 983 | 0.62 | 1052 | 0.75 | 1120 | 0.89 | 1188 | 1.02 | 1254 | 1.16 | 1318 | 1.29 | 1378 | 1.43 | 1435 | 1.56 |
| 1600 | 868 | 0.41 | 936 | 0.55 | 1004 | 0.68 | 1073 | 0.82 | 1142 | 0.95 | 1210 | 1.09 | 1276 | 1.23 | 1339 | 1.36 | 1400 | 1.50 | 1457 | 1.63 |
| 1700 | 889 | 0.49 | 957 | 0.62 | 1026 | 0.76 | 1095 | 0.90 | 1164 | 1.03 | 1231 | 1.17 | 1297 | 1.30 | 1361 | 1.44 | 1422 | 1.57 | 1479 | 1.71 |
| 1800 | 911 | 0.57 | 979 | 0.71 | 1048 | 0.85 | 1117 | 0.98 | 1186 | 1.12 | 1253 | 1.25 | 1319 | 1.39 | 1383 | 1.53 | 1443 | 1.66 | 1501 | 1.79 |
| 1900 | 934 | 0.67 | 1002 | 0.81 | 1071 | 0.94 | 1140 | 1.08 | 1208 | 1.21 | 1276 | 1.35 | 1342 | 1.48 | 1405 | 1.62 | 1466 | 1.75 | 1523 | 1.89 |
| 2000 | 958 | 0.77 | 1026 | 0.91 | 1094 | 1.04 | 1164 | 1.18 | 1232 | 1.32 | 1300 | 1.45 | 1366 | 1.59 | 1429 | 1.72 | 1490 | 1.86 | 1547 | 1.99 |
| 2100 | 983 | 0.88 | 1051 | 1.02 | 1120 | 1.15 | 1189 | 1.29 | 1258 | 1.42 | 1325 | 1.56 | 1391 | 1.69 | 1455 | 1.83 | 1516 | 1.96 | 1573 | 2.10 |
| 2200 | 1010 | 0.99 | 1078 | 1.13 | 1147 | 1.26 | 1216 | 1.40 | 1285 | 1.54 | 1352 | 1.67 | 1418 | 1.81 | 1482 | 1.94 | 1543 | 2.08 | -- | -- |
| 2300 | 1039 | 1.11 | 1107 | 1.25 | 1176 | 1.38 | 1245 | 1.52 | 1314 | 1.65 | 1381 | 1.79 | 1447 | 1.93 | 1511 | 2.06 | 1572 | 2.20 | -- | -- |
| 2400 | 1070 | 1.23 | 1138 | 1.37 | 1207 | 1.50 | 1276 | 1.64 | 1345 | 1.78 | 1412 | 1.91 | 1478 | 2.05 | 1542 | 2.18 | -- | -- | -- | -- |
| 2500 | 1103 | 1.36 | 1171 | 1.49 | 1240 | 1.63 | 1309 | 1.77 | 1378 | 1.90 | 1445 | 2.04 | 1511 | 2.17 | 1575 | 2.31 | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

ZXA7, 08 to 14 side duct application (belt drive)

Table 92: ZXA7 (6.0 ton) side duct

| CFM | Available external static | | | | | | | | | | | | | | | | | | | |
|---|---------------------------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1800 | 915 | 0.67 | 979 | 0.77 | 1041 | 0.89 | 1102 | 1.02 | 1162 | 1.16 | 1221 | 1.31 | 1278 | 1.45 | 1334 | 1.59 | 1389 | 1.72 | 1442 | 1.82 |
| 1900 | 939 | 0.78 | 1003 | 0.87 | 1065 | 0.99 | 1126 | 1.12 | 1186 | 1.27 | 1244 | 1.41 | 1302 | 1.56 | 1358 | 1.69 | 1412 | 1.82 | 1466 | 1.93 |
| 2000 | 964 | 0.89 | 1028 | 0.99 | 1090 | 1.11 | 1151 | 1.24 | 1211 | 1.38 | 1269 | 1.52 | 1327 | 1.67 | 1383 | 1.81 | 1437 | 1.93 | 1491 | 2.04 |
| 2100 | 990 | 1.01 | 1054 | 1.11 | 1116 | 1.23 | 1177 | 1.36 | 1237 | 1.50 | 1296 | 1.65 | 1353 | 1.79 | 1409 | 1.93 | 1464 | 2.05 | 1517 | 2.16 |
| 2200 | 1018 | 1.14 | 1081 | 1.24 | 1143 | 1.36 | 1204 | 1.49 | 1264 | 1.63 | 1323 | 1.78 | 1380 | 1.92 | 1436 | 2.06 | 1491 | 2.18 | 1544 | 2.29 |
| 2300 | 1046 | 1.28 | 1110 | 1.37 | 1172 | 1.49 | 1233 | 1.62 | 1293 | 1.77 | 1351 | 1.91 | 1409 | 2.05 | 1465 | 2.19 | 1519 | 2.32 | 1573 | 2.43 |
| 2400 | 1076 | 1.42 | 1139 | 1.52 | 1201 | 1.63 | 1262 | 1.76 | 1322 | 1.91 | 1381 | 2.05 | 1438 | 2.20 | 1494 | 2.33 | 1549 | 2.46 | 1602 | 2.57 |
| 2500 | 1106 | 1.56 | 1170 | 1.66 | 1232 | 1.78 | 1293 | 1.91 | 1353 | 2.05 | 1411 | 2.20 | 1469 | 2.34 | 1525 | 2.48 | 1579 | 2.60 | 1633 | 2.71 |
| 2600 | 1138 | 1.71 | 1201 | 1.81 | 1263 | 1.93 | 1324 | 2.06 | 1384 | 2.20 | 1443 | 2.35 | 1500 | 2.49 | 1556 | 2.63 | 1611 | 2.75 | -- | -- |
| 2700 | 1170 | 1.87 | 1234 | 1.96 | 1296 | 2.08 | 1357 | 2.21 | 1417 | 2.35 | 1475 | 2.50 | 1533 | 2.64 | 1589 | 2.78 | 1638 | 2.91 | -- | -- |
| 2800 | 1203 | 2.02 | 1267 | 2.12 | 1329 | 2.24 | 1390 | 2.37 | 1450 | 2.51 | 1509 | 2.66 | 1566 | 2.80 | 1622 | 2.94 | -- | -- | -- | -- |
| 2900 | 1238 | 2.18 | 1301 | 2.28 | 1364 | 2.40 | 1425 | 2.53 | 1484 | 2.67 | 1543 | 2.81 | 1600 | 2.96 | -- | -- | -- | -- | -- | -- |
| 3000 | 1273 | 2.34 | 1337 | 2.44 | 1399 | 2.56 | 1460 | 2.69 | 1520 | 2.83 | 1578 | 2.97 | 1635 | 3.12 | -- | -- | -- | -- | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| Static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

Table 93: ZX08 (7.5 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 557 | 0.48 | 623 | 0.67 | 685 | 0.85 | 742 | 1.04 | 796 | 1.23 | 848 | 1.41 | 898 | 1.59 | 947 | 1.77 | 997 | 1.94 | 1049 | 2.11 |
| 2400 | 569 | 0.56 | 636 | 0.75 | 698 | 0.94 | 755 | 1.13 | 809 | 1.32 | 860 | 1.50 | 910 | 1.68 | 960 | 1.86 | 1010 | 2.03 | 1062 | 2.20 |
| 2600 | 588 | 0.69 | 655 | 0.88 | 716 | 1.07 | 773 | 1.26 | 827 | 1.44 | 879 | 1.63 | 929 | 1.81 | 978 | 1.98 | 1029 | 2.16 | 1080 | 2.32 |
| 2800 | 607 | 0.83 | 674 | 1.02 | 736 | 1.21 | 793 | 1.40 | 847 | 1.58 | 898 | 1.77 | 948 | 1.95 | 998 | 2.13 | 1048 | 2.30 | 1100 | 2.47 |
| 3000 | 628 | 0.99 | 695 | 1.18 | 757 | 1.37 | 814 | 1.56 | 868 | 1.74 | 919 | 1.92 | 969 | 2.11 | 1019 | 2.28 | 1069 | 2.45 | -- | -- |
| 3200 | 650 | 1.16 | 717 | 1.35 | 779 | 1.54 | 836 | 1.73 | 890 | 1.91 | 941 | 2.10 | 991 | 2.28 | 1041 | 2.45 | 1091 | 2.63 | -- | -- |
| 3400 | 673 | 1.35 | 740 | 1.54 | 802 | 1.73 | 859 | 1.91 | 913 | 2.10 | 964 | 2.28 | 1014 | 2.46 | 1064 | 2.64 | -- | -- | -- | -- |
| 3600 | 697 | 1.55 | 764 | 1.74 | 826 | 1.93 | 883 | 2.11 | 937 | 2.30 | 988 | 2.48 | 1038 | 2.67 | 1088 | 2.84 | -- | -- | -- | -- |
| 3750 | 716 | 1.71 | 783 | 1.90 | 844 | 2.09 | 901 | 2.28 | 955 | 2.46 | 1007 | 2.65 | 1057 | 2.83 | 1100 | 3.00 | -- | -- | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 98: ZX08 (7.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 577 | 0.50 | 636 | 0.68 | 693 | 0.86 | 749 | 1.03 | 803 | 1.21 | 856 | 1.39 | 908 | 1.57 | 959 | 1.74 | 1009 | 1.91 | 1059 | 2.07 |
| 2400 | 591 | 0.59 | 650 | 0.77 | 707 | 0.95 | 763 | 1.13 | 817 | 1.31 | 870 | 1.48 | 922 | 1.66 | 973 | 1.83 | 1023 | 2.00 | 1073 | 2.17 |
| 2600 | 611 | 0.73 | 670 | 0.91 | 727 | 1.09 | 782 | 1.27 | 836 | 1.44 | 889 | 1.62 | 941 | 1.80 | 992 | 1.97 | 1043 | 2.14 | 1092 | 2.31 |
| 2800 | 631 | 0.88 | 690 | 1.06 | 747 | 1.24 | 803 | 1.42 | 857 | 1.60 | 910 | 1.77 | 962 | 1.95 | 1013 | 2.12 | 1063 | 2.29 | -- | -- |
| 3000 | 653 | 1.05 | 711 | 1.23 | 768 | 1.41 | 824 | 1.59 | 878 | 1.76 | 931 | 1.94 | 983 | 2.12 | 1034 | 2.29 | 1084 | 2.46 | -- | -- |
| 3200 | 675 | 1.23 | 733 | 1.41 | 790 | 1.59 | 846 | 1.77 | 900 | 1.94 | 953 | 2.12 | 1005 | 2.30 | 1056 | 2.47 | 1100 | 2.64 | -- | -- |
| 3400 | 697 | 1.42 | 755 | 1.60 | 813 | 1.78 | 868 | 1.96 | 922 | 2.14 | 975 | 2.31 | 1027 | 2.49 | 1078 | 2.66 | -- | -- | -- | -- |
| 3600 | 719 | 1.63 | 778 | 1.80 | 835 | 1.98 | 891 | 2.16 | 945 | 2.34 | 998 | 2.52 | 1050 | 2.69 | 1100 | 2.87 | -- | -- | -- | -- |
| 3750 | 736 | 1.78 | 795 | 1.96 | 852 | 2.14 | 908 | 2.32 | 962 | 2.50 | 1015 | 2.68 | 1067 | 2.85 | -- | -- | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | Static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 99: ZX09 (8.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2550 | 570 | 0.59 | 630 | 0.77 | 687 | 0.94 | 744 | 1.13 | 799 | 1.31 | 852 | 1.49 | 903 | 1.67 | 953 | 1.85 | 1002 | 2.01 | 1049 | 2.16 |
| 2600 | 573 | 0.63 | 632 | 0.80 | 690 | 0.98 | 747 | 1.16 | 801 | 1.34 | 855 | 1.53 | 906 | 1.71 | 956 | 1.88 | 1005 | 2.04 | 1052 | 2.19 |
| 2800 | 585 | 0.77 | 645 | 0.94 | 703 | 1.12 | 759 | 1.30 | 814 | 1.49 | 867 | 1.67 | 918 | 1.85 | 968 | 2.02 | 1017 | 2.18 | 1064 | 2.33 |
| 3000 | 599 | 0.92 | 658 | 1.10 | 716 | 1.27 | 773 | 1.46 | 827 | 1.64 | 880 | 1.82 | 932 | 2.00 | 982 | 2.18 | 1030 | 2.34 | 1077 | 2.49 |
| 3200 | 614 | 1.09 | 673 | 1.27 | 731 | 1.44 | 787 | 1.63 | 842 | 1.81 | 895 | 1.99 | 947 | 2.17 | 997 | 2.35 | 1045 | 2.51 | 1092 | 2.66 |
| 3400 | 630 | 1.28 | 690 | 1.45 | 747 | 1.62 | 804 | 1.81 | 859 | 1.99 | 912 | 2.18 | 963 | 2.35 | 1013 | 2.53 | 1062 | 2.69 | -- | -- |
| 3600 | 648 | 1.47 | 708 | 1.64 | 765 | 1.82 | 822 | 2.00 | 877 | 2.19 | 930 | 2.37 | 981 | 2.55 | 1031 | 2.72 | 1080 | 2.88 | -- | -- |
| 3800 | 668 | 1.67 | 727 | 1.84 | 785 | 2.02 | 841 | 2.20 | 896 | 2.39 | 949 | 2.57 | 1001 | 2.75 | 1051 | 2.92 | 1099 | 3.09 | -- | -- |
| 4000 | 689 | 1.89 | 748 | 2.06 | 806 | 2.23 | 863 | 2.42 | 917 | 2.60 | 971 | 2.79 | 1022 | 2.96 | 1072 | 3.14 | -- | -- | -- | -- |
| 4200 | 712 | 2.11 | 771 | 2.28 | 829 | 2.46 | 886 | 2.64 | 940 | 2.83 | 994 | 3.01 | 1045 | 3.19 | 1095 | 3.36 | -- | -- | -- | -- |
| 4250 | 718 | 2.17 | 777 | 2.34 | 842 | 2.52 | 892 | 2.70 | 946 | 2.88 | 1000 | 3.07 | 1051 | 3.24 | 1100 | 3.42 | -- | -- | -- | -- |
| Standard Static Option with Motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Static Option with Motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Static Option with Motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 100: ZX12 (10 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3000 | 653 | 0.79 | 706 | 1.02 | 758 | 1.25 | 808 | 1.49 | 858 | 1.72 | 907 | 1.95 | 955 | 2.18 | 1003 | 2.40 | 1049 | 2.62 | 1095 | 2.82 |
| 3200 | 667 | 0.94 | 720 | 1.17 | 771 | 1.40 | 822 | 1.64 | 872 | 1.88 | 921 | 2.11 | 969 | 2.34 | 1016 | 2.56 | 1063 | 2.77 | 1109 | 2.97 |
| 3400 | 682 | 1.11 | 734 | 1.34 | 786 | 1.57 | 837 | 1.81 | 887 | 2.04 | 936 | 2.28 | 984 | 2.50 | 1031 | 2.73 | 1078 | 2.94 | 1124 | 3.14 |
| 3600 | 697 | 1.29 | 750 | 1.52 | 802 | 1.76 | 853 | 1.99 | 903 | 2.23 | 952 | 2.46 | 1000 | 2.69 | 1047 | 2.91 | 1094 | 3.12 | 1140 | 3.32 |
| 3800 | 714 | 1.50 | 767 | 1.73 | 819 | 1.96 | 870 | 2.20 | 920 | 2.43 | 969 | 2.67 | 1017 | 2.90 | 1064 | 3.12 | 1111 | 3.33 | 1157 | 3.53 |
| 4000 | 733 | 1.73 | 786 | 1.96 | 837 | 2.19 | 888 | 2.43 | 938 | 2.66 | 987 | 2.90 | 1035 | 3.12 | 1083 | 3.34 | 1129 | 3.56 | 1174 | 3.76 |
| 4200 | 753 | 1.98 | 806 | 2.21 | 857 | 2.44 | 908 | 2.68 | 958 | 2.91 | 1007 | 3.15 | 1055 | 3.37 | 1102 | 3.60 | 1149 | 3.81 | -- | -- |
| 4400 | 774 | 2.25 | 827 | 2.48 | 879 | 2.72 | 930 | 2.95 | 979 | 3.19 | 1028 | 3.42 | 1076 | 3.65 | 1124 | 3.87 | 1170 | 4.08 | -- | -- |
| 4600 | 797 | 2.55 | 850 | 2.78 | 902 | 3.02 | 952 | 3.25 | 1002 | 3.49 | 1051 | 3.72 | 1099 | 3.95 | 1147 | 4.17 | -- | -- | -- | -- |
| 4800 | 822 | 2.88 | 874 | 3.11 | 926 | 3.34 | 977 | 3.58 | 1027 | 3.81 | 1076 | 4.05 | 1124 | 4.27 | 1171 | 4.50 | -- | -- | -- | -- |
| 5000 | 848 | 3.23 | 901 | 3.46 | 952 | 3.69 | 1003 | 3.93 | 1053 | 4.16 | 1102 | 4.40 | 1150 | 4.62 | -- | -- | -- | -- | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| Static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 101: ZX14 (12.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3750 | 715 | 1.46 | 762 | 1.68 | 810 | 1.91 | 858 | 2.13 | 907 | 2.36 | 957 | 2.58 | 1008 | 2.80 | 1060 | 3.02 | 1113 | 3.24 | 1167 | 3.46 |
| 3800 | 720 | 1.51 | 766 | 1.73 | 814 | 1.96 | 862 | 2.18 | 911 | 2.41 | 961 | 2.63 | 1012 | 2.85 | 1064 | 3.07 | 1117 | 3.29 | 1171 | 3.51 |
| 4000 | 737 | 1.72 | 784 | 1.94 | 832 | 2.17 | 880 | 2.39 | 929 | 2.62 | 979 | 2.84 | 1030 | 3.07 | 1082 | 3.29 | 1135 | 3.51 | -- | -- |
| 4200 | 756 | 1.95 | 803 | 2.17 | 851 | 2.40 | 899 | 2.63 | 948 | 2.85 | 998 | 3.07 | 1049 | 3.30 | 1101 | 3.52 | 1154 | 3.74 | -- | -- |
| 4400 | 777 | 2.20 | 824 | 2.42 | 871 | 2.65 | 920 | 2.87 | 969 | 3.10 | 1019 | 3.32 | 1069 | 3.55 | 1121 | 3.77 | 1174 | 3.98 | -- | -- |
| 4600 | 799 | 2.47 | 846 | 2.69 | 893 | 2.92 | 941 | 3.14 | 990 | 3.37 | 1040 | 3.59 | 1091 | 3.81 | 1143 | 4.04 | -- | -- | -- | -- |
| 4800 | 822 | 2.75 | 869 | 2.98 | 916 | 3.20 | 965 | 3.43 | 1014 | 3.65 | 1064 | 3.88 | 1114 | 4.10 | 1166 | 4.32 | -- | -- | -- | -- |
| 5000 | 846 | 3.06 | 893 | 3.28 | 941 | 3.51 | 989 | 3.73 | 1038 | 3.96 | 1088 | 4.18 | 1139 | 4.41 | -- | -- | -- | -- | -- | -- |
| 5200 | 872 | 3.39 | 919 | 3.61 | 966 | 3.83 | 1015 | 4.06 | 1064 | 4.28 | 1114 | 4.51 | 1164 | 4.73 | -- | -- | -- | -- | -- | -- |
| 5400 | 899 | 3.73 | 946 | 3.95 | 993 | 4.18 | 1042 | 4.40 | 1091 | 4.63 | 1141 | 4.85 | -- | -- | -- | -- | -- | -- | -- | -- |
| 5600 | 927 | 4.09 | 974 | 4.32 | 1021 | 4.54 | 1070 | 4.77 | 1119 | 4.99 | 1169 | 5.22 | -- | -- | -- | -- | -- | -- | -- | -- |
| 5800 | 956 | 4.47 | 1003 | 4.70 | 1051 | 4.92 | 1099 | 5.15 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 6000 | 987 | 4.87 | 1034 | 5.10 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.857 x BHP for standard static option, kW = 0.829 x BHP for medium and high static options

ZY04 to 12 side duct application (belt drive)

Table 102: ZY04 (3.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | n/a | n/a | 874 | 0.31 | 972 | 0.40 | 1065 | 0.50 | 1153 | 0.60 | 1236 | 0.70 | 1315 | 0.80 | 1390 | 0.89 | 1460 | 0.97 | 1526 | 1.05 |
| 1000 | n/a | n/a | 887 | 0.36 | 985 | 0.45 | 1078 | 0.55 | 1165 | 0.65 | 1249 | 0.75 | 1328 | 0.85 | 1402 | 0.94 | 1472 | 1.03 | 1539 | 1.10 |
| 1100 | 797 | 0.33 | 900 | 0.42 | 998 | 0.51 | 1091 | 0.61 | 1179 | 0.71 | 1263 | 0.81 | 1341 | 0.91 | 1416 | 1.00 | 1486 | 1.08 | 1553 | 1.16 |
| 1200 | 813 | 0.40 | 916 | 0.48 | 1014 | 0.57 | 1107 | 0.67 | 1195 | 0.77 | 1279 | 0.87 | 1357 | 0.97 | 1432 | 1.06 | 1502 | 1.15 | 1569 | 1.22 |
| 1300 | 831 | 0.46 | 935 | 0.55 | 1033 | 0.64 | 1126 | 0.74 | 1214 | 0.84 | 1297 | 0.94 | 1376 | 1.03 | 1450 | 1.13 | 1520 | 1.21 | 1583 | 1.28 |
| 1400 | 852 | 0.53 | 956 | 0.61 | 1054 | 0.71 | 1146 | 0.80 | 1234 | 0.90 | 1318 | 1.00 | 1396 | 1.10 | 1471 | 1.19 | 1541 | 1.28 | -- | -- |
| 1500 | 876 | 0.59 | 979 | 0.68 | 1077 | 0.77 | 1170 | 0.87 | 1258 | 0.97 | 1341 | 1.07 | 1420 | 1.17 | 1494 | 1.26 | 1565 | 1.34 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 103: ZY05 (4.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 840 | 0.30 | 927 | 0.41 | 1012 | 0.53 | 1096 | 0.65 | 1177 | 0.77 | 1257 | 0.89 | 1334 | 1.01 | 1411 | 1.12 | 1485 | 1.22 | 1558 | 1.31 |
| 1300 | 857 | 0.35 | 944 | 0.47 | 1029 | 0.59 | 1112 | 0.71 | 1194 | 0.83 | 1273 | 0.95 | 1351 | 1.07 | 1427 | 1.18 | 1502 | 1.28 | 1574 | 1.37 |
| 1400 | 875 | 0.42 | 962 | 0.53 | 1048 | 0.65 | 1131 | 0.77 | 1212 | 0.89 | 1292 | 1.01 | 1370 | 1.13 | 1446 | 1.24 | 1520 | 1.34 | 1593 | 1.43 |
| 1500 | 897 | 0.49 | 984 | 0.60 | 1069 | 0.72 | 1152 | 0.84 | 1233 | 0.96 | 1313 | 1.08 | 1391 | 1.20 | 1467 | 1.31 | 1542 | 1.41 | -- | -- |
| 1600 | 921 | 0.56 | 1008 | 0.67 | 1093 | 0.79 | 1176 | 0.91 | 1258 | 1.04 | 1337 | 1.16 | 1415 | 1.27 | 1491 | 1.38 | 1566 | 1.49 | -- | -- |
| 1700 | 948 | 0.64 | 1035 | 0.76 | 1120 | 0.87 | 1204 | 1.00 | 1285 | 1.12 | 1365 | 1.24 | 1442 | 1.36 | 1518 | 1.47 | 1593 | 1.57 | -- | -- |
| 1800 | 979 | 0.73 | 1066 | 0.85 | 1151 | 0.96 | 1234 | 1.08 | 1315 | 1.21 | 1395 | 1.33 | 1473 | 1.44 | 1549 | 1.56 | -- | -- | -- | -- |
| 1900 | 1012 | 0.83 | 1099 | 0.94 | 1185 | 1.06 | 1268 | 1.18 | 1349 | 1.30 | 1429 | 1.42 | 1507 | 1.54 | 1583 | 1.65 | -- | -- | -- | -- |
| 2000 | 1049 | 0.93 | 1136 | 1.04 | 1222 | 1.16 | 1305 | 1.28 | 1386 | 1.40 | 1466 | 1.52 | 1544 | 1.64 | -- | -- | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 104: ZY06 (5.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 810 | 0.49 | 883 | 0.60 | 954 | 0.70 | 1023 | 0.80 | 1089 | 0.91 | 1152 | 1.02 | 1213 | 1.14 | 1269 | 1.26 | 1323 | 1.40 | 1373 | 1.55 |
| 1600 | 831 | 0.58 | 904 | 0.68 | 975 | 0.79 | 1044 | 0.89 | 1110 | 1.00 | 1173 | 1.11 | 1233 | 1.22 | 1290 | 1.35 | 1344 | 1.49 | 1394 | 1.64 |
| 1700 | 854 | 0.66 | 927 | 0.77 | 998 | 0.87 | 1067 | 0.98 | 1133 | 1.08 | 1196 | 1.19 | 1256 | 1.31 | 1313 | 1.44 | 1367 | 1.57 | 1417 | 1.72 |
| 1800 | 878 | 0.75 | 952 | 0.86 | 1023 | 0.96 | 1091 | 1.07 | 1157 | 1.17 | 1221 | 1.28 | 1281 | 1.40 | 1338 | 1.52 | 1391 | 1.66 | 1441 | 1.81 |
| 1900 | 904 | 0.84 | 977 | 0.95 | 1048 | 1.05 | 1117 | 1.16 | 1183 | 1.26 | 1246 | 1.37 | 1306 | 1.49 | 1363 | 1.61 | 1417 | 1.75 | 1467 | 1.90 |
| 2000 | 931 | 0.93 | 1004 | 1.04 | 1075 | 1.15 | 1144 | 1.25 | 1210 | 1.36 | 1273 | 1.47 | 1333 | 1.58 | 1390 | 1.71 | 1444 | 1.84 | 1494 | 1.99 |
| 2100 | 959 | 1.03 | 1032 | 1.14 | 1103 | 1.24 | 1172 | 1.35 | 1238 | 1.45 | 1301 | 1.56 | 1361 | 1.68 | 1418 | 1.81 | 1472 | 1.94 | 1522 | 2.09 |
| 2200 | 988 | 1.13 | 1061 | 1.24 | 1132 | 1.35 | 1201 | 1.45 | 1267 | 1.56 | 1330 | 1.67 | 1390 | 1.78 | 1447 | 1.91 | 1501 | 2.04 | 1550 | 2.19 |
| 2300 | 1017 | 1.24 | 1091 | 1.35 | 1162 | 1.45 | 1230 | 1.56 | 1296 | 1.66 | 1359 | 1.77 | 1420 | 1.89 | 1477 | 2.02 | 1530 | 2.15 | 1580 | 2.30 |
| 2400 | 1047 | 1.36 | 1121 | 1.46 | 1192 | 1.57 | 1260 | 1.67 | 1326 | 1.78 | 1390 | 1.89 | 1450 | 2.01 | 1507 | 2.13 | 1560 | 2.27 | -- | -- |
| 2500 | 1078 | 1.48 | 1151 | 1.58 | 1222 | 1.69 | 1291 | 1.79 | 1357 | 1.90 | 1420 | 2.01 | 1480 | 2.13 | 1537 | 2.25 | 1591 | 2.39 | -- | -- |
| Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.857 x BHP

Table 105: ZY07 (6.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1800 | 521 | 0.27 | 583 | 0.44 | 644 | 0.63 | 703 | 0.81 | 759 | 0.99 | 814 | 1.17 | 866 | 1.34 | 916 | 1.51 | 964 | 1.67 | 1010 | 1.83 |
| 1900 | 529 | 0.31 | 591 | 0.49 | 651 | 0.67 | 710 | 0.85 | 767 | 1.03 | 821 | 1.21 | 874 | 1.39 | 924 | 1.56 | 972 | 1.72 | 1017 | 1.87 |
| 2000 | 536 | 0.36 | 598 | 0.54 | 659 | 0.72 | 718 | 0.90 | 774 | 1.08 | 829 | 1.26 | 881 | 1.44 | 931 | 1.61 | 979 | 1.77 | 1025 | 1.92 |
| 2100 | 544 | 0.42 | 606 | 0.59 | 667 | 0.77 | 725 | 0.95 | 782 | 1.14 | 836 | 1.32 | 889 | 1.49 | 939 | 1.66 | 987 | 1.82 | 1032 | 1.97 |
| 2200 | 551 | 0.47 | 614 | 0.65 | 674 | 0.83 | 733 | 1.01 | 789 | 1.19 | 844 | 1.37 | 896 | 1.55 | 947 | 1.72 | 994 | 1.88 | 1040 | 2.03 |
| 2300 | 559 | 0.53 | 622 | 0.71 | 682 | 0.89 | 741 | 1.07 | 797 | 1.25 | 852 | 1.43 | 904 | 1.61 | 954 | 1.77 | 1002 | 1.94 | 1048 | 2.09 |
| 2400 | 567 | 0.59 | 630 | 0.77 | 690 | 0.95 | 749 | 1.13 | 805 | 1.31 | 860 | 1.49 | 912 | 1.67 | 962 | 1.84 | 1010 | 2.00 | 1056 | 2.15 |
| 2500 | 575 | 0.66 | 638 | 0.83 | 698 | 1.01 | 757 | 1.20 | 813 | 1.38 | 868 | 1.56 | 920 | 1.73 | 970 | 1.90 | 1018 | 2.06 | 1064 | 2.22 |
| 2600 | 584 | 0.73 | 646 | 0.90 | 707 | 1.08 | 765 | 1.26 | 822 | 1.45 | 876 | 1.63 | 929 | 1.80 | 979 | 1.97 | 1027 | 2.13 | 1072 | 2.28 |
| 2700 | 592 | 0.80 | 655 | 0.97 | 715 | 1.15 | 774 | 1.34 | 830 | 1.52 | 885 | 1.70 | 937 | 1.87 | 987 | 2.04 | 1035 | 2.20 | 1081 | 2.36 |
| 2800 | 601 | 0.87 | 664 | 1.05 | 724 | 1.23 | 783 | 1.41 | 839 | 1.59 | 894 | 1.77 | 946 | 1.95 | 996 | 2.12 | 1044 | 2.28 | 1090 | 2.43 |
| 2900 | 610 | 0.95 | 673 | 1.13 | 733 | 1.31 | 792 | 1.49 | 848 | 1.67 | 903 | 1.85 | 955 | 2.03 | 1005 | 2.20 | 1053 | 2.36 | 1099 | 2.51 |
| 3000 | 619 | 1.03 | 682 | 1.21 | 742 | 1.39 | 801 | 1.57 | 858 | 1.75 | 912 | 1.93 | 964 | 2.11 | 1015 | 2.28 | 1063 | 2.44 | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 106: ZYA7 (6.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1800 | 521 | 0.27 | 583 | 0.44 | 644 | 0.63 | 703 | 0.81 | 759 | 0.99 | 814 | 1.17 | 866 | 1.34 | 916 | 1.51 | 964 | 1.67 | 1010 | 1.83 |
| 1900 | 529 | 0.31 | 591 | 0.49 | 651 | 0.67 | 710 | 0.85 | 767 | 1.03 | 821 | 1.21 | 874 | 1.39 | 924 | 1.56 | 972 | 1.72 | 1017 | 1.87 |
| 2000 | 536 | 0.36 | 598 | 0.54 | 659 | 0.72 | 718 | 0.90 | 774 | 1.08 | 829 | 1.26 | 881 | 1.44 | 931 | 1.61 | 979 | 1.77 | 1025 | 1.92 |
| 2100 | 544 | 0.42 | 606 | 0.59 | 667 | 0.77 | 725 | 0.95 | 782 | 1.14 | 836 | 1.32 | 889 | 1.49 | 939 | 1.66 | 987 | 1.82 | 1032 | 1.97 |
| 2200 | 551 | 0.47 | 614 | 0.65 | 674 | 0.83 | 733 | 1.01 | 789 | 1.19 | 844 | 1.37 | 896 | 1.55 | 947 | 1.72 | 994 | 1.88 | 1040 | 2.03 |
| 2300 | 559 | 0.53 | 622 | 0.71 | 682 | 0.89 | 741 | 1.07 | 797 | 1.25 | 852 | 1.43 | 904 | 1.61 | 954 | 1.77 | 1002 | 1.94 | 1048 | 2.09 |
| 2400 | 567 | 0.59 | 630 | 0.77 | 690 | 0.95 | 749 | 1.13 | 805 | 1.31 | 860 | 1.49 | 912 | 1.67 | 962 | 1.84 | 1010 | 2.00 | 1056 | 2.15 |
| 2500 | 575 | 0.66 | 638 | 0.83 | 698 | 1.01 | 757 | 1.20 | 813 | 1.38 | 868 | 1.56 | 920 | 1.73 | 970 | 1.90 | 1018 | 2.06 | 1064 | 2.22 |
| 2600 | 584 | 0.73 | 646 | 0.90 | 707 | 1.08 | 765 | 1.26 | 822 | 1.45 | 876 | 1.63 | 929 | 1.80 | 979 | 1.97 | 1027 | 2.13 | 1072 | 2.28 |
| 2700 | 592 | 0.80 | 655 | 0.97 | 715 | 1.15 | 774 | 1.34 | 830 | 1.52 | 885 | 1.70 | 937 | 1.87 | 987 | 2.04 | 1035 | 2.20 | 1081 | 2.36 |
| 2800 | 601 | 0.87 | 664 | 1.05 | 724 | 1.23 | 783 | 1.41 | 839 | 1.59 | 894 | 1.77 | 946 | 1.95 | 996 | 2.12 | 1044 | 2.28 | 1090 | 2.43 |
| 2900 | 610 | 0.95 | 673 | 1.13 | 733 | 1.31 | 792 | 1.49 | 848 | 1.67 | 903 | 1.85 | 955 | 2.03 | 1005 | 2.20 | 1053 | 2.36 | 1099 | 2.51 |
| 3000 | 619 | 1.03 | 682 | 1.21 | 742 | 1.39 | 801 | 1.57 | 858 | 1.75 | 912 | 1.93 | 964 | 2.11 | 1015 | 2.28 | 1063 | 2.44 | -- | -- |
| | Standard static option with motor rated at 2.4-hp> | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 107: ZY08 (7.5 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 547 | 0.39 | 610 | 0.60 | 670 | 0.81 | 727 | 1.01 | 783 | 1.21 | 836 | 1.41 | 888 | 1.59 | 939 | 1.78 | 989 | 1.96 | 1038 | 2.13 |
| 2400 | 556 | 0.47 | 619 | 0.69 | 679 | 0.90 | 736 | 1.10 | 792 | 1.30 | 845 | 1.49 | 897 | 1.68 | 948 | 1.86 | 998 | 2.04 | 1047 | 2.22 |
| 2600 | 568 | 0.60 | 631 | 0.81 | 691 | 1.02 | 749 | 1.22 | 804 | 1.42 | 857 | 1.61 | 909 | 1.80 | 960 | 1.99 | 1010 | 2.17 | 1059 | 2.34 |
| 2800 | 581 | 0.73 | 644 | 0.95 | 704 | 1.16 | 762 | 1.36 | 817 | 1.56 | 871 | 1.75 | 923 | 1.94 | 973 | 2.13 | 1023 | 2.31 | 1073 | 2.48 |
| 3000 | 595 | 0.89 | 658 | 1.10 | 718 | 1.31 | 776 | 1.51 | 831 | 1.71 | 885 | 1.91 | 937 | 2.09 | 988 | 2.28 | 1038 | 2.46 | 1087 | 2.63 |
| 3200 | 610 | 1.05 | 673 | 1.27 | 733 | 1.48 | 791 | 1.68 | 846 | 1.88 | 900 | 2.07 | 952 | 2.26 | 1003 | 2.44 | 1053 | 2.62 | -- | -- |
| 3400 | 627 | 1.23 | 689 | 1.45 | 750 | 1.66 | 807 | 1.86 | 863 | 2.06 | 916 | 2.25 | 968 | 2.44 | 1019 | 2.62 | 1069 | 2.80 | -- | -- |
| 3600 | 644 | 1.42 | 707 | 1.64 | 767 | 1.85 | 824 | 2.05 | 880 | 2.25 | 933 | 2.44 | 985 | 2.63 | 1036 | 2.82 | 1086 | 3.00 | -- | -- |
| 3750 | 657 | 1.58 | 720 | 1.79 | 780 | 2.00 | 838 | 2.20 | 893 | 2.40 | 947 | 2.60 | 999 | 2.78 | 1049 | 2.97 | 1099 | 3.15 | -- | -- |
| | Standard static option with motor rated at 2.4-hp> | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

- 1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 108: ZY09 (8.5 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|-------------|--|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2550 | 565 | 0.56 | 628 | 0.78 | 688 | 0.99 | 745 | 1.19 | 801 | 1.39 | 854 | 1.58 | 906 | 1.77 | 957 | 1.95 | 1007 | 2.13 | 1056 | 2.31 |
| 2600 | 568 | 0.60 | 631 | 0.81 | 691 | 1.02 | 749 | 1.22 | 804 | 1.42 | 857 | 1.61 | 909 | 1.80 | 960 | 1.99 | 1010 | 2.17 | 1059 | 2.34 |
| 2800 | 581 | 0.73 | 644 | 0.95 | 704 | 1.16 | 762 | 1.36 | 817 | 1.56 | 871 | 1.75 | 923 | 1.94 | 973 | 2.13 | 1023 | 2.31 | 1073 | 2.48 |
| 3000 | 595 | 0.89 | 658 | 1.10 | 718 | 1.31 | 776 | 1.51 | 831 | 1.71 | 885 | 1.91 | 937 | 2.09 | 988 | 2.28 | 1038 | 2.46 | 1087 | 2.63 |
| 3200 | 610 | 1.05 | 673 | 1.27 | 733 | 1.48 | 791 | 1.68 | 846 | 1.88 | 900 | 2.07 | 952 | 2.26 | 1003 | 2.44 | 1053 | 2.62 | 1100 | 2.80 |
| 3400 | 627 | 1.23 | 689 | 1.45 | 750 | 1.66 | 807 | 1.86 | 863 | 2.06 | 916 | 2.25 | 968 | 2.44 | 1019 | 2.62 | 1069 | 2.80 | -- | -- |
| 3600 | 644 | 1.42 | 707 | 1.64 | 767 | 1.85 | 824 | 2.05 | 880 | 2.25 | 933 | 2.44 | 985 | 2.63 | 1036 | 2.82 | 1086 | 3.00 | -- | -- |
| 3800 | 662 | 1.63 | 725 | 1.84 | 785 | 2.05 | 842 | 2.26 | 898 | 2.46 | 951 | 2.65 | 1003 | 2.84 | 1054 | 3.02 | 1100 | 3.20 | -- | -- |
| 4000 | 681 | 1.85 | 744 | 2.06 | 804 | 2.27 | 861 | 2.47 | 917 | 2.67 | 970 | 2.87 | 1022 | 3.05 | 1073 | 3.24 | -- | -- | -- | -- |
| 4200 | 701 | 2.08 | 764 | 2.29 | 824 | 2.50 | 881 | 2.70 | 937 | 2.90 | 990 | 3.09 | 1042 | 3.28 | 1093 | 3.47 | -- | -- | -- | -- |
| 4250 | 706 | 2.14 | 769 | 2.35 | 829 | 2.56 | 887 | 2.76 | 942 | 2.96 | 996 | 3.15 | 1048 | 3.34 | 1098 | 3.53 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp> | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| Bold | Field-supplied AK79 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 109: ZY12 (10 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3000 | 653 | 0.79 | 706 | 1.02 | 758 | 1.25 | 808 | 1.49 | 858 | 1.72 | 907 | 1.95 | 955 | 2.18 | 1003 | 2.40 | 1049 | 2.62 | 1095 | 2.82 |
| 3200 | 667 | 0.94 | 720 | 1.17 | 771 | 1.40 | 822 | 1.64 | 872 | 1.88 | 921 | 2.11 | 969 | 2.34 | 1016 | 2.56 | 1063 | 2.77 | 1109 | 2.97 |
| 3400 | 682 | 1.11 | 734 | 1.34 | 786 | 1.57 | 837 | 1.81 | 887 | 2.04 | 936 | 2.28 | 984 | 2.50 | 1031 | 2.73 | 1078 | 2.94 | 1124 | 3.14 |
| 3600 | 697 | 1.29 | 750 | 1.52 | 802 | 1.76 | 853 | 1.99 | 903 | 2.23 | 952 | 2.46 | 1000 | 2.69 | 1047 | 2.91 | 1094 | 3.12 | 1140 | 3.32 |
| 3800 | 714 | 1.50 | 767 | 1.73 | 819 | 1.96 | 870 | 2.20 | 920 | 2.43 | 969 | 2.67 | 1017 | 2.90 | 1064 | 3.12 | 1111 | 3.33 | 1157 | 3.53 |
| 4000 | 733 | 1.73 | 786 | 1.96 | 837 | 2.19 | 888 | 2.43 | 938 | 2.66 | 987 | 2.90 | 1035 | 3.12 | 1083 | 3.34 | 1129 | 3.56 | 1174 | 3.76 |
| 4200 | 753 | 1.98 | 806 | 2.21 | 857 | 2.44 | 908 | 2.68 | 958 | 2.91 | 1007 | 3.15 | 1055 | 3.37 | 1102 | 3.60 | 1149 | 3.81 | -- | -- |
| 4400 | 774 | 2.25 | 827 | 2.48 | 879 | 2.72 | 930 | 2.95 | 979 | 3.19 | 1028 | 3.42 | 1076 | 3.65 | 1124 | 3.87 | 1170 | 4.08 | -- | -- |
| 4600 | 797 | 2.55 | 850 | 2.78 | 902 | 3.02 | 952 | 3.25 | 1002 | 3.49 | 1051 | 3.72 | 1099 | 3.95 | 1147 | 4.17 | -- | -- | -- | -- |
| 4800 | 822 | 2.88 | 874 | 3.11 | 926 | 3.34 | 977 | 3.58 | 1027 | 3.81 | 1076 | 4.05 | 1124 | 4.27 | 1171 | 4.50 | -- | -- | -- | -- |
| 5000 | 848 | 3.23 | 901 | 3.46 | 952 | 3.69 | 1003 | 3.93 | 1053 | 4.16 | 1102 | 4.40 | 1150 | 4.62 | -- | -- | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp> | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

ZY04 to 12 bottom duct application (belt drive)

Table 110: ZY04 (3.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | n/a | n/a | 878 | 0.26 | 976 | 0.37 | 1070 | 0.47 | 1161 | 0.58 | 1247 | 0.67 | 1329 | 0.76 | 1405 | 0.85 | 1477 | 0.93 | 1543 | 1.00 |
| 1000 | 792 | 0.20 | 894 | 0.31 | 992 | 0.42 | 1087 | 0.52 | 1177 | 0.62 | 1263 | 0.72 | 1345 | 0.81 | 1422 | 0.90 | 1493 | 0.98 | 1560 | 1.05 |
| 1100 | 810 | 0.26 | 912 | 0.37 | 1010 | 0.47 | 1104 | 0.58 | 1195 | 0.68 | 1281 | 0.77 | 1363 | 0.87 | 1439 | 0.95 | 1511 | 1.03 | 1577 | 1.11 |
| 1200 | 829 | 0.32 | 931 | 0.43 | 1029 | 0.54 | 1124 | 0.64 | 1214 | 0.74 | 1300 | 0.84 | 1382 | 0.93 | 1459 | 1.02 | 1530 | 1.10 | 1593 | 1.17 |
| 1300 | 850 | 0.39 | 952 | 0.50 | 1050 | 0.61 | 1145 | 0.71 | 1235 | 0.81 | 1321 | 0.91 | 1403 | 1.00 | 1480 | 1.09 | 1552 | 1.17 | -- | -- |
| 1400 | 874 | 0.47 | 975 | 0.58 | 1073 | 0.69 | 1168 | 0.79 | 1258 | 0.89 | 1344 | 0.99 | 1426 | 1.08 | 1503 | 1.17 | 1575 | 1.25 | -- | -- |
| 1500 | 899 | 0.56 | 1000 | 0.67 | 1098 | 0.77 | 1193 | 0.88 | 1283 | 0.98 | 1370 | 1.07 | 1451 | 1.17 | 1528 | 1.25 | 1600 | 1.33 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 111: ZY05 (4.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 840 | 0.37 | 929 | 0.46 | 1016 | 0.56 | 1101 | 0.68 | 1184 | 0.80 | 1265 | 0.93 | 1345 | 1.04 | 1423 | 1.14 | 1500 | 1.22 | 1576 | 1.28 |
| 1300 | 858 | 0.43 | 947 | 0.52 | 1035 | 0.62 | 1120 | 0.74 | 1203 | 0.86 | 1284 | 0.99 | 1364 | 1.10 | 1442 | 1.20 | 1519 | 1.28 | 1593 | 1.34 |
| 1400 | 879 | 0.49 | 968 | 0.58 | 1055 | 0.69 | 1140 | 0.81 | 1224 | 0.93 | 1305 | 1.05 | 1385 | 1.17 | 1463 | 1.27 | 1540 | 1.35 | -- | -- |
| 1500 | 903 | 0.56 | 992 | 0.65 | 1079 | 0.76 | 1164 | 0.88 | 1247 | 1.00 | 1328 | 1.12 | 1408 | 1.24 | 1486 | 1.34 | 1563 | 1.42 | -- | -- |
| 1600 | 929 | 0.64 | 1018 | 0.73 | 1105 | 0.83 | 1190 | 0.95 | 1273 | 1.07 | 1354 | 1.20 | 1434 | 1.31 | 1512 | 1.41 | 1589 | 1.49 | -- | -- |
| 1700 | 957 | 0.72 | 1047 | 0.81 | 1134 | 0.91 | 1219 | 1.03 | 1302 | 1.15 | 1383 | 1.28 | 1463 | 1.39 | 1541 | 1.49 | -- | -- | -- | -- |
| 1800 | 989 | 0.80 | 1078 | 0.89 | 1165 | 1.00 | 1250 | 1.12 | 1333 | 1.24 | 1415 | 1.36 | 1494 | 1.47 | 1572 | 1.58 | -- | -- | -- | -- |
| 1900 | 1023 | 0.89 | 1112 | 0.98 | 1199 | 1.08 | 1284 | 1.20 | 1367 | 1.33 | 1449 | 1.45 | 1528 | 1.56 | -- | -- | -- | -- | -- | -- |
| 2000 | 1059 | 0.98 | 1149 | 1.07 | 1236 | 1.18 | 1321 | 1.29 | 1404 | 1.42 | 1485 | 1.54 | 1565 | 1.65 | -- | -- | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 112: ZY06 (5.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 840 | 0.48 | 910 | 0.58 | 977 | 0.67 | 1042 | 0.77 | 1106 | 0.87 | 1166 | 0.98 | 1225 | 1.08 | 1280 | 1.19 | 1334 | 1.30 | 1384 | 1.41 |
| 1600 | 866 | 0.55 | 935 | 0.65 | 1003 | 0.74 | 1068 | 0.84 | 1131 | 0.94 | 1192 | 1.04 | 1250 | 1.15 | 1306 | 1.26 | 1359 | 1.37 | 1410 | 1.48 |
| 1700 | 892 | 0.63 | 961 | 0.72 | 1029 | 0.82 | 1094 | 0.92 | 1157 | 1.02 | 1218 | 1.12 | 1276 | 1.23 | 1332 | 1.33 | 1385 | 1.44 | 1436 | 1.56 |
| 1800 | 918 | 0.71 | 987 | 0.81 | 1055 | 0.90 | 1120 | 1.00 | 1183 | 1.10 | 1244 | 1.21 | 1302 | 1.31 | 1358 | 1.42 | 1411 | 1.53 | 1462 | 1.64 |
| 1900 | 944 | 0.80 | 1014 | 0.90 | 1081 | 1.00 | 1146 | 1.09 | 1209 | 1.19 | 1270 | 1.30 | 1329 | 1.40 | 1384 | 1.51 | 1438 | 1.62 | 1488 | 1.73 |
| 2000 | 971 | 0.90 | 1041 | 1.00 | 1108 | 1.09 | 1174 | 1.19 | 1237 | 1.29 | 1297 | 1.39 | 1356 | 1.50 | 1412 | 1.61 | 1465 | 1.72 | 1516 | 1.83 |
| 2100 | 999 | 1.01 | 1069 | 1.10 | 1136 | 1.20 | 1202 | 1.30 | 1265 | 1.40 | 1326 | 1.50 | 1384 | 1.60 | 1440 | 1.71 | 1493 | 1.82 | 1544 | 1.93 |
| 2200 | 1028 | 1.12 | 1098 | 1.21 | 1165 | 1.31 | 1231 | 1.41 | 1294 | 1.51 | 1355 | 1.61 | 1413 | 1.72 | 1469 | 1.82 | 1522 | 1.93 | 1573 | 2.05 |
| 2300 | 1058 | 1.24 | 1128 | 1.33 | 1195 | 1.43 | 1261 | 1.53 | 1324 | 1.63 | 1385 | 1.73 | 1443 | 1.83 | 1499 | 1.94 | 1552 | 2.05 | -- | -- |
| 2400 | 1090 | 1.36 | 1159 | 1.46 | 1227 | 1.55 | 1292 | 1.65 | 1355 | 1.75 | 1416 | 1.85 | 1474 | 1.96 | 1530 | 2.07 | 1583 | 2.18 | -- | -- |
| 2500 | 1122 | 1.49 | 1191 | 1.59 | 1259 | 1.68 | 1324 | 1.78 | 1387 | 1.88 | 1448 | 1.98 | 1506 | 2.09 | 1562 | 2.20 | 1615 | 2.31 | -- | -- |
| Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.857 x BHP

Table 113: ZY07 (6.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1800 | 525 | 0.31 | 590 | 0.48 | 653 | 0.65 | 713 | 0.82 | 770 | 0.98 | 825 | 1.15 | 878 | 1.31 | 928 | 1.48 | 976 | 1.65 | 1022 | 1.83 |
| 1900 | 534 | 0.36 | 599 | 0.53 | 661 | 0.71 | 721 | 0.87 | 779 | 1.03 | 834 | 1.20 | 886 | 1.36 | 936 | 1.53 | 984 | 1.70 | 1030 | 1.88 |
| 2000 | 542 | 0.41 | 607 | 0.59 | 670 | 0.76 | 730 | 0.93 | 787 | 1.09 | 842 | 1.25 | 895 | 1.42 | 945 | 1.58 | 993 | 1.75 | 1039 | 1.93 |
| 2100 | 551 | 0.47 | 616 | 0.65 | 678 | 0.82 | 738 | 0.99 | 796 | 1.15 | 850 | 1.31 | 903 | 1.47 | 953 | 1.64 | 1001 | 1.81 | 1047 | 1.99 |
| 2200 | 559 | 0.53 | 624 | 0.71 | 687 | 0.88 | 747 | 1.05 | 804 | 1.21 | 859 | 1.37 | 912 | 1.54 | 962 | 1.70 | 1010 | 1.88 | 1056 | 2.05 |
| 2300 | 568 | 0.60 | 634 | 0.78 | 696 | 0.95 | 756 | 1.11 | 813 | 1.28 | 868 | 1.44 | 921 | 1.60 | 971 | 1.77 | 1019 | 1.94 | 1065 | 2.12 |
| 2400 | 578 | 0.66 | 643 | 0.84 | 705 | 1.01 | 765 | 1.18 | 823 | 1.34 | 878 | 1.51 | 930 | 1.67 | 981 | 1.84 | 1029 | 2.01 | 1074 | 2.19 |
| 2500 | 588 | 0.74 | 653 | 0.91 | 715 | 1.08 | 775 | 1.25 | 833 | 1.41 | 888 | 1.58 | 940 | 1.74 | 991 | 1.91 | 1039 | 2.08 | 1084 | 2.26 |
| 2600 | 598 | 0.81 | 663 | 0.99 | 725 | 1.16 | 785 | 1.32 | 843 | 1.49 | 898 | 1.65 | 950 | 1.81 | 1001 | 1.98 | 1049 | 2.15 | 1094 | 2.33 |
| 2700 | 609 | 0.88 | 674 | 1.06 | 736 | 1.23 | 796 | 1.40 | 853 | 1.56 | 908 | 1.72 | 961 | 1.89 | 1011 | 2.05 | 1059 | 2.23 | -- | -- |
| 2800 | 620 | 0.96 | 685 | 1.14 | 747 | 1.31 | 807 | 1.47 | 864 | 1.64 | 919 | 1.80 | 972 | 1.96 | 1022 | 2.13 | 1070 | 2.30 | -- | -- |
| 2900 | 631 | 1.04 | 696 | 1.22 | 759 | 1.39 | 819 | 1.55 | 876 | 1.72 | 931 | 1.88 | 984 | 2.04 | 1034 | 2.21 | 1082 | 2.38 | -- | -- |
| 3000 | 643 | 1.12 | 708 | 1.30 | 771 | 1.47 | 830 | 1.64 | 888 | 1.80 | 943 | 1.96 | 996 | 2.12 | 1046 | 2.29 | 1094 | 2.46 | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 114: ZYA7 (6.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1800 | 525 | 0.31 | 590 | 0.48 | 653 | 0.65 | 713 | 0.82 | 770 | 0.98 | 825 | 1.15 | 878 | 1.31 | 928 | 1.48 | 976 | 1.65 | 1022 | 1.83 |
| 1900 | 534 | 0.36 | 599 | 0.53 | 661 | 0.71 | 721 | 0.87 | 779 | 1.03 | 834 | 1.20 | 886 | 1.36 | 936 | 1.53 | 984 | 1.70 | 1030 | 1.88 |
| 2000 | 542 | 0.41 | 607 | 0.59 | 670 | 0.76 | 730 | 0.93 | 787 | 1.09 | 842 | 1.25 | 895 | 1.42 | 945 | 1.58 | 993 | 1.75 | 1039 | 1.93 |
| 2100 | 551 | 0.47 | 616 | 0.65 | 678 | 0.82 | 738 | 0.99 | 796 | 1.15 | 850 | 1.31 | 903 | 1.47 | 953 | 1.64 | 1001 | 1.81 | 1047 | 1.99 |
| 2200 | 559 | 0.53 | 624 | 0.71 | 687 | 0.88 | 747 | 1.05 | 804 | 1.21 | 859 | 1.37 | 912 | 1.54 | 962 | 1.70 | 1010 | 1.88 | 1056 | 2.05 |
| 2300 | 568 | 0.60 | 634 | 0.78 | 696 | 0.95 | 756 | 1.11 | 813 | 1.28 | 868 | 1.44 | 921 | 1.60 | 971 | 1.77 | 1019 | 1.94 | 1065 | 2.12 |
| 2400 | 578 | 0.66 | 643 | 0.84 | 705 | 1.01 | 765 | 1.18 | 823 | 1.34 | 878 | 1.51 | 930 | 1.67 | 981 | 1.84 | 1029 | 2.01 | 1074 | 2.19 |
| 2500 | 588 | 0.74 | 653 | 0.91 | 715 | 1.08 | 775 | 1.25 | 833 | 1.41 | 888 | 1.58 | 940 | 1.74 | 991 | 1.91 | 1039 | 2.08 | 1084 | 2.26 |
| 2600 | 598 | 0.81 | 663 | 0.99 | 725 | 1.16 | 785 | 1.32 | 843 | 1.49 | 898 | 1.65 | 950 | 1.81 | 1001 | 1.98 | 1049 | 2.15 | 1094 | 2.33 |
| 2700 | 609 | 0.88 | 674 | 1.06 | 736 | 1.23 | 796 | 1.40 | 853 | 1.56 | 908 | 1.72 | 961 | 1.89 | 1011 | 2.05 | 1059 | 2.23 | -- | -- |
| 2800 | 620 | 0.96 | 685 | 1.14 | 747 | 1.31 | 807 | 1.47 | 864 | 1.64 | 919 | 1.80 | 972 | 1.96 | 1022 | 2.13 | 1070 | 2.30 | -- | -- |
| 2900 | 631 | 1.04 | 696 | 1.22 | 759 | 1.39 | 819 | 1.55 | 876 | 1.72 | 931 | 1.88 | 984 | 2.04 | 1034 | 2.21 | 1082 | 2.38 | -- | -- |
| 3000 | 643 | 1.12 | 708 | 1.30 | 771 | 1.47 | 830 | 1.64 | 888 | 1.80 | 943 | 1.96 | 996 | 2.12 | 1046 | 2.29 | 1094 | 2.46 | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 115: ZY08 (7.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 556 | 0.45 | 621 | 0.65 | 683 | 0.83 | 742 | 1.00 | 798 | 1.18 | 852 | 1.34 | 904 | 1.51 | 954 | 1.69 | 1003 | 1.87 | 1050 | 2.06 |
| 2400 | 567 | 0.53 | 632 | 0.73 | 694 | 0.91 | 753 | 1.09 | 809 | 1.26 | 863 | 1.43 | 914 | 1.60 | 964 | 1.77 | 1013 | 1.95 | 1060 | 2.14 |
| 2600 | 580 | 0.65 | 646 | 0.85 | 707 | 1.03 | 766 | 1.21 | 823 | 1.38 | 876 | 1.55 | 928 | 1.72 | 978 | 1.89 | 1027 | 2.07 | 1074 | 2.27 |
| 2800 | 595 | 0.79 | 660 | 0.99 | 722 | 1.17 | 780 | 1.35 | 837 | 1.52 | 890 | 1.69 | 942 | 1.86 | 992 | 2.03 | 1041 | 2.21 | 1088 | 2.40 |
| 3000 | 609 | 0.94 | 674 | 1.14 | 736 | 1.32 | 795 | 1.50 | 851 | 1.67 | 905 | 1.83 | 957 | 2.00 | 1007 | 2.18 | 1056 | 2.36 | 1100 | 2.55 |
| 3200 | 625 | 1.10 | 690 | 1.30 | 752 | 1.48 | 810 | 1.66 | 867 | 1.83 | 921 | 2.00 | 972 | 2.17 | 1022 | 2.34 | 1071 | 2.52 | -- | -- |
| 3400 | 641 | 1.28 | 706 | 1.47 | 768 | 1.66 | 827 | 1.83 | 883 | 2.00 | 937 | 2.17 | 989 | 2.34 | 1039 | 2.52 | 1087 | 2.70 | -- | -- |
| 3600 | 658 | 1.47 | 723 | 1.66 | 785 | 1.85 | 844 | 2.02 | 900 | 2.19 | 954 | 2.36 | 1006 | 2.53 | 1056 | 2.70 | 1100 | 2.89 | -- | -- |
| 3750 | 672 | 1.61 | 737 | 1.81 | 799 | 1.99 | 858 | 2.17 | 914 | 2.34 | 968 | 2.51 | 1019 | 2.68 | 1069 | 2.85 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 116: ZY09 (8.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|-------------|--|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2550 | 577 | 0.62 | 642 | 0.82 | 704 | 1.00 | 763 | 1.18 | 819 | 1.35 | 873 | 1.52 | 925 | 1.69 | 975 | 1.86 | 1023 | 2.04 | 1071 | 2.23 |
| 2600 | 580 | 0.65 | 646 | 0.85 | 707 | 1.03 | 766 | 1.21 | 823 | 1.38 | 876 | 1.55 | 928 | 1.72 | 978 | 1.89 | 1027 | 2.07 | 1074 | 2.27 |
| 2800 | 595 | 0.79 | 660 | 0.99 | 722 | 1.17 | 780 | 1.35 | 837 | 1.52 | 890 | 1.69 | 942 | 1.86 | 992 | 2.03 | 1041 | 2.21 | 1088 | 2.40 |
| 3000 | 609 | 0.94 | 674 | 1.14 | 736 | 1.32 | 795 | 1.50 | 851 | 1.67 | 905 | 1.83 | 957 | 2.00 | 1007 | 2.18 | 1056 | 2.36 | 1103 | 2.55 |
| 3200 | 625 | 1.10 | 690 | 1.30 | 752 | 1.48 | 810 | 1.66 | 867 | 1.83 | 921 | 2.00 | 972 | 2.17 | 1022 | 2.34 | 1071 | 2.52 | -- | -- |
| 3400 | 641 | 1.28 | 706 | 1.47 | 768 | 1.66 | 827 | 1.83 | 883 | 2.00 | 937 | 2.17 | 989 | 2.34 | 1039 | 2.52 | 1087 | 2.70 | -- | -- |
| 3600 | 658 | 1.47 | 723 | 1.66 | 785 | 1.85 | 844 | 2.02 | 900 | 2.19 | 954 | 2.36 | 1006 | 2.53 | 1056 | 2.70 | 1104 | 2.89 | -- | -- |
| 3800 | 676 | 1.67 | 742 | 1.86 | 803 | 2.04 | 862 | 2.22 | 918 | 2.39 | 972 | 2.56 | 1024 | 2.73 | 1074 | 2.90 | -- | -- | -- | -- |
| 4000 | 696 | 1.88 | 761 | 2.07 | 823 | 2.26 | 882 | 2.43 | 938 | 2.60 | 992 | 2.77 | 1043 | 2.94 | 1093 | 3.12 | -- | -- | -- | -- |
| 4200 | 716 | 2.10 | 781 | 2.29 | 843 | 2.48 | 902 | 2.65 | 958 | 2.82 | 1012 | 2.99 | 1064 | 3.16 | 1114 | 3.34 | -- | -- | -- | -- |
| 4250 | 721 | 2.16 | 786 | 2.35 | 848 | 2.53 | 907 | 2.71 | 963 | 2.88 | 1017 | 3.05 | 1069 | 3.22 | 1119 | 3.39 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| Bold | Field-supplied AK79 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. $kw = 0.929 \times BHP$

Table 117: ZY12 (10 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2600 | 626 | 0.50 | 679 | 0.73 | 731 | 0.97 | 782 | 1.20 | 831 | 1.44 | 880 | 1.67 | 928 | 1.90 | 976 | 2.12 | 1022 | 2.33 | 1068 | 2.53 |
| 2800 | 639 | 0.64 | 692 | 0.87 | 744 | 1.11 | 795 | 1.34 | 845 | 1.58 | 894 | 1.81 | 942 | 2.04 | 989 | 2.26 | 1036 | 2.47 | 1082 | 2.67 |
| 3000 | 653 | 0.79 | 706 | 1.02 | 758 | 1.25 | 808 | 1.49 | 858 | 1.72 | 907 | 1.95 | 955 | 2.18 | 1003 | 2.40 | 1049 | 2.62 | 1095 | 2.82 |
| 3200 | 667 | 0.94 | 720 | 1.17 | 771 | 1.40 | 822 | 1.64 | 872 | 1.88 | 921 | 2.11 | 969 | 2.34 | 1016 | 2.56 | 1063 | 2.77 | 1109 | 2.97 |
| 3400 | 682 | 1.11 | 734 | 1.34 | 786 | 1.57 | 837 | 1.81 | 887 | 2.04 | 936 | 2.28 | 984 | 2.50 | 1031 | 2.73 | 1078 | 2.94 | 1124 | 3.14 |
| 3600 | 697 | 1.29 | 750 | 1.52 | 802 | 1.76 | 853 | 1.99 | 903 | 2.23 | 952 | 2.46 | 1000 | 2.69 | 1047 | 2.91 | 1094 | 3.12 | 1140 | 3.32 |
| 3800 | 714 | 1.50 | 767 | 1.73 | 819 | 1.96 | 870 | 2.20 | 920 | 2.43 | 969 | 2.67 | 1017 | 2.90 | 1064 | 3.12 | 1111 | 3.33 | 1157 | 3.53 |
| 4000 | 733 | 1.73 | 786 | 1.96 | 837 | 2.19 | 888 | 2.43 | 938 | 2.66 | 987 | 2.90 | 1035 | 3.12 | 1083 | 3.34 | 1129 | 3.56 | 1175 | 3.76 |
| 4200 | 753 | 1.98 | 806 | 2.21 | 857 | 2.44 | 908 | 2.68 | 958 | 2.91 | 1007 | 3.15 | 1055 | 3.37 | 1102 | 3.60 | 1149 | 3.81 | 1195 | 4.01 |
| 4400 | 774 | 2.25 | 827 | 2.48 | 879 | 2.72 | 930 | 2.95 | 979 | 3.19 | 1028 | 3.42 | 1076 | 3.65 | 1124 | 3.87 | 1170 | 4.08 | 1216 | 4.28 |
| 4600 | 797 | 2.55 | 850 | 2.78 | 902 | 3.02 | 952 | 3.25 | 1002 | 3.49 | 1051 | 3.72 | 1099 | 3.95 | 1147 | 4.17 | 1193 | 4.38 | 1239 | 4.58 |
| 4800 | 822 | 2.88 | 874 | 3.11 | 926 | 3.34 | 977 | 3.58 | 1027 | 3.81 | 1076 | 4.05 | 1124 | 4.27 | 1171 | 4.50 | 1218 | 4.71 | -- | -- |
| 5000 | 848 | 3.23 | 901 | 3.46 | 952 | 3.69 | 1003 | 3.93 | 1053 | 4.16 | 1102 | 4.40 | 1150 | 4.62 | 1197 | 4.84 | 1242 | 5.06 | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. $kw = 0.929 \times BHP$

ZL04 to ZL06 side duct application (belt drive)

Table 118: ZL04 (3.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | n/a | n/a | 874 | 0.31 | 972 | 0.40 | 1065 | 0.50 | 1153 | 0.60 | 1236 | 0.70 | 1315 | 0.80 | 1390 | 0.89 | 1460 | 0.97 | 1526 | 1.05 |
| 1000 | n/a | n/a | 887 | 0.36 | 985 | 0.45 | 1078 | 0.55 | 1165 | 0.65 | 1249 | 0.75 | 1328 | 0.85 | 1402 | 0.94 | 1472 | 1.03 | 1539 | 1.10 |
| 1100 | 797 | 0.33 | 900 | 0.42 | 998 | 0.51 | 1091 | 0.61 | 1179 | 0.71 | 1263 | 0.81 | 1341 | 0.91 | 1416 | 1.00 | 1486 | 1.08 | 1553 | 1.16 |
| 1200 | 813 | 0.40 | 916 | 0.48 | 1014 | 0.57 | 1107 | 0.67 | 1195 | 0.77 | 1279 | 0.87 | 1357 | 0.97 | 1432 | 1.06 | 1502 | 1.15 | 1569 | 1.22 |
| 1300 | 831 | 0.46 | 935 | 0.55 | 1033 | 0.64 | 1126 | 0.74 | 1214 | 0.84 | 1297 | 0.94 | 1376 | 1.03 | 1450 | 1.13 | 1520 | 1.21 | 1583 | 1.28 |
| 1400 | 852 | 0.53 | 956 | 0.61 | 1054 | 0.71 | 1146 | 0.80 | 1234 | 0.90 | 1318 | 1.00 | 1396 | 1.10 | 1471 | 1.19 | 1541 | 1.28 | -- | -- |
| 1500 | 876 | 0.59 | 979 | 0.68 | 1077 | 0.77 | 1170 | 0.87 | 1258 | 0.97 | 1341 | 1.07 | 1420 | 1.17 | 1494 | 1.26 | 1565 | 1.34 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 119: ZL05 (4.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 840 | 0.30 | 927 | 0.41 | 1012 | 0.53 | 1096 | 0.65 | 1177 | 0.77 | 1257 | 0.89 | 1334 | 1.01 | 1411 | 1.12 | 1485 | 1.22 | 1558 | 1.31 |
| 1300 | 857 | 0.35 | 944 | 0.47 | 1029 | 0.59 | 1112 | 0.71 | 1194 | 0.83 | 1273 | 0.95 | 1351 | 1.07 | 1427 | 1.18 | 1502 | 1.28 | 1574 | 1.37 |
| 1400 | 875 | 0.42 | 962 | 0.53 | 1048 | 0.65 | 1131 | 0.77 | 1212 | 0.89 | 1292 | 1.01 | 1370 | 1.13 | 1446 | 1.24 | 1520 | 1.34 | 1593 | 1.43 |
| 1500 | 897 | 0.49 | 984 | 0.60 | 1069 | 0.72 | 1152 | 0.84 | 1233 | 0.96 | 1313 | 1.08 | 1391 | 1.20 | 1467 | 1.31 | 1542 | 1.41 | -- | -- |
| 1600 | 921 | 0.56 | 1008 | 0.67 | 1093 | 0.79 | 1176 | 0.91 | 1258 | 1.04 | 1337 | 1.16 | 1415 | 1.27 | 1491 | 1.38 | 1566 | 1.49 | -- | -- |
| 1700 | 948 | 0.64 | 1035 | 0.76 | 1120 | 0.87 | 1204 | 1.00 | 1285 | 1.12 | 1365 | 1.24 | 1442 | 1.36 | 1518 | 1.47 | 1593 | 1.57 | -- | -- |
| 1800 | 979 | 0.73 | 1066 | 0.85 | 1151 | 0.96 | 1234 | 1.08 | 1315 | 1.21 | 1395 | 1.33 | 1473 | 1.44 | 1549 | 1.56 | -- | -- | -- | -- |
| 1900 | 1012 | 0.83 | 1099 | 0.94 | 1185 | 1.06 | 1268 | 1.18 | 1349 | 1.30 | 1429 | 1.42 | 1507 | 1.54 | 1583 | 1.65 | -- | -- | -- | -- |
| 2000 | 1049 | 0.93 | 1136 | 1.04 | 1222 | 1.16 | 1305 | 1.28 | 1386 | 1.40 | 1466 | 1.52 | 1544 | 1.64 | -- | -- | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See rpm selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 120: ZL06 (5.0 ton) side duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 810 | 0.49 | 883 | 0.60 | 954 | 0.70 | 1023 | 0.80 | 1089 | 0.91 | 1152 | 1.02 | 1213 | 1.14 | 1269 | 1.26 | 1323 | 1.40 | 1373 | 1.55 |
| 1600 | 831 | 0.58 | 904 | 0.68 | 975 | 0.79 | 1044 | 0.89 | 1110 | 1.00 | 1173 | 1.11 | 1233 | 1.22 | 1290 | 1.35 | 1344 | 1.49 | 1394 | 1.64 |
| 1700 | 854 | 0.66 | 927 | 0.77 | 998 | 0.87 | 1067 | 0.98 | 1133 | 1.08 | 1196 | 1.19 | 1256 | 1.31 | 1313 | 1.44 | 1367 | 1.57 | 1417 | 1.72 |
| 1800 | 878 | 0.75 | 952 | 0.86 | 1023 | 0.96 | 1091 | 1.07 | 1157 | 1.17 | 1221 | 1.28 | 1281 | 1.40 | 1338 | 1.52 | 1391 | 1.66 | 1441 | 1.81 |
| 1900 | 904 | 0.84 | 977 | 0.95 | 1048 | 1.05 | 1117 | 1.16 | 1183 | 1.26 | 1246 | 1.37 | 1306 | 1.49 | 1363 | 1.61 | 1417 | 1.75 | 1467 | 1.90 |
| 2000 | 931 | 0.93 | 1004 | 1.04 | 1075 | 1.15 | 1144 | 1.25 | 1210 | 1.36 | 1273 | 1.47 | 1333 | 1.58 | 1390 | 1.71 | 1444 | 1.84 | 1494 | 1.99 |
| 2100 | 959 | 1.03 | 1032 | 1.14 | 1103 | 1.24 | 1172 | 1.35 | 1238 | 1.45 | 1301 | 1.56 | 1361 | 1.68 | 1418 | 1.81 | 1472 | 1.94 | 1522 | 2.09 |
| 2200 | 988 | 1.13 | 1061 | 1.24 | 1132 | 1.35 | 1201 | 1.45 | 1267 | 1.56 | 1330 | 1.67 | 1390 | 1.78 | 1447 | 1.91 | 1501 | 2.04 | 1550 | 2.19 |
| 2300 | 1017 | 1.24 | 1091 | 1.35 | 1162 | 1.45 | 1230 | 1.56 | 1296 | 1.66 | 1359 | 1.77 | 1420 | 1.89 | 1477 | 2.02 | 1530 | 2.15 | 1580 | 2.30 |
| 2400 | 1047 | 1.36 | 1121 | 1.46 | 1192 | 1.57 | 1260 | 1.67 | 1326 | 1.78 | 1390 | 1.89 | 1450 | 2.01 | 1507 | 2.13 | 1560 | 2.27 | -- | -- |
| 2500 | 1078 | 1.48 | 1151 | 1.58 | 1222 | 1.69 | 1291 | 1.79 | 1357 | 1.90 | 1420 | 2.01 | 1480 | 2.13 | 1537 | 2.25 | 1591 | 2.39 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.857 x BHP

ZL04 to ZL06 bottom duct application (belt drive)

Table 121: ZL04 (3.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 900 | n/a | n/a | 878 | 0.26 | 976 | 0.37 | 1070 | 0.47 | 1161 | 0.58 | 1247 | 0.67 | 1329 | 0.76 | 1405 | 0.85 | 1477 | 0.93 | 1543 | 1.00 |
| 1000 | 792 | 0.20 | 894 | 0.31 | 992 | 0.42 | 1087 | 0.52 | 1177 | 0.62 | 1263 | 0.72 | 1345 | 0.81 | 1422 | 0.90 | 1493 | 0.98 | 1560 | 1.05 |
| 1100 | 810 | 0.26 | 912 | 0.37 | 1010 | 0.47 | 1104 | 0.58 | 1195 | 0.68 | 1281 | 0.77 | 1363 | 0.87 | 1439 | 0.95 | 1511 | 1.03 | 1577 | 1.11 |
| 1200 | 829 | 0.32 | 931 | 0.43 | 1029 | 0.54 | 1124 | 0.64 | 1214 | 0.74 | 1300 | 0.84 | 1382 | 0.93 | 1459 | 1.02 | 1530 | 1.10 | 1593 | 1.17 |
| 1300 | 850 | 0.39 | 952 | 0.50 | 1050 | 0.61 | 1145 | 0.71 | 1235 | 0.81 | 1321 | 0.91 | 1403 | 1.00 | 1480 | 1.09 | 1552 | 1.17 | -- | -- |
| 1400 | 874 | 0.47 | 975 | 0.58 | 1073 | 0.69 | 1168 | 0.79 | 1258 | 0.89 | 1344 | 0.99 | 1426 | 1.08 | 1503 | 1.17 | 1575 | 1.25 | -- | -- |
| 1500 | 899 | 0.56 | 1000 | 0.67 | 1098 | 0.77 | 1193 | 0.88 | 1283 | 0.98 | 1370 | 1.07 | 1451 | 1.17 | 1528 | 1.25 | 1600 | 1.33 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 122: ZL05 (4.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1200 | 840 | 0.37 | 929 | 0.46 | 1016 | 0.56 | 1101 | 0.68 | 1184 | 0.80 | 1265 | 0.93 | 1345 | 1.04 | 1423 | 1.14 | 1500 | 1.22 | 1576 | 1.28 |
| 1300 | 858 | 0.43 | 947 | 0.52 | 1035 | 0.62 | 1120 | 0.74 | 1203 | 0.86 | 1284 | 0.99 | 1364 | 1.10 | 1442 | 1.20 | 1519 | 1.28 | 1593 | 1.34 |
| 1400 | 879 | 0.49 | 968 | 0.58 | 1055 | 0.69 | 1140 | 0.81 | 1224 | 0.93 | 1305 | 1.05 | 1385 | 1.17 | 1463 | 1.27 | 1540 | 1.35 | -- | -- |
| 1500 | 903 | 0.56 | 992 | 0.65 | 1079 | 0.76 | 1164 | 0.88 | 1247 | 1.00 | 1328 | 1.12 | 1408 | 1.24 | 1486 | 1.34 | 1563 | 1.42 | -- | -- |
| 1600 | 929 | 0.64 | 1018 | 0.73 | 1105 | 0.83 | 1190 | 0.95 | 1273 | 1.07 | 1354 | 1.20 | 1434 | 1.31 | 1512 | 1.41 | 1589 | 1.49 | -- | -- |
| 1700 | 957 | 0.72 | 1047 | 0.81 | 1134 | 0.91 | 1219 | 1.03 | 1302 | 1.15 | 1383 | 1.28 | 1463 | 1.39 | 1541 | 1.49 | -- | -- | -- | -- |
| 1800 | 989 | 0.80 | 1078 | 0.89 | 1165 | 1.00 | 1250 | 1.12 | 1333 | 1.24 | 1415 | 1.36 | 1494 | 1.47 | 1572 | 1.58 | -- | -- | -- | -- |
| 1900 | 1023 | 0.89 | 1112 | 0.98 | 1199 | 1.08 | 1284 | 1.20 | 1367 | 1.33 | 1449 | 1.45 | 1528 | 1.56 | -- | -- | -- | -- | -- | -- |
| 2000 | 1059 | 0.98 | 1149 | 1.07 | 1236 | 1.18 | 1321 | 1.29 | 1404 | 1.42 | 1485 | 1.54 | 1565 | 1.65 | -- | -- | -- | -- | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 123: ZL06 (5.0 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 1500 | 840 | 0.48 | 910 | 0.58 | 977 | 0.67 | 1042 | 0.77 | 1106 | 0.87 | 1166 | 0.98 | 1225 | 1.08 | 1280 | 1.19 | 1334 | 1.30 | 1384 | 1.41 |
| 1600 | 866 | 0.55 | 935 | 0.65 | 1003 | 0.74 | 1068 | 0.84 | 1131 | 0.94 | 1192 | 1.04 | 1250 | 1.15 | 1306 | 1.26 | 1359 | 1.37 | 1410 | 1.48 |
| 1700 | 892 | 0.63 | 961 | 0.72 | 1029 | 0.82 | 1094 | 0.92 | 1157 | 1.02 | 1218 | 1.12 | 1276 | 1.23 | 1332 | 1.33 | 1385 | 1.44 | 1436 | 1.56 |
| 1800 | 918 | 0.71 | 987 | 0.81 | 1055 | 0.90 | 1120 | 1.00 | 1183 | 1.10 | 1244 | 1.21 | 1302 | 1.31 | 1358 | 1.42 | 1411 | 1.53 | 1462 | 1.64 |
| 1900 | 944 | 0.80 | 1014 | 0.90 | 1081 | 1.00 | 1146 | 1.09 | 1209 | 1.19 | 1270 | 1.30 | 1329 | 1.40 | 1384 | 1.51 | 1438 | 1.62 | 1488 | 1.73 |
| 2000 | 971 | 0.90 | 1041 | 1.00 | 1108 | 1.09 | 1174 | 1.19 | 1237 | 1.29 | 1297 | 1.39 | 1356 | 1.50 | 1412 | 1.61 | 1465 | 1.72 | 1516 | 1.83 |
| 2100 | 999 | 1.01 | 1069 | 1.10 | 1136 | 1.20 | 1202 | 1.30 | 1265 | 1.40 | 1326 | 1.50 | 1384 | 1.60 | 1440 | 1.71 | 1493 | 1.82 | 1544 | 1.93 |
| 2200 | 1028 | 1.12 | 1098 | 1.21 | 1165 | 1.31 | 1231 | 1.41 | 1294 | 1.51 | 1355 | 1.61 | 1413 | 1.72 | 1469 | 1.82 | 1522 | 1.93 | 1573 | 2.05 |
| 2300 | 1058 | 1.24 | 1128 | 1.33 | 1195 | 1.43 | 1261 | 1.53 | 1324 | 1.63 | 1385 | 1.73 | 1443 | 1.83 | 1499 | 1.94 | 1552 | 2.05 | -- | -- |
| 2400 | 1090 | 1.36 | 1159 | 1.46 | 1227 | 1.55 | 1292 | 1.65 | 1355 | 1.75 | 1416 | 1.85 | 1474 | 1.96 | 1530 | 2.07 | 1583 | 2.18 | -- | -- |
| 2500 | 1122 | 1.49 | 1191 | 1.59 | 1259 | 1.68 | 1324 | 1.78 | 1387 | 1.88 | 1448 | 1.98 | 1506 | 2.09 | 1562 | 2.20 | 1615 | 2.31 | -- | -- |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.857 x BHP

ZL08 to 14 side duct application (belt drive)

Table 124: ZL 08 (7.5 ton) side duct

| CFM | ¹ Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|--|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 547 | 0.39 | 610 | 0.60 | 670 | 0.81 | 727 | 1.01 | 783 | 1.21 | 836 | 1.41 | 888 | 1.59 | 939 | 1.78 | 989 | 1.96 | 1038 | 2.13 |
| 2400 | 556 | 0.47 | 619 | 0.69 | 679 | 0.90 | 736 | 1.10 | 792 | 1.30 | 845 | 1.49 | 897 | 1.68 | 948 | 1.86 | 998 | 2.04 | 1047 | 2.22 |
| 2600 | 568 | 0.60 | 631 | 0.81 | 691 | 1.02 | 749 | 1.22 | 804 | 1.42 | 857 | 1.61 | 909 | 1.80 | 960 | 1.99 | 1010 | 2.17 | 1059 | 2.34 |
| 2800 | 581 | 0.73 | 644 | 0.95 | 704 | 1.16 | 762 | 1.36 | 817 | 1.56 | 871 | 1.75 | 923 | 1.94 | 973 | 2.13 | 1023 | 2.31 | 1073 | 2.48 |
| 3000 | 595 | 0.89 | 658 | 1.10 | 718 | 1.31 | 776 | 1.51 | 831 | 1.71 | 885 | 1.91 | 937 | 2.09 | 988 | 2.28 | 1038 | 2.46 | 1087 | 2.63 |
| 3200 | 610 | 1.05 | 673 | 1.27 | 733 | 1.48 | 791 | 1.68 | 846 | 1.88 | 900 | 2.07 | 952 | 2.26 | 1003 | 2.44 | 1053 | 2.62 | -- | -- |
| 3400 | 627 | 1.23 | 689 | 1.45 | 750 | 1.66 | 807 | 1.86 | 863 | 2.06 | 916 | 2.25 | 968 | 2.44 | 1019 | 2.62 | 1069 | 2.80 | -- | -- |
| 3600 | 644 | 1.42 | 707 | 1.64 | 767 | 1.85 | 824 | 2.05 | 880 | 2.25 | 933 | 2.44 | 985 | 2.63 | 1036 | 2.82 | 1086 | 3.00 | -- | -- |
| 3750 | 657 | 1.58 | 720 | 1.79 | 780 | 2.00 | 838 | 2.20 | 893 | 2.40 | 947 | 2.60 | 999 | 2.78 | 1049 | 2.97 | 1099 | 3.15 | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 125: ZL 09 (8.5 ton) side duct

| CFM | ¹ Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|-------------|--|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2550 | 565 | 0.56 | 628 | 0.78 | 688 | 0.99 | 745 | 1.19 | 801 | 1.39 | 854 | 1.58 | 906 | 1.77 | 957 | 1.95 | 1007 | 2.13 | 1056 | 2.31 |
| 2600 | 568 | 0.60 | 631 | 0.81 | 691 | 1.02 | 749 | 1.22 | 804 | 1.42 | 857 | 1.61 | 909 | 1.80 | 960 | 1.99 | 1010 | 2.17 | 1059 | 2.34 |
| 2800 | 581 | 0.73 | 644 | 0.95 | 704 | 1.16 | 762 | 1.36 | 817 | 1.56 | 871 | 1.75 | 923 | 1.94 | 973 | 2.13 | 1023 | 2.31 | 1073 | 2.48 |
| 3000 | 595 | 0.89 | 658 | 1.10 | 718 | 1.31 | 776 | 1.51 | 831 | 1.71 | 885 | 1.91 | 937 | 2.09 | 988 | 2.28 | 1038 | 2.46 | 1087 | 2.63 |
| 3200 | 610 | 1.05 | 673 | 1.27 | 733 | 1.48 | 791 | 1.68 | 846 | 1.88 | 900 | 2.07 | 952 | 2.26 | 1003 | 2.44 | 1053 | 2.62 | 1100 | 2.80 |
| 3400 | 627 | 1.23 | 689 | 1.45 | 750 | 1.66 | 807 | 1.86 | 863 | 2.06 | 916 | 2.25 | 968 | 2.44 | 1019 | 2.62 | 1069 | 2.80 | -- | -- |
| 3600 | 644 | 1.42 | 707 | 1.64 | 767 | 1.85 | 824 | 2.05 | 880 | 2.25 | 933 | 2.44 | 985 | 2.63 | 1036 | 2.82 | 1086 | 3.00 | -- | -- |
| 3800 | 662 | 1.63 | 725 | 1.84 | 785 | 2.05 | 842 | 2.26 | 898 | 2.46 | 951 | 2.65 | 1003 | 2.84 | 1054 | 3.02 | 1100 | 3.20 | -- | -- |
| 4000 | 681 | 1.85 | 744 | 2.06 | 804 | 2.27 | 861 | 2.47 | 917 | 2.67 | 970 | 2.87 | 1022 | 3.05 | 1073 | 3.24 | -- | -- | -- | -- |
| 4200 | 701 | 2.08 | 764 | 2.29 | 824 | 2.50 | 881 | 2.70 | 937 | 2.90 | 990 | 3.09 | 1042 | 3.28 | 1093 | 3.47 | -- | -- | -- | -- |
| 4250 | 706 | 2.14 | 769 | 2.35 | 829 | 2.56 | 887 | 2.76 | 942 | 2.96 | 996 | 3.15 | 1048 | 3.34 | 1098 | 3.53 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| Bold | Field-supplied BK95 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 126: ZL 12 (10 ton) side duct

| CFM | ¹ Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|--|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3000 | 653 | 0.79 | 706 | 1.02 | 758 | 1.25 | 808 | 1.49 | 858 | 1.72 | 907 | 1.95 | 955 | 2.18 | 1003 | 2.4 | 1049 | 2.62 | 1095 | 2.82 |
| 3200 | 667 | 0.94 | 720 | 1.17 | 771 | 1.40 | 822 | 1.64 | 872 | 1.88 | 921 | 2.11 | 969 | 2.34 | 1016 | 2.56 | 1063 | 2.77 | 1109 | 2.97 |
| 3400 | 682 | 1.11 | 734 | 1.34 | 786 | 1.57 | 837 | 1.81 | 887 | 2.04 | 936 | 2.28 | 984 | 2.5 | 1031 | 2.73 | 1078 | 2.94 | 1124 | 3.14 |
| 3600 | 697 | 1.29 | 750 | 1.52 | 802 | 1.76 | 853 | 1.99 | 903 | 2.23 | 952 | 2.46 | 1000 | 2.69 | 1047 | 2.91 | 1094 | 3.12 | 1140 | 3.32 |
| 3800 | 714 | 1.50 | 767 | 1.73 | 819 | 1.96 | 870 | 2.20 | 920 | 2.43 | 969 | 2.67 | 1017 | 2.90 | 1064 | 3.12 | 1111 | 3.33 | 1157 | 3.53 |
| 4000 | 733 | 1.73 | 786 | 1.96 | 837 | 2.19 | 888 | 2.43 | 938 | 2.66 | 987 | 2.90 | 1035 | 3.12 | 1083 | 3.34 | 1129 | 3.56 | 1174 | 3.76 |
| 4200 | 753 | 1.98 | 806 | 2.21 | 857 | 2.44 | 908 | 2.68 | 958 | 2.91 | 1007 | 3.15 | 1055 | 3.37 | 1102 | 3.6 | 1149 | 3.81 | -- | -- |
| 4400 | 774 | 2.25 | 827 | 2.48 | 879 | 2.72 | 930 | 2.95 | 979 | 3.19 | 1028 | 3.42 | 1076 | 3.65 | 1124 | 3.87 | 1170 | 4.08 | -- | -- |
| 4600 | 797 | 2.55 | 850 | 2.78 | 902 | 3.02 | 952 | 3.25 | 1002 | 3.49 | 1051 | 3.72 | 1099 | 3.95 | 1147 | 4.17 | -- | -- | -- | -- |
| 4800 | 822 | 2.88 | 874 | 3.11 | 926 | 3.34 | 977 | 3.58 | 1027 | 3.81 | 1076 | 4.05 | 1124 | 4.27 | 1171 | 4.50 | -- | -- | -- | -- |
| 5000 | 848 | 3.23 | 901 | 3.46 | 952 | 3.69 | 1003 | 3.93 | 1053 | 4.16 | 1102 | 4.4 | 1150 | 4.62 | -- | -- | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| | -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 127: ZL14 (12.5 ton) side duct

| CFM | ¹ Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|--|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3750 | 684 | 1.33 | 741 | 1.56 | 792 | 1.81 | 840 | 2.07 | 884 | 2.33 | 927 | 2.60 | 971 | 2.85 | 1017 | 3.09 | 1066 | 3.30 | 1121 | 3.49 |
| 3800 | 688 | 1.38 | 745 | 1.61 | 797 | 1.85 | 844 | 2.12 | 888 | 2.38 | 932 | 2.65 | 976 | 2.90 | 1021 | 3.14 | 1071 | 3.35 | 1125 | 3.54 |
| 4000 | 706 | 1.58 | 763 | 1.81 | 814 | 2.06 | 861 | 2.32 | 906 | 2.59 | 949 | 2.85 | 993 | 3.11 | 1039 | 3.35 | 1088 | 3.56 | 1142 | 3.74 |
| 4200 | 724 | 1.81 | 781 | 2.04 | 832 | 2.29 | 879 | 2.55 | 924 | 2.82 | 967 | 3.08 | 1011 | 3.34 | 1057 | 3.57 | 1106 | 3.79 | 1160 | 3.97 |
| 4400 | 742 | 2.06 | 799 | 2.29 | 850 | 2.54 | 897 | 2.80 | 942 | 3.06 | 985 | 3.33 | 1029 | 3.58 | 1075 | 3.82 | 1124 | 4.03 | 1178 | 4.22 |
| 4600 | 760 | 2.32 | 817 | 2.55 | 869 | 2.80 | 916 | 3.06 | 960 | 3.33 | 1004 | 3.59 | 1048 | 3.85 | 1093 | 4.08 | 1143 | 4.30 | -- | -- |
| 4800 | 779 | 2.60 | 836 | 2.83 | 888 | 3.08 | 935 | 3.34 | 979 | 3.61 | 1023 | 3.88 | 1067 | 4.13 | 1112 | 4.37 | 1162 | 4.58 | -- | -- |
| 5000 | 799 | 2.91 | 856 | 3.14 | 907 | 3.39 | 954 | 3.65 | 999 | 3.91 | 1042 | 4.18 | 1086 | 4.43 | 1132 | 4.67 | -- | -- | -- | -- |
| 5200 | 819 | 3.23 | 876 | 3.46 | 927 | 3.71 | 974 | 3.97 | 1019 | 4.23 | 1062 | 4.50 | 1106 | 4.75 | 1152 | 4.99 | -- | -- | -- | -- |
| 5400 | 839 | 3.57 | 896 | 3.80 | 953 | 4.04 | 995 | 4.31 | 1039 | 4.57 | 1083 | 4.84 | 1127 | 5.09 | -- | -- | -- | -- | -- | -- |
| 5600 | 860 | 3.92 | 917 | 4.15 | 969 | 4.40 | 1016 | 4.66 | 1060 | 4.93 | 1104 | 5.19 | -- | -- | -- | -- | -- | -- | -- | -- |
| 5800 | 882 | 4.30 | 939 | 4.53 | 990 | 4.77 | 1037 | 5.04 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 6000 | 904 | 4.69 | 961 | 4.92 | 1012 | 5.17 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | |
| | -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

ZL08 to 14 bottom duct application (belt drive)

Table 128: ZL08 (7.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|------|---|------|-----|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2250 | 556 | 0.45 | 621 | 0.65 | 683 | 0.83 | 742 | 1.00 | 798 | 1.18 | 852 | 1.34 | 904 | 1.51 | 954 | 1.69 | 1003 | 1.87 | 1050 | 2.06 |
| 2400 | 567 | 0.53 | 632 | 0.73 | 694 | 0.91 | 753 | 1.09 | 809 | 1.26 | 863 | 1.43 | 914 | 1.60 | 964 | 1.77 | 1013 | 1.95 | 1060 | 2.14 |
| 2600 | 580 | 0.65 | 646 | 0.85 | 707 | 1.03 | 766 | 1.21 | 823 | 1.38 | 876 | 1.55 | 928 | 1.72 | 978 | 1.89 | 1027 | 2.07 | 1074 | 2.27 |
| 2800 | 595 | 0.79 | 660 | 0.99 | 722 | 1.17 | 780 | 1.35 | 837 | 1.52 | 890 | 1.69 | 942 | 1.86 | 992 | 2.03 | 1041 | 2.21 | 1088 | 2.40 |
| 3000 | 609 | 0.94 | 674 | 1.14 | 736 | 1.32 | 795 | 1.50 | 851 | 1.67 | 905 | 1.83 | 957 | 2.00 | 1007 | 2.18 | 1056 | 2.36 | 1100 | 2.55 |
| 3200 | 625 | 1.10 | 690 | 1.30 | 752 | 1.48 | 810 | 1.66 | 867 | 1.83 | 921 | 2.00 | 972 | 2.17 | 1022 | 2.34 | 1071 | 2.52 | -- | -- |
| 3400 | 641 | 1.28 | 706 | 1.47 | 768 | 1.66 | 827 | 1.83 | 883 | 2.00 | 937 | 2.17 | 989 | 2.34 | 1039 | 2.52 | 1087 | 2.70 | -- | -- |
| 3600 | 658 | 1.47 | 723 | 1.66 | 785 | 1.85 | 844 | 2.02 | 900 | 2.19 | 954 | 2.36 | 1006 | 2.53 | 1056 | 2.70 | 1100 | 2.89 | -- | -- |
| 3750 | 672 | 1.61 | 737 | 1.81 | 799 | 1.99 | 858 | 2.17 | 914 | 2.34 | 968 | 2.51 | 1019 | 2.68 | 1069 | 2.85 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 129: ZL09 (8.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|-------------|--|------|-----|------|-----|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2550 | 577 | 0.62 | 642 | 0.82 | 704 | 1.00 | 763 | 1.18 | 819 | 1.35 | 873 | 1.52 | 925 | 1.69 | 975 | 1.86 | 1023 | 2.04 | 1071 | 2.23 |
| 2600 | 580 | 0.65 | 646 | 0.85 | 707 | 1.03 | 766 | 1.21 | 823 | 1.38 | 876 | 1.55 | 928 | 1.72 | 978 | 1.89 | 1027 | 2.07 | 1074 | 2.27 |
| 2800 | 595 | 0.79 | 660 | 0.99 | 722 | 1.17 | 780 | 1.35 | 837 | 1.52 | 890 | 1.69 | 942 | 1.86 | 992 | 2.03 | 1041 | 2.21 | 1088 | 2.40 |
| 3000 | 609 | 0.94 | 674 | 1.14 | 736 | 1.32 | 795 | 1.50 | 851 | 1.67 | 905 | 1.83 | 957 | 2.00 | 1007 | 2.18 | 1056 | 2.36 | 1103 | 2.55 |
| 3200 | 625 | 1.10 | 690 | 1.30 | 752 | 1.48 | 810 | 1.66 | 867 | 1.83 | 921 | 2.00 | 972 | 2.17 | 1022 | 2.34 | 1071 | 2.52 | -- | -- |
| 3400 | 641 | 1.28 | 706 | 1.47 | 768 | 1.66 | 827 | 1.83 | 883 | 2.00 | 937 | 2.17 | 989 | 2.34 | 1039 | 2.52 | 1087 | 2.70 | -- | -- |
| 3600 | 658 | 1.47 | 723 | 1.66 | 785 | 1.85 | 844 | 2.02 | 900 | 2.19 | 954 | 2.36 | 1006 | 2.53 | 1056 | 2.7 | 1104 | 2.89 | -- | -- |
| 3800 | 676 | 1.67 | 742 | 1.86 | 803 | 2.04 | 862 | 2.22 | 918 | 2.39 | 972 | 2.56 | 1024 | 2.73 | 1074 | 2.90 | -- | -- | -- | -- |
| 4000 | 696 | 1.88 | 761 | 2.07 | 823 | 2.26 | 882 | 2.43 | 938 | 2.6 | 992 | 2.77 | 1043 | 2.94 | 1093 | 3.12 | -- | -- | -- | -- |
| 4200 | 716 | 2.1 | 781 | 2.29 | 843 | 2.48 | 902 | 2.65 | 958 | 2.82 | 1012 | 2.99 | 1064 | 3.16 | 1114 | 3.34 | -- | -- | -- | -- |
| 4250 | 721 | 2.16 | 786 | 2.35 | 848 | 2.53 | 907 | 2.71 | 963 | 2.88 | 1017 | 3.05 | 1069 | 3.22 | 1119 | 3.39 | -- | -- | -- | -- |
| | Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | |
| | Medium static option with motor rated at 2.9-hp | | | | | | | | | | | | | | | | | | | |
| | High static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| Bold | Field-supplied BK95 x 1 fixed pulley (p/n 9381) with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | |
| -- | Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | |

¹ Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 130: ZL12 (10 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|-----|------|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 2600 | 626 | 0.5 | 679 | 0.73 | 731 | 0.97 | 782 | 1.20 | 831 | 1.44 | 880 | 1.67 | 928 | 1.9 | 976 | 2.12 | 1022 | 2.33 | 1068 | 2.53 |
| 2800 | 639 | 0.64 | 692 | 0.87 | 744 | 1.11 | 795 | 1.34 | 845 | 1.58 | 894 | 1.81 | 942 | 2.04 | 989 | 2.26 | 1036 | 2.47 | 1082 | 2.67 |
| 3000 | 653 | 0.79 | 706 | 1.02 | 758 | 1.25 | 808 | 1.49 | 858 | 1.72 | 907 | 1.95 | 955 | 2.18 | 1003 | 2.40 | 1049 | 2.62 | 1095 | 2.82 |
| 3200 | 667 | 0.94 | 720 | 1.17 | 771 | 1.40 | 822 | 1.64 | 872 | 1.88 | 921 | 2.11 | 969 | 2.34 | 1016 | 2.56 | 1063 | 2.77 | 1109 | 2.97 |
| 3400 | 682 | 1.11 | 734 | 1.34 | 786 | 1.57 | 837 | 1.81 | 887 | 2.04 | 936 | 2.28 | 984 | 2.50 | 1031 | 2.73 | 1078 | 2.94 | 1124 | 3.14 |
| 3600 | 697 | 1.29 | 750 | 1.52 | 802 | 1.76 | 853 | 1.99 | 903 | 2.23 | 952 | 2.46 | 1000 | 2.69 | 1047 | 2.91 | 1094 | 3.12 | 1140 | 3.32 |
| 3800 | 714 | 1.5 | 767 | 1.73 | 819 | 1.96 | 870 | 2.20 | 920 | 2.43 | 969 | 2.67 | 1017 | 2.90 | 1064 | 3.12 | 1111 | 3.33 | 1157 | 3.53 |
| 4000 | 733 | 1.73 | 786 | 1.96 | 837 | 2.19 | 888 | 2.43 | 938 | 2.66 | 987 | 2.90 | 1035 | 3.12 | 1083 | 3.34 | 1129 | 3.56 | 1175 | 3.76 |
| 4200 | 753 | 1.98 | 806 | 2.21 | 857 | 2.44 | 908 | 2.68 | 958 | 2.91 | 1007 | 3.15 | 1055 | 3.37 | 1102 | 3.6 | 1149 | 3.81 | 1195 | 4.01 |
| 4400 | 774 | 2.25 | 827 | 2.48 | 879 | 2.72 | 930 | 2.95 | 979 | 3.19 | 1028 | 3.42 | 1076 | 3.65 | 1124 | 3.87 | 1170 | 4.08 | 1216 | 4.28 |
| 4600 | 797 | 2.55 | 850 | 2.78 | 902 | 3.02 | 952 | 3.25 | 1002 | 3.49 | 1051 | 3.72 | 1099 | 3.95 | 1147 | 4.17 | 1193 | 4.38 | 1239 | 4.58 |
| 4800 | 822 | 2.88 | 874 | 3.11 | 926 | 3.34 | 977 | 3.58 | 1027 | 3.81 | 1076 | 4.05 | 1124 | 4.27 | 1171 | 4.5 | 1218 | 4.71 | -- | -- |
| 5000 | 848 | 3.23 | 901 | 3.46 | 952 | 3.69 | 1003 | 3.93 | 1053 | 4.16 | 1102 | 4.40 | 1150 | 4.62 | 1197 | 4.84 | 1242 | 5.06 | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

Table 131: ZL14 (12.5 ton) bottom duct

| CFM | Available external static pressure - IWG ¹ | | | | | | | | | | | | | | | | | | | |
|---|---|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|
| | 0.2 | | 0.4 | | 0.6 | | 0.8 | | 1.0 | | 1.2 | | 1.4 | | 1.6 | | 1.8 | | 2.0 | |
| | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP | RPM | BHP |
| 3750 | 715 | 1.46 | 762 | 1.68 | 810 | 1.91 | 858 | 2.13 | 907 | 2.36 | 957 | 2.58 | 1008 | 2.80 | 1060 | 3.02 | 1113 | 3.24 | 1167 | 3.46 |
| 3800 | 720 | 1.51 | 766 | 1.73 | 814 | 1.96 | 862 | 2.18 | 911 | 2.41 | 961 | 2.63 | 1012 | 2.85 | 1064 | 3.07 | 1117 | 3.29 | 1171 | 3.51 |
| 4000 | 737 | 1.72 | 784 | 1.94 | 832 | 2.17 | 880 | 2.39 | 929 | 2.62 | 979 | 2.84 | 1030 | 3.07 | 1082 | 3.29 | 1135 | 3.51 | -- | -- |
| 4200 | 756 | 1.95 | 803 | 2.17 | 851 | 2.40 | 899 | 2.63 | 948 | 2.85 | 998 | 3.07 | 1049 | 3.30 | 1101 | 3.52 | 1154 | 3.74 | -- | -- |
| 4400 | 777 | 2.20 | 824 | 2.42 | 871 | 2.65 | 920 | 2.87 | 969 | 3.10 | 1019 | 3.32 | 1069 | 3.55 | 1121 | 3.77 | 1174 | 3.98 | -- | -- |
| 4600 | 799 | 2.47 | 846 | 2.69 | 893 | 2.92 | 941 | 3.14 | 990 | 3.37 | 1040 | 3.59 | 1091 | 3.81 | 1143 | 4.04 | -- | -- | -- | -- |
| 4800 | 822 | 2.75 | 869 | 2.98 | 916 | 3.20 | 965 | 3.43 | 1014 | 3.65 | 1064 | 3.88 | 1114 | 4.10 | 1166 | 4.32 | -- | -- | -- | -- |
| 5000 | 846 | 3.06 | 893 | 3.28 | 941 | 3.51 | 989 | 3.73 | 1038 | 3.96 | 1088 | 4.18 | 1139 | 4.41 | -- | -- | -- | -- | -- | -- |
| 5200 | 872 | 3.39 | 919 | 3.61 | 966 | 3.83 | 1015 | 4.06 | 1064 | 4.28 | 1114 | 4.51 | 1164 | 4.73 | -- | -- | -- | -- | -- | -- |
| 5400 | 899 | 3.73 | 946 | 3.95 | 993 | 4.18 | 1042 | 4.40 | 1091 | 4.63 | 1141 | 4.85 | -- | -- | -- | -- | -- | -- | -- | -- |
| 5600 | 927 | 4.09 | 974 | 4.32 | 1021 | 4.54 | 1070 | 4.77 | 1119 | 4.99 | 1169 | 5.22 | -- | -- | -- | -- | -- | -- | -- | -- |
| 5800 | 956 | 4.47 | 1003 | 4.70 | 1051 | 4.92 | 1099 | 5.15 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| 6000 | 987 | 4.87 | 1034 | 5.10 | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- | -- |
| Standard static option with motor rated at 2.4-hp | | | | | | | | | | | | | | | | | | | | |
| Medium static option with motor rated at 3.7-hp | | | | | | | | | | | | | | | | | | | | |
| High static option with motor rated at 5.25-hp | | | | | | | | | | | | | | | | | | | | |
| -- Exceeds recommended blower speed | | | | | | | | | | | | | | | | | | | | |

1 Blower performance includes gas heat exchangers and 2 in. filters. See static resistance table for additional applications. **Note:** See RPM selection table to determine required motor sheave setting and to determine the maximum continuous BHP. kW = 0.929 x BHP

ZQ04 to 06 side duct application (direct drive)

Table 132: ZQ04 to 06 side duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZQ04 (3) | 1 (Low) | 1147 | 152 | 659 | 988 | 181 | 787 | 901 | 203 | 891 | 800 | 226 | 987 | 682 | 247 | 1071 |
| | 2 (Med/Low) | 1214 | 175 | 683 | 1094 | 206 | 810 | 965 | 232 | 896 | 898 | 258 | 1003 | 794 | 276 | 1084 |
| | 3 (Med) | 1402 | 234 | 735 | 1324 | 264 | 835 | 1161 | 302 | 947 | 1074 | 329 | 1034 | 986 | 351 | 1114 |
| | 4 (Med/Hi) | 1570 | 310 | 791 | 1512 | 348 | 884 | 1429 | 381 | 977 | 1253 | 420 | 1079 | 1130 | 423 | 1148 |
| | 5 (Hi) | 1825 | 448 | 866 | 1769 | 487 | 946 | 1705 | 521 | 1023 | 1610 | 559 | 1107 | 1229 | 472 | 1159 |
| ZQ05 (4) | 1 (Low) | 1412 | 261 | 793 | 1322 | 290 | 884 | 1244 | 321 | 966 | 1109 | 347 | 1059 | 1035 | 369 | 1131 |
| | 2 (Med/Low) | 1521 | 313 | 831 | 1461 | 349 | 920 | 1382 | 374 | 989 | 1283 | 400 | 1072 | 1166 | 426 | 1150 |
| | 3 (Med) | 1636 | 376 | 874 | 1574 | 413 | 959 | 1487 | 441 | 1034 | 1413 | 465 | 1099 | 1184 | 446 | 1164 |
| | 4 (Med/Hi) | 1813 | 484 | 937 | 1747 | 522 | 1013 | 1668 | 552 | 1088 | 1581 | 565 | 1141 | 1212 | 458 | 1170 |
| | 5 (Hi) | 2351 | 920 | 1111 | 2129 | 819 | 1138 | 1912 | 718 | 1153 | 1678 | 622 | 1164 | 1378 | 513 | 1176 |
| ZQ06 (5) | 1 (Low) | 1692 | 345 | 727 | 1583 | 374 | 797 | 1482 | 403 | 866 | 1380 | 437 | 939 | 1262 | 462 | 1000 |
| | 2 (Med/Low) | 1849 | 438 | 779 | 1755 | 468 | 843 | 1667 | 495 | 902 | 1552 | 530 | 971 | 1439 | 558 | 1033 |
| | 3 (Med) | 1989 | 532 | 818 | 1904 | 564 | 877 | 1828 | 598 | 935 | 1738 | 628 | 994 | 1633 | 664 | 1058 |
| | 4 (Med/Hi) | 2159 | 673 | 876 | 2087 | 713 | 931 | 2010 | 729 | 985 | 1933 | 778 | 1035 | 1859 | 812 | 1091 |
| | 5 (Hi) | 2349 | 852 | 928 | 2270 | 887 | 978 | 2195 | 922 | 1028 | 2118 | 947 | 1075 | 1973 | 914 | 1109 |

Table 133: ZQ04 to 06 side duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZQ04 (3) | 1 (Low) | 1094 | 165 | 715 | 956 | 187 | 828 | 851 | 213 | 932 | 752 | 237 | 1026 | 638 | 253 | 1100 |
| | 2 (Med/Low) | 1180 | 189 | 735 | 1064 | 216 | 842 | 940 | 242 | 945 | 849 | 263 | 1029 | 748 | 286 | 1116 |
| | 3 (Med) | 1353 | 251 | 790 | 1271 | 280 | 883 | 1138 | 310 | 979 | 1036 | 338 | 1068 | 958 | 362 | 1144 |
| | 4 (Med/Hi) | 1517 | 340 | 863 | 1450 | 374 | 940 | 1364 | 398 | 1021 | 1232 | 434 | 1114 | 1022 | 393 | 1163 |
| | 5 (Hi) | 1763 | 490 | 953 | 1690 | 520 | 1020 | 1619 | 549 | 1086 | 1442 | 525 | 1140 | 1070 | 413 | 1168 |
| ZQ05 (4) | 1 (Low) | 1356 | 285 | 870 | 1280 | 308 | 939 | 1185 | 332 | 1019 | 1074 | 364 | 1113 | 850 | 343 | 1179 |
| | 2 (Med/Low) | 1459 | 349 | 920 | 1390 | 371 | 985 | 1306 | 393 | 1050 | 1195 | 421 | 1133 | 862 | 350 | 1182 |
| | 3 (Med) | 1553 | 412 | 973 | 1475 | 442 | 1039 | 1415 | 462 | 1092 | 1289 | 469 | 1155 | 880 | 357 | 1182 |
| | 4 (Med/Hi) | 1718 | 530 | 1040 | 1645 | 562 | 1102 | 1534 | 555 | 1147 | 1377 | 510 | 1165 | 961 | 390 | 1183 |
| | 5 (Hi) | 1955 | 737 | 1146 | 1780 | 665 | 1156 | 1587 | 599 | 1168 | 1407 | 529 | 1175 | 902 | 366 | 1186 |
| ZQ06 (5) | 1 (Low) | 1570 | 372 | 791 | 1463 | 399 | 855 | 1358 | 425 | 918 | 1260 | 456 | 983 | 1161 | 481 | 1044 |
| | 2 (Med/Low) | 1740 | 468 | 845 | 1638 | 496 | 903 | 1543 | 529 | 965 | 1454 | 553 | 1015 | 1360 | 578 | 1070 |
| | 3 (Med) | 1882 | 569 | 889 | 1786 | 601 | 947 | 1687 | 629 | 1002 | 1587 | 660 | 1053 | 1487 | 680 | 1105 |
| | 4 (Med/Hi) | 2052 | 732 | 955 | 1967 | 749 | 999 | 1883 | 778 | 1049 | 1788 | 808 | 1099 | 1621 | 778 | 1130 |
| | 5 (Hi) | 2227 | 905 | 1004 | 2138 | 937 | 1051 | 2038 | 947 | 1091 | 1869 | 887 | 1118 | 1662 | 811 | 1137 |

ZQ04 to 06 bottom duct application (direct drive)

Table 134: ZQ04 to 06 bottom duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZQ04 (3) | 1 (Low) | 1086 | 165 | 721 | 929 | 192 | 837 | 861 | 211 | 927 | 769 | 235 | 1023 | 636 | 253 | 1108 |
| | 2 (Med/Low) | 1171 | 192 | 745 | 1035 | 221 | 856 | 946 | 241 | 944 | 868 | 267 | 1037 | 771 | 290 | 1119 |
| | 3 (Med) | 1328 | 257 | 806 | 1255 | 280 | 890 | 1106 | 316 | 993 | 1038 | 336 | 1068 | 944 | 354 | 1148 |
| | 4 (Med/Hi) | 1509 | 340 | 867 | 1449 | 376 | 953 | 1309 | 407 | 1046 | 1210 | 436 | 1121 | 1002 | 387 | 1162 |
| | 5 (Hi) | 1740 | 490 | 959 | 1683 | 522 | 1033 | 1618 | 555 | 1101 | 1315 | 500 | 1149 | 1037 | 404 | 1168 |
| ZQ05 (4) | 1 (Low) | 1330 | 284 | 863 | 1261 | 302 | 929 | 1172 | 329 | 1006 | 1053 | 353 | 1088 | 970 | 376 | 1162 |
| | 2 (Med/Low) | 1458 | 349 | 917 | 1385 | 372 | 981 | 1307 | 395 | 1047 | 1174 | 421 | 1129 | 1023 | 398 | 1170 |
| | 3 (Med) | 1553 | 414 | 965 | 1477 | 440 | 1033 | 1427 | 461 | 1086 | 1334 | 480 | 1148 | 1017 | 400 | 1175 |
| | 4 (Med/Hi) | 1714 | 532 | 1041 | 1638 | 563 | 1107 | 1555 | 563 | 1143 | 1374 | 503 | 1161 | 1033 | 406 | 1176 |
| | 5 (Hi) | 1935 | 740 | 1150 | 1768 | 667 | 1160 | 1610 | 610 | 1167 | 1421 | 536 | 1175 | 1061 | 421 | 1183 |
| ZQ06 (5) | 1 (Low) | 1600 | 355 | 759 | 1518 | 390 | 831 | 1437 | 418 | 897 | 1324 | 445 | 961 | 1224 | 469 | 1020 |
| | 2 (Med/Low) | 1760 | 449 | 811 | 1676 | 486 | 879 | 1587 | 514 | 938 | 1497 | 547 | 999 | 1414 | 574 | 1057 |
| | 3 (Med) | 1898 | 554 | 859 | 1809 | 587 | 921 | 1735 | 619 | 977 | 1641 | 647 | 1035 | 1549 | 675 | 1088 |
| | 4 (Med/Hi) | 2072 | 708 | 923 | 1991 | 741 | 977 | 1917 | 775 | 1029 | 1836 | 802 | 1079 | 1702 | 794 | 1122 |
| | 5 (Hi) | 2228 | 884 | 980 | 2151 | 919 | 1031 | 2072 | 944 | 1077 | 1945 | 914 | 1109 | 1731 | 822 | 1131 |

Table 135: ZQ04 to 06 bottom duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZQ04 (3) | 1 (Low) | 1047 | 167 | 733 | 903 | 195 | 854 | 808 | 220 | 956 | 693 | 238 | 1042 | 567 | 254 | 1115 |
| | 2 (Med/Low) | 1122 | 197 | 769 | 995 | 225 | 876 | 899 | 252 | 979 | 804 | 276 | 1065 | 682 | 294 | 1143 |
| | 3 (Med) | 1275 | 262 | 829 | 1197 | 291 | 916 | 1058 | 324 | 1025 | 963 | 350 | 1108 | 792 | 334 | 1165 |
| | 4 (Med/Hi) | 1461 | 353 | 895 | 1391 | 381 | 972 | 1279 | 415 | 1064 | 1123 | 432 | 1146 | 854 | 355 | 1169 |
| | 5 (Hi) | 1674 | 506 | 993 | 1620 | 538 | 1061 | 1533 | 555 | 1123 | 1179 | 463 | 1161 | 885 | 369 | 1176 |
| ZQ05 (4) | 1 (Low) | 1301 | 300 | 911 | 1211 | 324 | 986 | 1112 | 349 | 1062 | 1007 | 371 | 1144 | 738 | 318 | 1184 |
| | 2 (Med/Low) | 1408 | 366 | 970 | 1331 | 390 | 1041 | 1232 | 416 | 1117 | 1061 | 401 | 1169 | 693 | 306 | 1184 |
| | 3 (Med) | 1496 | 436 | 1019 | 1425 | 459 | 1079 | 1331 | 482 | 1146 | 1083 | 415 | 1171 | 717 | 316 | 1184 |
| | 4 (Med/Hi) | 1641 | 553 | 1091 | 1566 | 566 | 1138 | 1392 | 520 | 1160 | 1104 | 429 | 1176 | 738 | 321 | 1185 |
| | 5 (Hi) | 1779 | 680 | 1160 | 1630 | 621 | 1167 | 1428 | 547 | 1174 | 1144 | 447 | 1184 | 761 | 332 | 1191 |
| ZQ06 (5) | 1 (Low) | 1572 | 373 | 802 | 1466 | 402 | 868 | 1378 | 434 | 935 | 1264 | 461 | 999 | 1183 | 484 | 1055 |
| | 2 (Med/Low) | 1718 | 475 | 859 | 1632 | 508 | 920 | 1531 | 535 | 980 | 1438 | 562 | 1036 | 1344 | 592 | 1094 |
| | 3 (Med) | 1868 | 578 | 908 | 1777 | 606 | 961 | 1687 | 639 | 1019 | 1591 | 666 | 1074 | 1474 | 678 | 1122 |
| | 4 (Med/Hi) | 2019 | 740 | 976 | 1944 | 770 | 1023 | 1859 | 797 | 1070 | 1743 | 796 | 1114 | 1528 | 728 | 1139 |
| | 5 (Hi) | 2182 | 927 | 1035 | 2089 | 949 | 1080 | 1961 | 918 | 1109 | 1808 | 854 | 1128 | 1552 | 737 | 1144 |

ZY04 to 06 side duct application (direct drive)

Table 136: ZY04 to 06 side duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|-----|------|-------|-----|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZY04 (3) | 1 (Low) | 987 | 120 | 651 | 813 | 145 | 774 | 698 | 162 | 864 | 541 | 180 | 959 | 383 | 201 | 1047 |
| | 2 (Med/Low) | 1079 | 144 | 677 | 936 | 171 | 795 | 793 | 190 | 886 | 692 | 214 | 975 | 521 | 232 | 1063 |
| | 3 (Med) | 1153 | 166 | 701 | 1037 | 195 | 812 | 875 | 221 | 913 | 786 | 239 | 986 | 654 | 263 | 1076 |
| | 4 (Med/Hi) | 1191 | 178 | 712 | 1086 | 206 | 815 | 927 | 233 | 916 | 837 | 257 | 998 | 711 | 278 | 1083 |
| | 5 (Hi) | 1326 | 229 | 757 | 1235 | 261 | 856 | 1124 | 291 | 951 | 973 | 319 | 1035 | 896 | 336 | 1099 |
| ZY05 (4) | 1 (Low) | 1302 | 207 | 727 | 1188 | 240 | 841 | 1037 | 266 | 933 | 941 | 296 | 1022 | 882 | 318 | 1098 |
| | 2 (Med/Low) | 1421 | 247 | 757 | 1323 | 282 | 861 | 1209 | 315 | 958 | 1064 | 346 | 1043 | 993 | 368 | 1116 |
| | 3 (Med) | 1538 | 297 | 795 | 1453 | 332 | 888 | 1343 | 367 | 982 | 1216 | 396 | 1058 | 1093 | 427 | 1146 |
| | 4 (Med/Hi) | 1571 | 315 | 809 | 1496 | 352 | 898 | 1385 | 389 | 996 | 1288 | 420 | 1072 | 1135 | 444 | 1147 |
| | 5 (Hi) | 1779 | 432 | 878 | 1707 | 470 | 960 | 1615 | 511 | 1042 | 1516 | 544 | 1123 | 1165 | 468 | 1160 |
| ZY06 (5) | 1 (Low) | 1588 | 298 | 695 | 1517 | 330 | 761 | 1409 | 358 | 835 | 1273 | 393 | 913 | 1167 | 418 | 973 |
| | 2 (Med/Low) | 1624 | 321 | 713 | 1557 | 352 | 777 | 1464 | 383 | 845 | 1315 | 418 | 924 | 1224 | 446 | 983 |
| | 3 (Med) | 1942 | 504 | 792 | 1881 | 536 | 852 | 1800 | 565 | 908 | 1714 | 605 | 969 | 1611 | 644 | 1038 |
| | 4 (Med/Hi) | 2146 | 631 | 840 | 2064 | 692 | 908 | 2001 | 713 | 954 | 1932 | 757 | 1007 | 1843 | 794 | 1065 |
| | 5 (Hi) | 2316 | 812 | 892 | 2240 | 861 | 954 | 2181 | 894 | 1000 | 2113 | 938 | 1045 | 2003 | 946 | 1093 |

Table 137: ZY04 to 06 side duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZY04 (3) | 1 (Low) | 978 | 125 | 684 | 853 | 149 | 797 | 734 | 172 | 906 | 596 | 190 | 998 | 445 | 203 | 1068 |
| | 2 (Med/Low) | 1078 | 153 | 721 | 962 | 175 | 817 | 846 | 200 | 922 | 726 | 226 | 1026 | 599 | 241 | 1098 |
| | 3 (Med) | 1153 | 178 | 748 | 1045 | 199 | 837 | 934 | 226 | 937 | 831 | 251 | 1031 | 709 | 272 | 1114 |
| | 4 (Med/Hi) | 1315 | 248 | 819 | 1239 | 272 | 895 | 1138 | 300 | 980 | 1037 | 323 | 1062 | 922 | 343 | 1144 |
| | 5 (Hi) | 1728 | 484 | 959 | 1649 | 515 | 1027 | 1579 | 544 | 1089 | 1425 | 524 | 1138 | 1001 | 405 | 1168 |
| ZY05 (4) | 1 (Low) | 1299 | 223 | 786 | 1226 | 249 | 871 | 1137 | 273 | 956 | 1031 | 303 | 1051 | 923 | 329 | 1143 |
| | 2 (Med/Low) | 1413 | 272 | 832 | 1349 | 299 | 906 | 1266 | 325 | 982 | 1160 | 352 | 1070 | 1042 | 370 | 1155 |
| | 3 (Med) | 1514 | 327 | 878 | 1456 | 353 | 942 | 1389 | 381 | 1014 | 1298 | 408 | 1089 | 1133 | 405 | 1165 |
| | 4 (Med/Hi) | 1751 | 472 | 972 | 1698 | 502 | 1033 | 1639 | 534 | 1088 | 1543 | 536 | 1142 | 1156 | 420 | 1172 |
| | 5 (Hi) | 2093 | 768 | 1116 | 1944 | 717 | 1137 | 1764 | 651 | 1152 | 1506 | 552 | 1163 | 1146 | 441 | 1177 |
| ZY06 (5) | 1 (Low) | 1528 | 328 | 781 | 1427 | 356 | 850 | 1346 | 386 | 912 | 1256 | 410 | 969 | 1181 | 434 | 1022 |
| | 2 (Med/Low) | 1575 | 362 | 803 | 1488 | 391 | 871 | 1401 | 419 | 929 | 1319 | 445 | 985 | 1247 | 469 | 1037 |
| | 3 (Med) | 1867 | 572 | 902 | 1795 | 601 | 963 | 1709 | 628 | 1015 | 1633 | 652 | 1061 | 1544 | 671 | 1110 |
| | 4 (Med/Hi) | 2049 | 718 | 968 | 1969 | 768 | 1026 | 1902 | 788 | 1070 | 1808 | 802 | 1110 | 1637 | 744 | 1132 |
| | 5 (Hi) | 2218 | 899 | 1021 | 2138 | 928 | 1074 | 2007 | 907 | 1105 | 1846 | 842 | 1123 | 1671 | 767 | 1139 |

ZY04 to 06 bottom duct application (direct drive)

Table 138: ZY04 to 06 bottom duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|-----|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZY04 (3) | 1 (Low) | 929 | 128 | 699 | 782 | 148 | 794 | 663 | 164 | 880 | 514 | 187 | 976 | 377 | 202 | 1053 |
| | 2 (Med/Low) | 1036 | 157 | 732 | 870 | 177 | 827 | 803 | 198 | 905 | 649 | 217 | 996 | 508 | 236 | 1074 |
| | 3 (Med) | 1106 | 181 | 760 | 956 | 204 | 849 | 878 | 225 | 928 | 755 | 245 | 1010 | 616 | 266 | 1092 |
| | 4 (Med/Hi) | 1147 | 197 | 776 | 1042 | 218 | 860 | 916 | 243 | 944 | 820 | 262 | 1017 | 671 | 286 | 1103 |
| | 5 (Hi) | 1272 | 252 | 830 | 1177 | 277 | 909 | 1037 | 304 | 986 | 975 | 323 | 1053 | 872 | 347 | 1125 |
| ZY05 (4) | 1 (Low) | 1256 | 220 | 776 | 1170 | 242 | 851 | 1077 | 266 | 931 | 988 | 298 | 1025 | 872 | 321 | 1113 |
| | 2 (Med/Low) | 1350 | 272 | 828 | 1279 | 292 | 893 | 1196 | 320 | 966 | 1105 | 347 | 1048 | 1003 | 372 | 1131 |
| | 3 (Med) | 1449 | 323 | 866 | 1380 | 350 | 937 | 1303 | 370 | 996 | 1223 | 402 | 1071 | 1133 | 428 | 1149 |
| | 4 (Med/Hi) | 1488 | 345 | 882 | 1418 | 374 | 954 | 1357 | 394 | 1006 | 1264 | 424 | 1083 | 1160 | 442 | 1155 |
| | 5 (Hi) | 1677 | 471 | 966 | 1602 | 507 | 1034 | 1543 | 525 | 1083 | 1475 | 545 | 1131 | 1209 | 465 | 1162 |
| ZY06 (5) | 1 (Low) | 1548 | 310 | 720 | 1441 | 336 | 792 | 1337 | 370 | 864 | 1213 | 397 | 928 | 1097 | 421 | 988 |
| | 2 (Med/Low) | 1593 | 337 | 738 | 1488 | 363 | 805 | 1381 | 394 | 875 | 1271 | 425 | 937 | 1150 | 451 | 997 |
| | 3 (Med) | 1880 | 532 | 827 | 1792 | 563 | 890 | 1719 | 588 | 944 | 1632 | 629 | 1006 | 1527 | 652 | 1061 |
| | 4 (Med/Hi) | 2066 | 689 | 895 | 1999 | 712 | 942 | 1907 | 761 | 999 | 1830 | 773 | 1048 | 1734 | 809 | 1100 |
| | 5 (Hi) | 2237 | 862 | 949 | 2163 | 882 | 996 | 2097 | 929 | 1036 | 1998 | 946 | 1085 | 1815 | 883 | 1115 |

Table 139: ZY04 to 06 bottom duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZY04 (3) | 1 (Low) | 969 | 130 | 703 | 839 | 151 | 810 | 717 | 174 | 916 | 569 | 191 | 1006 | 444 | 204 | 1069 |
| | 2 (Med/Low) | 1063 | 158 | 741 | 955 | 180 | 834 | 828 | 204 | 938 | 709 | 227 | 1030 | 583 | 242 | 1100 |
| | 3 (Med) | 1135 | 182 | 769 | 1041 | 208 | 858 | 919 | 229 | 952 | 805 | 254 | 1045 | 681 | 275 | 1127 |
| | 4 (Med/Hi) | 1310 | 256 | 842 | 1225 | 279 | 917 | 1123 | 307 | 1001 | 1029 | 334 | 1083 | 863 | 335 | 1155 |
| | 5 (Hi) | 1680 | 501 | 997 | 1622 | 526 | 1056 | 1538 | 546 | 1119 | 1296 | 485 | 1153 | 939 | 374 | 1176 |
| ZY05 (4) | 1 (Low) | 1277 | 228 | 801 | 1196 | 251 | 878 | 1096 | 278 | 967 | 983 | 305 | 1062 | 873 | 329 | 1156 |
| | 2 (Med/Low) | 1382 | 278 | 847 | 1307 | 302 | 916 | 1217 | 327 | 994 | 1108 | 355 | 1083 | 949 | 359 | 1164 |
| | 3 (Med) | 1486 | 331 | 888 | 1417 | 359 | 957 | 1331 | 385 | 1028 | 1237 | 410 | 1103 | 1023 | 385 | 1169 |
| | 4 (Med/Hi) | 1717 | 473 | 991 | 1653 | 509 | 1052 | 1586 | 538 | 1107 | 1443 | 521 | 1150 | 1052 | 394 | 1175 |
| | 5 (Hi) | 2006 | 738 | 1132 | 1854 | 682 | 1147 | 1704 | 621 | 1154 | 1504 | 552 | 1168 | 1073 | 418 | 1177 |
| ZY06 (5) | 1 (Low) | 1488 | 335 | 787 | 1400 | 363 | 851 | 1320 | 389 | 910 | 1242 | 416 | 969 | 1160 | 440 | 1027 |
| | 2 (Med/Low) | 1536 | 364 | 803 | 1453 | 392 | 864 | 1363 | 419 | 924 | 1293 | 447 | 981 | 1212 | 471 | 1037 |
| | 3 (Med) | 1822 | 586 | 914 | 1752 | 602 | 966 | 1666 | 632 | 1017 | 1586 | 656 | 1066 | 1503 | 676 | 1113 |
| | 4 (Med/Hi) | 1999 | 726 | 982 | 1932 | 761 | 1030 | 1860 | 809 | 1076 | 1753 | 799 | 1114 | 1598 | 749 | 1134 |
| | 5 (Hi) | 2170 | 932 | 1040 | 2091 | 930 | 1084 | 1965 | 910 | 1109 | 1798 | 843 | 1127 | 1618 | 763 | 1139 |

ZL04 to ZL06 side duct application (direct drive)

Table 140: ZL04 to ZL06 side duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|-----|------|-------|-----|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZL04 (3) | 1 (Low) | 894 | 104 | 646 | 707 | 127 | 777 | 578 | 137 | 855 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1079 | 144 | 677 | 936 | 171 | 795 | 793 | 190 | 886 | 692 | 214 | 975 | 521 | 232 | 1063 |
| | 3 (Med) | 1153 | 166 | 701 | 1037 | 195 | 812 | 875 | 221 | 913 | 786 | 239 | 986 | 654 | 263 | 1076 |
| | 4 (Med/Hi) | 1303 | 224 | 769 | 1211 | 258 | 876 | 1097 | 286 | 972 | 924 | 313 | 1059 | 839 | 326 | 1117 |
| | 5 (Hi) | 1326 | 229 | 757 | 1235 | 261 | 856 | 1124 | 291 | 951 | 973 | 319 | 1035 | 896 | 336 | 1099 |
| ZL05 (4) | 1 (Low) | 1063 | 130 | 651 | 900 | 158 | 783 | 698 | 183 | 900 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1421 | 247 | 757 | 1323 | 282 | 861 | 1209 | 315 | 958 | 1064 | 346 | 1043 | 993 | 368 | 1116 |
| | 3 (Med) | 1571 | 315 | 809 | 1496 | 352 | 898 | 1385 | 389 | 996 | 1288 | 420 | 1072 | 1135 | 444 | 1147 |
| | 4 (Med/Hi) | 1669 | 376 | 869 | 1552 | 416 | 974 | 1438 | 446 | 1055 | 1358 | 472 | 1113 | 1045 | 432 | 1160 |
| | 5 (Hi) | 1779 | 432 | 878 | 1707 | 470 | 960 | 1615 | 511 | 1042 | 1516 | 544 | 1123 | 1165 | 468 | 1160 |
| ZL06 (5) | 1 (Low) | 1220 | 120 | 544 | 1117 | 150 | 634 | 974 | 172 | 728 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1624 | 321 | 713 | 1557 | 352 | 777 | 1464 | 383 | 845 | 1315 | 418 | 924 | 1224 | 446 | 983 |
| | 3 (Med) | 1875 | 404 | 729 | 1800 | 443 | 792 | 1709 | 476 | 863 | 1608 | 525 | 941 | 1500 | 572 | 1017 |
| | 4 (Med/Hi) | 2146 | 631 | 840 | 2064 | 692 | 908 | 2001 | 713 | 954 | 1932 | 757 | 1007 | 1843 | 794 | 1065 |
| | 5 (Hi) | 2316 | 812 | 892 | 2240 | 861 | 954 | 2181 | 894 | 1000 | 2113 | 938 | 1045 | 2003 | 946 | 1093 |

Table 141: ZL04 to ZL06 side duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZL04 (3) | 1 (Low) | 885 | 109 | 679 | 747 | 131 | 800 | 614 | 147 | 897 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1078 | 153 | 721 | 962 | 175 | 817 | 846 | 200 | 922 | 726 | 226 | 1026 | 599 | 241 | 1098 |
| | 3 (Med) | 1153 | 178 | 748 | 1045 | 199 | 837 | 934 | 226 | 937 | 831 | 251 | 1031 | 709 | 272 | 1114 |
| | 4 (Med/Hi) | 1292 | 243 | 831 | 1215 | 269 | 915 | 1111 | 295 | 1001 | 988 | 317 | 1086 | 865 | 333 | 1162 |
| | 5 (Hi) | 1728 | 484 | 959 | 1649 | 515 | 1027 | 1579 | 544 | 1089 | 1425 | 524 | 1138 | 1001 | 405 | 1168 |
| ZL05 (4) | 1 (Low) | 1060 | 146 | 710 | 938 | 167 | 813 | 798 | 190 | 923 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1413 | 272 | 832 | 1349 | 299 | 906 | 1266 | 325 | 982 | 1160 | 352 | 1070 | 1042 | 370 | 1155 |
| | 3 (Med) | 1612 | 388 | 938 | 1512 | 417 | 1018 | 1442 | 438 | 1073 | 1368 | 460 | 1130 | 1043 | 393 | 1178 |
| | 4 (Med/Hi) | 1751 | 472 | 972 | 1698 | 502 | 1033 | 1639 | 534 | 1088 | 1543 | 536 | 1142 | 1156 | 420 | 1172 |
| | 5 (Hi) | 2093 | 768 | 1116 | 1944 | 717 | 1137 | 1764 | 651 | 1152 | 1506 | 552 | 1163 | 1146 | 441 | 1177 |
| ZL06 (5) | 1 (Low) | 1207 | 184 | 652 | 1088 | 211 | 744 | 966 | 233 | 822 | 847 | 254 | 891 | 722 | 271 | 948 |
| | 2 (Med/Low) | 1575 | 362 | 803 | 1488 | 391 | 871 | 1401 | 419 | 929 | 1319 | 445 | 985 | 1247 | 469 | 1037 |
| | 3 (Med) | 1800 | 472 | 839 | 1714 | 508 | 903 | 1618 | 539 | 970 | 1527 | 572 | 1033 | 1433 | 599 | 1089 |
| | 4 (Med/Hi) | 2049 | 718 | 968 | 1969 | 768 | 1026 | 1902 | 788 | 1070 | 1808 | 802 | 1110 | 1637 | 744 | 1132 |
| | 5 (Hi) | 2218 | 899 | 1021 | 2138 | 928 | 1074 | 2007 | 907 | 1105 | 1846 | 842 | 1123 | 1671 | 767 | 1139 |

ZL04 to ZL06 bottom duct application (direct drive)

Table 142: ZL04 to ZL06 bottom duct (cooling)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|-----|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZL04 (3) | 1 (Low) | 836 | 112 | 694 | 676 | 130 | 797 | 543 | 139 | 871 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1036 | 157 | 732 | 870 | 177 | 827 | 803 | 198 | 905 | 649 | 217 | 996 | 508 | 236 | 1074 |
| | 3 (Med) | 1106 | 181 | 760 | 956 | 204 | 849 | 878 | 225 | 928 | 755 | 245 | 1010 | 616 | 266 | 1092 |
| | 4 (Med/Hi) | 1249 | 247 | 842 | 1153 | 274 | 929 | 1010 | 299 | 1007 | 926 | 317 | 1077 | 815 | 337 | 1143 |
| | 5 (Hi) | 1272 | 252 | 830 | 1177 | 277 | 909 | 1037 | 304 | 986 | 975 | 323 | 1053 | 872 | 347 | 1125 |
| ZL05 (4) | 1 (Low) | 1017 | 143 | 700 | 882 | 160 | 793 | 738 | 183 | 898 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1350 | 272 | 828 | 1279 | 292 | 893 | 1196 | 320 | 966 | 1105 | 347 | 1048 | 1003 | 372 | 1131 |
| | 3 (Med) | 1586 | 406 | 942 | 1474 | 438 | 1030 | 1410 | 451 | 1065 | 1334 | 476 | 1124 | 1070 | 430 | 1168 |
| | 4 (Med/Hi) | 1488 | 345 | 882 | 1418 | 374 | 954 | 1357 | 394 | 1006 | 1264 | 424 | 1083 | 1160 | 442 | 1155 |
| | 5 (Hi) | 1677 | 471 | 966 | 1602 | 507 | 1034 | 1543 | 525 | 1083 | 1475 | 545 | 1131 | 1209 | 465 | 1162 |
| ZL06 (5) | 1 (Low) | 1180 | 132 | 569 | 1041 | 156 | 665 | 902 | 184 | 757 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1593 | 337 | 738 | 1488 | 363 | 805 | 1381 | 394 | 875 | 1271 | 425 | 937 | 1150 | 451 | 997 |
| | 3 (Med) | 1813 | 432 | 764 | 1711 | 470 | 830 | 1628 | 499 | 899 | 1526 | 549 | 978 | 1416 | 580 | 1040 |
| | 4 (Med/Hi) | 2066 | 689 | 895 | 1999 | 712 | 942 | 1907 | 761 | 999 | 1830 | 773 | 1048 | 1734 | 809 | 1100 |
| | 5 (Hi) | 2237 | 862 | 949 | 2163 | 882 | 996 | 2097 | 929 | 1036 | 1998 | 946 | 1085 | 1815 | 883 | 1115 |

Table 143: ZL04 to ZL06 bottom duct (gas heat)

| Unit (ton) | Motor speed | Available external static | | | | | | | | | | | | | | |
|------------|-------------|---------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|-------|------|
| | | 0.2 | | | 0.4 | | | 0.6 | | | 0.8 | | | 1.0 | | |
| | | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM | CFM | WATTS | RPM |
| ZL04 (3) | 1 (Low) | 876 | 114 | 698 | 733 | 133 | 813 | 597 | 149 | 907 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1063 | 158 | 741 | 955 | 180 | 834 | 828 | 204 | 938 | 709 | 227 | 1030 | 583 | 242 | 1100 |
| | 3 (Med) | 1135 | 182 | 769 | 1041 | 208 | 858 | 919 | 229 | 952 | 805 | 254 | 1045 | 681 | 275 | 1127 |
| | 4 (Med/Hi) | 1287 | 251 | 854 | 1201 | 276 | 937 | 1096 | 302 | 1022 | 980 | 328 | 1107 | 806 | 325 | 1173 |
| | 5 (Hi) | 1680 | 501 | 997 | 1622 | 526 | 1056 | 1538 | 546 | 1119 | 1296 | 485 | 1153 | 939 | 374 | 1176 |
| ZL05 (4) | 1 (Low) | 1038 | 151 | 725 | 908 | 169 | 820 | 757 | 195 | 934 | - | - | - | - | - | - |
| | 2 (Med/Low) | 1382 | 278 | 847 | 1307 | 302 | 916 | 1217 | 327 | 994 | 1108 | 355 | 1083 | 949 | 359 | 1164 |
| | 3 (Med) | 1584 | 392 | 948 | 1473 | 423 | 1033 | 1384 | 442 | 1087 | 1307 | 462 | 1144 | 933 | 373 | 1182 |
| | 4 (Med/Hi) | 1717 | 473 | 991 | 1653 | 509 | 1052 | 1586 | 538 | 1107 | 1443 | 521 | 1150 | 1052 | 394 | 1175 |
| | 5 (Hi) | 2006 | 738 | 1132 | 1854 | 682 | 1147 | 1704 | 621 | 1154 | 1504 | 552 | 1168 | 1073 | 418 | 1177 |
| ZL06 (5) | 1 (Low) | 1167 | 191 | 658 | 1061 | 218 | 745 | 940 | 236 | 820 | 833 | 260 | 891 | 701 | 277 | 953 |
| | 2 (Med/Low) | 1536 | 364 | 803 | 1453 | 392 | 864 | 1363 | 419 | 924 | 1293 | 447 | 981 | 1212 | 471 | 1037 |
| | 3 (Med) | 1755 | 486 | 851 | 1671 | 509 | 906 | 1575 | 543 | 972 | 1480 | 576 | 1038 | 1392 | 604 | 1092 |
| | 4 (Med/Hi) | 1999 | 726 | 982 | 1932 | 761 | 1030 | 1860 | 809 | 1076 | 1753 | 799 | 1114 | 1598 | 749 | 1134 |
| | 5 (Hi) | 2170 | 932 | 1040 | 2091 | 930 | 1084 | 1965 | 910 | 1109 | 1798 | 843 | 1127 | 1618 | 763 | 1139 |

Power exhaust blower curves

Figure 3: 208/280-1-60 power exhaust fan curve

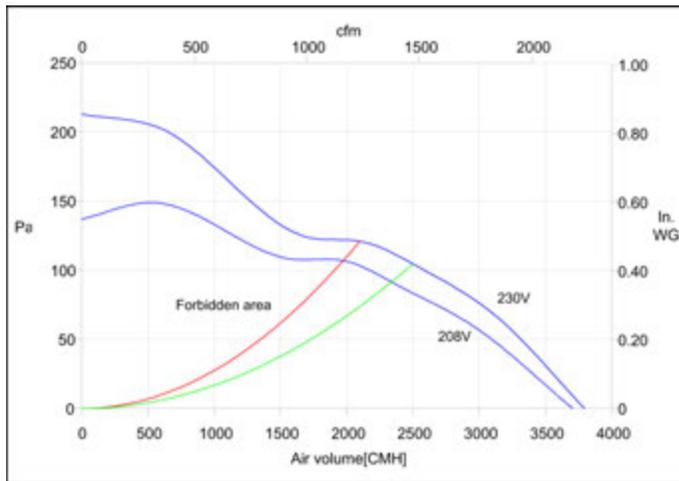


Figure 4: 460-3-60 power exhaust fan curve

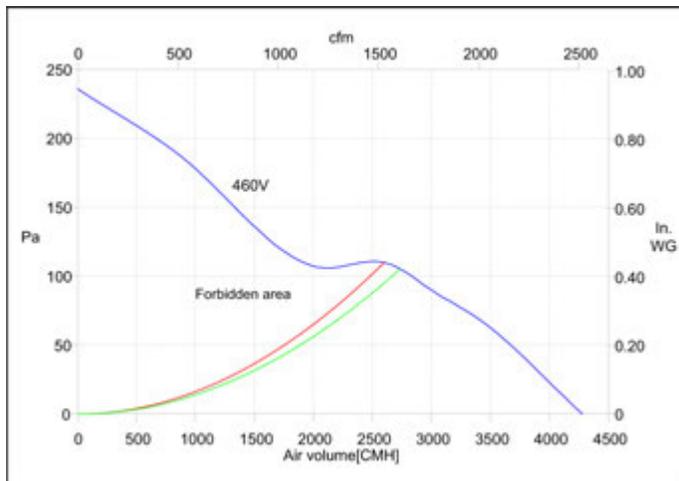


Figure 5: 208/280-3-60 power exhaust fan curve


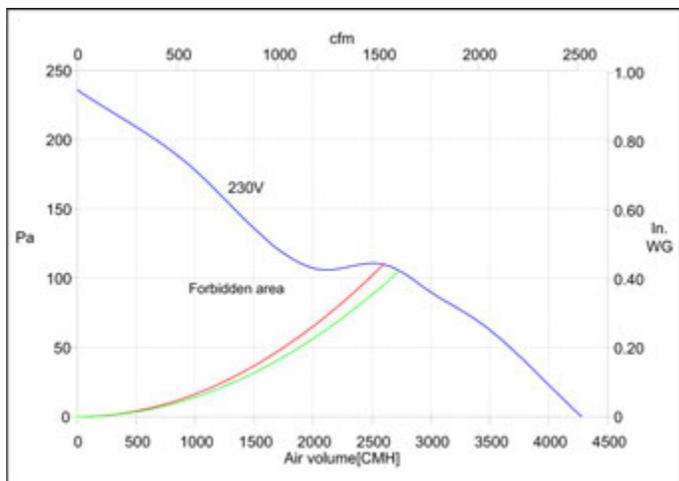


Figure 6: 575-3-50 power exhaust fan curve

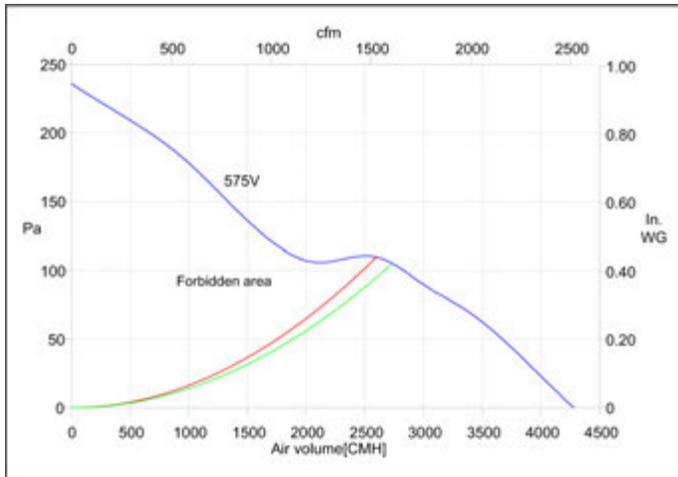

Electrical data

ZQ04 to 06 standard static indoor blower - without powered convenience outlet

Table 144: ZQ04 to 06 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 6.6 | 1.5 | - | None | - | - | - | 27.3 | 30 | 40 | 27 | 89 | 28.8 | 30 | 40 | 29 | 93 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 37.8 | 40 | 40 | 35 | 89 | 39.6 | 40 | 40 | 36 | 93 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 55.8 | 60 | 60 | 51 | 89 | 57.6 | 60 | 60 | 53 | 93 | | |
| | 230-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 6 | 1.3 | - | None | - | - | - | 26.7 | 30 | 40 | 26 | 89 | 28 | 30 | 40 | 28 | 92 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 41.4 | 45 | 45 | 38 | 89 | 43 | 45 | 45 | 40 | 92 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 62.3 | 70 | 70 | 57 | 89 | 63.9 | 70 | 70 | 59 | 92 | | |
| | 208-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 6.6 | 1.1 | - | None | - | - | - | 21 | 25 | 30 | 21 | 78 | 22.1 | 25 | 30 | 22 | 81 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 25.3 | 30 | 30 | 23 | 78 | 26.6 | 30 | 30 | 24 | 81 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 35.6 | 40 | 40 | 33 | 78 | 37 | 40 | 40 | 34 | 81 | | |
| | 230-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 6 | 1 | - | None | - | - | - | 20.4 | 25 | 30 | 20 | 78 | 21.4 | 25 | 30 | 22 | 81 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 27 | 30 | 30 | 25 | 78 | 28.3 | 30 | 30 | 26 | 81 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 39.1 | 40 | 40 | 36 | 78 | 40.4 | 45 | 45 | 37 | 81 | | |
| | 460-3-60 | 5.8 | 38 | 9 | - | - | - | 0.8 | 3.2 | 0.5 | - | None | - | - | - | 11.3 | 15 | 15 | 11 | 42 | 11.8 | 15 | 15 | 12 | 43 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 13 | 15 | 15 | 12 | 42 | 13.6 | 15 | 15 | 13 | 43 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.3 | 25 | 25 | 20 | 42 | 21.9 | 25 | 25 | 20 | 43 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | - | - | - | 0.6 | 6 | 0.4 | - | None | - | - | - | 7.8 | 15 | 15 | 8 | 39 | 8.2 | 15 | 15 | 8 | 40 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.1 | 15 | 15 | 13 | 39 | 14.6 | 15 | 15 | 13 | 40 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.6 | 20 | 20 | 18 | 39 | 20.1 | 25 | 25 | 19 | 40 | | |
| 05 (4) | 208-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 8.4 | 1.5 | - | None | - | - | - | 34.3 | 35 | 50 | 34 | 135 | 35.8 | 40 | 50 | 36 | 139 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 40 | 40 | 50 | 37 | 135 | 41.9 | 45 | 50 | 39 | 139 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 58 | 60 | 60 | 53 | 135 | 59.9 | 60 | 60 | 55 | 139 | | |
| | 230-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7.6 | 1.3 | - | None | - | - | - | 33.5 | 35 | 50 | 33 | 135 | 34.8 | 35 | 50 | 34 | 138 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 43.4 | 45 | 50 | 40 | 135 | 45 | 45 | 50 | 41 | 138 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 64.3 | 70 | 70 | 59 | 135 | 65.9 | 70 | 70 | 61 | 138 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 8.4 | 1.1 | - | None | - | - | - | 26.9 | 30 | 40 | 27 | 88 | 28 | 30 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 27.5 | 30 | 40 | 27 | 88 | 28.9 | 30 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 37.9 | 40 | 40 | 35 | 88 | 39.3 | 40 | 40 | 36 | 91 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 7.6 | 1 | - | None | - | - | - | 26.1 | 30 | 35 | 26 | 88 | 27.1 | 30 | 40 | 27 | 91 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 29 | 30 | 35 | 27 | 88 | 30.3 | 35 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.1 | 45 | 45 | 38 | 88 | 42.4 | 45 | 45 | 39 | 91 | | |
| | 460-3-60 | 6.2 | 41 | 10 | - | - | - | 0.8 | 4 | 0.5 | - | None | - | - | - | 12.6 | 15 | 15 | 13 | 45 | 13.1 | 15 | 15 | 13 | 46 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14 | 15 | 15 | 13 | 45 | 14.6 | 15 | 15 | 13 | 46 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.3 | 25 | 25 | 20 | 45 | 22.9 | 25 | 25 | 21 | 46 | | |
| | 575-3-60 | 4.8 | 33 | 8 | - | - | - | 0.6 | 7.6 | 0.4 | - | None | - | - | - | 9.6 | 15 | 15 | 10 | 35 | 10 | 15 | 15 | 10 | 36 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.9 | 15 | 15 | 14 | 35 | 15.4 | 20 | 20 | 14 | 36 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 20.4 | 25 | 25 | 19 | 35 | 20.9 | 25 | 25 | 19 | 36 | | |

Table 144: ZQ04 to 06 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 06 (5) | 208-1-60 | 24.4 | 144.2 | 38 | - | | | | | - | - | 2.3 | 8.4 | | | | 1.5 | - | | | | None | - |
| 10625 | 4.9 | | | | | | | 1 | 23.6 | 41.2 | 45 | | | | | 60 | 40 | 151 | | | 42.7 | 45 | 60 | 42 | 154 |
| 11125 | 7.9 | | | | | | | 1 | 38 | 58 | 60 | | | | | 60 | 53 | 151 | | | 59.9 | 60 | 60 | 55 | 154 |
| 230-1-60 | 24.4 | | 144.2 | 38 | - | - | - | 2.3 | 7.6 | 1.3 | - | None | - | - | - | 40.4 | 45 | 60 | 39 | 151 | 41.7 | 45 | 60 | 41 | 154 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 43.4 | 45 | 60 | 40 | 151 | 45 | 45 | 60 | 41 | 154 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 64.3 | 70 | 70 | 59 | 151 | 65.9 | 70 | 70 | 61 | 154 |
| 208-3-60 | 16 | | 110 | 25 | - | - | - | 2.3 | 8.4 | 1.1 | - | None | - | - | - | 30.7 | 35 | 45 | 31 | 117 | 31.8 | 35 | 45 | 32 | 119 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 30.7 | 35 | 45 | 31 | 117 | 31.8 | 35 | 45 | 32 | 119 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 37.9 | 40 | 45 | 35 | 117 | 39.3 | 40 | 45 | 36 | 119 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 52.1 | 60 | 60 | 48 | 117 | 53.5 | 60 | 60 | 49 | 119 |
| 230-3-60 | 16 | | 110 | 25 | - | - | - | 2.3 | 7.6 | 1 | - | None | - | - | - | 29.9 | 30 | 45 | 30 | 117 | 30.9 | 35 | 45 | 31 | 119 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 29.9 | 30 | 45 | 30 | 117 | 30.9 | 35 | 45 | 31 | 119 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.1 | 45 | 45 | 38 | 117 | 42.4 | 45 | 45 | 39 | 119 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 57.6 | 60 | 60 | 53 | 117 | 58.9 | 60 | 60 | 54 | 119 |
| 460-3-60 | 7.8 | | 52 | 12 | - | - | - | 1.3 | 4 | 0.5 | - | None | - | - | - | 15.1 | 20 | 20 | 15 | 57 | 15.6 | 20 | 20 | 16 | 58 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.1 | 20 | 20 | 13 | 57 | 15.6 | 20 | 20 | 13 | 58 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.3 | 25 | 25 | 20 | 57 | 22.9 | 25 | 25 | 21 | 58 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26 | 30 | 30 | 24 | 57 | 26.6 | 30 | 30 | 24 | 58 |
| 575-3-60 | 5.7 | | 38.9 | 9 | - | - | - | 1.1 | 7.6 | 0.4 | - | None | - | - | - | 11.2 | 15 | 15 | 11 | 42 | 11.6 | 15 | 15 | 12 | 43 |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 20.4 | 25 | 25 | 19 | 42 | 20.9 | 25 | 25 | 19 | 43 |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 31.4 | 35 | 35 | 29 | 42 | 31.9 | 35 | 35 | 29 | 43 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

ZQ04 to 06 standard static indoor blower - with powered convenience outlet

Table 145: ZQ04 to 06 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse/ breaker size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|-------------------------------|------------------------------------|-----|-----------------------------------|---|-----|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | | | | |
| | | 04 (3) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 6.6 | 1.5 | 8.6 | None | - | - | - | 31.6 | 35 | 45 | 32 | 94 | 33.1 | 35 | 45 | 34 | 97 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 43.1 | 45 | 45 | 40 | 94 | 45 | 45 | 45 | 41 | 97 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 61.1 | 70 | 70 | 56 | 94 | 63 | 70 | 70 | 58 | 97 | | |
| | 230-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 6 | 1.3 | 8.6 | None | - | - | - | 31 | 35 | 45 | 31 | 94 | 32.3 | 35 | 45 | 33 | 96 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 46.8 | 50 | 50 | 43 | 94 | 48.4 | 50 | 50 | 45 | 96 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 67.6 | 70 | 70 | 62 | 94 | 69.3 | 70 | 70 | 64 | 96 | | |
| | 208-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 6.6 | 1.1 | 8.6 | None | - | - | - | 25.3 | 30 | 35 | 26 | 83 | 26.4 | 30 | 35 | 27 | 85 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 30.6 | 35 | 35 | 28 | 83 | 32 | 35 | 35 | 29 | 85 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41 | 45 | 45 | 38 | 83 | 42.4 | 45 | 45 | 39 | 85 | | |
| | 230-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 6 | 1 | 8.6 | None | - | - | - | 24.7 | 25 | 35 | 25 | 83 | 25.7 | 30 | 35 | 27 | 85 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 32.4 | 35 | 35 | 30 | 83 | 33.6 | 35 | 35 | 31 | 85 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 44.5 | 45 | 45 | 41 | 83 | 45.8 | 50 | 50 | 42 | 85 | | |
| | 460-3-60 | 5.8 | 38 | 9 | - | - | - | 0.8 | 3.2 | 0.5 | 8.6 | None | - | - | - | 13.5 | 15 | 15 | 14 | 44 | 14 | 15 | 15 | 14 | 45 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.7 | 20 | 20 | 14 | 44 | 16.3 | 20 | 20 | 15 | 45 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.9 | 25 | 25 | 22 | 44 | 24.6 | 25 | 25 | 23 | 45 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | - | - | - | 0.6 | 6 | 0.4 | 8.6 | None | - | - | - | 9.5 | 15 | 15 | 10 | 41 | 9.9 | 15 | 15 | 10 | 41 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 16.3 | 20 | 20 | 15 | 41 | 16.8 | 20 | 20 | 15 | 41 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.8 | 25 | 25 | 20 | 41 | 22.3 | 25 | 25 | 20 | 41 | | |
| 05 (4) | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 05 (4) | 208-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 8.4 | 1.5 | 8.6 | None | - | - | - | 38.6 | 40 | 50 | 39 | 140 | 40.1 | 45 | 50 | 40 | 143 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 45.4 | 50 | 50 | 42 | 140 | 47.3 | 50 | 50 | 43 | 143 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 63.4 | 70 | 70 | 58 | 140 | 65.3 | 70 | 70 | 60 | 143 | | |
| | 230-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7.6 | 1.3 | 8.6 | None | - | - | - | 37.8 | 40 | 50 | 38 | 140 | 39.1 | 40 | 50 | 39 | 143 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48.8 | 50 | 50 | 45 | 140 | 50.4 | 60 | 60 | 46 | 143 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 69.6 | 70 | 70 | 64 | 140 | 71.3 | 80 | 80 | 66 | 143 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 8.4 | 1.1 | 8.6 | None | - | - | - | 31.2 | 35 | 40 | 32 | 93 | 32.3 | 35 | 45 | 33 | 95 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 32.9 | 35 | 40 | 32 | 93 | 34.3 | 35 | 45 | 33 | 95 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.3 | 45 | 45 | 40 | 93 | 44.6 | 45 | 45 | 41 | 95 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 7.6 | 1 | 8.6 | None | - | - | - | 30.4 | 35 | 40 | 31 | 93 | 31.4 | 35 | 45 | 32 | 95 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.4 | 35 | 40 | 32 | 93 | 35.6 | 40 | 45 | 33 | 95 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.5 | 50 | 50 | 43 | 93 | 47.8 | 50 | 50 | 44 | 95 | | |
| | 460-3-60 | 6.2 | 41 | 10 | - | - | - | 0.8 | 4 | 0.5 | 8.6 | None | - | - | - | 14.8 | 15 | 20 | 15 | 47 | 15.3 | 20 | 20 | 16 | 48 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.7 | 20 | 20 | 15 | 47 | 17.3 | 20 | 20 | 16 | 48 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.9 | 25 | 25 | 23 | 47 | 25.6 | 30 | 30 | 24 | 48 | | |
| | 575-3-60 | 4.8 | 33 | 8 | - | - | - | 0.6 | 7.6 | 0.4 | 8.6 | None | - | - | - | 11.4 | 15 | 15 | 12 | 37 | 11.8 | 15 | 15 | 12 | 38 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 17.1 | 20 | 20 | 16 | 37 | 17.6 | 20 | 20 | 16 | 38 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 37 | 23.1 | 25 | 25 | 21 | 38 | | |

Table 145: ZQ04 to 06 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|------------|----------------------|--------------|-------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 06 (5) | 208-1-60 | 24.4 | 144.2 | 38 | - | - | - | 2.3 | 8.4 | 1.5 | 8.6 | None | - | - | - | 45.5 | 50 | 60 | 45 | 155 | 47 | 50 | 70 | 47 | 159 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 45.5 | 50 | 60 | 45 | 155 | 47.3 | 50 | 70 | 47 | 159 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 63.4 | 70 | 70 | 58 | 155 | 65.3 | 70 | 70 | 60 | 159 | |
| | 230-1-60 | 24.4 | 144.2 | 38 | - | - | - | 2.3 | 7.6 | 1.3 | 8.6 | None | - | - | - | 44.7 | 45 | 60 | 44 | 156 | 46 | 50 | 70 | 46 | 158 | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48.8 | 50 | 60 | 45 | 156 | 50.4 | 60 | 70 | 46 | 158 | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 69.6 | 70 | 70 | 64 | 156 | 71.3 | 80 | 80 | 66 | 158 | |
| | 208-3-60 | 16 | 110 | 25 | - | - | - | 2.3 | 8.4 | 1.1 | 8.6 | None | - | - | - | 35 | 35 | 50 | 36 | 121 | 36.1 | 40 | 50 | 37 | 124 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 35 | 35 | 50 | 36 | 121 | 36.1 | 40 | 50 | 37 | 124 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.3 | 45 | 50 | 40 | 121 | 44.6 | 45 | 50 | 41 | 124 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 57.5 | 60 | 60 | 53 | 121 | 58.9 | 60 | 60 | 54 | 124 | |
| | 230-3-60 | 16 | 110 | 25 | - | - | - | 2.3 | 7.6 | 1 | 8.6 | None | - | - | - | 34.2 | 35 | 50 | 35 | 121 | 35.2 | 40 | 50 | 36 | 124 | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.4 | 35 | 50 | 35 | 121 | 35.6 | 40 | 50 | 36 | 124 | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.5 | 50 | 50 | 43 | 121 | 47.8 | 50 | 50 | 44 | 124 | |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63 | 70 | 70 | 58 | 121 | 64.3 | 70 | 70 | 59 | 124 | |
| | 460-3-60 | 7.8 | 52 | 12 | - | - | - | 1.3 | 4 | 0.5 | 8.6 | None | - | - | - | 17.3 | 20 | 25 | 18 | 59 | 17.8 | 20 | 25 | 18 | 60 | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.3 | 20 | 25 | 15 | 59 | 17.8 | 20 | 25 | 16 | 60 | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.9 | 25 | 25 | 23 | 59 | 25.6 | 30 | 30 | 24 | 60 | |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.7 | 30 | 30 | 26 | 59 | 29.3 | 30 | 30 | 27 | 60 | |
| | 575-3-60 | 5.7 | 38.9 | 9 | - | - | - | 1.1 | 7.6 | 0.4 | 8.6 | None | - | - | - | 13 | 15 | 15 | 13 | 44 | 13.4 | 15 | 15 | 14 | 45 | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 44 | 23.1 | 25 | 25 | 21 | 45 | |
| | | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 33.6 | 35 | 35 | 31 | 44 | 34.1 | 35 | 35 | 31 | 45 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

ZQ04 to 06 medium static indoor blower - without powered convenience outlet

Table 146: ZQ04 to 06 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|------|--------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|------|------|------------|--|--|------------------------------------|-----|-----------------------------------|---|----|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | FLA | LRA | FLA | LRA | | | | FLA | LRA | | | | | | | |
| | | Model | kW | Stages | Amps | FLA | LRA | | | | | FLA | LRA | FLA | LRA | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 7.6 | 1.5 | - | None | - | - | - | 28.3 | 30 | 40 | 28 | 120 | 29.8 | 30 | 45 | 30 | 124 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 39 | 40 | 40 | 36 | 120 | 40.9 | 45 | 45 | 38 | 124 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 57 | 60 | 60 | 52 | 120 | 58.9 | 60 | 60 | 54 | 124 | | |
| | 230-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 7 | 1.3 | - | - | None | - | - | - | 27.7 | 30 | 40 | 27 | 123 | 29 | 30 | 40 | 29 | 126 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 42.6 | 45 | 45 | 39 | 123 | 44.3 | 45 | 45 | 41 | 126 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 63.5 | 70 | 70 | 58 | 123 | 65.1 | 70 | 70 | 60 | 126 | |
| | 208-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 5.2 | 1.1 | - | - | None | - | - | - | 19.6 | 20 | 30 | 20 | 99 | 20.7 | 25 | 30 | 21 | 101 | |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 23.5 | 25 | 30 | 22 | 99 | 24.9 | 25 | 30 | 23 | 101 | |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 35 | 31 | 99 | 35.3 | 40 | 40 | 32 | 101 | |
| | 230-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 5.2 | 1 | - | - | None | - | - | - | 19.6 | 20 | 30 | 20 | 101 | 20.6 | 25 | 30 | 21 | 104 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 26 | 30 | 30 | 24 | 101 | 27.3 | 30 | 30 | 25 | 104 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 38.1 | 40 | 40 | 35 | 101 | 39.4 | 40 | 40 | 36 | 104 | |
| | 460-3-60 | 5.8 | 38 | 9 | - | - | - | 0.8 | 2.6 | 0.5 | - | - | None | - | - | - | 10.7 | 15 | 15 | 11 | 52 | 11.2 | 15 | 15 | 11 | 54 | |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 12.3 | 15 | 15 | 11 | 52 | 12.9 | 15 | 15 | 12 | 54 | |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 52 | 21.1 | 25 | 25 | 19 | 54 | |
| | 575-3-60 | 3.8 | 36.5 | 6 | - | - | - | 0.6 | 2 | 0.4 | - | - | None | - | - | - | 7.4 | 15 | 15 | 7 | 48 | 7.8 | 15 | 15 | 8 | 49 | |
| | | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 13.6 | 15 | 15 | 13 | 48 | 14.1 | 15 | 15 | 13 | 49 | |
| | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.1 | 20 | 20 | 18 | 48 | 19.6 | 20 | 20 | 18 | 49 | |
| 05 (4) | 208-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7.6 | 1.5 | - | None | - | - | - | 33.5 | 35 | 50 | 33 | 166 | 35 | 35 | 50 | 35 | 170 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 39 | 40 | 50 | 36 | 166 | 40.9 | 45 | 50 | 38 | 170 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 57 | 60 | 60 | 52 | 166 | 58.9 | 60 | 60 | 54 | 170 | | |
| | 230-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7 | 1.3 | - | - | None | - | - | - | 32.9 | 35 | 50 | 32 | 169 | 34.2 | 35 | 50 | 34 | 172 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 42.6 | 45 | 50 | 39 | 169 | 44.3 | 45 | 50 | 41 | 172 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 63.5 | 70 | 70 | 58 | 169 | 65.1 | 70 | 70 | 60 | 172 | |
| | 208-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 5.2 | 1.1 | - | - | None | - | - | - | 23.7 | 25 | 35 | 23 | 109 | 24.8 | 25 | 35 | 25 | 111 | |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 23.7 | 25 | 35 | 23 | 109 | 24.9 | 25 | 35 | 25 | 111 | |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 35 | 31 | 109 | 35.3 | 40 | 40 | 32 | 111 | |
| | 230-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 5.2 | 1 | - | - | None | - | - | - | 23.7 | 25 | 35 | 23 | 111 | 24.7 | 25 | 35 | 24 | 114 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 26 | 30 | 35 | 24 | 111 | 27.3 | 30 | 35 | 25 | 114 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 38.1 | 40 | 40 | 35 | 111 | 39.4 | 40 | 40 | 36 | 114 | |
| | 460-3-60 | 6.2 | 41 | 10 | - | - | - | 0.8 | 2.6 | 0.5 | - | - | None | - | - | - | 11.2 | 15 | 15 | 11 | 55 | 11.7 | 15 | 15 | 12 | 57 | |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 12.3 | 15 | 15 | 11 | 55 | 12.9 | 15 | 15 | 12 | 57 | |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 55 | 21.1 | 25 | 25 | 19 | 57 | |
| | 575-3-60 | 4.8 | 33 | 8 | - | - | - | 0.6 | 2 | 0.4 | - | - | None | - | - | - | 8.6 | 15 | 15 | 9 | 45 | 9 | 15 | 15 | 9 | 45 | |
| | | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 13.6 | 15 | 15 | 13 | 45 | 14.1 | 15 | 15 | 13 | 45 | |
| | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.1 | 20 | 20 | 18 | 45 | 19.6 | 20 | 20 | 18 | 45 | |

Table 146: ZQ04 to 06 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 06 (5) | 208-1-60 | 24.4 | 144.2 | 38 | - | | | | | - | - | 2.3 | 7.6 | | | | 1.5 | - | | | | None | - |
| 10625 | 4.9 | | | | | | | 1 | 23.6 | 40.4 | 45 | | | | | 60 | 39 | 182 | | | 41.9 | 45 | 60 | 41 | 185 |
| 11125 | 7.9 | | | | | | | 1 | 38 | 57 | 60 | | | | | 60 | 52 | 182 | | | 58.9 | 60 | 60 | 54 | 185 |
| 230-1-60 | 24.4 | | 144.2 | 38 | - | - | - | 2.3 | 7 | 1.3 | - | None | - | - | - | 39.8 | 40 | 60 | 39 | 185 | 41.1 | 45 | 60 | 40 | 188 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 42.6 | 45 | 60 | 39 | 185 | 44.3 | 45 | 60 | 41 | 188 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 63.5 | 70 | 70 | 58 | 185 | 65.1 | 70 | 70 | 60 | 188 |
| 208-3-60 | 16 | | 110 | 25 | - | - | - | 2.3 | 5.2 | 1.1 | - | None | - | - | - | 27.5 | 30 | 40 | 27 | 137 | 28.6 | 30 | 40 | 28 | 140 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 27.5 | 30 | 40 | 27 | 137 | 28.6 | 30 | 40 | 28 | 140 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 40 | 31 | 137 | 35.3 | 40 | 40 | 32 | 140 |
| 230-3-60 | 16 | | 110 | 25 | - | - | - | 2.3 | 5.2 | 1 | - | 11625 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 137 | 49.5 | 50 | 50 | 46 | 140 |
| | | | | | | | | | | | | None | - | - | - | 27.5 | 30 | 40 | 27 | 140 | 28.5 | 30 | 40 | 28 | 142 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 27.5 | 30 | 40 | 27 | 140 | 28.5 | 30 | 40 | 28 | 142 |
| 460-3-60 | 7.8 | | 52 | 12 | - | - | - | 1.3 | 2.6 | 0.5 | - | 11625 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 140 | 55.9 | 60 | 60 | 51 | 142 |
| | | | | | | | | | | | | None | - | - | - | 13.7 | 15 | 20 | 13 | 67 | 14.2 | 15 | 20 | 14 | 69 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 13.7 | 15 | 20 | 11 | 67 | 14.2 | 15 | 20 | 12 | 69 |
| 575-3-60 | 5.7 | | 38.9 | 9 | - | - | - | 1.1 | 2 | 0.4 | - | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 67 | 21.1 | 25 | 25 | 19 | 69 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 24.3 | 25 | 25 | 22 | 67 | 24.9 | 25 | 25 | 23 | 69 |
| | | | | | | | | | | | | None | - | - | - | 10.2 | 15 | 15 | 10 | 51 | 10.6 | 15 | 15 | 11 | 52 |
| 11458 | 13.8 | | 1 | 13.3 | 19.1 | 20 | 20 | 18 | 51 | 19.6 | 20 | 18 | 52 | 20 | 18 | 52 | 20 | 18 | 52 | 20 | 18 | 52 | 20 | 18 | 52 |
| | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

ZQ04 to 06 medium static indoor blower - with powered convenience outlet

Table 147: ZQ04 to 06 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | 1MCA ¹ (amps) | 2-3 Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | 4Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|--------------------------|--|--|-------------------------------------|-----|-----------------------------------|---|-----|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 7.6 | 1.5 | 8.6 | None | - | - | - | 32.6 | 35 | 45 | 33 | 125 | 34.1 | 35 | 45 | 35 | 128 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 44.4 | 45 | 45 | 41 | 125 | 46.3 | 50 | 50 | 43 | 128 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 62.4 | 70 | 70 | 57 | 125 | 64.3 | 70 | 70 | 59 | 128 | | |
| | 230-1-60 | 15.4 | 83.9 | 24 | - | - | - | 1.4 | 7 | 1.3 | 8.6 | None | - | - | - | 32 | 35 | 45 | 32 | 127 | 33.3 | 35 | 45 | 34 | 130 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48 | 50 | 50 | 44 | 127 | 49.6 | 50 | 50 | 46 | 130 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 68.9 | 70 | 70 | 63 | 127 | 70.5 | 80 | 80 | 65 | 130 | | |
| | 208-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 103 | 25 | 25 | 35 | 26 | 106 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.9 | 30 | 30 | 27 | 103 | 30.3 | 35 | 35 | 28 | 106 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 40 | 36 | 103 | 40.6 | 45 | 45 | 37 | 106 | | |
| | 230-3-60 | 10.4 | 73 | 16 | - | - | - | 1.4 | 5.2 | 1 | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 106 | 24.9 | 25 | 35 | 26 | 108 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.4 | 35 | 35 | 29 | 106 | 32.6 | 35 | 35 | 30 | 108 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 106 | 44.8 | 45 | 45 | 41 | 108 | | |
| | 460-3-60 | 5.8 | 38 | 9 | - | - | - | 0.8 | 2.6 | 0.5 | 8.6 | None | - | - | - | 12.9 | 15 | 15 | 13 | 55 | 13.4 | 15 | 15 | 14 | 56 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.9 | 15 | 15 | 14 | 55 | 15.6 | 20 | 20 | 14 | 56 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 55 | 23.8 | 25 | 25 | 22 | 56 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | - | - | - | 0.6 | 2 | 0.4 | 8.6 | None | - | - | - | 9.1 | 15 | 15 | 9 | 50 | 9.5 | 15 | 15 | 10 | 51 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 15.8 | 20 | 20 | 15 | 50 | 16.3 | 20 | 20 | 15 | 51 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 50 | 21.8 | 25 | 25 | 20 | 51 | | |
| 05 (4) | 208-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7.6 | 1.5 | 8.6 | None | - | - | - | 37.8 | 40 | 50 | 38 | 171 | 39.3 | 40 | 50 | 40 | 174 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 44.4 | 45 | 50 | 41 | 171 | 46.3 | 50 | 50 | 43 | 174 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 62.4 | 70 | 70 | 57 | 171 | 64.3 | 70 | 70 | 59 | 174 | | |
| | 230-1-60 | 19.6 | 130 | 31 | - | - | - | 1.4 | 7 | 1.3 | 8.6 | None | - | - | - | 37.2 | 40 | 50 | 37 | 173 | 38.5 | 40 | 50 | 39 | 176 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48 | 50 | 50 | 44 | 173 | 49.6 | 50 | 50 | 46 | 176 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 68.9 | 70 | 70 | 63 | 173 | 70.5 | 80 | 80 | 65 | 176 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 28 | 30 | 40 | 28 | 113 | 29.1 | 30 | 40 | 30 | 116 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.9 | 30 | 40 | 28 | 113 | 30.3 | 35 | 40 | 30 | 116 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 40 | 36 | 113 | 40.6 | 45 | 45 | 37 | 116 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | - | - | - | 1.4 | 5.2 | 1 | 8.6 | None | - | - | - | 28 | 30 | 40 | 28 | 116 | 29 | 30 | 40 | 29 | 118 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.4 | 35 | 40 | 29 | 116 | 32.6 | 35 | 40 | 30 | 118 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 116 | 44.8 | 45 | 45 | 41 | 118 | | |
| | 460-3-60 | 6.2 | 41 | 10 | - | - | - | 0.8 | 2.6 | 0.5 | 8.6 | None | - | - | - | 13.4 | 15 | 15 | 14 | 58 | 13.9 | 15 | 15 | 14 | 59 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.9 | 15 | 15 | 14 | 58 | 15.6 | 20 | 20 | 14 | 59 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 58 | 23.8 | 25 | 25 | 22 | 59 | | |
| | 575-3-60 | 4.8 | 33 | 8 | - | - | - | 0.6 | 2 | 0.4 | 8.6 | None | - | - | - | 10.3 | 15 | 15 | 10 | 46 | 10.7 | 15 | 15 | 11 | 47 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 15.8 | 20 | 20 | 15 | 46 | 16.3 | 20 | 20 | 15 | 47 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 46 | 21.8 | 25 | 25 | 20 | 47 | | |

Table 147: ZQ04 to 06 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | ¹ MCA ¹ (amps) | 2. ³ Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | ⁴ Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | Max fuse ² /breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|-------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|--------------------------------------|---|---|---|-----|-----------------------------------|--|--|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| 06 (5) | 208-1-60 | 24.4 | 144.2 | 38 | - | - | - | 2.3 | 7.6 | 1.5 | 8.6 | None | - | - | - | 44.7 | 45 | 60 | 44 | 186 | 46.2 | 50 | 70 | 46 | 190 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 44.7 | 45 | 60 | 44 | 186 | 46.3 | 50 | 70 | 46 | 190 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 62.4 | 70 | 70 | 57 | 186 | 64.3 | 70 | 70 | 59 | 190 |
| | 230-1-60 | 24.4 | 144.2 | 38 | - | - | - | 2.3 | 7 | 1.3 | 8.6 | None | - | - | - | 44.1 | 45 | 60 | 44 | 189 | 45.4 | 50 | 60 | 45 | 192 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48 | 50 | 60 | 44 | 189 | 49.6 | 50 | 60 | 46 | 192 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 68.9 | 70 | 70 | 63 | 189 | 70.5 | 80 | 80 | 65 | 192 |
| | 208-3-60 | 16 | 110 | 25 | - | - | - | 2.3 | 5.2 | 1.1 | 8.6 | None | - | - | - | 31.8 | 35 | 45 | 32 | 142 | 32.9 | 35 | 45 | 33 | 144 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 31.8 | 35 | 45 | 32 | 142 | 32.9 | 35 | 45 | 33 | 144 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 45 | 36 | 142 | 40.6 | 45 | 45 | 37 | 144 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 142 | 54.9 | 60 | 60 | 50 | 144 |
| | 230-3-60 | 16 | 110 | 25 | - | - | - | 2.3 | 5.2 | 1 | 8.6 | None | - | - | - | 31.8 | 35 | 45 | 32 | 144 | 32.8 | 35 | 45 | 33 | 147 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.8 | 35 | 45 | 32 | 144 | 32.8 | 35 | 45 | 33 | 147 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 144 | 44.8 | 45 | 45 | 41 | 147 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 144 | 61.3 | 70 | 70 | 56 | 147 |
| | 460-3-60 | 7.8 | 52 | 12 | - | - | - | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 15.9 | 20 | 20 | 16 | 70 | 16.4 | 20 | 20 | 17 | 71 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.9 | 20 | 20 | 14 | 70 | 16.4 | 20 | 20 | 14 | 71 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 70 | 23.8 | 25 | 25 | 22 | 71 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26.9 | 30 | 30 | 25 | 70 | 27.6 | 30 | 30 | 25 | 71 |
| | 575-3-60 | 5.7 | 38.9 | 9 | - | - | - | 1.1 | 2 | 0.4 | 8.6 | None | - | - | - | 11.9 | 15 | 15 | 12 | 53 | 12.3 | 15 | 15 | 13 | 54 |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 53 | 21.8 | 25 | 25 | 20 | 54 |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 32.3 | 35 | 35 | 30 | 53 | 32.8 | 35 | 35 | 30 | 54 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect ampereage rating.

- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field-installed electric heat kits may exceed the factory- installed disconnect amperage rating.

ZXA7, 08 to 14 standard static indoor blower - without powered convenience outlet

Table 150: ZXA7, 08 to 14 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2ek045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|-------------|----------------------|--------------|------|------|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 5.2 | 1.1 | | None | - | - | - | 31.6 | 35 | 45 | 31 | 158 | 32.7 | 35 | 50 | 33 | 161 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 31.6 | 35 | 45 | 31 | 158 | 32.7 | 35 | 50 | 33 | 161 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 45 | 31 | 158 | 35.3 | 40 | 50 | 33 | 161 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 158 | 49.5 | 50 | 50 | 46 | 161 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 5.2 | 1 | | | None | - | - | - | 31.6 | 35 | 45 | 31 | 161 | 32.6 | 35 | 50 | 32 | 163 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.6 | 35 | 45 | 31 | 161 | 32.6 | 35 | 50 | 32 | 163 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 38.1 | 40 | 45 | 35 | 161 | 39.4 | 40 | 50 | 36 | 163 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 161 | 55.9 | 60 | 60 | 51 | 163 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 2.6 | 0.5 | | | None | - | - | - | 15.7 | 20 | 20 | 16 | 79 | 16.2 | 20 | 20 | 16 | 80 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.7 | 20 | 20 | 11 | 79 | 16.2 | 20 | 20 | 12 | 80 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 79 | 21.1 | 25 | 25 | 19 | 80 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 24.3 | 25 | 25 | 22 | 79 | 24.9 | 25 | 25 | 23 | 80 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2 | 0.4 | | | None | - | - | - | 14.3 | 15 | 20 | 15 | 65 | 14.7 | 15 | 20 | 15 | 66 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7 | 1.1 | | None | - | - | - | 33.4 | 35 | 50 | 33 | 196 | 34.5 | 35 | 50 | 35 | 199 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 33.4 | 35 | 50 | 33 | 196 | 34.5 | 35 | 50 | 35 | 199 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 36.1 | 40 | 50 | 33 | 196 | 37.5 | 40 | 50 | 35 | 199 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 196 | 51.8 | 60 | 60 | 48 | 199 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.2 | 1 | | | None | - | - | - | 33.6 | 35 | 50 | 34 | 198 | 34.6 | 35 | 50 | 35 | 200 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 33.6 | 35 | 50 | 34 | 198 | 34.6 | 35 | 50 | 35 | 200 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 40.6 | 45 | 50 | 37 | 198 | 41.9 | 45 | 50 | 39 | 200 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 198 | 58.4 | 60 | 60 | 54 | 200 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 3.6 | 0.5 | | | None | - | - | - | 16.7 | 20 | 25 | 17 | 97 | 17.2 | 20 | 25 | 17 | 98 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.7 | 20 | 25 | 12 | 97 | 17.2 | 20 | 25 | 13 | 98 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.8 | 25 | 25 | 20 | 97 | 22.4 | 25 | 25 | 21 | 98 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 25.5 | 30 | 30 | 23 | 97 | 26.1 | 30 | 30 | 24 | 98 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2.5 | 0.4 | | | None | - | - | - | 14.8 | 15 | 20 | 15 | 73 | 15.2 | 20 | 20 | 16 | 74 | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.2 | 45 | 50 | 45 | 246 | 44.4 | 45 | 50 | 47 | 256 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 246 | 53.1 | 60 | 60 | 49 | 256 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 246 | 76 | 80 | 80 | 70 | 256 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 246 | 94.8 | 100 | 100 | 87 | 256 | |
| | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 246 | 121.9 | 125 | 125 | 112 | 256 | | | | | | | | | | | | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | | | None | - | - | - | 42.4 | 45 | 50 | 45 | 248 | 44.4 | 45 | 50 | 47 | 243 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 248 | 59.6 | 60 | 60 | 55 | 243 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 248 | 86.1 | 90 | 90 | 79 | 243 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 248 | 107.8 | 110 | 110 | 99 | 243 |
| | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 248 | 139 | 150 | 150 | 128 | 243 | | | | | | | | | | | | |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | | | None | - | - | - | 19.9 | 20 | 25 | 21 | 125 | 20.9 | 25 | 25 | 22 | 121 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 125 | 30.5 | 35 | 35 | 28 | 121 |
| 12846 | | | | | | | | | | | | | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 125 | 47.5 | 50 | 50 | 44 | 121 | |
| 13346 | | | | | | | | | | | | | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 125 | 55.4 | 60 | 60 | 51 | 121 | |
| 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 125 | 68.5 | 70 | 70 | 63 | 121 | | | | | | | | | | | | | |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | | | None | - | - | - | 14.2 | 15 | 15 | 15 | 93 | 15 | 15 | 15 | 16 | 90 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 93 | 24.6 | 25 | 25 | 23 | 90 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 93 | 45 | 45 | 45 | 41 | 90 | |

Table 150: ZXA7, 08 to 14 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2ek045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7 | 1.1 | | None | - | - | - | 44.2 | 45 | 50 | 47 | 275 | 46.4 | 50 | 50 | 49 | 285 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 47 | 275 | 53.1 | 60 | 60 | 49 | 285 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 275 | 76 | 80 | 80 | 70 | 285 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 275 | 94.8 | 100 | 100 | 87 | 285 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 275 | 121.9 | 125 | 125 | 112 | 285 | |
| | 230-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7.2 | 1 | | None | - | - | - | 44.4 | 45 | 50 | 47 | 278 | 46.4 | 50 | 60 | 49 | 272 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 278 | 59.6 | 60 | 60 | 55 | 272 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 278 | 86.1 | 90 | 90 | 79 | 272 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 278 | 107.8 | 110 | 110 | 99 | 272 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 278 | 139 | 150 | 150 | 128 | 272 | |
| | 460-3-60 | 6.3 | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 20.4 | 25 | 25 | 22 | 153 | 21.4 | 25 | 25 | 23 | 149 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 153 | 30.5 | 35 | 35 | 28 | 149 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 153 | 47.5 | 50 | 50 | 44 | 149 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 153 | 55.4 | 60 | 60 | 51 | 149 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 153 | 68.5 | 70 | 70 | 63 | 149 | |
| | 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 18.2 | 20 | 20 | 19 | 109 | 19 | 20 | 20 | 20 | 106 | |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 109 | 24.6 | 25 | 25 | 23 | 106 | | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 109 | 45 | 45 | 45 | 41 | 106 | | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 7 | 1.1 | | None | - | - | - | 47.2 | 50 | 60 | 50 | 299 | 49.4 | 50 | 60 | 52 | 309 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 50 | 299 | 53.1 | 60 | 60 | 52 | 309 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 299 | 76 | 80 | 80 | 70 | 309 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 299 | 94.8 | 100 | 100 | 87 | 309 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 299 | 121.9 | 125 | 125 | 112 | 309 | |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 7.2 | 1 | | None | - | - | - | 47.4 | 50 | 60 | 50 | 302 | 49.4 | 50 | 60 | 52 | 296 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 302 | 59.6 | 60 | 60 | 55 | 296 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 302 | 86.1 | 90 | 90 | 79 | 296 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 302 | 107.8 | 110 | 110 | 99 | 296 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 302 | 139 | 150 | 150 | 128 | 296 | |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 23.8 | 25 | 30 | 25 | 147 | 24.8 | 25 | 30 | 26 | 143 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 147 | 30.5 | 35 | 35 | 28 | 143 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 147 | 47.5 | 50 | 50 | 44 | 143 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 147 | 55.4 | 60 | 60 | 51 | 143 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 147 | 68.5 | 70 | 70 | 63 | 143 | |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 17.7 | 20 | 20 | 19 | 105 | 18.5 | 20 | 20 | 20 | 102 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 105 | 24.6 | 25 | 25 | 23 | 102 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 105 | 45 | 45 | 45 | 41 | 102 | |

Table 150: ZXA7, 08 to 14 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2ek045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | | | | | 136 | 31 | 5.8 | 8.9 | | | | 1.1 | | | | | None | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 58.8 | 60 | | | | | 70 | 62 | 371 | | | 61 | 70 | 65 | 381 | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 75.6 | 80 | | | | | 80 | 70 | 371 | | | 78.4 | 80 | 80 | 72 | 381 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 94.4 | 100 | | | | | 100 | 87 | 371 | | | 97.1 | 100 | 100 | 89 | 381 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 121.5 | 125 | | | | | 125 | 112 | 371 | | | 124.3 | 125 | 125 | 114 | 381 | |
| 230-3-60 | 19.6 | | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 8.2 | 1 | | | None | - | - | - | 57.5 | 60 | 70 | 60 | 370 | 59.5 | 60 | 70 | 63 | 375 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 58.4 | 60 | 70 | 60 | 370 | 60.9 | 70 | 70 | 63 | 375 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 84.9 | 90 | 90 | 78 | 370 | 87.4 | 90 | 90 | 80 | 375 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 106.5 | 110 | 110 | 98 | 370 | 109 | 110 | 110 | 100 | 375 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 137.8 | 150 | 150 | 127 | 370 | 140.3 | 150 | 150 | 129 | 375 |
| 460-3-60 | 8.2 | | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 4.1 | 0.5 | | | None | - | - | - | 25.5 | 30 | 30 | 27 | 178 | 26.5 | 30 | 30 | 28 | 180 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.9 | 30 | 30 | 27 | 178 | 31.1 | 35 | 35 | 29 | 180 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.9 | 50 | 50 | 43 | 178 | 48.1 | 50 | 50 | 44 | 180 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.8 | 60 | 60 | 50 | 178 | 56 | 60 | 60 | 52 | 180 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.9 | 70 | 70 | 62 | 178 | 69.1 | 70 | 70 | 64 | 180 |
| 575-3-60 | 6.6 | | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 3.2 | 0.4 | | | None | - | - | - | 20.3 | 25 | 25 | 21 | 148 | 21.1 | 25 | 25 | 22 | 150 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24.5 | 25 | 25 | 23 | 148 | 25.5 | 30 | 30 | 23 | 150 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44.9 | 45 | 45 | 41 | 148 | 45.9 | 50 | 50 | 42 | 150 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZXA7, 08 to 14 standard static indoor blower - with powered convenience outlet

Table 151: ZXA7, 08 to 14 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 35.9 | 40 | 50 | 36 | 163 | 37 | 40 | 50 | 37 | 165 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 35.9 | 40 | 50 | 36 | 163 | 37 | 40 | 50 | 37 | 165 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 50 | 36 | 163 | 40.6 | 45 | 50 | 37 | 165 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 163 | 54.9 | 60 | 60 | 50 | 165 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 5.2 | 1 | 8.6 | None | - | - | - | 35.9 | 40 | 50 | 36 | 165 | 36.9 | 40 | 50 | 37 | 168 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 35.9 | 40 | 50 | 36 | 165 | 36.9 | 40 | 50 | 37 | 168 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 50 | 40 | 165 | 44.8 | 45 | 50 | 41 | 168 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 165 | 61.3 | 70 | 70 | 56 | 168 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 2.6 | 0.5 | 8.6 | None | - | - | - | 17.9 | 20 | 25 | 18 | 81 | 18.4 | 20 | 25 | 19 | 82 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.9 | 20 | 25 | 14 | 81 | 18.4 | 20 | 25 | 14 | 82 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 81 | 23.8 | 25 | 25 | 22 | 82 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26.9 | 30 | 30 | 25 | 81 | 27.6 | 30 | 30 | 25 | 82 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2 | 0.4 | 8.6 | None | - | - | - | 16 | 20 | 20 | 17 | 67 | 16.4 | 20 | 20 | 17 | 68 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7 | 1.1 | 8.6 | None | - | - | - | 37.7 | 40 | 50 | 38 | 200 | 38.8 | 40 | 50 | 40 | 203 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 37.7 | 40 | 50 | 38 | 200 | 38.8 | 40 | 50 | 40 | 203 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41.5 | 45 | 50 | 38 | 200 | 42.9 | 45 | 50 | 40 | 203 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 200 | 57.1 | 60 | 60 | 53 | 203 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.2 | 1 | 8.6 | None | - | - | - | 37.9 | 40 | 50 | 39 | 202 | 38.9 | 40 | 50 | 40 | 204 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 37.9 | 40 | 50 | 39 | 202 | 38.9 | 40 | 50 | 40 | 204 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46 | 50 | 50 | 42 | 202 | 47.3 | 50 | 50 | 43 | 204 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 202 | 63.8 | 70 | 70 | 59 | 204 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 3.6 | 0.5 | 8.6 | None | - | - | - | 18.9 | 20 | 25 | 19 | 99 | 19.4 | 20 | 25 | 20 | 100 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 18.9 | 20 | 25 | 15 | 99 | 19.4 | 20 | 25 | 15 | 100 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.4 | 25 | 25 | 22 | 99 | 25.1 | 30 | 30 | 23 | 100 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.2 | 30 | 30 | 26 | 99 | 28.8 | 30 | 30 | 27 | 100 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2.5 | 0.4 | 8.6 | None | - | - | - | 16.5 | 20 | 20 | 17 | 75 | 16.9 | 20 | 20 | 18 | 76 | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 46.5 | 50 | 60 | 50 | 250 | 48.7 | 50 | 60 | 52 | 260 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 250 | 58.5 | 60 | 60 | 54 | 260 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 250 | 81.4 | 90 | 90 | 75 | 260 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 250 | 100.1 | 110 | 110 | 92 | 260 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 250 | 127.3 | 150 | 150 | 117 | 260 |
| | | | | | | | | | | | | None | - | - | - | 46.7 | 50 | 60 | 50 | 252 | 48.7 | 50 | 60 | 52 | 247 |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 252 | 65 | 70 | 70 | 60 | 247 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 252 | 91.5 | 100 | 100 | 84 | 247 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 252 | 113.1 | 125 | 125 | 104 | 247 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 252 | 144.4 | 150 | 150 | 133 | 247 |
| | | | | | | | | | | | | None | - | - | - | 22.1 | 25 | 25 | 24 | 127 | 23.1 | 25 | 25 | 25 | 123 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 127 | 33.2 | 35 | 35 | 31 | 123 |
| 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 127 | 50.2 | 60 | 60 | 46 | 123 | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 127 | 58.1 | 60 | 60 | 53 | 123 | |
| | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 127 | 71.2 | 80 | 80 | 65 | 123 | |
| | | | | | | | | | | | None | - | - | - | 15.9 | 20 | 20 | 17 | 95 | 16.7 | 20 | 20 | 18 | 92 | |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 95 | 26.8 | 30 | 30 | 25 | 92 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 95 | 47.2 | 50 | 50 | 43 | 92 | |

Table 151: ZXA7, 08 to 14 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 48.5 | 50 | 60 | 52 | 280 | 50.7 | 60 | 60 | 54 | 290 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 52 | 280 | 58.5 | 60 | 60 | 54 | 290 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 280 | 81.4 | 90 | 90 | 75 | 290 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 280 | 100.1 | 110 | 110 | 92 | 290 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 280 | 127.3 | 150 | 150 | 117 | 290 |
| | 230-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 48.7 | 50 | 60 | 52 | 282 | 50.7 | 60 | 60 | 54 | 277 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 282 | 65 | 70 | 70 | 60 | 277 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 282 | 91.5 | 100 | 100 | 84 | 277 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 282 | 113.1 | 125 | 125 | 104 | 277 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 282 | 144.4 | 150 | 150 | 133 | 277 |
| | 460-3-60 | 6.3 | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.6 | 25 | 25 | 24 | 155 | 23.6 | 25 | 25 | 25 | 151 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 155 | 33.2 | 35 | 35 | 31 | 151 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 155 | 50.2 | 60 | 60 | 46 | 151 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 155 | 58.1 | 60 | 60 | 53 | 151 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 155 | 71.2 | 80 | 80 | 65 | 151 |
| | 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 19.9 | 20 | 25 | 21 | 111 | 20.7 | 25 | 25 | 22 | 108 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 111 | 26.8 | 30 | 30 | 25 | 108 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 111 | 47.2 | 50 | 50 | 43 | 108 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 51.5 | 60 | 60 | 55 | 304 | 53.7 | 60 | 60 | 57 | 314 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 55 | 304 | 58.5 | 60 | 60 | 57 | 314 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 304 | 81.4 | 90 | 90 | 75 | 314 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 304 | 100.1 | 110 | 110 | 92 | 314 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 304 | 127.3 | 150 | 150 | 117 | 314 |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 51.7 | 60 | 60 | 55 | 306 | 53.7 | 60 | 60 | 57 | 301 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 306 | 65 | 70 | 70 | 60 | 301 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 306 | 91.5 | 100 | 100 | 84 | 301 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 306 | 113.1 | 125 | 125 | 104 | 301 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 306 | 144.4 | 150 | 150 | 133 | 301 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 26 | 30 | 30 | 28 | 149 | 27 | 30 | 30 | 29 | 145 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 149 | 33.2 | 35 | 35 | 31 | 145 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 149 | 50.2 | 60 | 60 | 46 | 145 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 149 | 58.1 | 60 | 60 | 53 | 145 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 149 | 71.2 | 80 | 80 | 65 | 145 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 19.4 | 20 | 25 | 21 | 107 | 20.2 | 25 | 25 | 22 | 104 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 107 | 26.8 | 30 | 30 | 25 | 104 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 107 | 47.2 | 50 | 50 | 43 | 104 | |

Table 151: ZXA7, 08 to 14 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|--------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.8 | 8.9 | 1.1 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 375 | 65.3 | 70 | 80 | 69 | 385 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 375 | 65.3 | 70 | 80 | 69 | 385 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81 | 90 | 90 | 75 | 375 | 83.8 | 90 | 90 | 77 | 385 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 99.8 | 100 | 100 | 92 | 375 | 102.5 | 110 | 110 | 94 | 385 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 126.9 | 150 | 150 | 117 | 375 | 129.6 | 150 | 150 | 119 | 385 | |
| | 230-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 8.2 | 1 | 8.6 | None | - | - | - | 61.8 | 70 | 80 | 65 | 374 | 63.8 | 70 | 80 | 68 | 379 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 63.8 | 70 | 80 | 65 | 374 | 66.3 | 70 | 80 | 68 | 379 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 90.3 | 100 | 100 | 83 | 374 | 92.8 | 100 | 100 | 85 | 379 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 111.9 | 125 | 125 | 103 | 374 | 114.4 | 125 | 125 | 105 | 379 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 143.1 | 150 | 150 | 132 | 374 | 145.6 | 150 | 150 | 134 | 379 | |
| | 460-3-60 | 8.2 | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 4.1 | 0.5 | 8.6 | None | - | - | - | 27.7 | 30 | 35 | 29 | 180 | 28.7 | 30 | 35 | 31 | 182 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 32.6 | 35 | 35 | 30 | 180 | 33.8 | 35 | 35 | 31 | 182 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 49.6 | 50 | 50 | 46 | 180 | 50.8 | 60 | 60 | 47 | 182 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 57.4 | 60 | 60 | 53 | 180 | 58.7 | 60 | 60 | 54 | 182 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 70.6 | 80 | 80 | 65 | 180 | 71.8 | 80 | 80 | 66 | 182 | |
| | 575-3-60 | 6.6 | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 3.2 | 0.4 | 8.6 | None | - | - | - | 22 | 25 | 25 | 23 | 150 | 22.8 | 25 | 25 | 24 | 152 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 26.7 | 30 | 30 | 25 | 150 | 27.7 | 30 | 30 | 25 | 152 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47 | 50 | 50 | 43 | 150 | 48 | 50 | 50 | 44 | 152 | |

- 1 Minimum Circuit Ampacity.
- 2 Dual Element, Time Delay Type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZXA7, ZX08 to 14 medium static indoor blower - without powered convenience outlet

Table 152: ZXA7, ZX08 to 14 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | Max fuse ² /breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|-------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|---|---|------------------------------------|-----|-----------------------------------|--|--|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.5 | 1.1 | | None | - | - | - | 33.9 | 35 | 50 | 34 | 185 | 35 | 35 | 50 | 35 | 187 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 33.9 | 35 | 50 | 34 | 185 | 35 | 35 | 50 | 35 | 187 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 36.8 | 40 | 50 | 34 | 185 | 38.1 | 40 | 50 | 35 | 187 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 51 | 60 | 60 | 47 | 185 | 52.4 | 60 | 60 | 48 | 187 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.5 | 1 | | | None | - | - | - | 33.9 | 35 | 50 | 34 | 191 | 34.9 | 35 | 50 | 35 | 193 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 33.9 | 35 | 50 | 34 | 191 | 34.9 | 35 | 50 | 35 | 193 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41 | 45 | 50 | 38 | 191 | 42.3 | 45 | 50 | 39 | 193 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 57.5 | 60 | 60 | 53 | 191 | 58.8 | 60 | 60 | 54 | 193 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 3.4 | 0.5 | | | None | - | - | - | 16.5 | 20 | 25 | 17 | 94 | 17 | 20 | 25 | 17 | 95 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.5 | 20 | 25 | 12 | 94 | 17 | 20 | 25 | 13 | 95 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.5 | 25 | 25 | 20 | 94 | 22.1 | 25 | 25 | 20 | 95 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 25.3 | 30 | 30 | 23 | 94 | 25.9 | 30 | 30 | 24 | 95 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2.8 | 0.4 | | | None | - | - | - | 15.1 | 20 | 20 | 16 | 77 | 15.5 | 20 | 20 | 16 | 78 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 8.9 | 1.1 | | None | - | - | - | 35.3 | 40 | 50 | 36 | 198 | 36.4 | 40 | 50 | 37 | 200 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 35.3 | 40 | 50 | 36 | 198 | 36.4 | 40 | 50 | 37 | 200 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 38.5 | 40 | 50 | 36 | 198 | 39.9 | 40 | 50 | 37 | 200 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 52.8 | 60 | 60 | 49 | 198 | 54.1 | 60 | 60 | 50 | 200 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 8.2 | 1 | | | None | - | - | - | 34.6 | 35 | 50 | 35 | 205 | 35.6 | 40 | 50 | 36 | 207 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.6 | 35 | 50 | 35 | 205 | 35.6 | 40 | 50 | 36 | 207 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.9 | 45 | 50 | 39 | 205 | 43.1 | 45 | 50 | 40 | 207 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 58.4 | 60 | 60 | 54 | 205 | 59.6 | 60 | 60 | 55 | 207 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.1 | 0.5 | | | None | - | - | - | 17.2 | 20 | 25 | 17 | 101 | 17.7 | 20 | 25 | 18 | 102 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.2 | 20 | 25 | 13 | 101 | 17.7 | 20 | 25 | 14 | 102 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.4 | 25 | 25 | 21 | 101 | 23 | 25 | 25 | 21 | 102 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26.1 | 30 | 30 | 24 | 101 | 26.8 | 30 | 30 | 25 | 102 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 3.2 | 0.4 | | | None | - | - | - | 15.5 | 20 | 20 | 16 | 81 | 15.9 | 20 | 20 | 16 | 82 |

Table 152: ZXA7, ZX08 to 14 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|-------------|----------------------|--------------|------|--------|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | FLA | LRA | FLA | LRA | | | | | | | | | | | |
| | | Model | kW | Stages | Amps | FLA | LRA | | | | | FLA | LRA | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 8.9 | 1.1 | | None | - | - | - | 44.1 | 45 | 50 | 47 | 262 | 46.3 | 50 | 50 | 49 | 272 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 52.8 | 60 | 60 | 49 | 262 | 55.5 | 60 | 60 | 51 | 272 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 75.6 | 80 | 80 | 70 | 262 | 78.4 | 80 | 80 | 72 | 272 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 94.4 | 100 | 100 | 87 | 262 | 97.1 | 100 | 100 | 89 | 272 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 121.5 | 125 | 125 | 112 | 262 | 124.3 | 125 | 125 | 114 | 272 | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 8.2 | 1 | | | None | - | - | - | 43.4 | 45 | 50 | 46 | 265 | 45.4 | 50 | 50 | 48 | 260 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 58.4 | 60 | 60 | 54 | 265 | 60.9 | 70 | 70 | 56 | 260 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 84.9 | 90 | 90 | 78 | 265 | 87.4 | 90 | 90 | 80 | 260 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 106.5 | 110 | 110 | 98 | 265 | 109 | 110 | 110 | 100 | 260 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 137.8 | 150 | 150 | 127 | 265 | 140.3 | 150 | 150 | 129 | 260 |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.1 | 0.5 | | | None | - | - | - | 20.4 | 25 | 25 | 22 | 128 | 21.4 | 25 | 25 | 23 | 125 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.9 | 30 | 30 | 27 | 128 | 31.1 | 35 | 35 | 29 | 125 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.9 | 50 | 50 | 43 | 128 | 48.1 | 50 | 50 | 44 | 125 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.8 | 60 | 60 | 50 | 128 | 56 | 60 | 60 | 52 | 125 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.9 | 70 | 70 | 62 | 128 | 69.1 | 70 | 70 | 64 | 125 |
| | 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 3.2 | 0.4 | | | None | - | - | - | 14.9 | 15 | 15 | 16 | 102 | 15.7 | 20 | 20 | 17 | 99 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24.5 | 25 | 25 | 23 | 102 | 25.5 | 30 | 30 | 23 | 99 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44.9 | 45 | 45 | 41 | 102 | 45.9 | 50 | 50 | 42 | 99 |
| | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 47 | 275 | 53.1 | 60 | 60 | 49 | 285 |
| | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 275 | 76 | 80 | 80 | 70 | 285 |
| 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7 | 1.1 | | None | - | - | - | 44.2 | 45 | 50 | 47 | 275 | 46.4 | 50 | 50 | 49 | 285 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 47 | 275 | 53.1 | 60 | 60 | 49 | 285 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 275 | 76 | 80 | 80 | 70 | 285 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 275 | 94.8 | 100 | 100 | 87 | 285 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 275 | 121.9 | 125 | 125 | 112 | 285 | |
| | 230-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7.2 | 1 | | | None | - | - | - | 44.4 | 45 | 50 | 47 | 278 | 46.4 | 50 | 60 | 49 | 272 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 278 | 59.6 | 60 | 60 | 55 | 272 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 278 | 86.1 | 90 | 90 | 79 | 272 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 278 | 107.8 | 110 | 110 | 99 | 272 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 278 | 139 | 150 | 150 | 128 | 272 |
| | 460-3-60 | 6.3 | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 3.6 | 0.5 | | | None | - | - | - | 20.4 | 25 | 25 | 22 | 153 | 21.4 | 25 | 25 | 23 | 149 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 153 | 30.5 | 35 | 35 | 28 | 149 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 153 | 47.5 | 50 | 50 | 44 | 149 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 153 | 55.4 | 60 | 60 | 51 | 149 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 153 | 68.5 | 70 | 70 | 63 | 149 |
| | 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 2.5 | 0.4 | | | None | - | - | - | 18.2 | 20 | 20 | 19 | 109 | 19 | 20 | 20 | 20 | 106 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 109 | 24.6 | 25 | 25 | 23 | 106 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 109 | 45 | 45 | 45 | 41 | 106 |
| | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 47 | 275 | 53.1 | 60 | 60 | 49 | 285 |
| | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 275 | 76 | 80 | 80 | 70 | 285 |

Table 152: ZXA7, ZX08 to 14 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 50.1 | 60 | 60 | 53 | 312 | 52.3 | 60 | 60 | 56 | 322 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 53 | 312 | 56.8 | 60 | 60 | 56 | 322 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 312 | 79.6 | 80 | 80 | 73 | 322 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 312 | 98.4 | 100 | 100 | 91 | 322 | |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 9.4 | 1 | | | None | - | - | - | 49.6 | 50 | 60 | 52 | 321 | 51.6 | 60 | 60 | 55 | 315 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 321 | 62.4 | 70 | 70 | 57 | 315 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 321 | 88.9 | 90 | 90 | 82 | 315 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 321 | 110.5 | 125 | 125 | 102 | 315 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 4.7 | 0.5 | | | None | - | - | - | 24.9 | 25 | 30 | 26 | 156 | 25.9 | 30 | 30 | 27 | 152 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 156 | 31.9 | 35 | 35 | 29 | 152 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 156 | 48.9 | 50 | 50 | 45 | 152 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 156 | 56.8 | 60 | 60 | 52 | 152 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 4.3 | 0.4 | | | None | - | - | - | 19.5 | 20 | 25 | 21 | 127 | 20.3 | 25 | 25 | 22 | 124 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 127 | 26.9 | 30 | 30 | 25 | 124 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 127 | 47.3 | 50 | 50 | 43 | 124 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.8 | 9.9 | 1.1 | | None | - | - | - | 59.8 | 60 | 70 | 63 | 367 | 62 | 70 | 80 | 66 | 377 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.8 | 60 | 70 | 63 | 367 | 62 | 70 | 80 | 66 | 377 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 367 | 79.6 | 80 | 80 | 73 | 377 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 367 | 98.4 | 100 | 100 | 91 | 377 | |
| | 230-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 9.4 | 1 | | | None | - | - | - | 58.7 | 60 | 70 | 62 | 372 | 60.7 | 70 | 80 | 64 | 376 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 70 | 62 | 372 | 62.4 | 70 | 80 | 64 | 376 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 372 | 88.9 | 90 | 90 | 82 | 376 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 372 | 110.5 | 125 | 125 | 102 | 376 |
| | 460-3-60 | 8.2 | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0.5 | | | None | - | - | - | 26.1 | 30 | 30 | 28 | 184 | 27.1 | 30 | 30 | 29 | 186 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 184 | 31.9 | 35 | 35 | 29 | 186 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 184 | 48.9 | 50 | 50 | 45 | 186 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 184 | 56.8 | 60 | 60 | 52 | 186 |
| | 575-3-60 | 6.6 | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0.4 | | | None | - | - | - | 21.4 | 25 | 25 | 23 | 162 | 22.2 | 25 | 25 | 24 | 164 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 162 | 26.9 | 30 | 30 | 25 | 164 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 162 | 47.3 | 50 | 50 | 43 | 164 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZXA7, ZX08 to 14 medium static indoor blower - with powered convenience outlet

Table 153: ZXA7, ZX08 to 14 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (Amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.5 | 1.1 | 8.6 | None | - | - | - | 38.2 | 40 | 50 | 39 | 189 | 39.3 | 40 | 50 | 40 | 191 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 38.2 | 40 | 50 | 39 | 189 | 39.3 | 40 | 50 | 40 | 191 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 42.1 | 45 | 50 | 39 | 189 | 43.5 | 45 | 50 | 40 | 191 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 56.4 | 60 | 60 | 52 | 189 | 57.8 | 60 | 60 | 53 | 191 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 7.5 | 1 | 8.6 | None | - | - | - | 38.2 | 40 | 50 | 39 | 195 | 39.2 | 40 | 50 | 40 | 198 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 38.2 | 40 | 50 | 39 | 195 | 39.2 | 40 | 50 | 40 | 198 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.4 | 50 | 50 | 43 | 195 | 47.6 | 50 | 50 | 44 | 198 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.9 | 70 | 70 | 58 | 195 | 64.1 | 70 | 70 | 59 | 198 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 3.4 | 0.5 | 8.6 | None | - | - | - | 18.7 | 20 | 25 | 19 | 96 | 19.2 | 20 | 25 | 20 | 97 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 18.7 | 20 | 25 | 15 | 96 | 19.2 | 20 | 25 | 15 | 97 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.2 | 25 | 25 | 22 | 96 | 24.8 | 25 | 25 | 23 | 97 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 2.8 | 0.4 | 8.6 | None | - | - | - | 16.8 | 20 | 20 | 17 | 79 | 17.2 | 20 | 20 | 18 | 80 |
| 11446 | | | | | | | | | | | | 14 | 1 | 16.8 | 27.9 | 30 | 30 | 26 | 96 | 28.6 | 30 | 30 | 26 | 97 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 8.9 | 1.1 | 8.6 | None | - | - | - | 39.6 | 40 | 50 | 40 | 202 | 40.7 | 45 | 50 | 42 | 205 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 39.6 | 40 | 50 | 40 | 202 | 40.7 | 45 | 50 | 42 | 205 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.9 | 45 | 50 | 40 | 202 | 45.3 | 50 | 50 | 42 | 205 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 58.1 | 60 | 60 | 53 | 202 | 59.5 | 60 | 60 | 55 | 205 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 8.2 | 1 | 8.6 | None | - | - | - | 38.9 | 40 | 50 | 40 | 209 | 39.9 | 40 | 50 | 41 | 212 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 38.9 | 40 | 50 | 40 | 209 | 39.9 | 40 | 50 | 41 | 212 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 47.3 | 50 | 50 | 43 | 209 | 48.5 | 50 | 50 | 45 | 212 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63.8 | 70 | 70 | 59 | 209 | 65 | 70 | 70 | 60 | 212 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.1 | 0.5 | 8.6 | None | - | - | - | 19.4 | 20 | 25 | 20 | 103 | 19.9 | 20 | 25 | 20 | 104 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 19.4 | 20 | 25 | 15 | 103 | 19.9 | 20 | 25 | 16 | 104 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 25.1 | 30 | 30 | 23 | 103 | 25.7 | 30 | 30 | 24 | 104 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 3.2 | 0.4 | 8.6 | None | - | - | - | 17.2 | 20 | 20 | 18 | 83 | 17.6 | 20 | 20 | 18 | 84 |
| 11446 | | | | | | | | | | | | 14 | 1 | 16.8 | 28.8 | 30 | 30 | 27 | 103 | 29.4 | 30 | 30 | 27 | 104 | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 8.9 | 1.1 | 8.6 | None | - | - | - | 48.4 | 50 | 60 | 52 | 267 | 50.6 | 60 | 60 | 54 | 277 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 58.1 | 60 | 60 | 53 | 267 | 60.9 | 70 | 70 | 56 | 277 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81 | 90 | 90 | 75 | 267 | 83.8 | 90 | 90 | 77 | 277 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 99.8 | 100 | 100 | 92 | 267 | 102.5 | 110 | 110 | 94 | 277 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 126.9 | 150 | 150 | 117 | 267 | 129.6 | 150 | 150 | 119 | 277 |
| | | | | | | | | | | | | None | - | - | - | 47.7 | 50 | 60 | 51 | 270 | 49.7 | 50 | 60 | 53 | 264 |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 8.2 | 1 | 8.6 | None | - | - | - | 47.7 | 50 | 60 | 51 | 270 | 49.7 | 50 | 60 | 53 | 264 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 63.8 | 70 | 70 | 59 | 270 | 66.3 | 70 | 70 | 61 | 264 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 90.3 | 100 | 100 | 83 | 270 | 92.8 | 100 | 100 | 85 | 264 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 111.9 | 125 | 125 | 103 | 270 | 114.4 | 125 | 125 | 105 | 264 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 143.1 | 150 | 150 | 132 | 270 | 145.6 | 150 | 150 | 134 | 264 |
| | | | | | | | | | | | | None | - | - | - | 22.6 | 25 | 25 | 24 | 130 | 23.6 | 25 | 25 | 25 | 127 |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.1 | 0.5 | 8.6 | None | - | - | - | 16.6 | 20 | 20 | 18 | 103 | 17.4 | 20 | 20 | 19 | 100 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 32.6 | 35 | 35 | 30 | 130 | 33.8 | 35 | 35 | 31 | 127 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 49.6 | 50 | 50 | 46 | 130 | 50.8 | 60 | 60 | 47 | 127 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 57.4 | 60 | 60 | 53 | 130 | 58.7 | 60 | 60 | 54 | 127 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 70.6 | 80 | 80 | 65 | 130 | 71.8 | 80 | 80 | 66 | 127 |
| | | | | | | | | | | | | None | - | - | - | 16.6 | 20 | 20 | 18 | 103 | 17.4 | 20 | 20 | 19 | 100 |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 3.2 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 26.7 | 30 | 30 | 25 | 103 | 27.7 | 30 | 30 | 25 | 100 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47 | 50 | 50 | 43 | 103 | 48 | 50 | 50 | 44 | 100 | |

Table 153: ZXA7, ZX08 to 14 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (Amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 48.5 | 50 | 60 | 52 | 280 | 50.7 | 60 | 60 | 54 | 290 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 52 | 280 | 58.5 | 60 | 60 | 54 | 290 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 280 | 81.4 | 90 | 90 | 75 | 290 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 280 | 100.1 | 110 | 110 | 92 | 290 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 280 | 127.3 | 150 | 150 | 117 | 290 |
| | 230-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 48.7 | 50 | 60 | 52 | 282 | 50.7 | 60 | 60 | 54 | 277 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 282 | 65 | 70 | 70 | 60 | 277 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 282 | 91.5 | 100 | 100 | 84 | 277 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 282 | 113.1 | 125 | 125 | 104 | 277 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 282 | 144.4 | 150 | 150 | 133 | 277 |
| | 460-3-60 | 6.3 | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.6 | 25 | 25 | 24 | 155 | 23.6 | 25 | 25 | 25 | 151 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 155 | 33.2 | 35 | 35 | 31 | 151 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 155 | 50.2 | 60 | 60 | 46 | 151 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 155 | 58.1 | 60 | 60 | 53 | 151 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 155 | 71.2 | 80 | 80 | 65 | 151 |
| | 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 19.9 | 20 | 25 | 21 | 111 | 20.7 | 25 | 25 | 22 | 108 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 111 | 26.8 | 30 | 30 | 25 | 108 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 111 | 47.2 | 50 | 50 | 43 | 108 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 54.4 | 60 | 70 | 58 | 316 | 56.6 | 60 | 70 | 60 | 326 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 70 | 58 | 316 | 62.1 | 70 | 70 | 60 | 326 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 316 | 85 | 90 | 90 | 78 | 326 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 316 | 103.8 | 110 | 110 | 95 | 326 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 316 | 130.9 | 150 | 150 | 120 | 326 |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 53.9 | 60 | 60 | 57 | 325 | 55.9 | 60 | 70 | 60 | 320 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 325 | 67.8 | 70 | 70 | 62 | 320 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 325 | 94.3 | 100 | 100 | 87 | 320 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 325 | 115.9 | 125 | 125 | 107 | 320 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 325 | 147.1 | 150 | 150 | 135 | 320 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 27.1 | 30 | 30 | 29 | 158 | 28.1 | 30 | 30 | 30 | 154 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 158 | 34.6 | 35 | 35 | 32 | 154 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 158 | 51.6 | 60 | 60 | 47 | 154 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 158 | 59.4 | 60 | 60 | 55 | 154 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 158 | 72.6 | 80 | 80 | 67 | 154 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21.2 | 25 | 25 | 23 | 129 | 22 | 25 | 25 | 24 | 126 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 129 | 29 | 30 | 30 | 27 | 126 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 129 | 49.4 | 50 | 50 | 45 | 126 | |

Table 153: ZXA7, ZX08 to 14 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (Amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|--------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.8 | 9.9 | 1.1 | 8.6 | None | - | - | - | 64.1 | 70 | 80 | 68 | 371 | 66.3 | 70 | 80 | 71 | 381 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 64.1 | 70 | 80 | 68 | 371 | 66.3 | 70 | 80 | 71 | 381 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 371 | 85 | 90 | 90 | 78 | 381 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 371 | 103.8 | 110 | 110 | 95 | 381 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 371 | 130.9 | 150 | 150 | 120 | 381 | |
| | 230-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | - | 63 | 70 | 80 | 67 | 376 | 65 | 70 | 80 | 69 | 381 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 67 | 376 | 67.8 | 70 | 80 | 69 | 381 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 376 | 94.3 | 100 | 100 | 87 | 381 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 376 | 115.9 | 125 | 125 | 107 | 381 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 376 | 147.1 | 150 | 150 | 135 | 381 | |
| | 460-3-60 | 8.2 | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 28.3 | 30 | 35 | 30 | 186 | 29.3 | 30 | 35 | 31 | 188 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 186 | 34.6 | 35 | 35 | 32 | 188 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 186 | 51.6 | 60 | 60 | 47 | 188 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 186 | 59.4 | 60 | 60 | 55 | 188 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 186 | 72.6 | 80 | 80 | 67 | 188 | |
| | 575-3-60 | 6.6 | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 23.1 | 25 | 25 | 25 | 164 | 23.9 | 25 | 25 | 26 | 165 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 29 | 30 | 30 | 27 | 165 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 49.4 | 50 | 50 | 45 | 165 | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZXA7, 08 to 14 high static indoor blower - without powered convenience outlet

Table 154: ZXA7, 08 to 14 high static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|------|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|------------|--|--|------------------------------------|------|-----------------------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 10.2 | 1.1 | | None | - | - | - | 36.6 | 40 | 50 | 37 | 199 | 37.7 | 40 | 50 | 38 | 202 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 36.6 | 40 | 50 | 37 | 199 | 37.7 | 40 | 50 | 38 | 202 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 40.1 | 45 | 50 | 37 | 199 | 41.5 | 45 | 50 | 38 | 202 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 54.4 | 60 | 50 | 37 | 199 | 55.8 | 60 | 60 | 51 | 202 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 10.2 | 1 | | None | - | - | - | 36.6 | 40 | 50 | 37 | 205 | 37.6 | 40 | 50 | 38 | 207 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 36.6 | 40 | 50 | 37 | 205 | 37.6 | 40 | 50 | 38 | 207 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 44.4 | 45 | 50 | 41 | 205 | 45.6 | 50 | 50 | 42 | 207 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 60.9 | 70 | 70 | 56 | 205 | 62.1 | 70 | 70 | 57 | 207 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.8 | 0.5 | | None | - | - | - | 17.9 | 20 | 25 | 18 | 101 | 18.4 | 20 | 25 | 19 | 102 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.9 | 20 | 25 | 14 | 101 | 18.4 | 20 | 25 | 14 | 102 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.3 | 25 | 25 | 21 | 101 | 23.9 | 25 | 25 | 22 | 102 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 27 | 30 | 30 | 25 | 101 | 27.6 | 30 | 30 | 25 | 102 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 3.4 | 0.4 | | None | - | - | - | 15.7 | 20 | 20 | 16 | 83 | 16.1 | 20 | 20 | 17 | 84 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 9.9 | 1.1 | | None | - | - | - | 36.3 | 40 | 50 | 37 | 209 | 37.4 | 40 | 50 | 38 | 211 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 36.3 | 40 | 50 | 37 | 209 | 37.4 | 40 | 50 | 38 | 211 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.8 | 40 | 50 | 37 | 209 | 41.1 | 45 | 50 | 38 | 211 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 54 | 60 | 50 | 37 | 209 | 55.4 | 60 | 60 | 51 | 211 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 9.4 | 1 | | None | - | - | - | 35.8 | 40 | 50 | 36 | 217 | 36.8 | 40 | 50 | 37 | 219 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 35.8 | 40 | 50 | 36 | 217 | 36.8 | 40 | 50 | 37 | 219 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.4 | 45 | 50 | 40 | 217 | 44.6 | 45 | 50 | 41 | 219 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 217 | 61.1 | 70 | 70 | 56 | 219 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.7 | 0.5 | | None | - | - | - | 17.8 | 20 | 25 | 18 | 106 | 18.3 | 20 | 25 | 19 | 108 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.8 | 20 | 25 | 14 | 106 | 18.3 | 20 | 25 | 14 | 108 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.1 | 25 | 25 | 21 | 106 | 23.8 | 25 | 25 | 22 | 108 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26.9 | 30 | 30 | 25 | 106 | 27.5 | 30 | 30 | 25 | 108 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 4.3 | 0.4 | | None | - | - | - | 16.6 | 20 | 20 | 17 | 95 | 17 | 20 | 20 | 18 | 96 | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 45.1 | 50 | 50 | 48 | 258 | 47.3 | 50 | 50 | 50 | 268 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 258 | 56.8 | 60 | 60 | 52 | 268 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 258 | 79.6 | 80 | 80 | 73 | 268 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 258 | 98.4 | 100 | 100 | 91 | 268 |
| | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 258 | 125.5 | 150 | 150 | 115 | 268 | | | | | | | | | | | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.4 | 1 | | None | - | - | - | 44.6 | 45 | 50 | 47 | 267 | 46.6 | 50 | 60 | 50 | 261 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 267 | 62.4 | 70 | 70 | 57 | 261 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 267 | 88.9 | 90 | 90 | 82 | 261 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 267 | 110.5 | 125 | 125 | 102 | 261 |
| | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 267 | 141.8 | 150 | 150 | 130 | 261 | | | | | | | | | | | |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.7 | 0.5 | | None | - | - | - | 21 | 25 | 25 | 22 | 134 | 22 | 25 | 25 | 24 | 130 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 134 | 31.9 | 35 | 35 | 29 | 130 |
| 12846 | | | | | | | | | | | | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 134 | 48.9 | 50 | 50 | 45 | 130 | |
| 13346 | | | | | | | | | | | | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 134 | 56.8 | 60 | 60 | 52 | 130 | |
| 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 134 | 69.9 | 70 | 70 | 64 | 130 | | | | | | | | | | | | |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 4.3 | 0.4 | | None | - | - | - | 16 | 20 | 20 | 17 | 115 | 16.8 | 20 | 20 | 18 | 113 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 115 | 26.9 | 30 | 30 | 25 | 113 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 115 | 47.3 | 50 | 50 | 43 | 113 | |

Table 154: ZXA7, 08 to 14 high static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|-----|---|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 47.1 | 50 | 60 | 50 | 288 | 49.3 | 50 | 60 | 53 | 298 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 288 | 56.8 | 60 | 60 | 53 | 298 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 288 | 79.6 | 80 | 80 | 73 | 298 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 288 | 98.4 | 100 | 100 | 91 | 298 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 288 | 125.5 | 150 | 150 | 115 | 298 | |
| | 230-3-60 | 14.5 | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 9.4 | 1 | | None | - | - | - | 46.6 | 50 | 60 | 49 | 297 | 48.6 | 50 | 60 | 52 | 291 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 297 | 62.4 | 70 | 70 | 57 | 291 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 297 | 88.9 | 90 | 90 | 82 | 291 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 297 | 110.5 | 125 | 125 | 102 | 291 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 297 | 141.8 | 150 | 150 | 130 | 291 | |
| | 460-3-60 | 6.3 | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 4.7 | 0.5 | | None | - | - | - | 21.5 | 25 | 25 | 23 | 162 | 22.5 | 25 | 25 | 24 | 158 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 162 | 31.9 | 35 | 35 | 29 | 158 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 162 | 48.9 | 50 | 50 | 45 | 158 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 162 | 56.8 | 60 | 60 | 52 | 158 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 162 | 69.9 | 70 | 70 | 64 | 158 | |
| | 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 4.3 | 0.4 | | None | - | - | - | 20 | 25 | 25 | 21 | 131 | 20.8 | 25 | 25 | 22 | 129 | |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 131 | 26.9 | 30 | 30 | 25 | 129 | | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 131 | 47.3 | 50 | 50 | 43 | 129 | | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 13.5 | 1.1 | | None | - | - | - | 53.7 | 60 | 60 | 57 | 342 | 55.9 | 60 | 70 | 60 | 352 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 58.5 | 60 | 60 | 57 | 342 | 61.3 | 70 | 70 | 60 | 352 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81.4 | 90 | 90 | 75 | 342 | 84.1 | 90 | 90 | 77 | 352 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 100.1 | 110 | 110 | 92 | 342 | 102.9 | 110 | 110 | 95 | 352 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 127.3 | 150 | 150 | 117 | 342 | 130 | 150 | 150 | 120 | 352 | |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 13.4 | 1 | | None | - | - | - | 53.6 | 60 | 60 | 57 | 342 | 55.6 | 60 | 70 | 59 | 337 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 64.9 | 70 | 70 | 60 | 342 | 67.4 | 70 | 70 | 62 | 337 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.4 | 100 | 100 | 84 | 342 | 93.9 | 100 | 100 | 86 | 337 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113 | 125 | 125 | 104 | 342 | 115.5 | 125 | 125 | 106 | 337 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.3 | 150 | 150 | 133 | 342 | 146.8 | 150 | 150 | 135 | 337 | |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 6.7 | 0.5 | | None | - | - | - | 26.9 | 30 | 30 | 29 | 167 | 27.9 | 30 | 30 | 30 | 163 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.1 | 35 | 35 | 30 | 167 | 34.4 | 35 | 35 | 32 | 163 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.1 | 60 | 60 | 46 | 167 | 51.4 | 60 | 60 | 47 | 163 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58 | 60 | 60 | 53 | 167 | 59.3 | 60 | 60 | 55 | 163 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.1 | 80 | 80 | 65 | 167 | 72.4 | 80 | 80 | 67 | 163 | |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 5.4 | 0.4 | | None | - | - | - | 20.6 | 25 | 25 | 22 | 127 | 21.4 | 25 | 25 | 23 | 124 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 27.3 | 30 | 30 | 25 | 127 | 28.3 | 30 | 30 | 26 | 124 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47.6 | 50 | 50 | 44 | 127 | 48.6 | 50 | 50 | 45 | 124 | |

Table 154: ZXA7, 08 to 14 high static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | | |
|--------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.8 | 13.5 | 1.1 | | None | - | - | - | 63.4 | 70 | 80 | 67 | 397 | 65.6 | 70 | 80 | 70 | 407 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.4 | 70 | 80 | 67 | 397 | 65.6 | 70 | 80 | 70 | 407 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81.4 | 90 | 90 | 75 | 397 | 84.1 | 90 | 90 | 77 | 407 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 100.1 | 110 | 110 | 92 | 397 | 102.9 | 110 | 110 | 95 | 407 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 127.3 | 150 | 150 | 117 | 397 | 130 | 150 | 150 | 120 | 407 | |
| | 230-3-60 | 19.6 | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 13.4 | 1 | | | None | - | - | - | 62.7 | 70 | 80 | 66 | 393 | 64.7 | 70 | 80 | 69 | 398 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 64.9 | 70 | 80 | 66 | 393 | 67.4 | 70 | 80 | 69 | 398 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.4 | 100 | 100 | 84 | 393 | 93.9 | 100 | 100 | 86 | 398 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113 | 125 | 125 | 104 | 393 | 115.5 | 125 | 125 | 106 | 398 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.3 | 150 | 150 | 133 | 393 | 146.8 | 150 | 150 | 135 | 398 |
| | 460-3-60 | 8.2 | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 6.7 | 0.5 | | | None | - | - | - | 28.1 | 30 | 35 | 30 | 194 | 29.1 | 30 | 35 | 31 | 196 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.1 | 35 | 35 | 30 | 194 | 34.4 | 35 | 35 | 32 | 196 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.1 | 60 | 60 | 46 | 194 | 51.4 | 60 | 60 | 47 | 196 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58 | 60 | 60 | 53 | 194 | 59.3 | 60 | 60 | 55 | 196 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.1 | 80 | 80 | 65 | 194 | 72.4 | 80 | 80 | 67 | 196 |
| | 575-3-60 | 6.6 | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 5.4 | 0.4 | | | None | - | - | - | 22.5 | 25 | 25 | 24 | 162 | 23.3 | 25 | 25 | 25 | 164 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 27.3 | 30 | 30 | 25 | 162 | 28.3 | 30 | 30 | 26 | 164 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47.6 | 50 | 50 | 44 | 162 | 48.6 | 50 | 50 | 45 | 164 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZXA7, 08 to 14 high static indoor blower - with powered convenience outlet

Table 155: ZXA7, 08 to 14 high static indoor blower - with powered convenience outlet

| Size (tons) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|----------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| Without VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 10.2 | 1.1 | 8.6 | None | - | - | - | 40.9 | 45 | 50 | 42 | 204 | 42 | 45 | 50 | 43 | 206 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 40.9 | 45 | 50 | 42 | 204 | 42 | 45 | 50 | 43 | 206 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 45.5 | 50 | 50 | 42 | 204 | 46.9 | 50 | 50 | 43 | 206 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 59.8 | 60 | 60 | 55 | 204 | 61.1 | 70 | 70 | 56 | 206 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 10.2 | 1 | 8.6 | None | - | - | - | 40.9 | 45 | 50 | 42 | 209 | 41.9 | 45 | 50 | 43 | 212 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 40.9 | 45 | 50 | 42 | 209 | 41.9 | 45 | 50 | 43 | 212 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 49.8 | 50 | 50 | 46 | 209 | 51 | 60 | 60 | 47 | 212 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 209 | 67.5 | 70 | 70 | 62 | 212 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.8 | 0.5 | 8.6 | None | - | - | - | 20.1 | 25 | 25 | 21 | 103 | 20.6 | 25 | 25 | 21 | 104 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 20.1 | 25 | 25 | 16 | 103 | 20.6 | 25 | 25 | 17 | 104 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 25.9 | 30 | 30 | 24 | 103 | 26.6 | 30 | 30 | 24 | 104 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 29.7 | 30 | 30 | 27 | 103 | 30.3 | 35 | 35 | 28 | 104 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 3.4 | 0.4 | 8.6 | None | - | - | - | 17.4 | 20 | 20 | 18 | 85 | 17.8 | 20 | 20 | 19 | 86 | |
| With VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 9.9 | 1.1 | 8.6 | None | - | - | - | 40.6 | 45 | 50 | 42 | 213 | 41.7 | 45 | 50 | 43 | 215 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 40.6 | 45 | 50 | 42 | 213 | 41.7 | 45 | 50 | 43 | 215 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 45.1 | 50 | 50 | 42 | 213 | 46.5 | 50 | 50 | 43 | 215 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 213 | 60.8 | 70 | 70 | 56 | 215 |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 4.4 | 9.4 | 1 | 8.6 | None | - | - | - | 40.1 | 45 | 50 | 41 | 221 | 41.1 | 45 | 50 | 42 | 223 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 40.1 | 45 | 50 | 41 | 221 | 41.1 | 45 | 50 | 42 | 223 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 48.8 | 50 | 50 | 45 | 221 | 50 | 50 | 46 | 223 | |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 221 | 66.5 | 70 | 70 | 61 | 223 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 2.5 | 4.7 | 0.5 | 8.6 | None | - | - | - | 20 | 25 | 25 | 21 | 109 | 20.5 | 25 | 25 | 21 | 110 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 20 | 20 | 25 | 16 | 109 | 20.5 | 25 | 25 | 17 | 110 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 25.8 | 30 | 30 | 24 | 109 | 26.4 | 30 | 30 | 24 | 110 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 29.6 | 30 | 30 | 27 | 109 | 30.2 | 35 | 35 | 28 | 110 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 4.4 | 4.3 | 0.4 | 8.6 | None | - | - | - | 18.3 | 20 | 20 | 19 | 97 | 18.7 | 20 | 20 | 98 | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 49.4 | 50 | 60 | 53 | 262 | 51.6 | 60 | 60 | 55 | 272 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 262 | 62.1 | 70 | 70 | 57 | 272 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 262 | 85 | 90 | 90 | 78 | 272 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 262 | 103.8 | 110 | 110 | 95 | 272 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 262 | 130.9 | 150 | 150 | 120 | 272 |
| | | | | | | | | | | | | None | - | - | - | 48.9 | 50 | 60 | 52 | 271 | 50.9 | 60 | 60 | 55 | 266 |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.4 | 1 | 8.6 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 271 | 67.8 | 70 | 70 | 62 | 266 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 271 | 94.3 | 100 | 100 | 87 | 266 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 271 | 115.9 | 125 | 125 | 107 | 266 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 271 | 147.1 | 150 | 150 | 135 | 266 |
| | | | | | | | | | | | | None | - | - | - | 23.2 | 25 | 25 | 25 | 136 | 24.2 | 25 | 25 | 26 | 132 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 136 | 34.6 | 35 | 35 | 32 | 132 |
| 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.7 | 0.5 | 8.6 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 136 | 51.6 | 60 | 60 | 47 | 132 | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 136 | 59.4 | 60 | 60 | 55 | 132 | |
| | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 136 | 72.6 | 80 | 80 | 67 | 132 | |
| | | | | | | | | | | | None | - | - | - | 17.7 | 20 | 20 | 19 | 117 | 18.5 | 20 | 20 | 20 | 114 | |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 4.3 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 117 | 29 | 30 | 30 | 27 | 114 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 117 | 49.4 | 50 | 50 | 45 | 114 | |

Table 155: ZXA7, 08 to 14 high static indoor blower - with powered convenience outlet

| Size (tons) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|-----|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|----------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 09 (8.5) | 208-3-60 | 14.5 | 98 | 23 | 14.5 | | | | | 98 | 23 | 2.3 | 9.9 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 59.4 | 60 | | | | | 60 | 55 | 292 | | | 62.1 | 70 | 70 | 58 | 302 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 82.3 | 90 | | | | | 90 | 76 | 292 | | | 85 | 90 | 90 | 78 | 302 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 101 | 110 | | | | | 110 | 93 | 292 | | | 103.8 | 110 | 110 | 95 | 302 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 128.1 | 150 | | | | | 150 | 118 | 292 | | | 130.9 | 150 | 150 | 120 | 302 |
| 230-3-60 | 14.5 | | 98 | 23 | 14.5 | 98 | 23 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 50.9 | 60 | 60 | 54 | 301 | 52.9 | 60 | 60 | 57 | 296 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 301 | 67.8 | 70 | 70 | 62 | 296 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 301 | 94.3 | 100 | 100 | 87 | 296 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 301 | 115.9 | 125 | 125 | 107 | 296 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 301 | 147.1 | 150 | 150 | 135 | 296 |
| 460-3-60 | 6.3 | | 55 | 10 | 6.3 | 55 | 10 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 23.7 | 25 | 25 | 25 | 164 | 24.7 | 25 | 25 | 27 | 160 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 164 | 34.6 | 35 | 35 | 32 | 160 |
| | | 12846 | | | | | | | | | | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 164 | 51.6 | 60 | 60 | 47 | 160 | |
| | | 13346 | | | | | | | | | | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 164 | 59.4 | 60 | 60 | 55 | 160 | |
| | | 14246 | | | | | | | | | | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 164 | 72.6 | 80 | 80 | 67 | 160 | |
| 575-3-60 | 6 | 41 | 9 | 6 | 41 | 9 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21.7 | 25 | 25 | 23 | 133 | 22.5 | 25 | 25 | 24 | 130 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 133 | 29 | 30 | 30 | 27 | 130 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 133 | 49.4 | 50 | 50 | 45 | 130 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 13.5 | 1.1 | 8.6 | None | - | - | - | 58 | 60 | 70 | 62 | 346 | 60.2 | 70 | 70 | 65 | 356 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.9 | 70 | 70 | 62 | 346 | 66.6 | 70 | 70 | 65 | 356 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 86.8 | 90 | 90 | 80 | 346 | 89.5 | 90 | 90 | 82 | 356 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 105.5 | 110 | 110 | 97 | 346 | 108.3 | 110 | 110 | 100 | 356 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 132.6 | 150 | 150 | 122 | 346 | 135.4 | 150 | 150 | 125 | 356 |
| | 230-3-60 | 16 | 110 | 25 | 15.6 | 110 | 24 | 2.3 | 13.4 | 1 | 8.6 | None | - | - | - | 57.9 | 60 | 70 | 62 | 346 | 59.9 | 60 | 70 | 64 | 341 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 70.3 | 80 | 80 | 65 | 346 | 72.8 | 80 | 80 | 67 | 341 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 96.8 | 100 | 100 | 89 | 346 | 99.3 | 100 | 100 | 91 | 341 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 118.4 | 125 | 125 | 109 | 346 | 120.9 | 125 | 125 | 111 | 341 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 149.6 | 150 | 150 | 138 | 346 | 152.1 | 175 | 175 | 140 | 341 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 1.3 | 6.7 | 0.5 | 8.6 | None | - | - | - | 29.1 | 30 | 35 | 31 | 169 | 30.1 | 35 | 35 | 32 | 165 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 35.8 | 40 | 40 | 33 | 169 | 37.1 | 40 | 40 | 34 | 165 |
| 12846 | | | | | | | | | | | | 27.8 | 1 | 33.4 | 52.8 | 60 | 60 | 49 | 169 | 54.1 | 60 | 60 | 50 | 165 | |
| 13346 | | | | | | | | | | | | 33 | 1 | 39.7 | 60.7 | 70 | 70 | 56 | 169 | 61.9 | 70 | 70 | 57 | 165 | |
| 14246 | | | | | | | | | | | | 41.7 | 2 | 50.2 | 73.8 | 80 | 80 | 68 | 169 | 75.1 | 80 | 80 | 69 | 165 | |
| 575-3-60 | 5.7 | 38.9 | 9 | 5.8 | 38.9 | 9 | 1.1 | 5.4 | 0.4 | 8.6 | None | - | - | - | 22.3 | 25 | 25 | 24 | 129 | 23.1 | 25 | 25 | 25 | 126 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 129 | 30.4 | 35 | 35 | 28 | 126 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 129 | 50.8 | 60 | 60 | 47 | 126 | |

Table 155: ZXA7, 08 to 14 high static indoor blower - with powered convenience outlet

| Size (tons) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect ⁴ rating | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect ⁴ rating/ pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|----------------------|---|---|---|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 14 (12.5) | 208-3-60 | 19.6 | 136 | 31 | 19.6 | | | | | 136 | 31 | 5.8 | 13.5 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 67.7 | 70 | | | | | 80 | 72 | 401 | | | 69.9 | 70 | 80 | 75 | 411 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 86.8 | 90 | | | | | 90 | 80 | 401 | | | 89.5 | 90 | 90 | 82 | 411 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 105.5 | 110 | | | | | 110 | 97 | 401 | | | 108.3 | 110 | 110 | 100 | 411 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 132.6 | 150 | | | | | 150 | 122 | 401 | | | 135.4 | 150 | 150 | 125 | 411 |
| None | - | | | | | | | - | - | 67 | 70 | | | | | 80 | 71 | 397 | | | 69 | 70 | 80 | 74 | 402 |
| 230-3-60 | 19.6 | | 136 | 31 | 19.6 | 136 | 31 | 5.2 | 13.4 | 1 | 8.6 | 11725 | 16 | 1 | 38.5 | 70.3 | 80 | 80 | 71 | 397 | 72.8 | 80 | 80 | 74 | 402 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 96.8 | 100 | 100 | 89 | 397 | 99.3 | 100 | 100 | 91 | 402 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 118.4 | 125 | 125 | 109 | 397 | 120.9 | 125 | 125 | 111 | 402 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 149.6 | 150 | 150 | 138 | 397 | 152.1 | 175 | 175 | 140 | 402 |
| | | | | | | | | | | | | None | - | - | - | 30.3 | 35 | 35 | 32 | 196 | 31.3 | 35 | 35 | 34 | 199 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 35.8 | 40 | 40 | 33 | 196 | 37.1 | 40 | 40 | 34 | 199 |
| 460-3-60 | 8.2 | | 66.1 | 13 | 8.2 | 66.1 | 13 | 2.9 | 6.7 | 0.5 | 8.6 | 12846 | 27.8 | 1 | 33.4 | 52.8 | 60 | 60 | 49 | 196 | 54.1 | 60 | 60 | 50 | 199 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 60.7 | 70 | 70 | 56 | 196 | 61.9 | 70 | 70 | 57 | 199 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 73.8 | 80 | 80 | 68 | 196 | 75.1 | 80 | 80 | 69 | 199 |
| | | | | | | | | | | | | None | - | - | - | 24.2 | 25 | 30 | 26 | 164 | 25 | 25 | 30 | 27 | 165 |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 164 | 30.4 | 35 | 35 | 28 | 165 |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 164 | 50.8 | 60 | 60 | 47 | 165 |
| 575-3-60 | 6.6 | | 55.3 | 10 | 6.6 | 55.3 | 10 | 2.2 | 5.4 | 0.4 | 8.6 | None | - | - | - | 24.2 | 25 | 30 | 26 | 164 | 25 | 25 | 30 | 27 | 165 |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 164 | 30.4 | 35 | 35 | 28 | 165 |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 164 | 50.8 | 60 | 60 | 47 | 165 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZY04 to 12 standard static indoor blower - without powered convenience outlet

Table 156: ZY04 to 12 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed Kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 6.6 | 1.5 | | None | - | - | - | 28.9 | 30 | 45 | 28 | 84 | 30.4 | 35 | 45 | 30 | 88 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 37.8 | 40 | 45 | 35 | 84 | 39.6 | 40 | 45 | 36 | 88 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 55.8 | 60 | 60 | 51 | 84 | 57.6 | 60 | 60 | 53 | 88 | | |
| | 230-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 6 | 1.3 | | None | - | - | - | 28.3 | 30 | 40 | 28 | 84 | 29.6 | 30 | 45 | 29 | 87 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 41.4 | 45 | 45 | 38 | 84 | 43 | 45 | 45 | 40 | 87 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 62.3 | 70 | 70 | 57 | 84 | 63.9 | 70 | 70 | 59 | 87 | | |
| | 208-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 6.6 | 1.1 | | None | - | - | - | 21 | 25 | 30 | 21 | 78 | 22.1 | 25 | 30 | 22 | 81 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 25.3 | 30 | 30 | 23 | 78 | 26.6 | 30 | 30 | 24 | 81 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 35.6 | 40 | 40 | 33 | 78 | 37 | 40 | 40 | 34 | 81 | | |
| | 230-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 6 | 1 | | None | - | - | - | 20.4 | 25 | 30 | 20 | 78 | 21.4 | 25 | 30 | 22 | 81 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 27 | 30 | 30 | 25 | 78 | 28.3 | 30 | 30 | 26 | 81 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 39.1 | 40 | 40 | 36 | 78 | 40.4 | 45 | 45 | 37 | 81 | | |
| | 460-3-60 | 5.8 | 38 | 9 | | | | 0.8 | 3.2 | 0.5 | | None | - | - | - | 11.3 | 15 | 15 | 11 | 42 | 11.8 | 15 | 15 | 12 | 43 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 13 | 15 | 15 | 12 | 42 | 13.6 | 15 | 15 | 13 | 43 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.3 | 25 | 25 | 20 | 42 | 21.9 | 25 | 25 | 20 | 43 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | | | | 0.6 | 6 | 0.4 | | None | - | - | - | 7.8 | 15 | 15 | 8 | 39 | 8.2 | 15 | 15 | 8 | 40 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.1 | 15 | 15 | 13 | 39 | 14.6 | 15 | 15 | 13 | 40 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.6 | 20 | 20 | 18 | 39 | 20.1 | 25 | 25 | 19 | 40 | | |
| 05 (4) | 208-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 8.4 | 1.5 | | None | - | - | - | 37.1 | 40 | 50 | 36 | 122 | 38.6 | 40 | 60 | 38 | 126 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 40 | 40 | 50 | 37 | 122 | 41.9 | 45 | 60 | 39 | 126 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 58 | 60 | 60 | 53 | 122 | 59.9 | 60 | 60 | 55 | 126 | | |
| | 230-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 7.6 | 1.3 | | None | - | - | - | 36.3 | 40 | 50 | 35 | 122 | 37.6 | 40 | 50 | 37 | 125 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 43.4 | 45 | 50 | 40 | 122 | 45 | 45 | 50 | 41 | 125 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 64.3 | 70 | 70 | 59 | 122 | 65.9 | 70 | 70 | 61 | 125 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 8.4 | 1.1 | | None | - | - | - | 26.9 | 30 | 40 | 27 | 88 | 28 | 30 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 27.5 | 30 | 40 | 27 | 88 | 28.9 | 30 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 37.9 | 40 | 40 | 35 | 88 | 39.3 | 40 | 40 | 36 | 91 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 7.6 | 1 | | None | - | - | - | 26.1 | 30 | 35 | 26 | 88 | 27.1 | 30 | 40 | 27 | 91 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 29 | 30 | 35 | 27 | 88 | 30.3 | 35 | 40 | 28 | 91 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.1 | 45 | 45 | 38 | 88 | 42.4 | 45 | 45 | 39 | 91 | | |
| | 460-3-60 | 6.2 | 41 | 10 | | | | 0.8 | 4 | 0.5 | | None | - | - | - | 12.6 | 15 | 15 | 13 | 45 | 13.1 | 15 | 15 | 13 | 46 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14 | 15 | 15 | 13 | 45 | 14.6 | 15 | 15 | 13 | 46 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.3 | 25 | 25 | 20 | 45 | 22.9 | 25 | 25 | 21 | 46 | | |
| | 575-3-60 | 4.8 | 33 | 8 | | | | 0.6 | 7.6 | 0.4 | | None | - | - | - | 9.6 | 15 | 15 | 10 | 35 | 10 | 15 | 15 | 10 | 36 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.9 | 15 | 15 | 14 | 35 | 15.4 | 20 | 20 | 14 | 36 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 20.4 | 25 | 25 | 19 | 35 | 20.9 | 25 | 25 | 19 | 36 | | |

Table 156: ZY04 to 12 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed Kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|----------------------|--------------|------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|-------|----|------|------|------|----|----|-----|------|------|----|----|-----|-------|-------|------|------|------|------|----|----|-----|------|------|----|----|-----|-------|-------|------|------|-------|-------|-----|-----|-----|-------|-------|-----|-----|-----|-------|-------|------|------|-------|-------|-----|-----|-----|-------|-------|-----|-----|-----|-------|-------|------|------|------|----|----|----|-----|------|------|----|----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | | None | - | - | - | 40.4 | 45 | 50 | 43 | 208 | 42.6 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | None | - | - | - | 40.4 | 45 | 50 | 43 | 211 | 42.4 | 45 | 50 | 45 | 206 | 11725 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 211 | 57.1 | 60 | 60 | 53 | 206 | 12525 | 24.8 | 1 | 59.7 | 81.1 | 90 | 90 | 75 | 211 | 83.6 | 90 | 90 | 77 | 206 | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 211 | 105.3 | 110 | 110 | 97 | 206 | 14225 | 42.4 | 2 | 102 | 134 | 150 | 150 | 123 | 211 | 136.5 | 150 | 150 | 126 | 206 | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | None | - | - | - | 18.9 | 20 | 25 | 20 | 106 | 19.9 | 20 | 25 | 21 | 103 | None | - | - | - | 18.9 | 20 | 25 | 20 | 106 | 19.9 | 20 | 25 | 21 | 103 | 11746 | 16.5 | 1 | 19.8 | 28 | 30 | 30 | 26 | 106 | 29.3 | 30 | 30 | 27 | 103 | 12846 | 27.8 | 1 | 33.4 | 45 | 45 | 45 | 41 | 106 | 46.3 | 50 | 50 | 43 | 103 | 13346 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 106 | 54.1 | 60 | 60 | 50 | 103 | 14246 | 41.7 | 2 | 50.2 | 66 | 70 | 70 | 61 | 106 | 67.3 | 70 | 70 | 62 | 103 | |
| | | | | | | | | | | | | None | - | - | - | 13.7 | 15 | 15 | 14 | 85 | 14.5 | 15 | 15 | 15 | 83 | 11758 | 17 | 1 | 16.4 | 23 | 25 | 25 | 21 | 85 | 24 | 25 | 25 | 22 | 83 | 13458 | 34 | 1 | 32.7 | 43.4 | 45 | 45 | 40 | 85 | 44.4 | 45 | 45 | 41 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | | | | | | | | | | | | | | | |
| | 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 211 | 42.6 | 45 | 50 | 45 | 206 | 11725 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 211 | 57.1 | 60 | 60 | 53 | 206 | 12525 | 24.8 | 1 | 59.7 | 81.1 | 90 | 90 | 75 | 211 | 83.6 | 90 | 90 | 77 | 206 | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 211 | 105.3 | 110 | 110 | 97 | 206 | 14225 | 42.4 | 2 | 102 | 134 | 150 | 150 | 123 | 211 | 136.5 | 150 | 150 | 126 | 206 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | None | - | - | - | 19.2 | 20 | 25 | 20 | 106 | 20.2 | 25 | 25 | 21 | 103 | None | - | - | - | 19.2 | 20 | 25 | 20 | 106 | 20.2 | 25 | 25 | 21 | 103 | 11746 | 16.5 | 1 | 19.8 | 28 | 30 | 30 | 26 | 106 | 29.3 | 30 | 30 | 27 | 103 | 12846 | 27.8 | 1 | 33.4 | 45 | 45 | 45 | 41 | 106 | 46.3 | 50 | 50 | 43 | 103 | 13346 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 106 | 54.1 | 60 | 60 | 50 | 103 | 14246 | 41.7 | 2 | 50.2 | 66 | 70 | 70 | 61 | 106 | 67.3 | 70 | 70 | 62 | 103 |
| | | | | | | | | | | | | | None | - | - | - | 15 | 20 | 20 | 16 | 85 | 15.8 | 20 | 20 | 17 | 83 | 11758 | 17 | 1 | 16.4 | 23 | 25 | 25 | 21 | 85 | 24 | 25 | 25 | 22 | 83 | 13458 | 34 | 1 | 32.7 | 43.4 | 45 | 45 | 40 | 85 | 44.4 | 45 | 45 | 41 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | | | | | | | | | | | | | | |

Table 156: ZY04 to 12 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed Kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 5.2 | | | | 1.1 | | | | | None | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 48.1 | 50 | | | | | 60 | 49 | 264 | | | 50.9 | 60 | 60 | 52 | 274 | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 71 | 80 | | | | | 80 | 65 | 264 | | | 73.8 | 80 | 80 | 68 | 274 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 89.8 | 90 | | | | | 90 | 83 | 264 | | | 92.5 | 100 | 100 | 85 | 274 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 116.9 | 125 | | | | | 125 | 108 | 264 | | | 119.6 | 125 | 125 | 110 | 274 | |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 5.2 | 1 | | | None | - | - | - | 46.4 | 50 | 60 | 49 | 264 | 48.4 | 50 | 60 | 51 | 269 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 264 | 57.1 | 60 | 60 | 53 | 269 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 81.1 | 90 | 90 | 75 | 264 | 83.6 | 90 | 90 | 77 | 269 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 264 | 105.3 | 110 | 110 | 97 | 269 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 134 | 150 | 150 | 123 | 264 | 136.5 | 150 | 150 | 126 | 269 |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 2.6 | 0.5 | | | None | - | - | - | 23.1 | 25 | 30 | 24 | 128 | 24.1 | 25 | 30 | 25 | 130 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 28 | 30 | 30 | 26 | 128 | 29.3 | 30 | 30 | 27 | 130 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 45 | 45 | 45 | 41 | 128 | 46.3 | 50 | 50 | 43 | 130 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 128 | 54.1 | 60 | 60 | 50 | 130 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 66 | 70 | 70 | 61 | 128 | 67.3 | 70 | 70 | 62 | 130 |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2 | 0.4 | | | None | - | - | - | 17 | 20 | 20 | 18 | 99 | 17.8 | 20 | 20 | 19 | 101 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23 | 25 | 25 | 21 | 99 | 24 | 25 | 25 | 22 | 101 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 43.4 | 45 | 45 | 40 | 99 | 44.4 | 45 | 45 | 41 | 101 |
| A7 (6) | 208-3-60 | | 17.6 | 136 | 27 | | | | 2.3 | 7 | 1.1 | | None | - | - | - | 33.6 | 35 | 50 | 34 | 206 | 35.8 | 40 | 50 | 36 | 211 |
| | | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 33.6 | 35 | 50 | 34 | 206 | 35.8 | 40 | 50 | 36 | 211 |
| | | 11725 | | | | | | | | | | | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 206 | 53.1 | 60 | 60 | 49 | 211 | |
| | | 12525 | | | | | | | | | | | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 206 | 76 | 80 | 80 | 70 | 211 | |
| | | 13225 | | | | | | | | | | | 24.8 | 1 | 66.6 | 96.2 | 90 | 90 | 83 | 206 | 105.3 | 100 | 100 | 85 | 211 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 7.2 | 1 | | | None | - | - | - | 33.8 | 35 | 50 | 34 | 208 | 35.8 | 40 | 50 | 36 | 212 |
| | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 33.8 | 35 | 50 | 34 | 208 | 35.8 | 40 | 50 | 36 | 212 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 208 | 59.6 | 60 | 60 | 55 | 212 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 208 | 86.1 | 90 | 90 | 79 | 212 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 208 | 105.3 | 110 | 110 | 97 | 212 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 3.6 | 0.5 | | | None | - | - | - | 16.8 | 20 | 25 | 17 | 103 | 17.8 | 20 | 25 | 18 | 105 |
| | | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 16.8 | 20 | 25 | 12 | 103 | 17.8 | 20 | 25 | 14 | 105 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 103 | 30.5 | 35 | 35 | 28 | 105 |
| | | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 42.9 | 45 | 45 | 39 | 103 | 44.1 | 45 | 45 | 41 | 105 |
| | | | | | | | | | | | | | 13446 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 103 | 54.1 | 60 | 60 | 50 | 105 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2.5 | 0.4 | | | None | - | - | - | 12.6 | 15 | 15 | 13 | 78 | 13.4 | 15 | 15 | 14 | 80 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 78 | 24.6 | 25 | 25 | 23 | 80 |
| | | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 34 | 35 | 35 | 31 | 78 | 35 | 35 | 35 | 32 | 80 |

Table 156: ZY04 to 12 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed Kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.2 | 45 | 50 | 45 | 246 | 44.4 | 45 | 50 | 47 | 256 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 246 | 53.1 | 60 | 60 | 49 | 256 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 246 | 76 | 80 | 80 | 70 | 256 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 246 | 94.8 | 100 | 100 | 87 | 256 | | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 42.4 | 45 | 50 | 45 | 248 | 44.4 | 45 | 50 | 47 | 243 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 248 | 59.6 | 60 | 60 | 55 | 243 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 248 | 86.1 | 90 | 90 | 79 | 243 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 248 | 107.8 | 110 | 110 | 99 | 243 | | |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 19.9 | 20 | 25 | 21 | 125 | 20.9 | 25 | 25 | 22 | 121 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 125 | 30.5 | 35 | 35 | 28 | 121 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 125 | 47.5 | 50 | 50 | 44 | 121 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 125 | 55.4 | 60 | 60 | 51 | 121 | | |
| | 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 14.2 | 15 | 15 | 15 | 93 | 15 | 15 | 15 | 16 | 90 | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 93 | 24.6 | 25 | 25 | 23 | 90 | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 93 | 45 | 45 | 45 | 41 | 90 | | |
| | | | | | | | | | | | | None | - | - | - | 42.4 | 45 | 50 | 45 | 246 | 44.6 | 45 | 50 | 47 | 256 | | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.4 | 45 | 50 | 45 | 246 | 44.6 | 45 | 50 | 47 | 256 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 246 | 53.1 | 60 | 60 | 49 | 256 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 246 | 76 | 80 | 80 | 70 | 256 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 246 | 94.8 | 100 | 100 | 87 | 256 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 42.6 | 45 | 50 | 45 | 248 | 44.6 | 45 | 50 | 47 | 243 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 248 | 59.6 | 60 | 60 | 55 | 243 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 248 | 86.1 | 90 | 90 | 79 | 243 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 248 | 107.8 | 110 | 110 | 99 | 243 | | |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 20.2 | 25 | 25 | 21 | 125 | 21.2 | 25 | 25 | 23 | 121 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 125 | 30.5 | 35 | 35 | 28 | 121 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 125 | 47.5 | 50 | 50 | 44 | 121 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 125 | 55.4 | 60 | 60 | 51 | 121 | | |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 15.5 | 20 | 20 | 16 | 93 | 16.3 | 20 | 20 | 17 | 90 | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 93 | 24.6 | 25 | 25 | 23 | 90 | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 93 | 45 | 45 | 45 | 41 | 90 | | |
| | | | | | | | | | | | | None | - | - | - | 42.6 | 45 | 50 | 45 | 246 | 44.6 | 45 | 50 | 47 | 256 | | |

Table 156: ZY04 to 12 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed Kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.8 | 7 | 1.1 | | None | - | - | - | 48.8 | 50 | 60 | 52 | 302 | 51 | 60 | 60 | 54 | 312 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 52 | 302 | 53.1 | 60 | 60 | 54 | 312 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 302 | 76 | 80 | 80 | 70 | 312 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 302 | 94.8 | 100 | 100 | 87 | 312 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 302 | 121.9 | 125 | 125 | 112 | 312 |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 7.2 | 1 | | None | - | - | - | 48.4 | 50 | 60 | 51 | 301 | 50.4 | 60 | 60 | 53 | 305 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 301 | 59.6 | 60 | 60 | 55 | 305 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 301 | 86.1 | 90 | 90 | 79 | 305 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 301 | 107.8 | 110 | 110 | 99 | 305 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 301 | 139 | 150 | 150 | 128 | 305 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 3.6 | 0.5 | | None | - | - | - | 24.1 | 25 | 30 | 25 | 146 | 25.1 | 30 | 30 | 27 | 148 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 146 | 30.5 | 35 | 35 | 28 | 148 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 146 | 47.5 | 50 | 50 | 44 | 148 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 146 | 55.4 | 60 | 60 | 51 | 148 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 146 | 68.5 | 70 | 70 | 63 | 148 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2.5 | 0.4 | | None | - | - | - | 17.5 | 20 | 20 | 19 | 107 | 18.3 | 20 | 20 | 19 | 109 |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 107 | 24.6 | 25 | 25 | 23 | 109 |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 107 | 45 | 45 | 45 | 41 | 109 |

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZY04 to 12 standard static indoor blower - with powered convenience outlet

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|------------|--|--|------------------------------------|-----|---------------------|---|-----|---|-----|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | 04 (3) | 208-1-60 | 16.7 | 79 | 26 | | | | | | | | 1.4 | 6.6 | | | | 1.5 | 8.6 | | None | - | - | - | 33.2 | 35 |
| 10625 | 4.9 | | | | | | | 1 | 23.6 | 43.1 | 45 | | | | | 45 | 40 | 89 | | | 45 | 45 | 50 | 41 | 92 | | |
| 11125 | 7.9 | | | | | | | 1 | 38 | 61.1 | 70 | | | | | 70 | 56 | 89 | | | 63 | 70 | 70 | 58 | 92 | | |
| 230-1-60 | 16.7 | | 79 | 26 | | | | 1.4 | 6 | 1.3 | 8.6 | None | - | - | - | 32.6 | 35 | 45 | 33 | 89 | 33.9 | 35 | 50 | 34 | 92 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 46.8 | 50 | 50 | 43 | 89 | 48.4 | 50 | 50 | 45 | 92 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 67.6 | 70 | 70 | 62 | 89 | 69.3 | 70 | 70 | 64 | 92 | | |
| 208-3-60 | 10.4 | | 73 | 16 | | | | 1.4 | 6.6 | 1.1 | 8.6 | None | - | - | - | 25.3 | 30 | 35 | 26 | 83 | 26.4 | 30 | 35 | 27 | 85 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 30.6 | 35 | 35 | 28 | 83 | 32 | 35 | 35 | 29 | 85 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41 | 45 | 45 | 38 | 83 | 42.4 | 45 | 45 | 39 | 85 | | |
| 230-3-60 | 10.4 | | 73 | 16 | | | | 1.4 | 6 | 1 | 8.6 | None | - | - | - | 24.7 | 25 | 35 | 25 | 83 | 25.7 | 30 | 35 | 27 | 85 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 32.4 | 35 | 35 | 30 | 83 | 33.6 | 35 | 35 | 31 | 85 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 44.5 | 45 | 45 | 41 | 83 | 45.8 | 50 | 50 | 42 | 85 | | |
| 460-3-60 | 5.8 | | 38 | 9 | | | | 0.8 | 3.2 | 0.5 | 8.6 | None | - | - | - | 13.5 | 15 | 15 | 14 | 44 | 14 | 15 | 15 | 14 | 45 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.7 | 20 | 20 | 14 | 44 | 16.3 | 20 | 20 | 15 | 45 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.9 | 25 | 25 | 22 | 44 | 24.6 | 25 | 25 | 23 | 45 | | |
| 575-3-60 | 3.8 | | 36.5 | 6 | | | | 0.6 | 6 | 0.4 | 8.6 | 11446 | 14 | 1 | 16.8 | 27.7 | 30 | 30 | 25 | 44 | 28.3 | 30 | 30 | 26 | 45 | | |
| | | | | | | | | | | | | None | - | - | - | 9.5 | 15 | 15 | 10 | 41 | 9.9 | 15 | 15 | 10 | 41 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 16.3 | 20 | 20 | 15 | 41 | 16.8 | 20 | 20 | 15 | 41 | | |
| 05 (4) | 208-1-60 | | 21.8 | 117 | 34 | | | | 1.4 | 8.4 | 1.5 | 8.6 | None | - | - | - | 41.4 | 45 | 60 | 41 | 127 | 42.9 | 45 | 60 | 43 | 130 | |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 45.4 | 50 | 60 | 42 | 127 | 47.3 | 50 | 60 | 43 | 130 | |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 63.4 | 70 | 70 | 58 | 127 | 65.3 | 70 | 70 | 60 | 130 | |
| | 230-1-60 | | 21.8 | 117 | 34 | | | | 1.4 | 7.6 | 1.3 | 8.6 | None | - | - | - | 40.6 | 45 | 60 | 40 | 127 | 41.9 | 45 | 60 | 42 | 130 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48.8 | 50 | 60 | 45 | 127 | 50.4 | 60 | 60 | 46 | 130 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 69.6 | 70 | 70 | 64 | 127 | 71.3 | 80 | 80 | 66 | 130 | |
| | 208-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 8.4 | 1.1 | 8.6 | None | - | - | - | 31.2 | 35 | 40 | 32 | 93 | 32.3 | 35 | 45 | 33 | 95 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 32.9 | 35 | 40 | 32 | 93 | 34.3 | 35 | 45 | 33 | 95 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.3 | 45 | 45 | 40 | 93 | 44.6 | 45 | 45 | 41 | 95 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 7.6 | 1 | 8.6 | 11625 | 12 | 1 | 33.3 | 57.5 | 60 | 60 | 53 | 93 | 58.9 | 60 | 60 | 54 | 95 | | |
| | | | | | | | | | | | | None | - | - | - | 30.4 | 35 | 40 | 31 | 93 | 31.4 | 35 | 45 | 32 | 95 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.4 | 35 | 40 | 32 | 93 | 35.6 | 40 | 45 | 33 | 95 | | |
| | 460-3-60 | 6.2 | 41 | 10 | | | | 0.8 | 4 | 0.5 | 8.6 | 11625 | 16 | 1 | 38.5 | 63 | 70 | 70 | 58 | 93 | 64.3 | 70 | 70 | 59 | 95 | | |
| | | | | | | | | | | | | None | - | - | - | 14.8 | 15 | 20 | 15 | 47 | 15.3 | 20 | 20 | 16 | 48 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.7 | 20 | 20 | 15 | 47 | 17.3 | 20 | 20 | 16 | 48 | | |
| | 575-3-60 | 4.8 | 33 | 8 | | | | 0.6 | 7.6 | 0.4 | 8.6 | 11146 | 11.5 | 1 | 13.8 | 24.9 | 25 | 25 | 23 | 47 | 25.6 | 30 | 30 | 24 | 48 | | |
| | | | | | | | | | | | | None | - | - | - | 11.4 | 15 | 15 | 12 | 37 | 11.8 | 15 | 15 | 12 | 38 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 17.1 | 20 | 20 | 16 | 37 | 17.6 | 20 | 20 | 16 | 38 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 37 | 23.1 | 25 | 25 | 21 | 38 | | |

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|---------------------|---|---|--|-----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 06 (5) | 208-1-60 | 25 | 134 | 39 | | | | 2.3 | 8.4 | 1.5 | 8.6 | None | - | - | - | 46.3 | 50 | 70 | 46 | 145 | 47.8 | 50 | 70 | 48 | 149 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 46.3 | 50 | 70 | 46 | 145 | 47.8 | 50 | 70 | 48 | 149 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 63.4 | 70 | 70 | 58 | 145 | 65.3 | 70 | 70 | 60 | 149 | | |
| | | 230-1-60 | 25 | 134 | 39 | | | | 2.3 | 7.6 | 1.3 | 8.6 | None | - | - | - | 45.5 | 50 | 70 | 45 | 145 | 46.8 | 50 | 70 | 47 | 148 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48.8 | 50 | 70 | 45 | 145 | 50.4 | 60 | 70 | 47 | 148 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 69.6 | 70 | 70 | 64 | 145 | 71.3 | 80 | 80 | 66 | 148 | |
| | 208-3-60 | 15.9 | 110 | 25 | | | | 2.3 | 8.4 | 1.1 | 8.6 | None | - | - | - | 34.9 | 35 | 50 | 36 | 121 | 36 | 40 | 50 | 37 | 124 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 34.9 | 35 | 50 | 36 | 121 | 36 | 40 | 50 | 37 | 124 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.3 | 45 | 50 | 40 | 121 | 44.6 | 45 | 50 | 41 | 124 | | |
| | | 230-3-60 | 15.9 | 110 | 25 | | | | 2.3 | 7.6 | 1 | 8.6 | 11625 | 12 | 1 | 33.3 | 57.5 | 60 | 60 | 53 | 121 | 58.9 | 60 | 60 | 54 | 124 | |
| | | | | | | | | | | | | | None | - | - | - | 34.1 | 35 | 45 | 35 | 121 | 35.1 | 40 | 50 | 36 | 124 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.4 | 35 | 45 | 35 | 121 | 35.6 | 40 | 50 | 36 | 124 | |
| | 460-3-60 | 7.1 | 52 | 11 | | | | 1.3 | 4 | 0.5 | 8.6 | 11125 | 10.5 | 1 | 25.3 | 46.5 | 50 | 50 | 43 | 121 | 47.8 | 50 | 50 | 44 | 124 | | |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63 | 70 | 70 | 58 | 121 | 64.3 | 70 | 70 | 59 | 124 | | |
| | | | | | | | | | | | | None | - | - | - | 16.4 | 20 | 20 | 17 | 59 | 16.9 | 20 | 20 | 17 | 60 | | |
| | | 575-3-60 | 5.1 | 39.5 | 8 | | | | 1.1 | 7.6 | 0.4 | 8.6 | 11146 | 6 | 1 | 7.2 | 16.7 | 20 | 20 | 15 | 59 | 17.3 | 20 | 20 | 16 | 60 | |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.7 | 30 | 30 | 26 | 59 | 29.3 | 30 | 30 | 27 | 60 | |
| | | | | | | | | | | | | | None | - | - | - | 12.3 | 15 | 15 | 13 | 44 | 12.7 | 15 | 15 | 13 | 45 | |
| | 07 (6) | 208-3-60 | 19 | 123 | 30 | | | | 2.3 | 5.2 | 1.1 | 8.6 | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 44 | 23.1 | 25 | 25 | 21 | 45 | |
| | | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 33.6 | 35 | 35 | 31 | 44 | 34.1 | 35 | 35 | 31 | 45 | |
| | | | | | | | | | | | | | None | - | - | - | 37.9 | 40 | 50 | 38 | 169 | 40.1 | 45 | 50 | 41 | 179 | |
| | | | 230-3-60 | 19 | 123 | 30 | | | | 2.3 | 5.2 | 1 | 8.6 | 10725 | 4.9 | 1 | 13.6 | 37.9 | 40 | 50 | 38 | 169 | 40.1 | 45 | 50 | 41 | 179 |
| | | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 169 | 56.3 | 60 | 60 | 52 | 179 |
| | | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.4 | 80 | 80 | 70 | 169 | 79.1 | 80 | 80 | 73 | 179 |
| 460-3-60 | | 9.7 | | 62 | 15 | | | | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 37.9 | 40 | 50 | 38 | 172 | 39.9 | 40 | 50 | 40 | 167 | |
| | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 37.9 | 40 | 50 | 38 | 172 | 39.9 | 40 | 50 | 40 | 167 | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 172 | 62.5 | 70 | 70 | 58 | 167 | |
| 575-3-60 | | 7.4 | 50 | 12 | | | | 1.1 | 2 | 0.4 | 8.6 | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 172 | 89 | 90 | 90 | 82 | 167 | | |
| | | | | | | | | | | | | None | - | - | - | 19.5 | 20 | 25 | 20 | 88 | 20.5 | 25 | 25 | 21 | 85 | | |
| | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 19.5 | 20 | 25 | 14 | 88 | 20.5 | 25 | 25 | 15 | 85 | | |
| | | 575-3-60 | 7.4 | 50 | 12 | | | | 1.1 | 2 | 0.4 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 88 | 31.9 | 35 | 35 | 29 | 85 | |
| | | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 44.3 | 45 | 45 | 41 | 88 | 45.6 | 50 | 50 | 42 | 85 | |
| | | | | | | | | | | | | | None | - | - | - | 15.2 | 20 | 20 | 15 | 71 | 16 | 20 | 20 | 16 | 68 | |
| A7 (6) | | 208-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 5.2 | 1.1 | 8.6 | 11758 | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 71 | 26.2 | 30 | 30 | 24 | 68 | |
| | | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 35.5 | 40 | 40 | 33 | 71 | 36.5 | 40 | 40 | 34 | 68 | |
| | | | | | | | | | | | | | None | - | - | - | 36.1 | 40 | 50 | 36 | 172 | 38.3 | 40 | 50 | 39 | 177 | |
| | | | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 5.2 | 1 | 8.6 | 10725 | 4.9 | 1 | 13.6 | 36.1 | 40 | 50 | 36 | 172 | 38.3 | 40 | 50 | 39 | 177 |
| | | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 172 | 56.3 | 60 | 60 | 52 | 177 |
| | | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.4 | 80 | 80 | 70 | 172 | 79.1 | 80 | 80 | 73 | 177 |
| | | 460-3-60 | | 8.5 | 66.1 | 13 | | | | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 36.1 | 40 | 50 | 36 | 175 | 38.1 | 40 | 50 | 39 | 180 |
| | | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 36.1 | 40 | 50 | 36 | 175 | 38.1 | 40 | 50 | 39 | 180 |
| | | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 175 | 62.5 | 70 | 70 | 58 | 180 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2 | 0.4 | 8.6 | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 175 | 89 | 90 | 90 | 82 | 180 | | |
| | | | | | | | | | | | | None | - | - | - | 18 | 20 | 25 | 18 | 87 | 19 | 20 | 25 | 19 | 89 | | |
| | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 18 | 20 | 25 | 14 | 87 | 19 | 20 | 25 | 15 | 89 | | |
| | | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2 | 0.4 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 87 | 31.9 | 35 | 35 | 29 | 89 | |
| | | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 44.3 | 45 | 45 | 41 | 87 | 45.6 | 50 | 50 | 42 | 89 | |
| | | | | | | | | | | | | | None | - | - | - | 13.8 | 15 | 20 | 14 | 72 | 14.6 | 15 | 20 | 15 | 74 | |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 72 | 26.2 | 30 | 30 | 24 | 74 | | |
| | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 35.5 | 40 | 40 | 33 | 72 | 36.5 | 40 | 40 | 34 | 74 | | |

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|---------------------|---|-----|---|-----|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | | | | | 83.1 | 21 | 2.3 | 5.2 | | | | 1.1 | 8.6 | | None | - | - | - | 44.7 | 45 |
| 11725 | 12 | | | | | | | 1 | 33.3 | 53.5 | 60 | | | | | 60 | 49 | 212 | | | 56.3 | 60 | 60 | 52 | 222 | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 76.4 | 80 | | | | | 80 | 70 | 212 | | | 79.1 | 80 | 80 | 73 | 222 | | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 95.1 | 100 | | | | | 100 | 88 | 212 | | | 97.9 | 100 | 100 | 90 | 222 | | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 122.3 | 125 | | | | | 125 | 112 | 212 | | | 125 | 150 | 150 | 115 | 222 | | |
| 230-3-60 | 13.6 | | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 5.2 | 1 | 8.6 | None | - | - | - | 44.7 | 45 | 50 | 47 | 216 | 46.7 | 50 | 60 | 50 | 210 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 216 | 62.5 | 70 | 70 | 58 | 210 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 216 | 89 | 90 | 90 | 82 | 210 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108.1 | 110 | 110 | 99 | 216 | 110.6 | 125 | 125 | 102 | 210 | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.4 | 150 | 150 | 128 | 216 | 141.9 | 150 | 150 | 131 | 210 | | |
| 460-3-60 | 6.1 | | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 21.1 | 25 | 25 | 23 | 108 | 22.1 | 25 | 25 | 24 | 105 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 108 | 31.9 | 35 | 35 | 29 | 105 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.7 | 50 | 50 | 44 | 108 | 48.9 | 50 | 50 | 45 | 105 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 108 | 56.8 | 60 | 60 | 52 | 105 | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.7 | 70 | 70 | 63 | 108 | 69.9 | 70 | 70 | 64 | 105 | | |
| 575-3-60 | 4.2 | | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2 | 0.4 | 8.6 | None | - | - | - | 15.4 | 20 | 20 | 16 | 87 | 16.2 | 20 | 20 | 17 | 84 | | |
| | | 11758 | | | | | | | | | | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 87 | 26.2 | 30 | 30 | 24 | 84 | | | |
| | | 13458 | | | | | | | | | | 34 | 1 | 32.7 | 45.5 | 50 | 50 | 42 | 87 | 46.5 | 50 | 50 | 43 | 84 | | | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | 8.6 | None | - | - | - | 44.9 | 45 | 50 | 48 | 212 | 47.1 | 50 | 50 | 50 | 222 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 212 | 56.3 | 60 | 60 | 52 | 222 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.4 | 80 | 80 | 70 | 212 | 79.1 | 80 | 80 | 73 | 222 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.1 | 100 | 100 | 88 | 212 | 97.9 | 100 | 100 | 90 | 222 | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.3 | 125 | 125 | 112 | 212 | 125 | 150 | 150 | 115 | 222 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1 | 8.6 | None | - | - | - | 44.9 | 45 | 50 | 48 | 216 | 46.9 | 50 | 60 | 50 | 210 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 216 | 62.5 | 70 | 70 | 58 | 210 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 216 | 89 | 90 | 90 | 82 | 210 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108.1 | 110 | 110 | 99 | 216 | 110.6 | 125 | 125 | 102 | 210 | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.4 | 150 | 150 | 128 | 216 | 141.9 | 150 | 150 | 131 | 210 | | |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 21.4 | 25 | 25 | 23 | 108 | 22.4 | 25 | 25 | 24 | 105 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 108 | 31.9 | 35 | 35 | 29 | 105 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.7 | 50 | 50 | 44 | 108 | 48.9 | 50 | 50 | 45 | 105 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 108 | 56.8 | 60 | 60 | 52 | 105 | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.7 | 70 | 70 | 63 | 108 | 69.9 | 70 | 70 | 64 | 105 | | |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2 | 0.4 | 8.6 | None | - | - | - | 16.7 | 20 | 20 | 18 | 87 | 17.5 | 20 | 20 | 19 | 84 | | |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 87 | 26.2 | 30 | 30 | 24 | 84 | | | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 45.5 | 50 | 50 | 42 | 87 | 46.5 | 50 | 50 | 43 | 84 | | | |

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|------|---------------------|---|---|-----|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 5.2 | | | | 1.1 | 8.6 | | | None | - | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 53.5 | 60 | | | | | 60 | 54 | 269 | | | 56.3 | 60 | 60 | 57 | 279 | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 76.4 | 80 | | | | | 80 | 70 | 269 | | | 79.1 | 80 | 80 | 73 | 279 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 95.1 | 100 | | | | | 100 | 88 | 269 | | | 97.9 | 100 | 100 | 90 | 279 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 122.3 | 125 | | | | | 125 | 112 | 269 | | | 125 | 150 | 150 | 115 | 279 | |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 5.2 | 1 | 8.6 | None | - | - | - | 50.7 | 60 | 60 | 54 | 268 | 52.7 | 60 | 60 | 56 | 273 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 55 | 268 | 62.5 | 70 | 70 | 58 | 273 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 268 | 89 | 90 | 90 | 82 | 273 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108.1 | 110 | 110 | 99 | 268 | 110.6 | 125 | 125 | 102 | 273 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.4 | 150 | 150 | 128 | 268 | 141.9 | 150 | 150 | 131 | 273 | |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 2.6 | 0.5 | 8.6 | None | - | - | - | 25.3 | 30 | 30 | 27 | 130 | 26.3 | 30 | 30 | 28 | 132 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 130 | 31.9 | 35 | 35 | 29 | 132 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.7 | 50 | 50 | 44 | 130 | 48.9 | 50 | 50 | 45 | 132 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 130 | 56.8 | 60 | 60 | 52 | 132 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.7 | 70 | 70 | 63 | 130 | 69.9 | 70 | 70 | 64 | 132 | |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2 | 0.4 | 8.6 | None | - | - | - | 18.7 | 20 | 20 | 20 | 101 | 19.5 | 20 | 20 | 21 | 103 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 101 | 26.2 | 30 | 30 | 24 | 103 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 45.5 | 50 | 50 | 42 | 101 | 46.5 | 50 | 50 | 43 | 103 | |
| A7 (6) | 208-3-60 | | 17.6 | 136 | 27 | | | | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 37.9 | 40 | 50 | 39 | 210 | 40.1 | 45 | 50 | 41 | 215 |
| | | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 37.9 | 40 | 50 | 39 | 210 | 40.1 | 45 | 50 | 41 | 215 |
| | | 11725 | | | | | | | | | | | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 210 | 58.5 | 60 | 60 | 54 | 215 | |
| | | 12525 | | | | | | | | | | | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 210 | 81.4 | 90 | 90 | 75 | 215 | |
| | | None | | | | | | | | | | | - | - | - | 38.1 | 40 | 50 | 39 | 212 | 40.1 | 45 | 50 | 41 | 217 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 7.2 | 1 | 8.6 | 10725 | 6.5 | 1 | 15.6 | 38.1 | 40 | 50 | 39 | 212 | 40.1 | 45 | 50 | 41 | 217 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 212 | 65 | 70 | 70 | 60 | 217 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 212 | 91.5 | 100 | 100 | 84 | 217 | |
| | | | | | | | | | | | | None | - | - | - | 19 | 20 | 25 | 19 | 105 | 20 | 20 | 25 | 21 | 107 | |
| | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 19 | 20 | 25 | 15 | 105 | 20 | 20 | 25 | 16 | 107 | |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 3.6 | 0.5 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 105 | 33.2 | 35 | 35 | 31 | 107 | |
| | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 45.6 | 50 | 50 | 42 | 105 | 46.8 | 50 | 50 | 43 | 107 | |
| | | | | | | | | | | | | None | - | - | - | 14.3 | 15 | 20 | 15 | 79 | 15.1 | 20 | 20 | 16 | 81 | |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2.5 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 79 | 26.8 | 30 | 30 | 25 | 81 | |
| | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 36.2 | 40 | 40 | 33 | 79 | 37.2 | 40 | 40 | 34 | 81 | |

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|---------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | | | | | 83.1 | 21 | 2.3 | 7 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 55.8 | 60 | | | | | 60 | 51 | 250 | | | 58.5 | 60 | 60 | 54 | 260 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 78.6 | 80 | | | | | 80 | 72 | 250 | | | 81.4 | 90 | 90 | 75 | 260 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 97.4 | 100 | | | | | 100 | 90 | 250 | | | 100.1 | 110 | 110 | 92 | 260 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 124.5 | 125 | | | | | 125 | 115 | 250 | | | 127.3 | 150 | 150 | 117 | 260 |
| 230-3-60 | 13.6 | | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 46.7 | 50 | 60 | 50 | 252 | 48.7 | 50 | 60 | 52 | 247 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 252 | 65 | 70 | 70 | 60 | 247 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 252 | 91.5 | 100 | 100 | 84 | 247 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 252 | 113.1 | 125 | 125 | 104 | 247 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 252 | 144.4 | 150 | 150 | 133 | 247 |
| 460-3-60 | 6.1 | | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.1 | 25 | 25 | 24 | 127 | 23.1 | 25 | 25 | 25 | 123 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 127 | 33.2 | 35 | 35 | 31 | 123 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 127 | 50.2 | 60 | 60 | 46 | 123 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 127 | 58.1 | 60 | 60 | 53 | 123 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 127 | 71.2 | 80 | 80 | 65 | 123 |
| 575-3-60 | 4.2 | | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 15.9 | 20 | 20 | 17 | 95 | 16.7 | 20 | 20 | 18 | 92 |
| | | 11758 | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 95 | 26.8 | 30 | 30 | 25 | 92 | |
| | | 13458 | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 95 | 47.2 | 50 | 50 | 43 | 92 | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 46.7 | 50 | 60 | 50 | 250 | 48.9 | 50 | 60 | 52 | 260 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 250 | 58.5 | 60 | 60 | 54 | 260 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 250 | 81.4 | 90 | 90 | 75 | 260 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 250 | 100.1 | 110 | 110 | 92 | 260 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 250 | 127.3 | 150 | 150 | 117 | 260 |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 46.9 | 50 | 60 | 50 | 252 | 48.9 | 50 | 60 | 52 | 247 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 252 | 65 | 70 | 70 | 60 | 247 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 252 | 91.5 | 100 | 100 | 84 | 247 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 252 | 113.1 | 125 | 125 | 104 | 247 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 252 | 144.4 | 150 | 150 | 133 | 247 |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.4 | 25 | 25 | 24 | 127 | 23.4 | 25 | 25 | 25 | 123 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 127 | 33.2 | 35 | 35 | 31 | 123 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 127 | 50.2 | 60 | 60 | 46 | 123 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 127 | 58.1 | 60 | 60 | 53 | 123 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 127 | 71.2 | 80 | 80 | 65 | 123 |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 17.2 | 20 | 20 | 18 | 95 | 18 | 20 | 20 | 19 | 92 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 95 | 26.8 | 30 | 30 | 25 | 92 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 95 | 47.2 | 50 | 50 | 43 | 92 | |

Table 157: ZY04 to 12 standard static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCAw/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|---------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 7 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 55.8 | 60 | | | | | 60 | 56 | 306 | | | 58.5 | 60 | 70 | 59 | 316 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 78.6 | 80 | | | | | 80 | 72 | 306 | | | 81.4 | 90 | 90 | 75 | 316 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 97.4 | 100 | | | | | 100 | 90 | 306 | | | 100.1 | 110 | 110 | 92 | 316 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 124.5 | 125 | | | | | 125 | 115 | 306 | | | 127.3 | 150 | 150 | 117 | 316 |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 7.2 | 1 | 8.6 | None | - | - | - | 52.7 | 60 | 60 | 56 | 305 | 54.7 | 60 | 70 | 58 | 310 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 305 | 65 | 70 | 70 | 60 | 310 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 305 | 91.5 | 100 | 100 | 84 | 310 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 305 | 113.1 | 125 | 125 | 104 | 310 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 305 | 144.4 | 150 | 150 | 133 | 310 |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 3.6 | 0.5 | 8.6 | None | - | - | - | 26.3 | 30 | 30 | 28 | 148 | 27.3 | 30 | 30 | 29 | 150 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 148 | 33.2 | 35 | 35 | 31 | 150 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 148 | 50.2 | 60 | 60 | 46 | 150 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 148 | 58.1 | 60 | 60 | 53 | 150 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 148 | 71.2 | 80 | 80 | 65 | 150 |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2.5 | 0.4 | 8.6 | None | - | - | - | 19.2 | 20 | 20 | 20 | 109 | 20 | 20 | 20 | 21 | 110 |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 109 | 26.8 | 30 | 30 | 25 | 110 |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 109 | 47.2 | 50 | 50 | 43 | 110 |

- 1 Minimum circuit ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZY04 to 12 medium static indoor blower - without powered convenience outlet

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|------------|--|--|------------------------------------|-----|----------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 7.6 | 1.5 | | None | - | - | - | 29.9 | 30 | 45 | 30 | 115 | 31.4 | 35 | 45 | 31 | 119 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 39 | 40 | 45 | 36 | 115 | 40.9 | 45 | 45 | 38 | 119 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 57 | 60 | 60 | 52 | 115 | 58.9 | 60 | 60 | 54 | 119 | | |
| | 230-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 7 | 1.3 | | None | - | - | - | 29.3 | 30 | 45 | 29 | 118 | 30.6 | 35 | 45 | 30 | 121 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 42.6 | 45 | 45 | 39 | 118 | 44.3 | 45 | 45 | 41 | 121 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 63.5 | 70 | 70 | 58 | 118 | 65.1 | 70 | 70 | 60 | 121 | | |
| | 208-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1.1 | | None | - | - | - | 19.6 | 20 | 30 | 20 | 99 | 20.7 | 25 | 30 | 21 | 101 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 23.5 | 25 | 30 | 22 | 99 | 24.9 | 25 | 30 | 23 | 101 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 35 | 31 | 99 | 35.3 | 40 | 40 | 32 | 101 | | |
| | 230-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1 | | None | - | - | - | 19.6 | 20 | 30 | 20 | 101 | 20.6 | 25 | 30 | 21 | 104 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 26 | 30 | 30 | 24 | 101 | 27.3 | 30 | 30 | 25 | 104 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 38.1 | 40 | 40 | 35 | 101 | 39.4 | 40 | 40 | 36 | 104 | | |
| | 460-3-60 | 5.8 | 38 | 9 | | | | 0.8 | 2.6 | 0.5 | | None | - | - | - | 10.7 | 15 | 15 | 11 | 52 | 11.2 | 15 | 15 | 11 | 54 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 12.3 | 15 | 15 | 11 | 52 | 12.9 | 15 | 15 | 12 | 54 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 52 | 21.1 | 25 | 25 | 19 | 54 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | | | | 0.6 | 2 | 0.4 | | None | - | - | - | 7.4 | 15 | 15 | 7 | 48 | 7.8 | 15 | 15 | 8 | 49 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 13.6 | 15 | 15 | 13 | 48 | 14.1 | 15 | 15 | 13 | 49 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.1 | 20 | 20 | 18 | 48 | 19.6 | 20 | 20 | 18 | 49 | | |
| 05 (4) | 208-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 7.6 | 1.5 | | None | - | - | - | 36.3 | 40 | 50 | 35 | 153 | 37.8 | 40 | 50 | 37 | 157 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 39 | 40 | 50 | 36 | 153 | 40.9 | 45 | 50 | 38 | 157 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 57 | 60 | 60 | 52 | 153 | 58.9 | 60 | 60 | 54 | 157 | | |
| | 230-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 7 | 1.3 | | None | - | - | - | 35.7 | 40 | 50 | 35 | 156 | 37 | 40 | 50 | 36 | 159 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 42.6 | 45 | 50 | 39 | 156 | 44.3 | 45 | 50 | 41 | 159 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 63.5 | 70 | 70 | 58 | 156 | 65.1 | 70 | 70 | 60 | 159 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 5.2 | 1.1 | | None | - | - | - | 23.7 | 25 | 35 | 23 | 109 | 24.8 | 25 | 35 | 25 | 111 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 23.7 | 25 | 35 | 23 | 109 | 24.9 | 25 | 35 | 25 | 111 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 33.9 | 35 | 35 | 31 | 109 | 35.3 | 40 | 40 | 32 | 111 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 5.2 | 1 | | None | - | - | - | 23.7 | 25 | 35 | 23 | 111 | 24.7 | 25 | 35 | 24 | 114 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 26 | 30 | 35 | 24 | 111 | 27.3 | 30 | 35 | 25 | 114 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 38.1 | 40 | 40 | 35 | 111 | 39.4 | 40 | 40 | 36 | 114 | | |
| | 460-3-60 | 6.2 | 41 | 10 | | | | 0.8 | 2.6 | 0.5 | | None | - | - | - | 11.2 | 15 | 15 | 11 | 55 | 11.7 | 15 | 15 | 12 | 57 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 12.3 | 15 | 15 | 11 | 55 | 12.9 | 15 | 15 | 12 | 57 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 20.5 | 25 | 25 | 19 | 55 | 21.1 | 25 | 25 | 19 | 57 | | |
| | 575-3-60 | 4.8 | 33 | 8 | | | | 0.6 | 2 | 0.4 | | None | - | - | - | 8.6 | 15 | 15 | 9 | 45 | 9 | 15 | 15 | 9 | 45 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 13.6 | 15 | 15 | 13 | 45 | 14.1 | 15 | 15 | 13 | 45 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.1 | 20 | 20 | 18 | 45 | 19.6 | 20 | 20 | 18 | 45 | | |

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|----------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 06 (5) | 208-1-60 | 25 | 134 | 39 | | | | 2.3 | 6.8 | 1.5 | | None | - | - | - | 40.4 | 45 | 60 | 39 | 171 | 41.9 | 45 | 60 | 41 | 175 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 40.4 | 45 | 60 | 39 | 171 | 41.9 | 45 | 60 | 41 | 175 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 56 | 60 | 60 | 52 | 171 | 57.9 | 60 | 60 | 53 | 175 | |
| | 230-1-60 | 25 | 134 | 39 | | | | 2.3 | 6.2 | 1.3 | | | None | - | - | - | 39.8 | 40 | 60 | 39 | 172 | 41.1 | 45 | 60 | 40 | 175 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 41.6 | 45 | 60 | 39 | 172 | 43.3 | 45 | 60 | 40 | 175 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 62.5 | 70 | 70 | 58 | 172 | 64.1 | 70 | 70 | 59 | 175 |
| | 208-3-60 | 15.9 | 110 | 25 | | | | 2.3 | 7 | 1.1 | | | None | - | - | - | 29.2 | 30 | 45 | 29 | 175 | 30.3 | 35 | 45 | 30 | 177 |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 29.2 | 30 | 45 | 29 | 175 | 30.3 | 35 | 45 | 30 | 177 |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 36.1 | 40 | 45 | 33 | 175 | 37.5 | 40 | 45 | 35 | 177 |
| | 230-3-60 | 15.9 | 110 | 25 | | | | 2.3 | 7.2 | 1 | | | None | - | - | - | 29.4 | 30 | 45 | 29 | 177 | 30.4 | 35 | 45 | 30 | 179 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 29.4 | 30 | 45 | 29 | 177 | 30.4 | 35 | 45 | 30 | 179 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 40.6 | 45 | 45 | 37 | 177 | 41.9 | 45 | 45 | 39 | 179 |
| | 460-3-60 | 7.1 | 52 | 11 | | | | 1.3 | 3.6 | 0.5 | | | None | - | - | - | 13.8 | 15 | 20 | 14 | 86 | 14.3 | 15 | 20 | 14 | 87 |
| | | | | | | | | | | | | | 11146 | 6 | 1 | 7.2 | 13.8 | 15 | 20 | 12 | 86 | 14.3 | 15 | 20 | 13 | 87 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.8 | 25 | 25 | 20 | 86 | 22.4 | 25 | 25 | 21 | 87 |
| | 575-3-60 | 5.1 | 39.5 | 8 | | | | 1.1 | 2.5 | 0.4 | | | None | - | - | - | 10 | 15 | 15 | 10 | 60 | 10.4 | 15 | 15 | 10 | 60 |
| | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.8 | 20 | 20 | 18 | 60 | 20.3 | 25 | 25 | 19 | 60 |
| | | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 30.8 | 35 | 35 | 28 | 60 | 31.3 | 35 | 35 | 29 | 60 |
| 07 (6) | 208-3-60 | 19 | 123 | 30 | | | 2.3 | 7.5 | 1.1 | | | None | - | - | - | 35.9 | 40 | 50 | 36 | 191 | 38.1 | 40 | 50 | 38 | 201 | |
| | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 35.9 | 40 | 50 | 36 | 191 | 38.1 | 40 | 50 | 38 | 201 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 51 | 60 | 60 | 47 | 191 | 53.8 | 60 | 60 | 49 | 201 | |
| | 230-3-60 | 19 | 123 | 30 | | | | 2.3 | 7.5 | 1 | | | None | - | - | - | 35.9 | 40 | 50 | 36 | 198 | 37.9 | 40 | 50 | 38 | 193 |
| | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 35.9 | 40 | 50 | 36 | 198 | 37.9 | 40 | 50 | 38 | 193 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.5 | 60 | 60 | 53 | 198 | 60 | 60 | 55 | 193 | |
| | 460-3-60 | 9.7 | 62 | 15 | | | | 1.3 | 3.4 | 0.5 | | | None | - | - | - | 18.1 | 20 | 25 | 18 | 101 | 19.1 | 20 | 25 | 19 | 98 |
| | | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 18.1 | 20 | 25 | 12 | 101 | 19.1 | 20 | 25 | 13 | 98 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29 | 30 | 30 | 27 | 101 | 30.3 | 35 | 35 | 28 | 98 |
| | 575-3-60 | 7.4 | 50 | 12 | | | | 1.1 | 2.8 | 0.4 | | | None | - | - | - | 14.3 | 15 | 20 | 14 | 81 | 15.1 | 20 | 20 | 15 | 79 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24 | 25 | 25 | 22 | 81 | 25 | 25 | 23 | 79 | |
| | | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 34.4 | 35 | 35 | 32 | 81 | 35.4 | 40 | 40 | 33 | 79 |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | 2.3 | 7.5 | 1.1 | | | None | - | - | - | 34.1 | 35 | 50 | 34 | 194 | 36.3 | 40 | 50 | 37 | 199 | |
| | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 34.1 | 35 | 50 | 34 | 194 | 36.3 | 40 | 50 | 37 | 199 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 51 | 60 | 60 | 47 | 194 | 53.8 | 60 | 60 | 49 | 199 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 7.5 | 1 | | | None | - | - | - | 34.1 | 35 | 50 | 34 | 201 | 36.1 | 40 | 50 | 36 | 206 |
| | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 34.1 | 35 | 50 | 34 | 201 | 36.1 | 40 | 50 | 36 | 206 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.5 | 60 | 60 | 53 | 201 | 60 | 60 | 55 | 206 | |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 3.4 | 0.5 | | | None | - | - | - | 16.6 | 20 | 25 | 17 | 99 | 17.6 | 20 | 25 | 18 | 102 |
| | | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 16.6 | 20 | 25 | 12 | 99 | 17.6 | 20 | 25 | 13 | 102 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29 | 30 | 30 | 27 | 99 | 30.3 | 35 | 35 | 28 | 102 |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 2.8 | 0.4 | | | None | - | - | - | 12.9 | 15 | 15 | 13 | 82 | 13.7 | 15 | 15 | 14 | 84 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24 | 25 | 25 | 22 | 82 | 25 | 25 | 23 | 84 | |
| | | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 34.4 | 35 | 35 | 32 | 82 | 35.4 | 40 | 40 | 33 | 84 |

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-------------|----------------------|--------------|------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|------------|--|--|------------------------------------|-----|----------------------|---|-----|---|-----|--|-------|------|------|------|------|----|----|-----|------|------|----|----|-----|-------|-------|------|------|------|------|----|----|-----|------|------|----|----|-----|-------|-------|----|------|-------|-------|-----|-----|-----|-------|-------|-----|-----|-----|-------|-------|------|------|-------|-------|-----|-----|-----|-------|-------|-----|-----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | | None | - | - | - | 40.4 | 45 | 50 | 43 | 208 | 42.6 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | |
| | | | | | | | | | | | | None | - | - | - | 40.4 | 45 | 50 | 43 | 211 | 42.4 | 45 | 50 | 45 | 206 | 11725 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 211 | 57.1 | 60 | 60 | 53 | 206 | 12525 | 24.8 | 1 | 59.7 | 81.1 | 90 | 90 | 75 | 211 | 83.6 | 90 | 90 | 77 | 206 | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 211 | 105.3 | 110 | 110 | 97 | 206 | 14225 | 42.4 | 2 | 102 | 134 | 150 | 150 | 123 | 211 | 136.5 | 150 | 150 | 126 | 206 | |
| | | | | | | | | | | | | None | - | - | - | 18.9 | 20 | 25 | 20 | 106 | 19.9 | 20 | 25 | 21 | 103 | 11746 | 16.5 | 1 | 19.8 | 28 | 30 | 30 | 26 | 106 | 29.3 | 30 | 30 | 27 | 103 | 12846 | 27.8 | 1 | 33.4 | 45 | 45 | 45 | 41 | 106 | 46.3 | 50 | 50 | 43 | 103 | 13346 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 106 | 54.1 | 60 | 60 | 50 | 103 | 14246 | 41.7 | 2 | 50.2 | 66 | 70 | 70 | 61 | 106 | 67.3 | 70 | 70 | 62 | 103 | |
| | | | | | | | | | | | | None | - | - | - | 13.7 | 15 | 15 | 14 | 85 | 14.5 | 15 | 15 | 15 | 83 | 11758 | 17 | 1 | 16.4 | 23 | 25 | 25 | 21 | 85 | 24 | 25 | 25 | 22 | 83 | 13458 | 34 | 1 | 32.7 | 43.4 | 45 | 45 | 40 | 85 | 44.4 | 45 | 45 | 41 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 | |
| | 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 |
| | | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 211 | 42.6 | 45 | 50 | 45 | 206 | 11725 | 16 | 1 | 38.5 | 54.6 | 60 | 60 | 50 | 211 | 57.1 | 60 | 60 | 53 | 206 | 12525 | 24.8 | 1 | 59.7 | 81.1 | 90 | 90 | 75 | 211 | 83.6 | 90 | 90 | 77 | 206 | 13225 | 32 | 1 | 77 | 102.8 | 110 | 110 | 95 | 211 | 105.3 | 110 | 110 | 97 | 206 | 14225 | 42.4 | 2 | 102 | 134 | 150 | 150 | 123 | 211 | 136.5 | 150 | 150 | 126 | 206 |
| | | | | | | | | | | | | | None | - | - | - | 19.2 | 20 | 25 | 20 | 106 | 20.2 | 25 | 25 | 21 | 103 | 11746 | 16.5 | 1 | 19.8 | 28 | 30 | 30 | 26 | 106 | 29.3 | 30 | 30 | 27 | 103 | 12846 | 27.8 | 1 | 33.4 | 45 | 45 | 45 | 41 | 106 | 46.3 | 50 | 50 | 43 | 103 | 13346 | 33 | 1 | 39.7 | 52.9 | 60 | 60 | 49 | 106 | 54.1 | 60 | 60 | 50 | 103 | 14246 | 41.7 | 2 | 50.2 | 66 | 70 | 70 | 61 | 106 | 67.3 | 70 | 70 | 62 | 103 |
| | | | | | | | | | | | | | None | - | - | - | 15 | 20 | 20 | 16 | 85 | 15.8 | 20 | 20 | 17 | 83 | 11758 | 17 | 1 | 16.4 | 23 | 25 | 25 | 21 | 85 | 24 | 25 | 25 | 22 | 83 | 13458 | 34 | 1 | 32.7 | 43.4 | 45 | 45 | 40 | 85 | 44.4 | 45 | 45 | 41 | 83 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | None | - | - | - | 40.6 | 45 | 50 | 43 | 208 | 42.8 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 48.1 | 50 | 50 | 44 | 208 | 50.9 | 60 | 60 | 47 | 218 | 12525 | 18.6 | 1 | 51.6 | 71 | 80 | 80 | 65 | 208 | 73.8 | 80 | 80 | 68 | 218 | 13225 | 24 | 1 | 66.6 | 89.8 | 90 | 90 | 83 | 208 | 92.5 | 100 | 100 | 85 | 218 | 14225 | 31.8 | 2 | 88.3 | 116.9 | 125 | 125 | 108 | 208 | 119.6 | 125 | 125 | 110 | 218 |

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|----|--------|-------|-------------------------|--|--|------------------------------------|-------|----------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 10.2 | | | | 1.1 | None | | | | - | - |
| | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54.4 | 60 | 60 | 55 | 305 | 57.1 | 60 | 60 | 58 | 315 | |
| | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 77.3 | 80 | 80 | 71 | 305 | 80 | 90 | 90 | 74 | 315 | |
| | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 96 | 100 | 100 | 88 | 305 | 98.8 | 100 | 100 | 91 | 315 | |
| | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 123.1 | 125 | 125 | 113 | 305 | 125.9 | 150 | 150 | 116 | 315 | |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 10.2 | 1 | None | - | - | - | 51.4 | 60 | 60 | 55 | 308 | 53.4 | 60 | 60 | 57 | 313 | |
| | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60.9 | 70 | 70 | 56 | 308 | 63.4 | 70 | 70 | 58 | 313 | |
| | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 87.4 | 90 | 90 | 80 | 308 | 89.9 | 90 | 90 | 83 | 313 | |
| | | | | | | | | | | | 13225 | 32 | 1 | 77 | 109 | 110 | 110 | 100 | 308 | 111.5 | 125 | 125 | 103 | 313 | |
| | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 140.3 | 150 | 150 | 129 | 308 | 142.8 | 150 | 150 | 131 | 313 | |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 4.8 | 0.5 | None | - | - | - | 25.3 | 30 | 30 | 27 | 150 | 26.3 | 30 | 30 | 28 | 152 | |
| | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.8 | 35 | 35 | 28 | 150 | 32 | 35 | 35 | 29 | 152 | |
| | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.8 | 50 | 50 | 44 | 150 | 49 | 50 | 50 | 45 | 152 | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 150 | 56.9 | 60 | 60 | 52 | 152 | |
| | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.8 | 70 | 70 | 63 | 150 | 70 | 70 | 70 | 64 | 152 | |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 3.4 | 0.4 | None | - | - | - | 18.4 | 20 | 20 | 20 | 117 | 19.2 | 20 | 20 | 20 | 119 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24.8 | 25 | 25 | 23 | 117 | 25.8 | 30 | 30 | 24 | 119 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 45.1 | 50 | 50 | 42 | 117 | 46.1 | 50 | 50 | 42 | 119 | |
| | | | | | | | | | | | With VFD | | | | | | | | | | | | | | |
| | 208-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 8.9 | 1.1 | None | - | - | - | 35.5 | 40 | 50 | 36 | 207 | 37.7 | 40 | 50 | 38 | 212 | |
| | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 35.5 | 40 | 50 | 36 | 207 | 37.7 | 40 | 50 | 38 | 212 | |
| | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 52.8 | 60 | 60 | 49 | 207 | 55.5 | 60 | 60 | 51 | 212 | |
| | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 75.6 | 80 | 80 | 70 | 207 | 78.4 | 80 | 80 | 72 | 212 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 8.2 | 1 | None | - | - | - | 34.8 | 35 | 50 | 35 | 215 | 36.8 | 40 | 50 | 37 | 220 | |
| | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 34.8 | 35 | 50 | 35 | 215 | 36.8 | 40 | 50 | 37 | 220 | |
| | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 58.4 | 60 | 60 | 54 | 215 | 60.9 | 70 | 70 | 56 | 220 | |
| | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 84.9 | 90 | 90 | 78 | 215 | 87.4 | 90 | 90 | 80 | 220 | |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 4.1 | 0.5 | None | - | - | - | 17.3 | 20 | 25 | 17 | 106 | 18.3 | 20 | 25 | 19 | 109 | |
| | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 17.3 | 20 | 25 | 13 | 106 | 18.3 | 20 | 25 | 14 | 109 | |
| | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.9 | 30 | 30 | 27 | 106 | 31.1 | 35 | 35 | 29 | 109 | |
| | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 43.5 | 45 | 45 | 40 | 106 | 44.8 | 45 | 45 | 41 | 109 | |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 3.2 | 0.4 | None | - | - | - | 13.3 | 15 | 15 | 13 | 86 | 14.1 | 15 | 15 | 14 | 88 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 24.5 | 25 | 25 | 23 | 86 | 25.5 | 30 | 30 | 23 | 88 | |
| | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 34.9 | 35 | 35 | 32 | 86 | 35.9 | 40 | 40 | 33 | 88 | |

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA †(amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | | | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------|--|--|------------------------------------|-----|----------------------|---|-----|---|-----|--|--|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.2 | 45 | 50 | 45 | 246 | 44.4 | 45 | 50 | 47 | 256 | | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 246 | 53.1 | 60 | 60 | 49 | 256 | | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 246 | 76 | 80 | 80 | 70 | 256 | | | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 246 | 94.8 | 100 | 100 | 87 | 256 | | | | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 42.4 | 45 | 50 | 45 | 248 | 44.4 | 45 | 50 | 47 | 243 | | | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 248 | 59.6 | 60 | 60 | 55 | 243 | | | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 248 | 86.1 | 90 | 90 | 79 | 243 | | | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 248 | 107.8 | 110 | 110 | 99 | 243 | | | | |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 19.9 | 20 | 25 | 21 | 125 | 20.9 | 25 | 25 | 22 | 121 | | | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 125 | 30.5 | 35 | 35 | 28 | 121 | | | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 125 | 47.5 | 50 | 50 | 44 | 121 | | | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 125 | 55.4 | 60 | 60 | 51 | 121 | | | | |
| | 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 14.2 | 15 | 15 | 15 | 93 | 15 | 15 | 15 | 16 | 90 | | | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 93 | 24.6 | 25 | 25 | 23 | 90 | | | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 93 | 45 | 45 | 45 | 41 | 90 | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.4 | 45 | 50 | 45 | 246 | 44.6 | 45 | 50 | 47 | 256 | | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 246 | 53.1 | 60 | 60 | 49 | 256 | | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 246 | 76 | 80 | 80 | 70 | 256 | | | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 246 | 94.8 | 100 | 100 | 87 | 256 | | | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 42.6 | 45 | 50 | 45 | 248 | 44.6 | 45 | 50 | 47 | 243 | | | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 248 | 59.6 | 60 | 60 | 55 | 243 | | | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 248 | 86.1 | 90 | 90 | 79 | 243 | | | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 248 | 107.8 | 110 | 110 | 99 | 243 | | | | |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 20.2 | 25 | 25 | 21 | 125 | 21.2 | 25 | 25 | 23 | 121 | | | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 125 | 30.5 | 35 | 35 | 28 | 121 | | | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 125 | 47.5 | 50 | 50 | 44 | 121 | | | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 125 | 55.4 | 60 | 60 | 51 | 121 | | | | |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 15.5 | 20 | 20 | 16 | 93 | 16.3 | 20 | 20 | 17 | 90 | | | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 93 | 24.6 | 25 | 25 | 23 | 90 | | | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 93 | 45 | 45 | 45 | 41 | 90 | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Table 158: ZY04 to 12 medium static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|----------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 9.9 | | | | 1.1 | | | | | None | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 54 | 60 | | | | | 60 | 55 | 315 | | | 56.8 | 60 | 60 | 57 | 325 | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 76.9 | 80 | | | | | 80 | 71 | 315 | | | 79.6 | 80 | 80 | 73 | 325 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 95.6 | 100 | | | | | 100 | 88 | 315 | | | 98.4 | 100 | 100 | 91 | 325 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 122.8 | 125 | | | | | 125 | 113 | 315 | | | 125.5 | 150 | 150 | 115 | 325 | |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | | | None | - | - | - | 50.6 | 60 | 60 | 54 | 320 | 52.6 | 60 | 60 | 56 | 324 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 320 | 62.4 | 70 | 70 | 57 | 324 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 320 | 88.9 | 90 | 90 | 82 | 324 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 320 | 110.5 | 125 | 125 | 102 | 324 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 320 | 141.8 | 150 | 150 | 130 | 324 |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | | | None | - | - | - | 25.2 | 30 | 30 | 27 | 155 | 26.2 | 30 | 30 | 28 | 158 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 155 | 31.9 | 35 | 35 | 29 | 158 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 155 | 48.9 | 50 | 50 | 45 | 158 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 155 | 56.8 | 60 | 60 | 52 | 158 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 155 | 69.9 | 70 | 70 | 64 | 158 |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | | | None | - | - | - | 19.3 | 20 | 25 | 21 | 129 | 20.1 | 25 | 25 | 22 | 131 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 129 | 26.9 | 30 | 30 | 25 | 131 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 129 | 47.3 | 50 | 50 | 43 | 131 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZY04 to 12 medium static indoor blower - with powered convenience outlet

Table 159: ZY04 to 12 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 7.6 | 1.5 | 8.6 | None | - | - | - | 34.2 | 35 | 50 | 35 | 120 | 35.7 | 40 | 50 | 36 | 123 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 44.4 | 45 | 50 | 41 | 120 | 46.3 | 50 | 50 | 43 | 123 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 62.4 | 70 | 70 | 57 | 120 | 64.3 | 70 | 70 | 59 | 123 | | |
| | 230-1-60 | 16.7 | 79 | 26 | | | | 1.4 | 7 | 1.3 | 8.6 | None | - | - | - | 33.6 | 35 | 50 | 34 | 122 | 34.9 | 35 | 50 | 35 | 125 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48 | 50 | 50 | 44 | 122 | 49.6 | 50 | 50 | 46 | 125 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 68.9 | 70 | 70 | 63 | 122 | 70.5 | 80 | 80 | 65 | 125 | | |
| | 208-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 103 | 25 | 25 | 35 | 26 | 105 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.9 | 30 | 30 | 27 | 103 | 30.3 | 35 | 35 | 28 | 105 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 40 | 36 | 103 | 40.6 | 45 | 45 | 37 | 105 | | |
| | 230-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1 | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 106 | 24.9 | 25 | 35 | 26 | 108 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.4 | 35 | 35 | 29 | 106 | 32.6 | 35 | 35 | 30 | 108 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 106 | 44.8 | 45 | 45 | 41 | 108 | | |
| | 460-3-60 | 5.8 | 38 | 9 | | | | 0.8 | 2.6 | 0.5 | 8.6 | None | - | - | - | 12.9 | 15 | 15 | 13 | 55 | 13.4 | 15 | 15 | 14 | 56 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.9 | 15 | 15 | 14 | 55 | 15.6 | 20 | 20 | 14 | 56 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 55 | 23.8 | 25 | 25 | 22 | 56 | | |
| | 575-3-60 | 3.8 | 36.5 | 6 | | | | 0.6 | 2 | 0.4 | 8.6 | None | - | - | - | 9.1 | 15 | 15 | 9 | 50 | 9.5 | 15 | 15 | 10 | 51 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 15.8 | 20 | 20 | 15 | 50 | 16.3 | 20 | 20 | 15 | 51 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 50 | 21.8 | 25 | 25 | 20 | 51 | | |
| 05 (4) | 208-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 7.6 | 1.5 | 8.6 | None | - | - | - | 40.6 | 45 | 60 | 40 | 158 | 42.1 | 45 | 60 | 42 | 161 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 44.4 | 45 | 60 | 41 | 158 | 46.3 | 50 | 60 | 43 | 161 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 62.4 | 70 | 70 | 57 | 158 | 64.3 | 70 | 70 | 59 | 161 | | |
| | 230-1-60 | 21.8 | 117 | 34 | | | | 1.4 | 7 | 1.3 | 8.6 | None | - | - | - | 40 | 40 | 60 | 40 | 160 | 41.3 | 45 | 60 | 41 | 163 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48 | 50 | 60 | 44 | 160 | 49.6 | 50 | 60 | 46 | 163 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 68.9 | 70 | 70 | 63 | 160 | 70.5 | 80 | 80 | 65 | 163 | | |
| | 208-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 28 | 30 | 40 | 28 | 113 | 29.1 | 30 | 40 | 30 | 116 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.9 | 30 | 40 | 28 | 113 | 30.3 | 35 | 40 | 30 | 116 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 40 | 36 | 113 | 40.6 | 45 | 45 | 37 | 116 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | | | | 1.4 | 5.2 | 1 | 8.6 | None | - | - | - | 28 | 30 | 40 | 28 | 116 | 29 | 30 | 40 | 29 | 118 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.4 | 35 | 40 | 29 | 116 | 32.6 | 35 | 40 | 30 | 118 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 116 | 44.8 | 45 | 45 | 41 | 118 | | |
| | 460-3-60 | 6.2 | 41 | 10 | | | | 0.8 | 2.6 | 0.5 | 8.6 | None | - | - | - | 13.4 | 15 | 15 | 14 | 58 | 13.9 | 15 | 15 | 14 | 59 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.9 | 15 | 15 | 14 | 58 | 15.6 | 20 | 20 | 14 | 59 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 58 | 23.8 | 25 | 25 | 22 | 59 | | |
| | 575-3-60 | 4.8 | 33 | 8 | | | | 0.6 | 2 | 0.4 | 8.6 | None | - | - | - | 10.3 | 15 | 15 | 10 | 46 | 10.7 | 15 | 15 | 11 | 47 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 15.8 | 20 | 20 | 15 | 46 | 16.3 | 20 | 20 | 15 | 47 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 46 | 21.8 | 25 | 25 | 20 | 47 | | |

Table 159: ZY04 to 12 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | | | | | 83.1 | 21 | 2.3 | 5.2 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 53.5 | 60 | | | | | 60 | 49 | 212 | | | 56.3 | 60 | 60 | 52 | 222 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 76.4 | 80 | | | | | 80 | 70 | 212 | | | 79.1 | 80 | 80 | 73 | 222 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 95.1 | 100 | | | | | 100 | 88 | 212 | | | 97.9 | 100 | 100 | 90 | 222 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 122.3 | 125 | | | | | 125 | 112 | 212 | | | 125 | 150 | 150 | 115 | 222 |
| 230-3-60 | 13.6 | | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 5.2 | 1 | 8.6 | None | - | - | - | 44.7 | 45 | 50 | 47 | 216 | 46.7 | 50 | 60 | 50 | 210 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 216 | 62.5 | 70 | 70 | 58 | 210 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 216 | 89 | 90 | 90 | 82 | 210 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108.1 | 110 | 110 | 99 | 216 | 110.6 | 125 | 125 | 102 | 210 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.4 | 150 | 150 | 128 | 216 | 141.9 | 150 | 150 | 131 | 210 |
| 460-3-60 | 6.1 | | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 21.1 | 25 | 25 | 23 | 108 | 22.1 | 25 | 25 | 24 | 105 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 108 | 31.9 | 35 | 35 | 29 | 105 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.7 | 50 | 50 | 44 | 108 | 48.9 | 50 | 50 | 45 | 105 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 108 | 56.8 | 60 | 60 | 52 | 105 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.7 | 70 | 70 | 63 | 108 | 69.9 | 70 | 70 | 64 | 105 |
| 575-3-60 | 4.2 | | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2 | 0.4 | 8.6 | None | - | - | - | 15.4 | 20 | 20 | 16 | 87 | 16.2 | 20 | 20 | 17 | 84 |
| | | 11758 | | | | | | | | | | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 87 | 26.2 | 30 | 30 | 24 | 84 | |
| | | 13458 | | | | | | | | | | 34 | 1 | 32.7 | 45.5 | 50 | 50 | 42 | 87 | 46.5 | 50 | 50 | 43 | 84 | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1.1 | 8.6 | None | - | - | - | 44.9 | 45 | 50 | 48 | 212 | 47.1 | 50 | 50 | 50 | 222 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 212 | 56.3 | 60 | 60 | 52 | 222 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.4 | 80 | 80 | 70 | 212 | 79.1 | 80 | 80 | 73 | 222 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.1 | 100 | 100 | 88 | 212 | 97.9 | 100 | 100 | 90 | 222 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.3 | 125 | 125 | 112 | 212 | 125 | 150 | 150 | 115 | 222 |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 5.2 | 1 | 8.6 | None | - | - | - | 44.9 | 45 | 50 | 48 | 216 | 46.9 | 50 | 60 | 50 | 210 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 216 | 62.5 | 70 | 70 | 58 | 210 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.5 | 90 | 90 | 80 | 216 | 89 | 90 | 90 | 82 | 210 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108.1 | 110 | 110 | 99 | 216 | 110.6 | 125 | 125 | 102 | 210 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.4 | 150 | 150 | 128 | 216 | 141.9 | 150 | 150 | 131 | 210 |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 2.6 | 0.5 | 8.6 | None | - | - | - | 21.4 | 25 | 25 | 23 | 108 | 22.4 | 25 | 25 | 24 | 105 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.7 | 35 | 35 | 28 | 108 | 31.9 | 35 | 35 | 29 | 105 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.7 | 50 | 50 | 44 | 108 | 48.9 | 50 | 50 | 45 | 105 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 108 | 56.8 | 60 | 60 | 52 | 105 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.7 | 70 | 70 | 63 | 108 | 69.9 | 70 | 70 | 64 | 105 |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2 | 0.4 | 8.6 | None | - | - | - | 16.7 | 20 | 20 | 18 | 87 | 17.5 | 20 | 20 | 19 | 84 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.2 | 30 | 30 | 23 | 87 | 26.2 | 30 | 30 | 24 | 84 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 45.5 | 50 | 50 | 42 | 87 | 46.5 | 50 | 50 | 43 | 84 | |

Table 159: ZY04 to 12 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|-----|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 10.2 | | | | 1.1 | 8.6 | | | None | - | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 59.8 | 60 | | | | | 60 | 310 | 62.5 | | | 70 | 70 | 63 | 320 | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 82.6 | 90 | | | | | 90 | 76 | 310 | | | 85.4 | 90 | 90 | 79 | 320 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 101.4 | 110 | | | | | 110 | 93 | 310 | | | 104.1 | 110 | 110 | 96 | 320 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 128.5 | 150 | | | | | 150 | 118 | 310 | | | 131.3 | 150 | 150 | 121 | 320 | |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 10.2 | 1 | 8.6 | None | - | - | - | 55.7 | 60 | 70 | 59 | 312 | 57.7 | 60 | 70 | 62 | 317 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 312 | 68.8 | 70 | 70 | 63 | 317 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 92.8 | 100 | 100 | 85 | 312 | 95.3 | 100 | 100 | 88 | 317 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 114.4 | 125 | 125 | 105 | 312 | 116.9 | 125 | 125 | 108 | 317 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 145.6 | 150 | 150 | 134 | 312 | 148.1 | 150 | 150 | 136 | 317 | |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 4.8 | 0.5 | 8.6 | None | - | - | - | 27.5 | 30 | 35 | 29 | 152 | 28.5 | 30 | 35 | 30 | 154 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.4 | 35 | 35 | 31 | 152 | 34.7 | 35 | 35 | 32 | 154 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.4 | 60 | 60 | 46 | 152 | 51.7 | 60 | 60 | 48 | 154 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.3 | 60 | 60 | 54 | 152 | 59.6 | 60 | 60 | 55 | 154 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.4 | 80 | 80 | 66 | 152 | 72.7 | 80 | 80 | 67 | 154 | |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 3.4 | 0.4 | 8.6 | None | - | - | - | 20.1 | 25 | 25 | 22 | 118 | 20.9 | 25 | 25 | 22 | 120 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 26.9 | 30 | 30 | 25 | 118 | 27.9 | 30 | 30 | 26 | 120 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47.3 | 50 | 50 | 43 | 118 | 48.3 | 50 | 50 | 44 | 120 | |
| A7 (6) | 208-3-60 | | 17.6 | 136 | 27 | | | | 2.3 | 8.9 | 1.1 | 8.6 | None | - | - | - | 39.8 | 40 | 50 | 41 | 212 | 42 | 45 | 50 | 43 | 217 |
| | | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 39.8 | 40 | 50 | 41 | 212 | 42 | 45 | 50 | 43 | 217 |
| | | 11725 | | | | | | | | | | | 12 | 1 | 33.3 | 58.1 | 60 | 60 | 53 | 212 | 60.9 | 70 | 70 | 56 | 217 | |
| | | 12525 | | | | | | | | | | | 18.6 | 1 | 51.6 | 81 | 90 | 90 | 75 | 212 | 83.8 | 90 | 90 | 77 | 217 | |
| | | None | | | | | | | | | | | - | - | - | 39.1 | 40 | 50 | 40 | 219 | 41.1 | 45 | 50 | 42 | 224 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 8.2 | 1 | 8.6 | 10725 | 6.5 | 1 | 15.6 | 39.1 | 40 | 50 | 40 | 219 | 41.1 | 45 | 50 | 42 | 224 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 63.8 | 70 | 70 | 59 | 219 | 66.3 | 70 | 70 | 61 | 224 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 90.3 | 100 | 100 | 83 | 219 | 92.8 | 100 | 100 | 85 | 224 | |
| | | | | | | | | | | | | None | - | - | - | 19.5 | 20 | 25 | 20 | 109 | 20.5 | 25 | 25 | 21 | 111 | |
| | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 19.5 | 20 | 25 | 15 | 109 | 20.5 | 25 | 25 | 17 | 111 | |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 4.1 | 0.5 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 32.6 | 35 | 35 | 30 | 109 | 33.8 | 35 | 35 | 31 | 111 | |
| | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 46.2 | 50 | 50 | 42 | 109 | 47.4 | 50 | 50 | 44 | 111 | |
| | | | | | | | | | | | | None | - | - | - | 15 | 20 | 20 | 15 | 88 | 15.8 | 20 | 20 | 16 | 90 | |
| | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 3.2 | 0.4 | 8.6 | 11758 | 17 | 1 | 16.4 | 26.7 | 30 | 30 | 25 | 88 | 27.7 | 30 | 30 | 25 | 90 | |
| | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 37 | 40 | 40 | 34 | 88 | 38 | 40 | 40 | 35 | 90 | |

Table 159: ZY04 to 12 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | | | | | 83.1 | 21 | 2.3 | 7 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 55.8 | 60 | | | | | 60 | 51 | 250 | | | 58.5 | 60 | 60 | 54 | 260 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 78.6 | 80 | | | | | 80 | 72 | 250 | | | 81.4 | 90 | 90 | 75 | 260 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 97.4 | 100 | | | | | 100 | 90 | 250 | | | 100.1 | 110 | 110 | 92 | 260 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 124.5 | 125 | | | | | 125 | 115 | 250 | | | 127.3 | 150 | 150 | 117 | 260 |
| 230-3-60 | 13.6 | | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 46.7 | 50 | 60 | 50 | 252 | 48.7 | 50 | 60 | 52 | 247 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 252 | 65 | 70 | 70 | 60 | 247 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 252 | 91.5 | 100 | 100 | 84 | 247 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 252 | 113.1 | 125 | 125 | 104 | 247 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 252 | 144.4 | 150 | 150 | 133 | 247 |
| 460-3-60 | 6.1 | | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.1 | 25 | 25 | 24 | 127 | 23.1 | 25 | 25 | 25 | 123 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 127 | 33.2 | 35 | 35 | 31 | 123 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 127 | 50.2 | 60 | 60 | 46 | 123 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 127 | 58.1 | 60 | 60 | 53 | 123 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 127 | 71.2 | 80 | 80 | 65 | 123 |
| 575-3-60 | 4.2 | | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 15.9 | 20 | 20 | 17 | 95 | 16.7 | 20 | 20 | 18 | 92 |
| | | 11758 | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 95 | 26.8 | 30 | 30 | 25 | 92 | |
| | | 13458 | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 95 | 47.2 | 50 | 50 | 43 | 92 | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 46.7 | 50 | 60 | 50 | 250 | 48.9 | 50 | 60 | 52 | 260 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 250 | 58.5 | 60 | 60 | 54 | 260 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 250 | 81.4 | 90 | 90 | 75 | 260 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 250 | 100.1 | 110 | 110 | 92 | 260 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 250 | 127.3 | 150 | 150 | 117 | 260 |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 46.9 | 50 | 60 | 50 | 252 | 48.9 | 50 | 60 | 52 | 247 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 252 | 65 | 70 | 70 | 60 | 247 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 252 | 91.5 | 100 | 100 | 84 | 247 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 252 | 113.1 | 125 | 125 | 104 | 247 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 252 | 144.4 | 150 | 150 | 133 | 247 |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.4 | 25 | 25 | 24 | 127 | 23.4 | 25 | 25 | 25 | 123 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 127 | 33.2 | 35 | 35 | 31 | 123 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 127 | 50.2 | 60 | 60 | 46 | 123 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 127 | 58.1 | 60 | 60 | 53 | 123 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 127 | 71.2 | 80 | 80 | 65 | 123 |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 17.2 | 20 | 20 | 18 | 95 | 18 | 20 | 20 | 19 | 92 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 95 | 26.8 | 30 | 30 | 25 | 92 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 95 | 47.2 | 50 | 50 | 43 | 92 | |

Table 159: ZY04 to 12 medium static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | | | | | 110 | 25 | 5.8 | 9.9 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 59.4 | 60 | | | | | 70 | 60 | 319 | | | 62.1 | 70 | 70 | 62 | 329 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 82.3 | 90 | | | | | 90 | 76 | 319 | | | 85 | 90 | 90 | 78 | 329 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 101 | 110 | | | | | 110 | 93 | 319 | | | 103.8 | 110 | 110 | 95 | 329 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 128.1 | 150 | | | | | 150 | 118 | 319 | | | 130.9 | 150 | 150 | 120 | 329 |
| 230-3-60 | 16 | | 110 | 25 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | - | 54.9 | 60 | 70 | 59 | 324 | 56.9 | 60 | 70 | 61 | 329 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 |
| 460-3-60 | 7.8 | | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 27.4 | 30 | 35 | 29 | 157 | 28.4 | 30 | 35 | 30 | 160 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 |
| 575-3-60 | 5.7 | | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 131 | 21.8 | 25 | 25 | 23 | 133 |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 131 | 29 | 30 | 30 | 27 | 133 |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 131 | 49.4 | 50 | 50 | 45 | 133 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Table 160: ZY04 to 12 high static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | |
|------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-----------------------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | | | | | 83.1 | 21 | 2.3 | 10.2 | | | | 1.1 | | | | | None | - | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 54.4 | 60 | | | | | 60 | 50 | 249 | | | 57.1 | 60 | 60 | 53 | 259 | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 77.3 | 80 | | | | | 80 | 71 | 249 | | | 80 | 90 | 90 | 74 | 259 | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 96 | 100 | | | | | 100 | 88 | 249 | | | 98.8 | 100 | 100 | 91 | 259 | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 123.1 | 125 | | | | | 125 | 113 | 249 | | | 125.9 | 150 | 150 | 116 | 259 | |
| 230-3-60 | 13.7 | | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 10.2 | 1 | | | None | - | - | - | 45.6 | 50 | 50 | 49 | 255 | 47.6 | 50 | 60 | 51 | 250 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 60.9 | 70 | 70 | 56 | 255 | 63.4 | 70 | 70 | 58 | 250 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 87.4 | 90 | 90 | 80 | 255 | 89.9 | 90 | 90 | 83 | 250 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 109 | 110 | 110 | 100 | 255 | 111.5 | 125 | 125 | 103 | 250 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 140.3 | 150 | 150 | 129 | 255 | 142.8 | 150 | 150 | 131 | 250 |
| 460-3-60 | 6.2 | | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.8 | 0.5 | | | None | - | - | - | 21.4 | 25 | 25 | 23 | 128 | 22.4 | 25 | 25 | 24 | 125 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.8 | 35 | 35 | 28 | 128 | 32 | 35 | 35 | 29 | 125 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.8 | 50 | 50 | 44 | 128 | 49 | 50 | 50 | 45 | 125 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.6 | 60 | 60 | 51 | 128 | 56.9 | 60 | 60 | 52 | 125 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.8 | 70 | 70 | 63 | 128 | 70 | 70 | 70 | 64 | 125 |
| 575-3-60 | 4.8 | | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 3.4 | 0.4 | | | None | - | - | - | 16.4 | 20 | 20 | 17 | 103 | 17.2 | 20 | 20 | 18 | 100 |
| | | 11758 | | | | | | | | | | | 17 | 1 | 16.4 | 24.8 | 25 | 25 | 23 | 103 | 25.8 | 30 | 30 | 24 | 100 | |
| | | 13458 | | | | | | | | | | | 34 | 1 | 32.7 | 45.1 | 50 | 50 | 42 | 103 | 46.1 | 50 | 50 | 42 | 100 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.8 | 14.9 | 1.1 | | None | - | - | - | 56.7 | 60 | 70 | 61 | 323 | 58.9 | 60 | 70 | 63 | 333 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 60.3 | 70 | 70 | 61 | 323 | 63 | 70 | 70 | 63 | 333 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 83.1 | 90 | 90 | 76 | 323 | 85.9 | 90 | 90 | 79 | 333 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101.9 | 110 | 110 | 94 | 323 | 104.6 | 110 | 110 | 96 | 333 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 129 | 150 | 150 | 119 | 323 | 131.8 | 150 | 150 | 121 | 333 | |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 15 | 1 | | | None | - | - | - | 56.2 | 60 | 70 | 60 | 322 | 58.2 | 60 | 70 | 62 | 327 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 66.9 | 70 | 70 | 62 | 322 | 69.4 | 70 | 70 | 64 | 327 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 93.4 | 100 | 100 | 86 | 322 | 95.9 | 100 | 100 | 88 | 327 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 115 | 125 | 125 | 106 | 322 | 117.5 | 125 | 125 | 108 | 327 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 146.3 | 150 | 150 | 135 | 322 | 148.8 | 150 | 150 | 137 | 327 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 7.5 | 0.5 | | | None | - | - | - | 28 | 30 | 35 | 30 | 159 | 29 | 30 | 35 | 31 | 161 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 34.1 | 35 | 35 | 31 | 159 | 35.4 | 40 | 40 | 33 | 161 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 51.1 | 60 | 60 | 47 | 159 | 52.4 | 60 | 60 | 48 | 161 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 59 | 60 | 60 | 54 | 159 | 60.3 | 70 | 70 | 55 | 161 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 72.1 | 80 | 80 | 66 | 159 | 73.4 | 80 | 80 | 68 | 161 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.6 | 0.4 | | | None | - | - | - | 20.6 | 25 | 25 | 22 | 124 | 21.4 | 25 | 25 | 23 | 126 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 27.5 | 30 | 30 | 25 | 124 | 28.5 | 30 | 30 | 26 | 126 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47.9 | 50 | 50 | 44 | 124 | 48.9 | 50 | 50 | 45 | 126 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Table 161: ZY04 to 12 High Static Indoor Blower - Without Powered Convenience Outlet (with VFD)

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | ¹ MCA ¹ (amps) | ^{2,3} Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | ⁴ Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|--------------------------------------|---|--|---|-----|-----------------------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | With VFD | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 9.9 | 1.1 | | None | - | - | - | 36.5 | 40 | 50 | 37 | 218 | 38.7 | 40 | 50 | 39 | 223 | |
| | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 36.5 | 40 | 50 | 37 | 218 | 38.7 | 40 | 50 | 39 | 223 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 218 | 56.8 | 60 | 60 | 52 | 223 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 218 | 79.6 | 80 | 80 | 73 | 223 | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 9.4 | 1 | | | None | - | - | - | 36 | 40 | 50 | 36 | 227 | 38 | 40 | 50 | 39 | 231 |
| | | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 36 | 40 | 50 | 36 | 227 | 38 | 40 | 50 | 39 | 231 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 227 | 62.4 | 70 | 70 | 57 | 231 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 227 | 88.9 | 90 | 90 | 82 | 231 |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 4.7 | 0.5 | | | None | - | - | - | 17.9 | 20 | 25 | 18 | 112 | 18.9 | 20 | 25 | 19 | 114 |
| | | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 17.9 | 20 | 25 | 14 | 112 | 18.9 | 20 | 25 | 15 | 114 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 112 | 31.9 | 35 | 35 | 29 | 114 |
| | | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 44.3 | 45 | 45 | 41 | 112 | 45.5 | 50 | 50 | 42 | 114 |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 4.3 | 0.4 | | | None | - | - | - | 14.4 | 15 | 20 | 15 | 100 | 15.2 | 20 | 20 | 16 | 102 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 100 | 26.9 | 30 | 30 | 25 | 102 | |
| | | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 36.3 | 40 | 40 | 33 | 100 | 37.3 | 40 | 40 | 34 | 102 | |
| | | | | | | | | | | | | None | - | - | - | 45.1 | 50 | 50 | 48 | 258 | 47.3 | 50 | 50 | 50 | 268 | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 258 | 56.8 | 60 | 60 | 52 | 268 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 258 | 79.6 | 80 | 80 | 73 | 268 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 258 | 98.4 | 100 | 100 | 91 | 268 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 258 | 125.5 | 150 | 150 | 115 | 268 | |
| | | | | | | | | | | | | None | - | - | - | 44.6 | 45 | 50 | 47 | 267 | 46.6 | 50 | 60 | 50 | 261 | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.4 | 1 | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 267 | 62.4 | 70 | 70 | 57 | 261 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 267 | 88.9 | 90 | 90 | 82 | 261 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 267 | 110.5 | 125 | 125 | 102 | 261 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 267 | 141.8 | 150 | 150 | 130 | 261 |
| | | | | | | | | | | | | | None | - | - | - | 21 | 25 | 25 | 22 | 134 | 22 | 25 | 25 | 24 | 130 |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.7 | 0.5 | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 134 | 31.9 | 35 | 35 | 29 | 130 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 134 | 48.9 | 50 | 50 | 45 | 130 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 134 | 56.8 | 60 | 60 | 52 | 130 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 134 | 69.9 | 70 | 70 | 64 | 130 |
| | | | | | | | | | | | | | None | - | - | - | 16 | 20 | 20 | 17 | 115 | 16.8 | 20 | 20 | 18 | 113 |
| | 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 4.3 | 0.4 | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 115 | 26.9 | 30 | 30 | 25 | 113 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 115 | 47.3 | 50 | 50 | 43 | 113 |
| | | | | | | | | | | | | | None | - | - | - | 45.1 | 50 | 50 | 48 | 258 | 47.3 | 50 | 50 | 50 | 268 |

Table 161: ZY04 to 12 High Static Indoor Blower - Without Powered Convenience Outlet (with VFD)

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | 1MCA ¹ (amps) | 2-3 Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | 4 Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|--------------------------|--|--|--------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 45.3 | 50 | 50 | 48 | 258 | 47.5 | 50 | 60 | 51 | 268 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 258 | 56.8 | 60 | 60 | 52 | 268 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 258 | 79.6 | 80 | 80 | 73 | 268 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 258 | 98.4 | 100 | 100 | 91 | 268 | | |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 9.4 | 1 | | | None | - | - | - | 44.8 | 45 | 50 | 48 | 267 | 46.8 | 50 | 60 | 50 | 261 | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 267 | 62.4 | 70 | 70 | 57 | 261 | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 267 | 88.9 | 90 | 90 | 82 | 261 | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 267 | 110.5 | 125 | 125 | 102 | 261 | |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.7 | 0.5 | | | None | - | - | - | 21.3 | 25 | 25 | 23 | 134 | 22.3 | 25 | 25 | 24 | 130 | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 134 | 31.9 | 35 | 35 | 29 | 130 | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 134 | 48.9 | 50 | 50 | 45 | 130 | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 134 | 56.8 | 60 | 60 | 52 | 130 | |
| 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 4.3 | 0.4 | | | None | - | - | - | 17.3 | 20 | 20 | 19 | 115 | 18.1 | 20 | 20 | 19 | 113 | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 115 | 26.9 | 30 | 30 | 25 | 113 | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 115 | 47.3 | 50 | 50 | 43 | 113 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.8 | 13.5 | 1.1 | | None | - | - | - | 55.3 | 60 | 70 | 59 | 345 | 57.5 | 60 | 70 | 62 | 355 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 58.5 | 60 | 70 | 59 | 345 | 61.3 | 70 | 70 | 62 | 355 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81.4 | 90 | 90 | 75 | 345 | 84.1 | 90 | 90 | 77 | 355 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 100.1 | 110 | 110 | 92 | 345 | 102.9 | 110 | 110 | 95 | 355 | | |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 13.4 | 1 | | | None | - | - | - | 54.6 | 60 | 70 | 58 | 341 | 56.6 | 60 | 70 | 60 | 346 | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 64.9 | 70 | 70 | 60 | 341 | 67.4 | 70 | 70 | 62 | 346 | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.4 | 100 | 100 | 84 | 341 | 93.9 | 100 | 100 | 86 | 346 | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113 | 125 | 125 | 104 | 341 | 115.5 | 125 | 125 | 106 | 346 | |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 6.7 | 0.5 | | | None | - | - | - | 27.2 | 30 | 30 | 29 | 166 | 28.2 | 30 | 30 | 30 | 168 | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.1 | 35 | 35 | 30 | 166 | 34.4 | 35 | 35 | 32 | 168 | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.1 | 60 | 60 | 46 | 166 | 51.4 | 60 | 60 | 47 | 168 | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58 | 60 | 60 | 53 | 166 | 59.3 | 60 | 60 | 55 | 168 | |
| 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.4 | 0.4 | | | None | - | - | - | 20.4 | 25 | 25 | 22 | 129 | 21.2 | 25 | 25 | 23 | 131 | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 27.3 | 30 | 30 | 25 | 129 | 28.3 | 30 | 30 | 26 | 131 | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47.6 | 50 | 50 | 44 | 129 | 48.6 | 50 | 50 | 45 | 131 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZY04 to 12 high static indoor blower - with powered convenience outlet

Table 162: ZY04 to 12 high static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | 2. ³ Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | ⁴ min disconnect rating ¹ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ¹ / pwr exh | | |
|------------|----------------------|--------------|------|--------|--------------|-----|-----|----------------------|---------------------|---------------|-----------------|---|-------|------|------|-------------------------|--|--|---|-----|----------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | FLA | LRA | FLA | LRA | | | | | | | | | | | |
| | | Model | kW | Stages | Amps | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1.1 | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 103 | 25 | 25 | 35 | 26 | 105 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.9 | 30 | 30 | 27 | 103 | 30.3 | 35 | 35 | 28 | 105 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 39.3 | 40 | 40 | 36 | 103 | 40.6 | 45 | 45 | 37 | 105 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 53.5 | 60 | 60 | 49 | 103 | 54.9 | 60 | 60 | 50 | 105 | |
| | 230-3-60 | 10.4 | 73 | 16 | | | | 1.4 | 5.2 | 1 | | 8.6 | None | - | - | - | 23.9 | 25 | 30 | 24 | 106 | 24.9 | 25 | 35 | 26 | 108 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 31.4 | 35 | 35 | 29 | 106 | 32.6 | 35 | 35 | 30 | 108 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 43.5 | 45 | 45 | 40 | 106 | 44.8 | 45 | 45 | 41 | 108 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 60 | 60 | 60 | 55 | 106 | 61.3 | 70 | 70 | 56 | 108 |
| | 460-3-60 | 5.8 | 38 | 9 | | | | 0.8 | 2.6 | 0.5 | | 8.6 | None | - | - | - | 12.9 | 15 | 15 | 13 | 55 | 13.4 | 15 | 15 | 14 | 56 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.9 | 15 | 15 | 14 | 55 | 15.6 | 20 | 20 | 14 | 56 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.2 | 25 | 25 | 21 | 55 | 23.8 | 25 | 25 | 22 | 56 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26.9 | 30 | 30 | 25 | 55 | 27.6 | 30 | 30 | 25 | 56 |
| 575-3-60 | 3.8 | 36.5 | 6 | | | | 0.6 | 2 | 0.4 | | 8.6 | None | - | - | - | 9.1 | 15 | 15 | 9 | 50 | 9.5 | 15 | 15 | 10 | 51 | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 15.8 | 20 | 20 | 15 | 50 | 16.3 | 20 | 20 | 15 | 51 | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.3 | 25 | 25 | 20 | 50 | 21.8 | 25 | 25 | 20 | 51 | |
| | | | | | | | | | | | | None | - | - | - | 30.3 | 35 | 40 | 31 | 139 | 31.4 | 35 | 45 | 32 | 142 | |
| 05 (4) | 208-3-60 | 13.7 | 83.1 | 21 | | | 1.4 | 7.5 | 1.1 | | 8.6 | None | - | - | - | 30.3 | 35 | 40 | 31 | 139 | 31.4 | 35 | 45 | 32 | 142 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 31.8 | 35 | 40 | 31 | 139 | 33.1 | 35 | 45 | 32 | 142 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 42.1 | 45 | 45 | 39 | 139 | 43.5 | 45 | 45 | 40 | 142 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 56.4 | 60 | 60 | 52 | 139 | 57.8 | 60 | 60 | 53 | 142 | |
| | 230-3-60 | 13.7 | 83.1 | 21 | | | 1.4 | 7.5 | 1 | | | 8.6 | None | - | - | - | 30.3 | 35 | 40 | 31 | 146 | 31.3 | 35 | 45 | 32 | 148 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.3 | 35 | 40 | 32 | 146 | 35.5 | 40 | 45 | 33 | 148 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.4 | 50 | 50 | 43 | 146 | 47.6 | 50 | 50 | 44 | 148 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.9 | 70 | 70 | 58 | 146 | 64.1 | 70 | 70 | 59 | 148 |
| | 460-3-60 | 6.2 | 41 | 10 | | | 0.8 | 3.4 | 0.5 | | | 8.6 | None | - | - | - | 14.2 | 15 | 20 | 14 | 73 | 14.7 | 15 | 20 | 15 | 74 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.9 | 20 | 20 | 15 | 73 | 16.6 | 20 | 20 | 15 | 74 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.2 | 25 | 25 | 22 | 73 | 24.8 | 25 | 25 | 23 | 74 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 27.9 | 30 | 30 | 26 | 73 | 28.6 | 30 | 30 | 26 | 74 |
| 575-3-60 | 4.8 | 33 | 8 | | | 0.6 | 2.8 | 0.4 | | | 8.6 | None | - | - | - | 11.1 | 15 | 15 | 11 | 58 | 11.5 | 15 | 15 | 12 | 59 | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 16.8 | 20 | 20 | 15 | 58 | 17.3 | 20 | 20 | 16 | 59 | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.3 | 25 | 25 | 20 | 58 | 22.8 | 25 | 25 | 21 | 59 | |
| | | | | | | | | | | | | None | - | - | - | 35.4 | 40 | 50 | 36 | 196 | 36.5 | 40 | 50 | 37 | 198 | |
| 06 (5) | 208-3-60 | 15.9 | 110 | 25 | | | 2.3 | 8.9 | 1.1 | | 8.6 | None | - | - | - | 35.4 | 40 | 50 | 36 | 196 | 36.5 | 40 | 50 | 37 | 198 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 35.4 | 40 | 50 | 36 | 196 | 36.5 | 40 | 50 | 37 | 198 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.9 | 45 | 50 | 40 | 196 | 45.3 | 50 | 50 | 42 | 198 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 58.1 | 60 | 60 | 53 | 196 | 59.5 | 60 | 60 | 55 | 198 | |
| | 230-3-60 | 15.9 | 110 | 25 | | | 2.3 | 8.2 | 1 | | | 8.6 | None | - | - | - | 34.7 | 35 | 50 | 35 | 198 | 35.7 | 40 | 50 | 36 | 201 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 35.1 | 40 | 50 | 35 | 198 | 36.4 | 40 | 50 | 36 | 201 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 47.3 | 50 | 50 | 43 | 198 | 48.5 | 50 | 50 | 45 | 201 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63.8 | 70 | 70 | 59 | 198 | 65 | 70 | 70 | 60 | 201 |
| | 460-3-60 | 7.1 | 52 | 11 | | | 1.3 | 4.1 | 0.5 | | | 8.6 | None | - | - | - | 16.5 | 20 | 20 | 17 | 92 | 17 | 20 | 20 | 17 | 93 |
| | | | | | | | | | | | | | 11146 | 6 | 1 | 7.2 | 16.8 | 20 | 20 | 15 | 92 | 17.4 | 20 | 20 | 16 | 93 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 25.1 | 30 | 30 | 23 | 92 | 25.7 | 30 | 30 | 24 | 93 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.8 | 30 | 30 | 27 | 92 | 29.4 | 30 | 30 | 27 | 93 |
| 575-3-60 | 5.1 | 39.5 | 8 | | | 1.1 | 3.2 | 0.4 | | | 8.6 | None | - | - | - | 12.4 | 15 | 15 | 13 | 70 | 12.8 | 15 | 15 | 13 | 71 | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.8 | 25 | 25 | 21 | 70 | 23.3 | 25 | 25 | 21 | 71 | |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 33.8 | 35 | 35 | 31 | 70 | 34.3 | 35 | 35 | 32 | 71 | |
| | | | | | | | | | | | | None | - | - | - | 35.4 | 40 | 50 | 36 | 196 | 36.5 | 40 | 50 | 37 | 198 | |

Table 162: ZY04 to 12 high static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | 1 MCA ¹ (amps) | 2,3 Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | 4 min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|----------------------|--------------|----------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|----|--------|------|---------------------------|--|--|--------------------------------------|-----|----------------------|---|-----|---|-----|--|------|----|------|------|------|----|----|-----|------|-------|-----|----|------|-------|------|----|------|------|------|-----|----|-----|------|-------|-----|----|------|-------|------|----|------|-------|------|-----|-----|-----|-------|-------|------|-----|------|-------|------|----|------|-------|------|-----|-----|-----|-------|-----|-----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 07 (6) | 208-3-60 | 19 | 123 | 30 | | | | | | | | 2.3 | 10.2 | | | | 1.1 | 8.6 | | None | - | - | - | 42.9 | 45 | 60 | 44 | 210 | 45.1 | 50 | 60 | 46 | 220 | 10725 | 4.9 | 1 | 13.6 | 42.9 | 45 | 60 | 44 | 210 | 45.1 | 50 | 60 | 46 | 220 | 11725 | 12 | 1 | 33.3 | 59.8 | 60 | 60 | 55 | 210 | 62.5 | 70 | 70 | 58 | 220 | 12525 | 18.6 | 1 | 51.6 | 82.6 | 90 | 90 | 76 | 210 | 85.4 | 90 | 90 | 79 | 220 | | | | |
| 07 (6) | 230-3-60 | 19 | 123 | 30 | | | | 2.3 | 10.2 | 1 | 8.6 | None | - | - | - | 42.9 | 45 | 60 | 44 | 216 | 44.9 | 45 | 60 | 46 | 211 | 10725 | 6.5 | 1 | 15.6 | 42.9 | 45 | 60 | 44 | 216 | 44.9 | 45 | 60 | 46 | 211 | 11725 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 216 | 68.8 | 70 | 70 | 63 | 211 | 12525 | 24.8 | 1 | 59.7 | 92.8 | 100 | 100 | 85 | 216 | 95.3 | 100 | 100 | 88 | 211 | | | | | | | | | | | | | | |
| 07 (6) | 460-3-60 | 9.7 | 62 | 15 | | | | 1.3 | 4.8 | 0.5 | 8.6 | None | - | - | - | 21.7 | 25 | 30 | 22 | 110 | 22.7 | 25 | 30 | 23 | 107 | 10746 | 6 | 1 | 7.2 | 21.7 | 25 | 30 | 16 | 110 | 22.7 | 25 | 30 | 17 | 107 | 11746 | 16.5 | 1 | 19.8 | 33.4 | 35 | 35 | 31 | 110 | 34.7 | 35 | 35 | 32 | 107 | 12646 | 25.5 | 1 | 30.7 | 47.1 | 50 | 50 | 43 | 110 | 48.3 | 50 | 50 | 44 | 107 | | | | | | | | | | | | | | |
| 07 (6) | 575-3-60 | 7.4 | 50 | 12 | | | | 1.1 | 3.4 | 0.4 | 8.6 | None | - | - | - | 16.6 | 20 | 20 | 17 | 89 | 17.4 | 20 | 20 | 18 | 86 | 11758 | 17 | 1 | 16.4 | 26.9 | 30 | 30 | 25 | 89 | 27.9 | 30 | 30 | 26 | 86 | 12658 | 25.7 | 1 | 24.7 | 37.3 | 40 | 40 | 34 | 89 | 38.3 | 40 | 40 | 35 | 86 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 10.2 | 1.1 | 8.6 | None | - | - | - | 41.1 | 45 | 50 | 42 | 213 | 43.3 | 45 | 50 | 45 | 218 | 10725 | 4.9 | 1 | 13.6 | 41.1 | 45 | 50 | 42 | 213 | 43.3 | 45 | 50 | 45 | 218 | 11725 | 12 | 1 | 33.3 | 59.8 | 60 | 60 | 55 | 213 | 62.5 | 70 | 70 | 58 | 218 | 12525 | 18.6 | 1 | 51.6 | 82.6 | 90 | 90 | 76 | 213 | 85.4 | 90 | 90 | 79 | 218 | | | | | | | | | | | | | | |
| A7 (6) | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 10.2 | 1 | 8.6 | None | - | - | - | 41.1 | 45 | 50 | 42 | 219 | 43.1 | 45 | 60 | 45 | 224 | 10725 | 6.5 | 1 | 15.6 | 41.1 | 45 | 50 | 42 | 219 | 43.1 | 45 | 60 | 45 | 224 | 11725 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 219 | 68.8 | 70 | 70 | 63 | 224 | 12525 | 24.8 | 1 | 59.7 | 92.8 | 100 | 100 | 85 | 219 | 95.3 | 100 | 100 | 88 | 224 | | | | | | | | | | | | | | |
| A7 (6) | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 4.8 | 0.5 | 8.6 | None | - | - | - | 20.2 | 25 | 25 | 21 | 109 | 21.2 | 25 | 25 | 22 | 111 | 10746 | 6 | 1 | 7.2 | 20.2 | 25 | 25 | 16 | 109 | 21.2 | 25 | 25 | 17 | 111 | 11746 | 16.5 | 1 | 19.8 | 33.4 | 35 | 35 | 31 | 109 | 34.7 | 35 | 35 | 32 | 111 | 12646 | 25.5 | 1 | 30.7 | 47.1 | 50 | 50 | 43 | 109 | 48.3 | 50 | 50 | 44 | 111 | | | | | | | | | | | | | | |
| A7 (6) | 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 3.4 | 0.4 | 8.6 | None | - | - | - | 15.2 | 20 | 20 | 16 | 89 | 16 | 20 | 20 | 17 | 91 | 11758 | 17 | 1 | 16.4 | 26.9 | 30 | 30 | 25 | 89 | 27.9 | 30 | 30 | 26 | 91 | 12658 | 25.7 | 1 | 24.7 | 37.3 | 40 | 40 | 34 | 89 | 38.3 | 40 | 40 | 35 | 91 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 10.2 | 1.1 | 8.6 | None | - | - | - | 49.7 | 50 | 60 | 53 | 253 | 51.9 | 60 | 60 | 56 | 263 | 11725 | 12 | 1 | 33.3 | 59.8 | 60 | 60 | 55 | 253 | 62.5 | 70 | 70 | 58 | 263 | 12525 | 18.6 | 1 | 51.6 | 82.6 | 90 | 90 | 76 | 253 | 85.4 | 90 | 90 | 79 | 263 | 13225 | 24 | 1 | 66.6 | 101.4 | 110 | 110 | 93 | 253 | 104.1 | 110 | 110 | 96 | 263 | 14225 | 31.8 | 2 | 88.3 | 128.5 | 150 | 150 | 118 | 253 | 131.3 | 150 | 150 | 121 | 263 |
| 08 (7.5) | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 10.2 | 1 | 8.6 | None | - | - | - | 49.7 | 50 | 60 | 53 | 260 | 51.7 | 60 | 60 | 56 | 254 | 11725 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 260 | 68.8 | 70 | 70 | 63 | 254 | 12525 | 24.8 | 1 | 59.7 | 92.8 | 100 | 100 | 85 | 260 | 95.3 | 100 | 100 | 88 | 254 | 13225 | 32 | 1 | 77 | 114.4 | 125 | 125 | 105 | 260 | 116.9 | 125 | 125 | 108 | 254 | 14225 | 42.4 | 2 | 102 | 145.6 | 150 | 150 | 134 | 260 | 148.1 | 150 | 150 | 136 | 254 |
| 08 (7.5) | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.8 | 0.5 | 8.6 | None | - | - | - | 23.3 | 25 | 25 | 25 | 130 | 24.3 | 25 | 25 | 26 | 127 | 11746 | 16.5 | 1 | 19.8 | 33.4 | 35 | 35 | 31 | 130 | 34.7 | 35 | 35 | 32 | 127 | 12846 | 27.8 | 1 | 33.4 | 50.4 | 60 | 60 | 46 | 130 | 51.7 | 60 | 60 | 48 | 127 | 13346 | 33 | 1 | 39.7 | 58.3 | 60 | 60 | 54 | 130 | 59.6 | 60 | 60 | 55 | 127 | 14246 | 41.7 | 2 | 50.2 | 71.4 | 80 | 80 | 66 | 130 | 72.7 | 80 | 80 | 67 | 127 |
| 08 (7.5) | 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 3.4 | 0.4 | 8.6 | None | - | - | - | 16.8 | 20 | 20 | 18 | 105 | 17.6 | 20 | 20 | 19 | 102 | 11758 | 17 | 1 | 16.4 | 26.9 | 30 | 30 | 25 | 105 | 27.9 | 30 | 30 | 26 | 102 | 13458 | 34 | 1 | 32.7 | 47.3 | 50 | 50 | 43 | 105 | 48.3 | 50 | 50 | 44 | 102 | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Table 162: ZY04 to 12 high static indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | 1 MCA ¹ (amps) | 2,3 Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | 4 min disconnect rating ⁴ | | MCA w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|------|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|---------------------------|--|--|--------------------------------------|------|----------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | | | | | 83.1 | 21 | 2.3 | 10.2 | | | | 1.1 | 8.6 | | | | None | - |
| 11725 | 12 | | | | | | | 1 | 33.3 | 59.8 | 60 | | | | | 60 | 55 | 253 | | | 62.5 | 70 | 70 | 58 | 263 |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 82.6 | 90 | | | | | 90 | 76 | 253 | | | 85.4 | 90 | 90 | 79 | 263 |
| 13225 | 24 | | | | | | | 1 | 66.6 | 101.4 | 110 | | | | | 110 | 93 | 253 | | | 104.1 | 110 | 110 | 96 | 263 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 128.5 | 150 | | | | | 150 | 118 | 253 | | | 131.3 | 150 | 150 | 121 | 263 |
| None | - | | | | | | | - | - | 49.9 | 50 | | | | | 60 | 53 | 260 | | | 51.9 | 60 | 60 | 56 | 254 |
| 230-3-60 | 13.7 | | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 10.2 | 1 | 8.6 | None | - | - | - | 49.9 | 50 | 60 | 53 | 260 | 51.9 | 60 | 60 | 56 | 254 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 66.3 | 70 | 70 | 61 | 260 | 68.8 | 70 | 70 | 63 | 254 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 92.8 | 100 | 100 | 85 | 260 | 95.3 | 100 | 100 | 88 | 254 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 114.4 | 125 | 125 | 105 | 260 | 116.9 | 125 | 125 | 108 | 254 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 145.6 | 150 | 150 | 134 | 260 | 148.1 | 150 | 150 | 136 | 254 |
| | | | | | | | | | | | | None | - | - | - | 23.6 | 25 | 25 | 25 | 130 | 24.6 | 25 | 25 | 26 | 127 |
| 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.8 | 0.5 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 33.4 | 35 | 35 | 31 | 130 | 34.7 | 35 | 35 | 32 | 127 | |
| | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.4 | 60 | 60 | 46 | 130 | 51.7 | 60 | 60 | 48 | 127 | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.3 | 60 | 60 | 54 | 130 | 59.6 | 60 | 60 | 55 | 127 | |
| | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.4 | 80 | 80 | 66 | 130 | 72.7 | 80 | 80 | 67 | 127 | |
| | | | | | | | | | | | None | - | - | - | 18.1 | 20 | 20 | 19 | 105 | 18.9 | 20 | 20 | 20 | 102 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 26.9 | 30 | 30 | 25 | 105 | 27.9 | 30 | 30 | 26 | 102 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.8 | 14.9 | 1.1 | 8.6 | 13458 | 34 | 1 | 32.7 | 47.3 | 50 | 50 | 43 | 105 | 48.3 | 50 | 50 | 44 | 102 |
| | | | | | | | | | | | | None | - | - | - | 61 | 70 | 70 | 66 | 328 | 63.2 | 70 | 70 | 68 | 338 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 65.6 | 70 | 70 | 66 | 328 | 68.4 | 70 | 70 | 68 | 338 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 88.5 | 90 | 90 | 81 | 328 | 91.3 | 100 | 100 | 84 | 338 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 107.3 | 110 | 110 | 99 | 328 | 110 | 125 | 125 | 101 | 338 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 134.4 | 150 | 150 | 124 | 328 | 137.1 | 150 | 150 | 126 | 338 |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 15 | 1 | 8.6 | None | - | - | - | 60.5 | 70 | 70 | 65 | 326 | 62.5 | 70 | 70 | 67 | 331 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 72.3 | 80 | 80 | 66 | 326 | 74.8 | 80 | 80 | 69 | 331 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 98.8 | 100 | 100 | 91 | 326 | 101.3 | 110 | 110 | 93 | 331 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 120.4 | 125 | 125 | 111 | 326 | 122.9 | 125 | 125 | 113 | 331 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 151.6 | 175 | 175 | 139 | 326 | 154.1 | 175 | 175 | 142 | 331 |
| | | | | | | | | | | | | None | - | - | - | 30.2 | 35 | 35 | 32 | 161 | 31.2 | 35 | 35 | 34 | 163 |
| 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 7.5 | 0.5 | 8.6 | 11746 | 16.5 | 1 | 19.8 | 36.8 | 40 | 40 | 34 | 161 | 38.1 | 40 | 40 | 35 | 163 | |
| | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 53.8 | 60 | 60 | 50 | 161 | 55.1 | 60 | 60 | 51 | 163 | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 61.7 | 70 | 70 | 57 | 161 | 62.9 | 70 | 70 | 58 | 163 | |
| | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 74.8 | 80 | 80 | 69 | 161 | 76.1 | 80 | 80 | 70 | 163 | |
| | | | | | | | | | | | None | - | - | - | 22.3 | 25 | 25 | 24 | 126 | 23.1 | 25 | 25 | 25 | 128 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.7 | 30 | 30 | 27 | 126 | 30.7 | 35 | 35 | 28 | 128 | |
| 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.6 | 0.4 | 8.6 | 13458 | 34 | 1 | 32.7 | 50 | 50 | 50 | 46 | 126 | 51 | 60 | 60 | 47 | 128 | |

- 1 Minimum Circuit Ampacity.
- 2 Dual Element, Time Delay Type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Table 163: ZY04 to 12 High Static Indoor Blower - With Powered Convenience Outlet (with VFD)

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|-----|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | With VFD | | | | | | | | | | | | | | | | | | | | | | | | | |
| A7 (6) | 208-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 40.8 | 45 | 50 | 42 | 222 | 43 | 45 | 50 | 44 | 227 | | |
| | | | | | | | | | | | | 10725 | 4.9 | 1 | 13.6 | 40.8 | 45 | 50 | 42 | 222 | 43 | 45 | 50 | 44 | 227 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 222 | 62.1 | 70 | 70 | 57 | 227 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 222 | 85 | 90 | 90 | 78 | 227 | | |
| | 230-3-60 | 17.6 | 136 | 27 | | | | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 40.3 | 45 | 50 | 41 | 231 | 42.3 | 45 | 50 | 44 | 236 | | |
| | | | | | | | | | | | | 10725 | 6.5 | 1 | 15.6 | 40.3 | 45 | 50 | 41 | 231 | 42.3 | 45 | 50 | 44 | 236 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 231 | 67.8 | 70 | 70 | 62 | 236 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 231 | 94.3 | 100 | 100 | 87 | 236 | | |
| | 460-3-60 | 8.5 | 66.1 | 13 | | | | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 20.1 | 25 | 25 | 21 | 114 | 21.1 | 25 | 25 | 22 | 117 | | |
| | | | | | | | | | | | | 10746 | 6 | 1 | 7.2 | 20.1 | 25 | 25 | 16 | 114 | 21.1 | 25 | 25 | 17 | 117 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 114 | 34.6 | 35 | 35 | 32 | 117 | | |
| | | | | | | | | | | | | 12646 | 25.5 | 1 | 30.7 | 46.9 | 50 | 50 | 43 | 114 | 48.2 | 50 | 50 | 44 | 117 | | |
| 575-3-60 | 6.3 | 55.3 | 10 | | | | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 16.1 | 20 | 20 | 17 | 102 | 16.9 | 20 | 20 | 18 | 104 | | | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 102 | 29 | 30 | 30 | 27 | 104 | | | |
| | | | | | | | | | | | 12658 | 25.7 | 1 | 24.7 | 38.4 | 40 | 40 | 35 | 102 | 39.4 | 40 | 40 | 36 | 104 | | | |
| | | | | | | | | | | | None | - | - | - | 49.4 | 50 | 60 | 53 | 262 | 51.6 | 60 | 60 | 55 | 272 | | | |
| 08 (7.5) | 208-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 49.4 | 50 | 60 | 53 | 262 | 51.6 | 60 | 60 | 55 | 272 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 262 | 62.1 | 70 | 70 | 57 | 272 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 262 | 85 | 90 | 90 | 78 | 272 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 262 | 103.8 | 110 | 110 | 95 | 272 | | |
| | 230-3-60 | 13.6 | 83.1 | 21 | 13.6 | 83.1 | 21 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 48.9 | 50 | 60 | 52 | 271 | 50.9 | 60 | 60 | 55 | 266 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 271 | 67.8 | 70 | 70 | 62 | 266 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 271 | 94.3 | 100 | 100 | 87 | 266 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 271 | 115.9 | 125 | 125 | 107 | 266 | | |
| | 460-3-60 | 6.1 | 41 | 10 | 6.1 | 41 | 10 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 23.2 | 25 | 25 | 25 | 136 | 24.2 | 25 | 25 | 26 | 132 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 136 | 34.6 | 35 | 35 | 32 | 132 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 136 | 51.6 | 60 | 60 | 47 | 132 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 136 | 59.4 | 60 | 60 | 55 | 132 | | |
| 575-3-60 | 4.2 | 33 | 7 | 4.2 | 33 | 7 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 17.7 | 20 | 20 | 19 | 117 | 18.5 | 20 | 20 | 20 | 114 | | | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 117 | 29 | 30 | 30 | 27 | 114 | | | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 117 | 49.4 | 50 | 50 | 45 | 114 | | | |

Table 163: ZY04 to 12 High Static Indoor Blower - With Powered Convenience Outlet (with VFD)

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 49.6 | 50 | 60 | 53 | 262 | 51.8 | 60 | 60 | 56 | 272 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 262 | 62.1 | 70 | 70 | 57 | 272 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 262 | 85 | 90 | 90 | 78 | 272 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 262 | 103.8 | 110 | 110 | 95 | 272 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 262 | 130.9 | 150 | 150 | 120 | 272 |
| | 230-3-60 | 13.7 | 83.1 | 21 | 13.7 | 83.1 | 21 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 49.1 | 50 | 60 | 53 | 271 | 51.1 | 60 | 60 | 55 | 266 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 271 | 67.8 | 70 | 70 | 62 | 266 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 271 | 94.3 | 100 | 100 | 87 | 266 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 271 | 115.9 | 125 | 125 | 107 | 266 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 271 | 147.1 | 150 | 150 | 135 | 266 |
| | 460-3-60 | 6.2 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 23.5 | 25 | 25 | 25 | 136 | 24.5 | 25 | 25 | 26 | 132 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 136 | 34.6 | 35 | 35 | 32 | 132 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 136 | 51.6 | 60 | 60 | 47 | 132 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 136 | 59.4 | 60 | 60 | 55 | 132 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 136 | 72.6 | 80 | 80 | 67 | 132 |
| | 575-3-60 | 4.8 | 33 | 8 | 4.8 | 33 | 8 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 19 | 20 | 20 | 20 | 117 | 19.8 | 20 | 20 | 21 | 114 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 117 | 29 | 30 | 30 | 27 | 114 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 117 | 49.4 | 50 | 50 | 45 | 114 | |
| 12 (10) | 208-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.8 | 13.5 | 1.1 | 8.6 | None | - | - | - | 59.6 | 60 | 70 | 64 | 349 | 61.8 | 70 | 70 | 66 | 359 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.9 | 70 | 70 | 64 | 349 | 66.6 | 70 | 70 | 66 | 359 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 86.8 | 90 | 90 | 80 | 349 | 89.5 | 90 | 90 | 82 | 359 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 105.5 | 110 | 110 | 97 | 349 | 108.3 | 110 | 110 | 100 | 359 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 132.6 | 150 | 150 | 122 | 349 | 135.4 | 150 | 150 | 125 | 359 |
| | 230-3-60 | 16 | 110 | 25 | 16 | 110 | 25 | 5.2 | 13.4 | 1 | 8.6 | None | - | - | - | 58.9 | 60 | 70 | 63 | 345 | 60.9 | 70 | 70 | 65 | 350 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 70.3 | 80 | 80 | 65 | 345 | 72.8 | 80 | 80 | 67 | 350 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 96.8 | 100 | 100 | 89 | 345 | 99.3 | 100 | 100 | 91 | 350 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 118.4 | 125 | 125 | 109 | 345 | 120.9 | 125 | 125 | 111 | 350 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 149.6 | 150 | 150 | 138 | 345 | 152.1 | 175 | 175 | 140 | 350 |
| | 460-3-60 | 7.8 | 52 | 12 | 7.8 | 52 | 12 | 2.9 | 6.7 | 0.5 | 8.6 | None | - | - | - | 29.4 | 30 | 35 | 32 | 168 | 30.4 | 35 | 35 | 33 | 170 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 35.8 | 40 | 40 | 33 | 168 | 37.1 | 40 | 40 | 34 | 170 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 52.8 | 60 | 60 | 49 | 168 | 54.1 | 60 | 60 | 50 | 170 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 60.7 | 70 | 70 | 56 | 168 | 61.9 | 70 | 70 | 57 | 170 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 73.8 | 80 | 80 | 68 | 168 | 75.1 | 80 | 80 | 69 | 170 |
| | 575-3-60 | 5.7 | 38.9 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.4 | 0.4 | 8.6 | None | - | - | - | 22.1 | 25 | 25 | 24 | 131 | 22.9 | 25 | 25 | 25 | 133 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 131 | 30.4 | 35 | 35 | 28 | 133 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 131 | 50.8 | 60 | 60 | 47 | 133 | |

- 1 Minimum Circuit Ampacity.
- 2 Dual Element, Time Delay Type.
- 3 HACR type per NEC.
- 4 Non-fused Disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL04 to 06 standard indoor blowers - without powered convenience outlet

Table 164: ZL04 to 06 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² / breaker ³ size w/ power exh (amps) | Max fuse ² / breaker ³ size w/ power exh (amps) | Min disconnect rating ⁴ / power exh | | | |
|------------|----------------------|--------------|------|--------|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|-------|-------|------|-------------------------|--|--|------------------------------------|----|-------------------------------------|---|---|--|----|----|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | FLA | LRA | FLA | LRA | | | | | | | | | | | | |
| | | Model | kW | Stages | Amps | FLA | LRA | | | | | FLA | LRA | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 6.6 | 1.5 | | None | - | - | - | 27 | 30 | 40 | 27 | 86 | 28.5 | 30 | 40 | 29 | 90 | | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 37.8 | 40 | 40 | 35 | 86 | 39.6 | 40 | 40 | 36 | 90 | | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 55.8 | 60 | 60 | 51 | 86 | 57.6 | 60 | 60 | 53 | 90 | | |
| | 230-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 6 | 1.3 | | | None | - | - | - | 26.4 | 30 | 40 | 26 | 86 | 27.7 | 30 | 40 | 28 | 89 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 41.4 | 45 | 45 | 38 | 86 | 43 | 45 | 45 | 40 | 89 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 62.3 | 70 | 70 | 57 | 86 | 63.9 | 70 | 70 | 59 | 89 | |
| | 208-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 6.6 | 1.1 | | | None | - | - | - | 21.4 | 25 | 30 | 22 | 76 | 22.5 | 25 | 30 | 23 | 78 | |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 25.3 | 30 | 30 | 23 | 76 | 26.6 | 30 | 30 | 24 | 78 | |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 35.6 | 40 | 40 | 33 | 76 | 37 | 40 | 40 | 34 | 78 | |
| | | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 49.9 | 50 | 50 | 46 | 76 | 51.3 | 60 | 60 | 47 | 78 | |
| | 230-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 6 | 1 | | | None | - | - | - | 20.8 | 25 | 30 | 21 | 76 | 21.8 | 25 | 30 | 22 | 78 | |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 27 | 30 | 30 | 25 | 76 | 28.3 | 30 | 30 | 26 | 78 | |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 39.1 | 40 | 40 | 36 | 76 | 40.4 | 45 | 45 | 37 | 78 | |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 55.6 | 60 | 60 | 51 | 76 | 56.9 | 60 | 60 | 52 | 78 | |
| | 460-3-60 | 5.1 | 37 | 8 | | | | 1.6 | 3.2 | 0.5 | | | None | - | - | - | 11.2 | 15 | 15 | 11 | 39 | 11.7 | 15 | 15 | 12 | 40 | |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 13 | 15 | 15 | 12 | 39 | 13.6 | 15 | 15 | 13 | 40 | |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.3 | 25 | 25 | 20 | 39 | 21.9 | 25 | 25 | 20 | 40 | |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 25 | 25 | 23 | 39 | 25.6 | 30 | 30 | 24 | 40 | | |
| 575-3-60 | 3.2 | 26 | 5 | | | | 2.8 | 6 | 0.4 | | | None | - | - | - | 9.2 | 15 | 15 | 10 | 27 | 9.6 | 15 | 15 | 10 | 28 | | |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.1 | 15 | 15 | 13 | 27 | 14.6 | 15 | 15 | 13 | 28 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.6 | 20 | 20 | 18 | 27 | 20.1 | 25 | 25 | 19 | 28 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 05 (4) | 208-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 8.4 | 1.1 | | | None | - | - | - | 28.7 | 30 | 40 | 29 | 85 | 29.8 | 30 | 40 | 30 | 88 | |
| | | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 28.7 | 30 | 40 | 29 | 85 | 29.8 | 30 | 40 | 30 | 88 | |
| | | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 37.9 | 40 | 40 | 35 | 85 | 39.3 | 40 | 40 | 36 | 88 | |
| | | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 52.1 | 60 | 60 | 48 | 85 | 53.5 | 60 | 60 | 49 | 88 | |
| | 230-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 7.6 | 1 | | | | None | - | - | - | 27.9 | 30 | 40 | 28 | 85 | 28.9 | 30 | 40 | 29 | 87 |
| | | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 29 | 30 | 40 | 28 | 85 | 30.3 | 35 | 40 | 29 | 87 |
| | | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.1 | 45 | 45 | 38 | 85 | 42.4 | 45 | 45 | 39 | 87 |
| | | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 57.6 | 60 | 60 | 53 | 85 | 58.9 | 60 | 60 | 54 | 87 |
| | 460-3-60 | 6.4 | 41 | 10 | | | | 1.6 | 4 | 0.5 | | | | None | - | - | - | 13.6 | 15 | 20 | 14 | 43 | 14.1 | 15 | 20 | 14 | 44 |
| | | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14 | 15 | 20 | 13 | 43 | 14.6 | 15 | 20 | 13 | 44 |
| | | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.3 | 25 | 25 | 20 | 43 | 22.9 | 25 | 25 | 21 | 44 |
| | | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 26 | 30 | 30 | 24 | 43 | 26.6 | 30 | 30 | 24 | 44 |
| | 575-3-60 | 4.6 | 33 | 7 | | | | 2.8 | 7.6 | 0.4 | | | | None | - | - | - | 11.6 | 15 | 15 | 12 | 34 | 12 | 15 | 15 | 12 | 35 |
| | | | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 14.9 | 15 | 15 | 14 | 34 | 15.4 | 20 | 20 | 14 | 35 |
| | | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 20.4 | 25 | 25 | 19 | 34 | 20.9 | 25 | 25 | 19 | 35 |

Table 164: ZL04 to 06 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² / breaker ³ size w/ power exh (amps) | Max fuse ² / breaker ³ size w/ power exh (amps) | Min disconnect rating ⁴ / power exh | | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|-------|--------|------|-------------------------|--|--|------------------------------------|-----|-------------------------------------|---|---|--|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | 06 (5) | 208-3-60 | 16.2 | 110 | 25 | | | | | | | | 2.8 | 8.4 | | | | 1.1 | | | | | None | - | - |
| 10625 | 4.9 | | | | | | | 1 | 13.6 | 31.5 | 35 | | | | | 45 | 32 | 112 | | | 32.6 | 35 | 45 | 33 | 115 | |
| 11125 | 7.9 | | | | | | | 1 | 21.9 | 37.9 | 40 | | | | | 45 | 35 | 112 | | | 39.3 | 40 | 45 | 36 | 115 | |
| 11625 | 12 | | | | | | | 1 | 33.3 | 52.1 | 60 | | | | | 60 | 48 | 112 | | | 53.5 | 60 | 60 | 49 | 115 | |
| 230-3-60 | 16.2 | | 110 | 25 | | | | 2.8 | 7.6 | 1 | | | None | - | - | - | 30.7 | 35 | 45 | 31 | 112 | 31.7 | 35 | 45 | 32 | 114 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 30.7 | 35 | 45 | 31 | 112 | 31.7 | 35 | 45 | 32 | 114 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 41.1 | 45 | 45 | 38 | 112 | 42.4 | 45 | 45 | 39 | 114 |
| 460-3-60 | 7.6 | | 52 | 12 | | | | 1.6 | 4 | 0.5 | | | None | - | - | - | 15.1 | 20 | 20 | 15 | 54 | 15.6 | 20 | 20 | 16 | 55 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 15.1 | 20 | 20 | 13 | 54 | 15.6 | 20 | 20 | 13 | 55 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 22.3 | 25 | 25 | 20 | 54 | 22.9 | 25 | 25 | 21 | 55 |
| 575-3-60 | 5.1 | | 43.8 | 8 | | | | 2.8 | 7.6 | 0.4 | | | None | - | - | - | 12.2 | 15 | 15 | 13 | 45 | 12.6 | 15 | 15 | 13 | 46 |
| | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 20.4 | 25 | 25 | 19 | 45 | 20.9 | 25 | 25 | 19 | 46 |
| | | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 31.4 | 35 | 35 | 29 | 45 | 31.9 | 35 | 35 | 29 | 46 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL04 to 06 standard indoor blower - with powered convenience outlet

Table 165: ZL04 to 06 standard indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | 1 MCA¹ (amps) | Min fuse²/breaker³ size (amps) | Max fuse² / breaker³ size (amps) | Min disconnect rating⁴ | | MCA¹ w/pwr exh (amps) | Min fuse²/breaker³ size w/ pwr exh (amps) | Max fuse²/breaker³ size w/ power exh (amps) | | Min disconnect rating⁴/ power exh |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|------|--------|------|---------------|--------------------------------|----------------------------------|------------------------|------|-----------------------|---|---|-----|-----------------------------------|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 6.6 | 1.5 | 8.6 | None | - | - | - | 31.3 | 35 | 45 | 32 | 91 | 32.8 | 35 | 45 | 34 | 94 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 43.1 | 45 | 45 | 40 | 91 | 45 | 45 | 41 | 94 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 61.1 | 70 | 70 | 56 | 91 | 63 | 70 | 58 | 94 | |
| | 230-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 6 | 1.3 | 8.6 | None | - | - | - | 30.7 | 35 | 40 | 31 | 91 | 32 | 35 | 45 | 33 | 93 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 46.8 | 50 | 50 | 43 | 91 | 48.4 | 50 | 50 | 45 | 93 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 67.6 | 70 | 70 | 62 | 91 | 69.3 | 70 | 64 | 93 | |
| | 208-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 6.6 | 1.1 | 8.6 | None | - | - | - | 25.7 | 30 | 35 | 27 | 80 | 26.8 | 30 | 35 | 28 | 83 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 30.6 | 35 | 35 | 28 | 80 | 32 | 35 | 29 | 83 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41 | 45 | 45 | 38 | 80 | 42.4 | 45 | 45 | 39 | 83 |
| | 230-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 6 | 1 | 8.6 | 11625 | 12 | 1 | 33.3 | 55.3 | 60 | 60 | 51 | 80 | 56.6 | 60 | 60 | 52 | 83 |
| | | | | | | | | | | | | None | - | - | - | 25.1 | 30 | 30 | 26 | 80 | 26.1 | 30 | 35 | 27 | 82 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 32.4 | 35 | 35 | 30 | 80 | 33.6 | 35 | 35 | 31 | 82 |
| | 460-3-60 | 5.1 | 37 | 8 | | | | 1.6 | 3.2 | 0.5 | 8.6 | 11125 | 10.5 | 1 | 25.3 | 44.5 | 45 | 45 | 41 | 80 | 45.8 | 50 | 50 | 42 | 82 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 61 | 70 | 70 | 56 | 80 | 62.3 | 70 | 70 | 57 | 82 |
| | | | | | | | | | | | | None | - | - | - | 13.4 | 15 | 15 | 14 | 41 | 13.9 | 15 | 15 | 14 | 42 |
| | 575-3-60 | 3.2 | 26 | 5 | | | | 2.8 | 6 | 0.4 | 8.6 | 10646 | 6 | 1 | 7.2 | 15.7 | 20 | 20 | 14 | 41 | 16.3 | 20 | 20 | 15 | 42 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 23.9 | 25 | 25 | 22 | 41 | 24.6 | 25 | 25 | 23 | 42 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 27.7 | 30 | 30 | 25 | 41 | 28.3 | 30 | 30 | 26 | 42 |
| 575-3-60 | 3.2 | 26 | 5 | | | | 2.8 | 6 | 0.4 | 8.6 | None | - | - | - | 10.9 | 15 | 15 | 12 | 29 | 11.3 | 15 | 15 | 12 | 29 | |
| | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 16.3 | 20 | 20 | 15 | 29 | 16.8 | 20 | 20 | 15 | 29 | |
| | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.8 | 25 | 25 | 20 | 29 | 22.3 | 25 | 25 | 20 | 29 | |
| 05 (4) | 208-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 8.4 | 1.1 | 8.6 | None | - | - | - | 33 | 35 | 45 | 34 | 89 | 34.1 | 35 | 45 | 35 | 92 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 33 | 35 | 45 | 34 | 89 | 34.3 | 35 | 45 | 35 | 92 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 43.3 | 45 | 45 | 40 | 89 | 44.6 | 45 | 45 | 41 | 92 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 57.5 | 60 | 60 | 53 | 89 | 58.9 | 60 | 60 | 54 | 92 |
| | 230-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 7.6 | 1 | 8.6 | None | - | - | - | 32.2 | 35 | 45 | 33 | 89 | 33.2 | 35 | 45 | 34 | 92 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.4 | 35 | 45 | 33 | 89 | 35.6 | 40 | 45 | 34 | 92 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.5 | 50 | 50 | 43 | 89 | 47.8 | 50 | 50 | 44 | 92 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63 | 70 | 70 | 58 | 89 | 64.3 | 70 | 70 | 59 | 92 |
| | 460-3-60 | 6.4 | 41 | 10 | | | | 1.6 | 4 | 0.5 | 8.6 | None | - | - | - | 15.8 | 20 | 20 | 16 | 45 | 16.3 | 20 | 20 | 17 | 46 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.7 | 20 | 20 | 15 | 45 | 17.3 | 20 | 20 | 16 | 46 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.9 | 25 | 25 | 23 | 45 | 25.6 | 30 | 30 | 24 | 46 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.7 | 30 | 30 | 26 | 45 | 29.3 | 30 | 30 | 27 | 46 |
| | 575-3-60 | 4.6 | 33 | 7 | | | | 2.8 | 7.6 | 0.4 | 8.6 | None | - | - | - | 13.4 | 15 | 15 | 14 | 36 | 13.8 | 15 | 15 | 14 | 36 |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 17.1 | 20 | 20 | 16 | 36 | 17.6 | 20 | 20 | 16 | 36 |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 36 | 23.1 | 25 | 25 | 21 | 36 |

Table 165: ZL04 to 06 standard indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | ¹ MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ power exh (amps) | | Min disconnect rating ⁴ / power exh | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|------|--------|------|--------------------------------------|---|--|------------------------------------|-----|-----------------------------------|---|-----|---|-----|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | | | | |
| | | 06 (5) | 208-3-60 | 16.2 | 110 | 25 | | | | | | | | 2.8 | 8.4 | | | | 1.1 | 8.6 | | None | - | - | - | 35.8 | 40 |
| 10625 | 4.9 | | | | | | | 1 | 13.6 | 35.8 | 40 | | | | | 50 | 36 | 116 | | | 36.9 | 40 | 50 | 38 | 119 | | |
| 11125 | 7.9 | | | | | | | 1 | 21.9 | 43.3 | 45 | | | | | 50 | 40 | 116 | | | 44.6 | 45 | 50 | 41 | 119 | | |
| 11625 | 12 | | | | | | | 1 | 33.3 | 57.5 | 60 | | | | | 60 | 53 | 116 | | | 58.9 | 60 | 60 | 54 | 119 | | |
| 230-3-60 | 16.2 | | 110 | 25 | | | | 2.8 | 7.6 | 1 | 8.6 | None | - | - | - | 35 | 35 | 50 | 36 | 116 | 36 | 40 | 50 | 37 | 119 | | |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 35 | 35 | 50 | 36 | 116 | 36 | 40 | 50 | 37 | 119 | | |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46.5 | 50 | 50 | 43 | 116 | 47.8 | 50 | 50 | 44 | 119 | | |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63 | 70 | 70 | 58 | 116 | 64.3 | 70 | 70 | 59 | 119 | | |
| 460-3-60 | 7.6 | | 52 | 12 | | | | 1.6 | 4 | 0.5 | 8.6 | None | - | - | - | 17.3 | 20 | 20 | 18 | 56 | 17.8 | 20 | 20 | 18 | 57 | | |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.3 | 20 | 20 | 15 | 56 | 17.8 | 20 | 20 | 16 | 57 | | |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.9 | 25 | 25 | 23 | 56 | 25.6 | 30 | 30 | 24 | 57 | | |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.7 | 30 | 30 | 26 | 56 | 29.3 | 30 | 30 | 27 | 57 | | |
| 575-3-60 | 5.1 | | 43.8 | 8 | | | | 2.8 | 7.6 | 0.4 | 8.6 | None | - | - | - | 14 | 15 | 15 | 15 | 46 | 14.4 | 15 | 15 | 15 | 47 | | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.6 | 25 | 25 | 21 | 46 | 23.1 | 25 | 25 | 21 | 47 | | |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 33.6 | 35 | 35 | 31 | 46 | 34.1 | 35 | 35 | 31 | 47 | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Table 166: ZL04 to 06 medium indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power Exh (Amps) | Min fuse ² /breaker ³ size w/ power exh (amps) | | Min disconnect rating ⁴ / power exh | | |
|------------|----------------------|--------------|-----|-----|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|-------|--------|------|-------------------------|---|---|------------------------------------|-----|-------------------------------------|--|------------------------------------|--|------------------------------------|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | Min fuse ² /breaker ³ size w/ power exh (amps) | Min disconnect rating ⁴ | Max fuse ² /breaker ³ size w/ power exh (amps) | Min disconnect rating ⁴ | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 06 (5) | 208-3-60 | 16.2 | 110 | 25 | | | | 2.8 | 7 | 1.1 | | None | - | - | - | 30.1 | 35 | 45 | 30 | 170 | 31.2 | 35 | 45 | 31 | 173 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 30.1 | 35 | 45 | 30 | 170 | 31.2 | 35 | 45 | 31 | 173 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 36.1 | 40 | 45 | 33 | 170 | 37.5 | 40 | 45 | 35 | 173 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 170 | 51.8 | 60 | 60 | 48 | 173 | |
| | 230-3-60 | 16.2 | 110 | 25 | | | | 2.8 | 7.2 | 1 | | | None | - | - | - | 30.3 | 35 | 45 | 30 | 172 | 31.3 | 35 | 45 | 31 | 174 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 30.3 | 35 | 45 | 30 | 172 | 31.3 | 35 | 45 | 31 | 174 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 40.6 | 45 | 45 | 37 | 172 | 41.9 | 45 | 45 | 39 | 174 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 172 | 58.4 | 60 | 60 | 54 | 174 |
| | 460-3-60 | 7.6 | 52 | 12 | | | | 1.6 | 3.6 | 0.5 | | | None | - | - | - | 14.7 | 15 | 20 | 15 | 83 | 15.2 | 20 | 20 | 15 | 84 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 14.7 | 15 | 20 | 12 | 83 | 15.2 | 20 | 20 | 13 | 84 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 21.8 | 25 | 25 | 20 | 83 | 22.4 | 25 | 25 | 21 | 84 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 25.5 | 30 | 30 | 23 | 83 | 26.1 | 30 | 30 | 24 | 84 |
| 575-3-60 | 5.1 | 43.8 | 8 | | | | 2.8 | 2.5 | 0.4 | | | None | - | - | - | 11.7 | 15 | 15 | 12 | 62 | 12.1 | 15 | 15 | 12 | 62 | |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 19.8 | 20 | 20 | 18 | 62 | 20.3 | 25 | 25 | 19 | 62 | |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 30.8 | 35 | 35 | 28 | 62 | 31.3 | 35 | 35 | 29 | 62 | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL04 to 06 medium indoor blower - with powered convenience outlet

Table 167: ZL04 to 06 medium indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² /breaker ³ size w/ power exh (amps) | Max fuse ² /breaker ³ size w/ power exh (amps) | | Min disconnect rating ⁴ w/power exh ⁴ |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|------|--------|------|-------------------------|---|---|------------------------------------|------|-------------------------------------|--|--|-----|---|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 04 (3) | 208-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 7 | 1.5 | 8.6 | None | - | - | - | 31.7 | 35 | 45 | 32 | 149 | 33.2 | 35 | 45 | 34 | 152 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 23.6 | 43.6 | 45 | 45 | 40 | 149 | 45.5 | 50 | 50 | 42 | 152 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 38 | 61.6 | 70 | 70 | 57 | 149 | 63.5 | 70 | 70 | 58 | 152 |
| | | | | | | | | | | | | None | - | - | - | 31.9 | 35 | 45 | 33 | 150 | 33.2 | 35 | 45 | 34 | 153 |
| | 230-1-60 | 14.1 | 84.2 | 22 | | | | 2.8 | 7.2 | 1.3 | 8.6 | None | - | - | - | 26.1 | 30 | 35 | 27 | 138 | 27.2 | 30 | 35 | 29 | 141 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 27.1 | 48.3 | 50 | 50 | 44 | 150 | 49.9 | 50 | 50 | 46 | 153 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 43.8 | 69.1 | 70 | 70 | 64 | 150 | 70.8 | 80 | 80 | 65 | 153 |
| | | | | | | | | | | | | None | - | - | - | 26.1 | 30 | 35 | 27 | 138 | 27.2 | 30 | 35 | 29 | 141 |
| | 208-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 7 | 1.1 | 8.6 | None | - | - | - | 26.1 | 30 | 35 | 27 | 138 | 27.2 | 30 | 35 | 29 | 141 |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 31.1 | 35 | 35 | 29 | 138 | 32.5 | 35 | 35 | 30 | 141 |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41.5 | 45 | 45 | 38 | 138 | 42.9 | 45 | 45 | 39 | 141 |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 138 | 57.1 | 60 | 60 | 53 | 141 |
| | 230-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 7.2 | 1 | 8.6 | None | - | - | - | 26.3 | 30 | 35 | 27 | 140 | 27.3 | 30 | 35 | 29 | 142 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 33.9 | 35 | 35 | 31 | 140 | 35.1 | 40 | 40 | 32 | 142 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46 | 50 | 50 | 42 | 140 | 47.3 | 50 | 50 | 43 | 142 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 140 | 63.8 | 70 | 70 | 59 | 142 |
| | 460-3-60 | 5.1 | 37 | 8 | | | | 1.6 | 3.6 | 0.5 | 8.6 | None | - | - | - | 13.8 | 15 | 15 | 14 | 70 | 14.3 | 15 | 15 | 15 | 71 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.2 | 20 | 20 | 15 | 70 | 16.8 | 20 | 20 | 15 | 71 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.4 | 25 | 25 | 22 | 70 | 25.1 | 30 | 30 | 23 | 71 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.2 | 30 | 30 | 26 | 70 | 28.8 | 30 | 30 | 27 | 71 |
| | 575-3-60 | 3.2 | 26 | 5 | | | | 2.8 | 2.5 | 0.4 | 8.6 | None | - | - | - | 11 | 15 | 15 | 12 | 45 | 11.4 | 15 | 15 | 12 | 46 |
| 11058 | | | | | | | | | | | | 9.2 | 1 | 8.9 | 16.4 | 20 | 20 | 15 | 45 | 16.9 | 20 | 20 | 16 | 46 | |
| 11458 | | | | | | | | | | | | 13.8 | 1 | 13.3 | 21.9 | 25 | 25 | 20 | 45 | 22.4 | 25 | 25 | 21 | 46 | |
| None | | | | | | | | | | | | - | - | - | 31.6 | 35 | 45 | 32 | 148 | 32.7 | 35 | 45 | 34 | 150 | |
| 05 (4) | 208-3-60 | 14 | 83.1 | 22 | | | 2.8 | 7 | 1.1 | 8.6 | None | - | - | - | 31.6 | 35 | 45 | 32 | 148 | 32.7 | 35 | 45 | 34 | 150 | |
| | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 31.6 | 35 | 45 | 32 | 148 | 32.7 | 35 | 45 | 34 | 150 | |
| | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41.5 | 45 | 45 | 38 | 148 | 42.9 | 45 | 45 | 39 | 150 | |
| | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 148 | 57.1 | 60 | 60 | 53 | 150 | |
| | 230-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 7.2 | 1 | 8.6 | None | - | - | - | 31.8 | 35 | 45 | 33 | 149 | 32.8 | 35 | 45 | 34 | 152 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 33.9 | 35 | 45 | 33 | 149 | 35.1 | 40 | 40 | 34 | 152 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46 | 50 | 50 | 42 | 149 | 47.3 | 50 | 50 | 43 | 152 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 149 | 63.8 | 70 | 70 | 59 | 152 |
| | 460-3-60 | 6.4 | 41 | 10 | | | | 1.6 | 3.6 | 0.5 | 8.6 | None | - | - | - | 15.4 | 20 | 20 | 16 | 74 | 15.9 | 20 | 20 | 16 | 75 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.2 | 20 | 20 | 15 | 74 | 16.8 | 20 | 20 | 15 | 75 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.4 | 25 | 25 | 22 | 74 | 25.1 | 30 | 30 | 23 | 75 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.2 | 30 | 30 | 26 | 74 | 28.8 | 30 | 30 | 27 | 75 |
| | 575-3-60 | 4.6 | 33 | 7 | | | | 2.8 | 2.5 | 0.4 | 8.6 | None | - | - | - | 12.8 | 15 | 15 | 13 | 52 | 13.2 | 15 | 15 | 14 | 53 |
| | | | | | | | | | | | | 11058 | 9.2 | 1 | 8.9 | 16.4 | 20 | 20 | 15 | 52 | 16.9 | 20 | 20 | 16 | 53 |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.9 | 25 | 25 | 20 | 52 | 22.4 | 25 | 25 | 21 | 53 |
| | | | | | | | | | | | | None | - | - | - | 12.8 | 15 | 15 | 13 | 52 | 13.2 | 15 | 15 | 14 | 53 |

Table 167: ZL04 to 06 medium indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² / breaker ³ size w/ power exh (amps) | Max fuse ² / breaker ³ size w/ power exh (amps) | Min disconnect rating/ power exh ⁴ | | |
|------------|----------------------|--------------|------|-----|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|-------|--------|------|-------------------------|---|--|------------------------------------|-----|-------------------------------------|---|---|---|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 06 (5) | 208-3-60 | 16.2 | 110 | 25 | | | | 2.8 | 7 | 1.1 | 8.6 | None | - | - | - | 34.4 | 35 | 50 | 35 | 174 | 35.5 | 40 | 50 | 36 | 177 | |
| | | | | | | | | | | | | 10625 | 4.9 | 1 | 13.6 | 34.4 | 35 | 50 | 35 | 174 | 35.5 | 40 | 50 | 36 | 177 | |
| | | | | | | | | | | | | 11125 | 7.9 | 1 | 21.9 | 41.5 | 45 | 50 | 38 | 174 | 42.9 | 45 | 50 | 39 | 177 | |
| | | | | | | | | | | | | 11625 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 174 | 57.1 | 60 | 60 | 53 | 177 | |
| | 230-3-60 | 16.2 | 110 | 25 | | | | 2.8 | 7.2 | 1 | | 8.6 | None | - | - | - | 34.6 | 35 | 50 | 35 | 176 | 35.6 | 40 | 50 | 36 | 178 |
| | | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 34.6 | 35 | 50 | 35 | 176 | 35.6 | 40 | 50 | 36 | 178 |
| | | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 46 | 50 | 50 | 42 | 176 | 47.3 | 50 | 50 | 43 | 178 |
| | | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 176 | 63.8 | 70 | 70 | 59 | 178 |
| | 460-3-60 | 7.6 | 52 | 12 | | | | 1.6 | 3.6 | 0.5 | | 8.6 | None | - | - | - | 16.9 | 20 | 20 | 17 | 85 | 17.4 | 20 | 20 | 18 | 86 |
| | | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 16.9 | 20 | 20 | 15 | 85 | 17.4 | 20 | 20 | 15 | 86 |
| | | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 24.4 | 25 | 25 | 22 | 85 | 25.1 | 30 | 30 | 23 | 86 |
| | | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.2 | 30 | 30 | 26 | 85 | 28.8 | 30 | 30 | 27 | 86 |
| | 575-3-60 | 5.1 | 43.8 | 8 | | | | 2.8 | 2.5 | 0.4 | | 8.6 | None | - | - | - | 13.4 | 15 | 15 | 14 | 63 | 13.8 | 15 | 15 | 14 | 64 |
| | | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 21.9 | 25 | 25 | 20 | 63 | 22.4 | 25 | 25 | 21 | 64 |
| | | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 32.9 | 35 | 35 | 30 | 63 | 33.4 | 35 | 35 | 31 | 64 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL04 to 06 high indoor blower - with powered convenience outlet

Table 169: ZL 04 to 06 high indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² /breaker ³ size w/ power exh (amps) | | Max fuse ² /breaker ³ size w/ power exh (amps) | | Min disconnect rating ⁴ / power exh | | | | | | | | | | | | | | | |
|------------|----------------------|--------------|----------|-----|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|----|--------|------|-------------------------|---|---|------------------------------------|-----|-------------------------------------|--|-----|--|-----|--|----|----|----|-----|------|------|----|----|-----|------|------|----|----|-----|------|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | | | | | | | | | | | | | | |
| | | 04 (3) | 208-3-60 | 9.6 | 73.8 | 15 | | | | | | | | 2.8 | 7 | | | | 1.1 | 8.6 | | None | - | - | - | 26.1 | 30 | 35 | 27 | 138 | 27.2 | 30 | 35 | 29 | 138 | 32.5 | 35 | 35 | 30 | 141 | 41.5 |
| | 230-3-60 | 9.6 | 73.8 | 15 | | | | 2.8 | 7.2 | 1 | 8.6 | None | - | - | - | 26.3 | 30 | 35 | 27 | 140 | 27.3 | 30 | 35 | 29 | 142 | 35.1 | 40 | 40 | 32 | 142 | 51 | 50 | 50 | 42 | 140 | 47.3 | 50 | 50 | 43 | 142 | |
| | 460-3-60 | 5.1 | 37 | 8 | | | | 1.6 | 3.6 | 0.5 | 8.6 | None | - | - | - | 13.8 | 15 | 15 | 14 | 70 | 14.3 | 15 | 15 | 15 | 71 | 25.1 | 30 | 30 | 23 | 71 | 20 | 20 | 20 | 15 | 70 | 16.8 | 20 | 20 | 15 | 71 | |
| | 575-3-60 | 3.2 | 26 | 5 | | | | 2.8 | 2.5 | 0.4 | 8.6 | None | - | - | - | 11 | 15 | 15 | 12 | 45 | 11.4 | 15 | 15 | 12 | 46 | 9.2 | 20 | 20 | 16 | 46 | 8.9 | 16.4 | 20 | 20 | 15 | 45 | 16.9 | 20 | 20 | 16 | 46 |
| 05 (4) | 208-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 8.9 | 1.1 | 8.6 | None | - | - | - | 33.5 | 35 | 45 | 35 | 149 | 34.6 | 35 | 45 | 36 | 152 | 4.9 | 35 | 45 | 36 | 152 | 13.6 | 33.5 | 35 | 45 | 35 | 149 | 34.9 | 35 | 45 | 36 | 152 |
| | 230-3-60 | 14 | 83.1 | 22 | | | | 2.8 | 8.2 | 1 | 8.6 | None | - | - | - | 32.8 | 35 | 45 | 34 | 156 | 33.8 | 35 | 45 | 35 | 159 | 6.5 | 40 | 45 | 35 | 159 | 15.6 | 35.1 | 40 | 45 | 34 | 156 | 36.4 | 40 | 45 | 35 | 159 |
| | 460-3-60 | 6.4 | 41 | 10 | | | | 1.6 | 4.1 | 0.5 | 8.6 | None | - | - | - | 15.9 | 20 | 20 | 16 | 78 | 16.4 | 20 | 20 | 17 | 79 | 11.5 | 30 | 30 | 23 | 79 | 7.2 | 16.8 | 20 | 20 | 15 | 78 | 17.4 | 20 | 20 | 16 | 79 |
| | 575-3-60 | 4.6 | 33 | 7 | | | | 2.8 | 3.2 | 0.4 | 8.6 | None | - | - | - | 13.5 | 15 | 15 | 14 | 61 | 13.9 | 15 | 15 | 15 | 62 | 9.2 | 20 | 20 | 16 | 62 | 8.9 | 17.3 | 20 | 20 | 16 | 61 | 17.8 | 20 | 20 | 16 | 62 |

Table 169: ZL 04 to 06 high indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Power exh motor | Power conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/power exh (amps) | Min fuse ² / breaker ³ size w/ power exh (amps) | Max fuse ² / breaker ³ size w/ power exh (amps) | Min disconnect rating ⁴ / power exh | |
|------------|----------------------|--------------|----------|------|--------------|-----|-----|----------------------|---------------------|-----------------|-------------------|---|------|--------|------|-------------------------|---|--|------------------------------------|-----|-------------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | 06 (5) | 208-3-60 | 16.2 | 110 | 25 | | | | | | | | 2.8 | 8.9 | | | | 1.1 | 8.6 | | | | None | - |
| 10625 | 4.9 | | | | | | | 1 | 13.6 | 36.3 | 40 | | | | | 50 | 37 | 176 | | | 37.4 | 40 | 50 | 38 | 179 |
| 11125 | 7.9 | | | | | | | 1 | 21.9 | 43.9 | 45 | | | | | 50 | 40 | 176 | | | 45.3 | 50 | 50 | 42 | 179 |
| 11625 | 12 | | | | | | | 1 | 33.3 | 58.1 | 60 | | | | | 60 | 53 | 176 | | | 59.5 | 60 | 60 | 55 | 179 |
| 230-3-60 | 16.2 | | 110 | 25 | | | | 2.8 | 8.2 | 1 | 8.6 | None | - | - | - | 35.6 | 40 | 50 | 36 | 183 | 36.6 | 40 | 50 | 37 | 186 |
| | | | | | | | | | | | | 10625 | 6.5 | 1 | 15.6 | 35.6 | 40 | 50 | 36 | 183 | 36.6 | 40 | 50 | 37 | 186 |
| | | | | | | | | | | | | 11125 | 10.5 | 1 | 25.3 | 47.3 | 50 | 50 | 43 | 183 | 48.5 | 50 | 50 | 45 | 186 |
| | | | | | | | | | | | | 11625 | 16 | 1 | 38.5 | 63.8 | 70 | 70 | 59 | 183 | 65 | 70 | 70 | 60 | 186 |
| 460-3-60 | 7.6 | | 52 | 12 | | | | 1.6 | 4.1 | 0.5 | 8.6 | None | - | - | - | 17.4 | 20 | 25 | 18 | 89 | 17.9 | 20 | 25 | 18 | 90 |
| | | | | | | | | | | | | 10646 | 6 | 1 | 7.2 | 17.4 | 20 | 25 | 15 | 89 | 17.9 | 20 | 25 | 16 | 90 |
| | | | | | | | | | | | | 11146 | 11.5 | 1 | 13.8 | 25.1 | 30 | 30 | 23 | 89 | 25.7 | 30 | 30 | 24 | 90 |
| | | | | | | | | | | | | 11446 | 14 | 1 | 16.8 | 28.8 | 30 | 30 | 27 | 89 | 29.4 | 30 | 30 | 27 | 90 |
| 575-3-60 | 5.1 | | 43.8 | 8 | | | | 2.8 | 3.2 | 0.4 | 8.6 | None | - | - | - | 14.1 | 15 | 15 | 15 | 72 | 14.5 | 15 | 15 | 15 | 73 |
| | | | | | | | | | | | | 11458 | 13.8 | 1 | 13.3 | 22.8 | 25 | 25 | 21 | 72 | 23.3 | 25 | 25 | 21 | 73 |
| | | | | | | | | | | | | 12358 | 23 | 1 | 22.1 | 33.8 | 35 | 35 | 31 | 72 | 34.3 | 35 | 35 | 32 | 73 |
| | | | | | | | | | | | | | | | | | | | | | | | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect, verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 static indoor blowers - without powered convenience outlet

Table 170: ZL08 to 14 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|-----|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|-------|-------------------------|--|--|------------------------------------|-------|-----------------------------------|---|-----|---|------|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | | | | | 88 | 21 | 2.3 | 7 | | | | 1.1 | None | | - | - | - | 42.6 | 45 | 50 |
| 11725 | 12 | | | | | | | 1 | 33.3 | 50.4 | 60 | | | | | 60 | 46 | 241 | | 53.1 | 60 | 60 | 49 | 246 | | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 73.3 | 80 | | | | | 80 | 67 | 241 | | 76 | 80 | 80 | 70 | 246 | | | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 92 | 100 | | | | | 100 | 85 | 241 | | 94.8 | 100 | 100 | 87 | 246 | | | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 119.1 | 125 | | | | | 125 | 110 | 241 | | 121.9 | 125 | 125 | 112 | 246 | | | |
| 230-3-60 | 14 | | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 7.2 | 1 | None | - | - | - | 42.8 | 45 | 50 | 45 | 243 | 44.8 | 45 | 50 | 47 | 248 | | | |
| | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 243 | 59.6 | 60 | 60 | 55 | 248 | | | |
| | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 243 | 86.1 | 90 | 90 | 79 | 248 | | | |
| | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 243 | 107.8 | 110 | 110 | 99 | 248 | | | |
| | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 243 | 139 | 150 | 150 | 128 | 248 | | | |
| 460-3-60 | 6.4 | | 41 | 10 | 6 | 44 | 9 | 1.3 | 3.6 | 0.5 | None | - | - | - | 20.2 | 25 | 25 | 21 | 122 | 21.2 | 25 | 25 | 23 | 124 | | | |
| | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 122 | 30.5 | 35 | 35 | 28 | 124 | | | |
| | | 12846 | | | | | | | | | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 122 | 47.5 | 50 | 50 | 44 | 124 | | | | |
| | | 13346 | | | | | | | | | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 122 | 55.4 | 60 | 60 | 51 | 124 | | | | |
| | | 14246 | | | | | | | | | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 122 | 68.5 | 70 | 70 | 63 | 124 | | | | |
| 575-3-60 | 4.6 | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 2.5 | 0.4 | None | - | - | - | 15.4 | 20 | 20 | 16 | 89 | 16.2 | 20 | 20 | 17 | 91 | | | | |
| | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 89 | 24.6 | 25 | 25 | 23 | 91 | | | | |
| | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 89 | 45 | 45 | 45 | 41 | 91 | | | | |
| | | | | | | | | | | None | - | - | - | - | - | - | - | - | - | - | - | - | - | | | | |
| 09 (8.5) | 208-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | None | - | - | - | 42.8 | 45 | 50 | 45 | 236 | 45 | 45 | 50 | 48 | 241 | | | |
| | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 236 | 53.1 | 60 | 60 | 49 | 241 | | | |
| | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 236 | 76 | 80 | 80 | 70 | 241 | | | |
| | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 236 | 94.8 | 100 | 100 | 87 | 241 | | | |
| | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 236 | 121.9 | 125 | 125 | 112 | 241 | | | |
| | 230-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | None | - | - | - | 43 | 45 | 50 | 45 | 238 | 45 | 45 | 50 | 48 | 243 | | | |
| | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 238 | 59.6 | 60 | 60 | 55 | 243 | | | |
| | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 238 | 86.1 | 90 | 90 | 79 | 243 | | | |
| | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 238 | 107.8 | 110 | 110 | 99 | 243 | | | |
| | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 238 | 139 | 150 | 150 | 128 | 243 | | | |
| | 460-3-60 | 6.4 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | None | - | - | - | 20.4 | 25 | 25 | 22 | 119 | 21.4 | 25 | 25 | 23 | 121 | | | |
| | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 119 | 30.5 | 35 | 35 | 28 | 121 | | | |
| | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 119 | 47.5 | 50 | 50 | 44 | 121 | | | |
| | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 119 | 55.4 | 60 | 60 | 51 | 121 | | | |
| | 575-3-60 | 4.6 | 33 | 7 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | None | - | - | - | 15.3 | 20 | 20 | 16 | 88 | 16.1 | 20 | 20 | 17 | 90 | | | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 88 | 24.6 | 25 | 25 | 23 | 90 | | | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 88 | 45 | 45 | 45 | 41 | 90 | | | |
| | | | | | | | | | | | None | - | - | - | - | - | - | - | - | - | - | - | - | - | | | |
| | | | | | | | | | | | None | - | - | - | - | - | - | - | - | - | - | - | - | - | | | |
| | | | | | | | | | | | None | - | - | - | - | - | - | - | - | - | - | - | - | - | | | |

Table 170: ZL08 to 14 standard static indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | | | | | | | | | | | | | | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|----|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|--|-------|-------|------|------|-------|-------|-----|-----|------|-------|-------|-----|-----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | None | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.8 | 7 | 1.1 | | | | | 49.4 | 50 | 60 | 52 | 302 | 51.6 | 60 | 60 | 55 | 307 | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 52 | 302 | 53.1 | 60 | 60 | 55 | 307 | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 302 | 76 | 80 | 80 | 70 | 307 | |
| | | | | | | | | | | | | | | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 302 | 94.8 | 100 | 100 | 87 | 307 | |
| | | | | | | | | | | | | | | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 302 | 121.9 | 125 | 125 | 112 | 307 | |
| | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 7.2 | 1 | | | | | | 49 | 50 | 60 | 52 | 301 | 51 | 60 | 60 | 54 | 305 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 301 | 59.6 | 60 | 60 | 55 | 305 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 301 | 86.1 | 90 | 90 | 79 | 305 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 301 | 107.8 | 110 | 110 | 99 | 305 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 301 | 139 | 150 | 150 | 128 | 305 |
| | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 3.6 | 0.5 | | | | | | 23.5 | 25 | 30 | 25 | 146 | 24.5 | 25 | 30 | 26 | 148 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 146 | 30.5 | 35 | 35 | 28 | 148 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 146 | 47.5 | 50 | 50 | 44 | 148 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 146 | 55.4 | 60 | 60 | 51 | 148 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 146 | 68.5 | 70 | 70 | 63 | 148 |
| | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2.5 | 0.4 | | | | | | 17.5 | 20 | 20 | 19 | 112 | 18.3 | 20 | 20 | 19 | 114 | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 112 | 24.6 | 25 | 25 | 23 | 114 |
| | | | | | | | | | | | | | | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 112 | 45 | 45 | 45 | 41 | 114 |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 standard indoor blower - with powered convenience outlet

Table 171: ZL08 to 14 standard indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|----------|-----|--------------|------|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|---|--|------------------------------------|------|-----------------------------------|---|-----|---|-----|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | | | | | 88 | 21 | 2.3 | 7 | | | | 1.1 | 8.6 | | None | - | - | - | 46.9 | 50 |
| 11725 | 12 | | | | | | | 1 | 33.3 | 55.8 | 60 | | | | | 60 | 51 | 245 | | | 58.5 | 60 | 60 | 54 | 250 | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 78.6 | 80 | | | | | 80 | 72 | 245 | | | 81.4 | 90 | 90 | 75 | 250 | | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 97.4 | 100 | | | | | 100 | 90 | 245 | | | 100.1 | 110 | 110 | 92 | 250 | | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 124.5 | 125 | | | | | 125 | 115 | 245 | | | 127.3 | 150 | 150 | 117 | 250 | | |
| 230-3-60 | 14 | | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 47.1 | 50 | 60 | 50 | 247 | 49.1 | 50 | 60 | 52 | 252 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 247 | 65 | 70 | 70 | 60 | 252 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 247 | 91.5 | 100 | 100 | 84 | 252 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 247 | 113.1 | 125 | 125 | 104 | 252 | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 247 | 144.4 | 150 | 150 | 133 | 252 | | |
| 460-3-60 | 6.4 | | 41 | 10 | 6 | 44 | 9 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.4 | 25 | 25 | 24 | 124 | 23.4 | 25 | 25 | 25 | 126 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 124 | 33.2 | 35 | 35 | 31 | 126 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 124 | 50.2 | 60 | 60 | 46 | 126 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 124 | 58.1 | 60 | 60 | 53 | 126 | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 124 | 71.2 | 80 | 80 | 65 | 126 | | |
| 575-3-60 | 4.6 | | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 17.1 | 20 | 20 | 18 | 91 | 17.9 | 20 | 20 | 19 | 93 | | |
| | | 13458 | | | | | | | | | | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 91 | 47.2 | 50 | 50 | 43 | 93 | | | |
| | | 11758 | | | | | | | | | | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 91 | 26.8 | 30 | 30 | 25 | 93 | | | |
| | | - | | | | | | | | | | - | - | - | - | - | - | - | - | - | - | - | - | - | | | |
| 09 (8.5) | 208-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | 8.6 | None | - | - | - | 47.1 | 50 | 60 | 50 | 240 | 49.3 | 50 | 60 | 53 | 245 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 60 | 51 | 240 | 58.5 | 60 | 60 | 54 | 245 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 240 | 81.4 | 90 | 90 | 75 | 245 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 240 | 100.1 | 110 | 110 | 92 | 245 | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 240 | 127.3 | 150 | 150 | 117 | 245 | | |
| | 230-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 47.3 | 50 | 60 | 50 | 242 | 49.3 | 50 | 60 | 53 | 247 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 242 | 65 | 70 | 70 | 60 | 247 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 242 | 91.5 | 100 | 100 | 84 | 247 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 242 | 113.1 | 125 | 125 | 104 | 247 | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 242 | 144.4 | 150 | 150 | 133 | 247 | | |
| | 460-3-60 | 6.4 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.6 | 25 | 25 | 24 | 121 | 23.6 | 25 | 25 | 25 | 123 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 121 | 33.2 | 35 | 35 | 31 | 123 | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 121 | 50.2 | 60 | 60 | 46 | 123 | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 121 | 58.1 | 60 | 60 | 53 | 123 | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 121 | 71.2 | 80 | 80 | 65 | 123 | | |
| | 575-3-60 | 4.6 | 33 | 7 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 17 | 20 | 20 | 18 | 90 | 17.8 | 20 | 20 | 19 | 92 | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 90 | 26.8 | 30 | 30 | 25 | 92 | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 90 | 47.2 | 50 | 50 | 43 | 92 | | |
| | | | | | | | | | | | | - | - | - | - | - | - | - | - | - | - | - | - | - | - | | |

Table 171: ZL08 to 14 standard indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | Max fuse ² /breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|---|---|------------------------------------|-----|-----------------------------------|--|--|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.8 | 7 | 1.1 | 8.6 | None | - | - | - | 53.7 | 60 | 70 | 57 | 306 | 55.9 | 60 | 70 | 60 | 311 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 55.8 | 60 | 70 | 57 | 306 | 58.5 | 60 | 70 | 60 | 311 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 78.6 | 80 | 80 | 72 | 306 | 81.4 | 90 | 90 | 75 | 311 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 97.4 | 100 | 100 | 90 | 306 | 100.1 | 110 | 110 | 92 | 311 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 124.5 | 125 | 125 | 115 | 306 | 127.3 | 150 | 150 | 117 | 311 | |
| | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 7.2 | 1 | 8.6 | None | - | - | - | 53.3 | 60 | 60 | 57 | 305 | 55.3 | 60 | 70 | 59 | 310 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 305 | 65 | 70 | 70 | 60 | 310 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 305 | 91.5 | 100 | 100 | 84 | 310 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 305 | 113.1 | 125 | 125 | 104 | 310 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 305 | 144.4 | 150 | 150 | 133 | 310 | |
| | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 3.6 | 0.5 | 8.6 | None | - | - | - | 25.7 | 30 | 30 | 27 | 148 | 26.7 | 30 | 30 | 28 | 150 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 148 | 33.2 | 35 | 35 | 31 | 150 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 148 | 50.2 | 60 | 60 | 46 | 150 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 148 | 58.1 | 60 | 60 | 53 | 150 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 148 | 71.2 | 80 | 80 | 65 | 150 | |
| | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 2.5 | 0.4 | 8.6 | None | - | - | - | 19.2 | 20 | 20 | 20 | 113 | 20 | 20 | 20 | 21 | 115 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 113 | 26.8 | 30 | 30 | 25 | 115 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 113 | 47.2 | 50 | 50 | 43 | 115 | |
| | | | | | | | | | | | | None | - | - | - | 62.1 | 70 | 80 | 66 | 388 | 62.1 | 70 | 80 | 66 | 388 | |
| 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 8.9 | 0 | 8.6 | None | - | - | - | 62.1 | 70 | 80 | 66 | 388 | 62.1 | 70 | 80 | 66 | 388 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 62.1 | 70 | 80 | 66 | 388 | 62.1 | 70 | 80 | 66 | 388 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81 | 90 | 90 | 75 | 388 | 81 | 90 | 90 | 75 | 388 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 99.8 | 100 | 100 | 92 | 388 | 99.8 | 100 | 100 | 92 | 388 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 126.9 | 150 | 150 | 117 | 388 | 126.9 | 150 | 150 | 117 | 388 | |
| | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 8.2 | 0 | 8.6 | None | - | - | - | 60.8 | 70 | 80 | 64 | 387 | 60.8 | 70 | 80 | 64 | 387 | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 63.8 | 70 | 80 | 64 | 387 | 63.8 | 70 | 80 | 64 | 387 | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 90.3 | 100 | 100 | 83 | 387 | 90.3 | 100 | 100 | 83 | 387 | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 111.9 | 125 | 125 | 103 | 387 | 111.9 | 125 | 125 | 103 | 387 | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 143.1 | 150 | 150 | 132 | 387 | 143.1 | 150 | 150 | 132 | 387 | |
| | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.1 | 0 | 8.6 | None | - | - | - | 28.7 | 30 | 35 | 30 | 175 | 28.7 | 30 | 35 | 30 | 175 | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 32.6 | 35 | 35 | 30 | 175 | 32.6 | 35 | 35 | 30 | 175 | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 49.6 | 50 | 50 | 46 | 175 | 49.6 | 50 | 50 | 46 | 175 | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 57.4 | 60 | 60 | 53 | 175 | 57.4 | 60 | 60 | 53 | 175 | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 70.6 | 80 | 80 | 65 | 175 | 70.6 | 80 | 80 | 65 | 175 | |
| | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 3.2 | 0 | 8.6 | None | - | - | - | 22.6 | 25 | 25 | 24 | 150 | 22.6 | 25 | 25 | 24 | 150 | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 26.7 | 30 | 30 | 25 | 150 | 26.7 | 30 | 30 | 25 | 150 | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 47 | 50 | 50 | 43 | 150 | 47 | 50 | 50 | 43 | 150 | |
| | | | | | | | | | | | | None | - | - | - | 60.8 | 70 | 80 | 64 | 387 | 60.8 | 70 | 80 | 64 | 387 | |

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 medium indoor blower - without powered convenience outlet

Table 172: ZL08 to 14 medium indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA¹ (amps) | Min fuse²/breaker³ size (amps) | Max Fuse² / Breaker³ Size (Amps) | Min disconnect rating⁴ | | MCA¹ w/pwr exh (amps) | Min fuse² / breaker³ size w/ pwr exh (amps) | Max fuse² / breaker³ size w/ pwr exh (amps) | Min disconnect rating⁴ / pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------|--------------------------------|----------------------------------|------------------------|------|-----------------------|---|---|----------------------------------|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.6 | 45 | 50 | 45 | 241 | 44.8 | 45 | 50 | 47 | 246 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 241 | 53.1 | 60 | 60 | 49 | 246 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 241 | 76 | 80 | 80 | 70 | 246 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 241 | 94.8 | 100 | 100 | 87 | 246 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 241 | 121.9 | 125 | 125 | 112 | 246 |
| | 230-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 42.8 | 45 | 50 | 45 | 243 | 44.8 | 45 | 50 | 47 | 248 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 243 | 59.6 | 60 | 60 | 55 | 248 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 243 | 86.1 | 90 | 90 | 79 | 248 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 243 | 107.8 | 110 | 110 | 99 | 248 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 243 | 139 | 150 | 150 | 128 | 248 |
| | 460-3-60 | 6.4 | 41 | 10 | 6 | 44 | 9 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 20.2 | 25 | 25 | 21 | 122 | 21.2 | 25 | 25 | 23 | 124 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 122 | 30.5 | 35 | 35 | 28 | 124 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 122 | 47.5 | 50 | 50 | 44 | 124 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 122 | 55.4 | 60 | 60 | 51 | 124 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 122 | 68.5 | 70 | 70 | 63 | 124 |
| | 575-3-60 | 4.6 | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 15.4 | 20 | 20 | 16 | 89 | 16.2 | 20 | 20 | 17 | 91 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 89 | 24.6 | 25 | 25 | 23 | 91 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 89 | 45 | 45 | 45 | 41 | 91 | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 09 (8.5) | 208-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7 | 1.1 | | None | - | - | - | 42.8 | 45 | 50 | 45 | 236 | 45 | 45 | 50 | 48 | 241 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 50.4 | 60 | 60 | 46 | 236 | 53.1 | 60 | 60 | 49 | 241 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 73.3 | 80 | 80 | 67 | 236 | 76 | 80 | 80 | 70 | 241 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 92 | 100 | 100 | 85 | 236 | 94.8 | 100 | 100 | 87 | 241 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 119.1 | 125 | 125 | 110 | 236 | 121.9 | 125 | 125 | 112 | 241 |
| | 230-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 7.2 | 1 | | None | - | - | - | 43 | 45 | 50 | 45 | 238 | 45 | 45 | 50 | 48 | 243 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 57.1 | 60 | 60 | 53 | 238 | 59.6 | 60 | 60 | 55 | 243 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 83.6 | 90 | 90 | 77 | 238 | 86.1 | 90 | 90 | 79 | 243 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 105.3 | 110 | 110 | 97 | 238 | 107.8 | 110 | 110 | 99 | 243 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 136.5 | 150 | 150 | 126 | 238 | 139 | 150 | 150 | 128 | 243 |
| | 460-3-60 | 6.4 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 3.6 | 0.5 | | None | - | - | - | 20.4 | 25 | 25 | 22 | 119 | 21.4 | 25 | 25 | 23 | 121 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 29.3 | 30 | 30 | 27 | 119 | 30.5 | 35 | 35 | 28 | 121 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 46.3 | 50 | 50 | 43 | 119 | 47.5 | 50 | 50 | 44 | 121 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 54.1 | 60 | 60 | 50 | 119 | 55.4 | 60 | 60 | 51 | 121 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 67.3 | 70 | 70 | 62 | 119 | 68.5 | 70 | 70 | 63 | 121 |
| | 575-3-60 | 4.6 | 33 | 7 | 4.8 | 33 | 8 | 1.1 | 2.5 | 0.4 | | None | - | - | - | 15.3 | 20 | 20 | 16 | 88 | 16.1 | 20 | 20 | 17 | 90 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 23.6 | 25 | 25 | 22 | 88 | 24.6 | 25 | 25 | 23 | 90 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 44 | 45 | 45 | 40 | 88 | 45 | 45 | 45 | 41 | 90 | |

Table 172: ZL08 to 14 medium indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max Fuse ² /Breaker ³ Size (Amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|---|---|------------------------------------|-----|-----------------------------------|---|---|-----|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | FLA | LRA | | |
| 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.8 | 9.9 | 1.1 | | None | - | - | - | 52.3 | 60 | 60 | 55 | 315 | 54.5 | 60 | 60 | 58 | 320 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 55 | 315 | 56.8 | 60 | 60 | 58 | 320 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 315 | 79.6 | 80 | 80 | 73 | 320 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 315 | 98.4 | 100 | 100 | 91 | 320 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 315 | 125.5 | 150 | 150 | 115 | 320 | |
| | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | | | None | - | - | - | 51.2 | 60 | 60 | 54 | 320 | 53.2 | 60 | 60 | 56 | 324 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 320 | 62.4 | 70 | 70 | 57 | 324 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 320 | 88.9 | 90 | 90 | 82 | 324 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 320 | 110.5 | 125 | 125 | 102 | 324 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 320 | 141.8 | 150 | 150 | 130 | 324 |
| | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | | | None | - | - | - | 24.6 | 25 | 30 | 26 | 155 | 25.6 | 30 | 30 | 27 | 158 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 155 | 31.9 | 35 | 35 | 29 | 158 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 155 | 48.9 | 50 | 50 | 45 | 158 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 155 | 56.8 | 60 | 60 | 52 | 158 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 155 | 69.9 | 70 | 70 | 64 | 158 |
| | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | | | None | - | - | - | 19.3 | 20 | 25 | 21 | 134 | 20.1 | 25 | 25 | 22 | 136 |
| 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 134 | 26.9 | 30 | 30 | 25 | 136 | |
| 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 134 | 47.3 | 50 | 50 | 43 | 136 | |
| 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | | None | - | - | - | 58.8 | 60 | 70 | 62 | 380 | 58.8 | 60 | 70 | 62 | 380 | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 58.8 | 60 | 70 | 62 | 380 | 58.8 | 60 | 70 | 62 | 380 | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 380 | 76.9 | 80 | 80 | 71 | 380 | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 380 | 95.6 | 100 | 100 | 88 | 380 | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 380 | 122.8 | 125 | 125 | 113 | 380 | |
| | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | | | None | - | - | - | 57.7 | 60 | 70 | 61 | 385 | 57.7 | 60 | 70 | 61 | 385 |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 70 | 61 | 385 | 59.9 | 60 | 70 | 61 | 385 |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 385 | 86.4 | 90 | 90 | 79 | 385 |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 385 | 108 | 110 | 110 | 99 | 385 |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 385 | 139.3 | 150 | 150 | 128 | 385 |
| | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | | | None | - | - | - | 27.1 | 30 | 35 | 29 | 178 | 27.1 | 30 | 35 | 29 | 178 |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 178 | 30.6 | 35 | 35 | 28 | 178 |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 178 | 47.6 | 50 | 50 | 44 | 178 |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 178 | 55.5 | 60 | 60 | 51 | 178 |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 178 | 68.6 | 70 | 70 | 63 | 178 |
| | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | | | None | - | - | - | 22 | 25 | 25 | 23 | 163 | 22 | 25 | 25 | 23 | 163 |
| | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 163 | 25.9 | 30 | 30 | 24 | 163 |
| | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 163 | 46.3 | 50 | 50 | 43 | 163 |

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 medium indoor blower - with powered convenience outlet

Table 173: ZL08 to 14 medium indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min Fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / breaker ³ size w/ pwr exh (amps) | | Min Disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|----------|-----|--------------|-----|------|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|-----|---|-----|--|----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | |
| | | 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | | | | | 88 | 21 | 2.3 | 7 | | | | 1.1 | 8.6 | | None | - | - | - | 46.9 | 50 |
| 11725 | 12 | | | | | | | 1 | 33.3 | 55.8 | 60 | | | | | 60 | 51 | 245 | | | 58.5 | 60 | 60 | 54 | 250 | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 78.6 | 80 | | | | | 80 | 72 | 245 | | | 81.4 | 90 | 90 | 75 | 250 | | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 97.4 | 100 | | | | | 100 | 90 | 245 | | | 100.1 | 110 | 110 | 92 | 250 | | |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 124.5 | 125 | | | | | 125 | 115 | 245 | | | 127.3 | 150 | 150 | 117 | 250 | | |
| 230-3-60 | 14 | | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 7.2 | 1 | 8.6 | None | - | - | - | 47.1 | 50 | 60 | 50 | 247 | 49.1 | 50 | 60 | 52 | 252 | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 62.5 | 70 | 70 | 58 | 247 | 65 | 70 | 70 | 60 | 252 | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 89 | 90 | 90 | 82 | 247 | 91.5 | 100 | 100 | 84 | 252 | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 110.6 | 125 | 125 | 102 | 247 | 113.1 | 125 | 125 | 104 | 252 | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 141.9 | 150 | 150 | 131 | 247 | 144.4 | 150 | 150 | 133 | 252 | | |
| 460-3-60 | 6.4 | | 41 | 10 | 6 | 44 | 9 | 1.3 | 3.6 | 0.5 | 8.6 | None | - | - | - | 22.4 | 25 | 25 | 24 | 124 | 23.4 | 25 | 25 | 25 | 126 | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 31.9 | 35 | 35 | 29 | 124 | 33.2 | 35 | 35 | 31 | 126 | | |
| | | 12846 | | | | | | | | | | 27.8 | 1 | 33.4 | 48.9 | 50 | 50 | 45 | 124 | 50.2 | 60 | 60 | 46 | 126 | | | |
| | | 13346 | | | | | | | | | | 33 | 1 | 39.7 | 56.8 | 60 | 60 | 52 | 124 | 58.1 | 60 | 60 | 53 | 126 | | | |
| | | 14246 | | | | | | | | | | 41.7 | 2 | 50.2 | 69.9 | 70 | 70 | 64 | 124 | 71.2 | 80 | 80 | 65 | 126 | | | |
| 575-3-60 | 4.6 | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 2.5 | 0.4 | 8.6 | None | - | - | - | 17.1 | 20 | 20 | 18 | 91 | 17.9 | 20 | 20 | 19 | 93 | | | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 25.8 | 30 | 30 | 24 | 91 | 26.8 | 30 | 30 | 25 | 93 | | | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 46.2 | 50 | 50 | 42 | 91 | 47.2 | 50 | 50 | 43 | 93 | | | |

Table 173: ZL08 to 14 medium indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min Fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | Max fuse ² /breaker ³ size w/ pwr exh (amps) | Min Disconnect rating ⁴ /pwr exh | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|------------|----------------------|--------------|----------|------|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|---|---|------------------------------------|-----|-----------------------------------|--|--|---|-----|-----------|----------|------|------|-------|------|------|------|-----|-------|-----|-------|-------|-------|----------|-------|-------|-------|-------|-----|-------|-------|-------|-------|-----|-----------|----------|----------|----------|------|------|-------|-------|-----|-----|-----|-------|-------|-------|-------|-------|------|----------|-------|-----|-------|------|-------|-------|-------|-----------|----------|------|----------|----------|------|-------|------|-------|------|-----|-------|------|-------|-------|-------|------|-------|----------|-------|-------|------|-------|-------|-------|-----------|----------|------|-----|----------|----------|-------|------|-------|------|-----|-------|------|-------|-------|-------|-------|-------|-------|-------|-------|------|-------|------|-------|-----------|----------|------|-------|-------|----------|----------|-------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|------|-------|-------|------|-------|-------|-----------|----------|-------|----------|-------|-------|----------|------|------|----------|-------|-------|------|-------|-------|-------|-------|----------|-------|-------|-------|------|-------|------|----------|-----------|----------|-------|-------|------|------|----------|----------|----------|----------|------|-------|------|-------|-------|-------|-------|------|-------|-------|-------|------|------|-------|-------|-----------|----------|------|-------|-------|------|----------|------|----------|----------|------|-------|------|-------|-------|-------|-------|-------|-------|-------|-------|------|-------|-------|-------|-----------|----------|-------|------|------|-------|----------|------|-------|----------|----------|-------|-------|-------|-------|-------|-------|------|-------|-------|-------|-------|-------|------|-------|-----------|----------|------|------|------|----------|----------|------|-----|------|----------|----------|------|-------|-------|-------|-------|------|-------|-------|-------|-------|-------|------|-------|-----------|----------|------|------|------|-------|----------|------|------|------|------|----------|-------|-------|-----------|----------|------|-------|------|-------|-------|-------|-------|-------|-------|----------|-------|-------|------|------|-------|----------|------|-------|------|------|----------|-------|----------|-----------|----------|------|-------|------|----------|-------|-------|-------|------|-------|-------|-------|------|------|-------|-------|----------|------|-------|-------|------|-----------|----------|-------|-------|----------|-------|-------|------|-------|-------|-------|-------|-------|-------|-------|-----------|----------|------|------|-----------|----------|-------|----------|------|------|------|-------|----------|-------|-------|-------|----------|-------|------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|----------|------|------|-------|-----------|----------|----------|------|-------|-------|------|----------|-------|-------|----------|------|-------|-------|-----------|----------|-------|-------|-------|-------|-------|------|-------|-------|------|-------|-------|----------|------|------|-------|-----------|----------|----------|------|-------|----------|------|-------|-------|-------|-------|-------|----------|------|-------|------|-------|-------|------|------|-------|----------|------|------|-------|-------|----------|------|-------|----------|------|----------|------|-------|-------|-------|-------|------|-------|-------|-------|-------|------|-------|------|----------|-------|------|-------|------|----------|------|------|-----------|----------|-------|-------|------|-------|-------|-------|-------|-------|-------|-------|----------|------|------|-------|------|----------|------|-------|----------|-------|----------|-------|-------|------|------|-------|-------|----------|-------|-------|-------|------|-------|-------|-------|-------|-------|-------|-------|----------|-------|-------|-------|-------|----------|------|-------|-------|-----|-------|-------|-------|----------|------|-------|-------|----------|-------|-------|-------|-------|-------|------|-------|------|------|-------|------|----------|------|-------|-------|------|------|------|-------|----------|-----|-------|-------|-------|-------|----------|-------|------|------|------|-------|-------|------|------|------|----------|-------|-------|-------|-------|-------|------|-------|----------|-----|-------|-------|-------|-------|-------|-------|----------|------|-------|-------|-------|------|-------|------|----------|-------|------|-------|------|-------|-------|------|----------|-------|-------|-------|-------|-------|-------|-------|----------|-------|-------|------|------|------|------|------|----------|------|------|-------|------|------|----------|-------|-----|-------|-------|------|-------|-------|-------|-------|------|-------|------|------|----------|-------|-------|-------|----------|------|------|------|-----|------|------|-------|-------|-------|------|-------|-------|----------|-------|-------|------|-----|-------|------|------|-------|-------|-------|-------|-------|----------|-------|----------|------|------|-----|----------|-----|------|-------|------|------|------|-------|------|------|------|-------|------|-----|-------|-------|-------|-------|------|------|------|------|------|------|------|-------|------|------|----------|----------|-----|-------|------|------|------|------|-----|-----|-----|------|-------|-------|------|-------|------|-------|------|------|------|------|-------|------|------|-------|-------|-------|------|-------|------|-------|------|------|------|------|----------|----|------|-------|-------|------|------|------|------|------|-----|----------|------|------|-------|------|------|-------|-------|-----|------|------|------|------|------|-------|-------|-------|----------|------|------|-------|------|------|------|------|------|------|-----|------|------|-------|------|-------|------|------|------|-------|------|-----|-------|-------|------|-------|------|------|------|----------|-----|------|----|-----|------|-----|-------|-----|-----|-------|------|----|------|------|-------|------|----|------|-------|------|-------|------|------|-------|-------|----|------|------|-------|------|----|------|------|-----|----------|-----|-----|-------|------|------|------|------|-----|----|-----|------|------|-----|------|-------|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | | | | | 110 | 25 | 5.8 | 9.9 | | | | 1.1 | 8.6 | | | | None | - | - | - | 56.6 | 60 | 70 | 60 | 319 | 58.8 | 60 | 70 | 63 | 324 | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 70 | 60 | 319 | 62.1 | 70 | 70 | 63 | 324 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 319 | 85 | 90 | 90 | 78 | 324 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 319 | 103.8 | 110 | 110 | 95 | 324 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 319 | 130.9 | 150 | 150 | 120 | 324 | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | - | 55.5 | 60 | 70 | 59 | 324 | 57.5 | 60 | 70 | 61 | 329 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11725 | 12 | | | | | | | 1 | 33.3 | 59.4 | 60 | | | | | 70 | 60 | 319 | | | 62.1 | 70 | 70 | 63 | 324 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 319 | 85 | 90 | 90 | 78 | 324 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 319 | 103.8 | 110 | 110 | 95 | 324 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 319 | 130.9 | 150 | 150 | 120 | 324 | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | - | 55.5 | 60 | 70 | 59 | 324 | 57.5 | 60 | 70 | 61 | 329 | 11725 | | | | | | | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | | | | | | | | | | | | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | | | | | | | | | | | | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | | | | | | | | | | | | | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | | | | | | | | | | | | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | | | | | | | | | | | | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | | | | | | | | | | | | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12525 | 18.6 | | | | | | | 1 | 51.6 | 82.3 | 90 | | | | | 90 | 76 | 319 | | | 85 | 90 | 90 | 78 | 324 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 319 | 103.8 | 110 | 110 | 95 | 324 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 319 | 130.9 | 150 | 150 | 120 | 324 | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | | | | | | | | | | | | - | 55.5 | 60 | 70 | 59 | 324 | 57.5 | 60 | 70 | 61 | 329 | 11725 | 16 | 1 | 38.5 | | | | | | | | | | | | 65.3 | 70 | 70 | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | | | | | | | | | | | | 11 | 7.8 | 52 | 12 | | | | | | | | | | | | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | | | | | | | | | | | | | | | | | | | | | | | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | | | | | | | | | | | | | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | | | | | | | | | | | | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | | | | | | | | | | | | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | | | | | | | | | | | | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | | | | | | | | | | | | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 13225 | 24 | | | | | | | 1 | 66.6 | 101 | 110 | | | | | 110 | 93 | 319 | | | 103.8 | 110 | 110 | 95 | 324 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 319 | 130.9 | 150 | 150 | 120 | 324 | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | | | | | | | | | | | | - | 55.5 | 60 | | | | | | | | | | | | 70 | 59 | 324 | 57.5 | 60 | 70 | 61 | 329 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | | | | | | | | | | | | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | | | | | | | | | | | | | | | | | | | | | | | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | | | | | | | | | | | | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | | | | | | | | | | | | | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | | | | | | | | | | | | | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | | | | | | | | | | | | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | | | | | | | | | | | | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | | | | | | | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | | | | | | | | | | | | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | | | | | | | | | | | | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 |
| 14225 | 31.8 | | | | | | | 2 | 88.3 | 128.1 | 150 | | | | | 150 | 118 | 319 | | | 130.9 | 150 | 150 | 120 | 324 | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | | | | | | | | | | | | - | 55.5 | 60 | | | | | | | | | | | | 70 | 59 | 324 | | | | | | | | | | | | 57.5 | 60 | 70 | 61 | 329 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 324 | 67.8 | | | | | | | | | | | | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | | | | | | | | | | | | | | | | | | | | | | | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | | | | | | | | | | | | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | | | | | | | | | | | | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | | | | | | | | | | | | | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | | | | | | | | | | | | | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | | | | | | | | | | | | | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | | | | | | | | | | | | | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | | | | | | | | | | | | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | | | | | | | | | | | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | | | | | | | | | | | | 384 | 82.3 | 90 | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | | | | | | | | | | | | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | | | | | | | | | | | | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | | | | | | | | | | | | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | | | | | | | | | | | | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | | | | | | | | | | | | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 |
| 230-3-60 | 16.5 | | 110 | 26 | 16 | 110 | 25 | 5.2 | 9.4 | 1 | 8.6 | None | - | - | - | 55.5 | 60 | 70 | 59 | 324 | 57.5 | 60 | 70 | 61 | 329 | | | | | | | | | | | | 11725 | 16 | 1 | | | | | | | | | | | | 38.5 | 65.3 | 70 | | | | | | | | | | | | 70 | 60 | 324 | | | | | | | | | | | | 67.8 | 70 | 70 | 62 | 329 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | | | | | | | | | | | | | | | | | | | | | 35 | 32 | 160 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | | | | | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | | | | | | | | - | - | - | 21 | 25 | 25 | 23 | 136 | | | | | | | | | | | | 21.8 | 25 | 25 | 23 | 138 | 11758 | 17 | 1 | | | | | | | | | | | | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | | | | | | | | | | | | 30 | 27 | 138 | 13458 | 34 | 1 | | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | | | | | | | | | | | | | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | | | | | | | | | | | | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | | | | | | | | | | | | | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 13225 | | | | | | | | | | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | | | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | | | | | | | | | | | | - | - | - | | | | | | | | | | | | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | | | | | | | | | | | | 32 | 1 | 77 | | | | | | | | | | | | 113.4 | 125 | 125 | | | | | | | | | | | | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | | | | | | | | | | | | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | | | | | | | | | | | | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | | | | | | | | | | | | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | | | | | | | | | | | | 30 | 30 | 26 | 164 | 13458 | 34 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 324 | 67.8 | 70 | 70 | 62 | 329 | | | | | | | | | | | | 12525 | 24.8 | 1 | | | | | | | | | | | | 59.7 | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | | | | | 60 | 47 | 160 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | | | | | | | | | | | | | | | | | | | | | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | 11758 | 17 | 1 | 16.4 | | | | | | | | | | | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | 384 | 63.1 | 70 | 80 | 67 | 384 | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 63.1 | | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | | | | | | | | | | | | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | | | | | | | | | | | | | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | | | | | | | | | | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | | | | | | | | | | | | 70 | 80 | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | | | | | | | | | | | | 4.7 | 0 | 8.6 | | | | | | | | | | | | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | | | | | | | | | | | | | | | | | | | | | | | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | | | | | | | | | | | | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | | | | | | | | | | | | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | | | | | | | | | | | | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | | | | | | | | | | | | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | | | | | | | | | | | | 80 | 67 | 384 | 63.1 | 70 | 80 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 324 | 94.3 | 100 | 100 | 87 | 329 | | | | | | | | | | | | 13225 | 32 | 1 | | | | | | | | | | | | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | | | | | | | | | | | | | | | | | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | 13458 | 34 | 1 | 32.7 | | | | | | | | | | | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | | | | | | | | | | | | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | | | | | | | | | | | | | 110 | 93 | 384 | 101 | 110 | | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | | | | | | | | | | | | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | | | | 389 | 65.3 | 70 | 80 | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | | | | | | | | | | | | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | | | | | | | | | | | | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | | | | | | | | | | | | | | | 35 | 35 | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | | | | | | | | | | | | | | | | | | | | | | | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | | | | | | | | | | | | | | | | | | | | | | | 30 | 30 | 26 | 164 | 13458 | 34 | | | | | | | | | | | | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | | | | | | | | | | | | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 324 | 115.9 | 125 | 125 | 107 | 329 | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | | | | | | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | 11725 | 12 | 1 | 33.3 | | | | | | | | | | | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | | | | | | | | | | | | | 150 | 150 | 118 | 384 | 128.1 | | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | | | | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | | | | | | | | | | | | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | | | | | | | | | | | | | | | 50.3 | 60 | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | | | | | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | | | | | | | | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | | | | | | | | | | | | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 324 | 147.1 | 150 | 150 | 135 | 329 | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | | | | | | | | | | | | 25 | 23 | 136 | 21.8 | 25 | 25 | | | | | | 23 | 138 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | 12525 | 18.6 | 1 | 51.6 | | | | | | | | | | | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | | | | | | | | | | | | | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 11725 | | | | | | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | | | | | | | | | | | | | 19.6 | 136 | 31 | 5.2 | 9.4 | | 0 | 8.6 | None | - | | | | | | | | | | | | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | 11725 | | | | | | | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | | | | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | | | | | | | | | | | | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | | | | | | | | | | | | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | | | | | | | | | | | | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | | | | | | | | | | | | | | | | - | - | | | | | | | | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 460-3-60 | 7.2 | | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 4.7 | 0.5 | 8.6 | None | - | - | - | 26.8 | 30 | 30 | 29 | 157 | 27.8 | 30 | 30 | 30 | 160 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | | | | | | | | | | | | 30 | 26 | 136 | 29 | 30 | 30 | | | | | | 27 | 138 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | | | | | | | | | | | | | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | | | | | | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | 389 | 11725 | | | | | | | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | | | | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | | | | | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | 180 | 11746 | | | | | | | | | | | | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | | | | | | | | | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | | | | | | | | | | | | - | - | | | 23.7 | 25 | 30 | 25 | | | | | | | | | | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | | | | | | | | | | | | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 157 | 34.6 | 35 | 35 | 32 | 160 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 136 | 49.4 | 50 | 50 | | | | | | 45 | 138 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | | | | | | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | | 389 | 11725 | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | | | | | | | | | | | | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | 180 | 11746 | | | | | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | | | | | | | | | | | | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | | | | | | | | | | | | 17 | 1 | | | 16.4 | 28 | 30 | 30 | | | | | | | | | | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | | | | | | | | | | | | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 157 | 51.6 | 60 | 60 | 47 | 160 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | | | | | | | | | | | | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | | | | | | | | | | | | | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | | 66 | 389 | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | 100 | 84 | | | | | | | | | | | | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | 31 | 180 | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | 60 | 46 | | | | | | | | | | | | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | | | | | | | | | | | | 13458 | 34 | | | 1 | 32.7 | 48.4 | 50 | | | | | | | | | | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 157 | 59.4 | 60 | 60 | 55 | 160 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | | 70 | 80 | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | | 100 | 84 | | | | | | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | 60 | 46 | | | | | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | | | | | | | | | | | | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 157 | 72.6 | 80 | 80 | 67 | 160 | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | | 100 | 84 | 389 | | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 575-3-60 | 5.7 | | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 4.3 | 0.4 | 8.6 | None | - | - | - | 21 | 25 | 25 | 23 | 136 | 21.8 | 25 | 25 | 23 | 138 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | | 125 | 125 | 104 | | 389 | 113.4 | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 136 | 29 | 30 | 30 | 27 | 138 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | | 144.6 | 150 | 150 | | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | | 31 | | | | | | | | | | | | 180 | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 136 | 49.4 | 50 | 50 | 45 | 138 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | | - | 29.3 | 30 | | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | | 35 | | | | | | | | | | | | 31 | | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | | 180 | 11746 | 16.5 | | 1 | 19.8 | 33.3 | | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | | 60 | | | | | | | | | | | | 60 | | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | | 31 | 180 | 12846 | | 27.8 | 1 | 33.4 | | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | 60 | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | | 58.2 | | | | | | | | | | | | 60 | | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 (12.5) | 208-3-60 | | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 9.9 | 0 | 8.6 | None | - | - | - | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | | | | | | | | | | | | 90 | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | | | | | | | | | | | | | 110 | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | | 128.1 | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | | 389 | 62 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | | 66 | 389 | 65.3 | 70 | 80 | | | | | | | | | | | | 66 | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | | 100 | 84 | 389 | 91.8 | 100 | | | | | | | | | | | | 100 | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | | 125 | 125 | 104 | 389 | 113.4 | | | | | | | | | | | | 125 | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | | | | | | | | | | | | 180 | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | | | | | | | | | | | | 31 | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | | | | | | | | | | | | 60 | 46 | 180 | | 13346 | 33 | 1 | | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | | | | | | | | | | | 60 | 60 | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | | 25 | | | | | | | | | | | | 164 | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | | | | | | | | | | | 26 | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | | | | | | | | | | | | 50 | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | | | | | | | | | | | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | | | | | | | | | | | | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | | | | | | | | | | | | | 76 | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | | | | | | | | | | | | | 110 | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | | 150 | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | | 62 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | | 389 | 65.3 | 70 | 80 | 66 | | | | | | | | | | | | 389 | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | | 84 | 389 | 91.8 | 100 | 100 | | | | | | | | | | | | 84 | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | | 125 | 104 | 389 | 113.4 | 125 | | | | | | | | | | | | 125 | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | | | | | | | | | | | | | 180 | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | | | | | | | | | | | | | 46 | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | | | | | | | | | | | | | 60 | 54 | 180 | | 14246 | 41.7 | 2 | | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | 26 | | | | | | | | | | | | 164 | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | | | | | | | | | | | | 45 | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | | | | | | | | | | | | | 80 | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | | | | | | | | | | | | | 384 | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | | | | | | | | | | | | | 93 | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | | 150 | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | | 70 | 80 | 66 | 389 | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | | 389 | 91.8 | 100 | 100 | 84 | | | | | | | | | | | | 389 | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | | 104 | 389 | 113.4 | 125 | 125 | | | | | | | | | | | | 104 | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | | | | | | | | | | | | | 180 | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | | | | | | | | | | | | | 54 | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | | None | - | - | | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | | 45 | | | | | | | | | | | | 164 | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | | | | | | | | | | | 67 | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 384 | 101 | 110 | 110 | 93 | | | | | | | | | | | | | 384 | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | | 118 | 384 | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | | 80 | 66 | 389 | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | | 70 | 80 | 66 | 389 | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | | 91.8 | 100 | 100 | 84 | 389 | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | | 389 | 113.4 | 125 | 125 | 104 | | | | | | | | | | | | 389 | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | | | | | | | | | | | | 13346 | 33 | 1 | | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | | | | | | | | | | | | | 180 | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | | 30 | 25 | 164 | | | | | | | | | | | | | 11758 | 17 | 1 | | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | 67 | | | | | | | | | | | | 384 | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | 14225 | | | | | | | | | | | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 384 | 128.1 | 150 | 150 | 118 | 384 | | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | | 389 | 11725 | | | | | | | | | | | | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | | 66 | 389 | 12525 | | | | | | | | | | | | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | | 100 | 84 | 389 | 13225 | | | | | | | | | | | | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | | 125 | 125 | 104 | 389 | 14225 | | | | | | | | | | | | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | | 144.6 | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | | 180 | 29.3 | 30 | 35 | 31 | 180 | 11746 | | | | | | | | | | | | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | | | | | | | | | | | | 27.8 | 1 | 33.4 | 50.3 | 60 | | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | | | | | | | | | | | | 33 | 1 | 39.7 | 58.2 | | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | | | | | | | | | | | | 41.7 | 2 | 50.2 | | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | 34 | | | | | | | | | | | | | 1 | 32.7 | 48.4 | | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | | | | | | | | | | | | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | 70 | 80 | 67 | 384 | 12525 | 18.6 | | | | | | | | | | | | | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 9.4 | 0 | 8.6 | None | - | - | - | 62 | 70 | 80 | 66 | 389 | 62 | 70 | 80 | 66 | 389 | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | | 389 | 12525 | | | | | | | | | | | | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | | 84 | 389 | 13225 | | | | | | | | | | | | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | | 125 | 104 | 389 | 14225 | | | | | | | | | | | | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | | 150 | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | | 29.3 | 30 | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | | 180 | 33.3 | 35 | 35 | 31 | 180 | 12846 | | | | | | | | | | | | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | | | | | | | | | | | | 33 | 1 | 39.7 | 58.2 | 60 | | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | | | | | | | | | | | | 41.7 | 2 | 50.2 | 71.3 | | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | 12 | | | | | | | | | | | | | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | 1 | | | | | | | | | | | | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 80 | 66 | 389 | 65.3 | 70 | 80 | 66 | 389 | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | | 389 | 13225 | | | | | | | | | | | | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | | 104 | 389 | 14225 | | | | | | | | | | | | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | | 150 | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | | 30 | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | | 180 | 50.3 | 60 | 60 | 46 | 180 | 13346 | | | | | | | | | | | | 33 | 1 | 39.7 | 58.2 | 60 | 60 | | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | | | | | | | | | | | | 41.7 | 2 | 50.2 | 71.3 | 80 | | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | 11725 | | | | | | | | | | | | | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | 18.6 | | | | | | | | | | | | | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 389 | 91.8 | 100 | 100 | 84 | 389 | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | | 389 | 14225 | | | | | | | | | | | | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | | 133 | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | | 35 | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | | 35 | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | | 50.3 | 60 | 60 | 46 | 180 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | | 180 | 58.2 | 60 | 60 | 54 | 180 | 14246 | | | | | | | | | | | | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | 12525 | | | | | | | | | | | | | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 389 | 113.4 | 125 | 125 | 104 | 389 | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | | 389 | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | | 31 | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | | 35 | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | | 60 | 60 | 46 | 180 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | | 58.2 | 60 | 60 | 54 | 180 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | | 180 | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 389 | 144.6 | 150 | 150 | 133 | 389 | | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | | 180 | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | | 31 | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | | 60 | 46 | 180 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | | 60 | 60 | 54 | 180 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | | 71.3 | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 4.7 | 0 | 8.6 | None | - | - | - | 29.3 | 30 | 35 | 31 | 180 | 29.3 | 30 | 35 | 31 | 180 | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | | 180 | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | | 46 | 180 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | | 60 | 54 | 180 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | | 80 | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 180 | 33.3 | 35 | 35 | 31 | 180 | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | | 180 | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | | 54 | 180 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | | 80 | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | | 25 | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 180 | 50.3 | 60 | 60 | 46 | 180 | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | | 180 | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | | 66 | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | | 30 | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | | 30 | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 180 | 58.2 | 60 | 60 | 54 | 180 | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | | 180 | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | | 25 | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | | 30 | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | | 50 | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 180 | 71.3 | 80 | 80 | 66 | 180 | | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | | 164 | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | | 26 | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | | 50 | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | | 70 | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 4.3 | 0 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 164 | 23.7 | 25 | 30 | 25 | 164 | | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | | 164 | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | | 45 | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | | 80 | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 164 | 28 | 30 | 30 | 26 | 164 | | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | | 164 | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | | 67 | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 164 | 48.4 | 50 | 50 | 45 | 164 | | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | | 384 | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.1 | 70 | 80 | 67 | 384 | 63.1 | 70 | 80 | 67 | 384 | | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 384 | 82.3 | 90 | 90 | 76 | 384 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

1 Minimum Circuit Ampacity.

2 Dual element, time delay type.

3 HACR type per NEC.

4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 high indoor blower - without powered convenience outlet

Table 174: ZL08 to 14 high indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | | Max fuse ² / Breaker ³ size w/ pwr exh (amps) | | Min disconnect rating ⁴ / pwr exh | |
|-------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|---|--|------------------------------------|-----|-----------------------------------|---|---|---|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max fuse ² / Breaker ³ size w/ pwr exh (amps) | FLA | LRA | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 45.5 | 50 | 50 | 48 | 253 | 47.7 | 50 | 60 | 51 | 258 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 253 | 56.8 | 60 | 60 | 52 | 258 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 253 | 79.6 | 80 | 80 | 73 | 258 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 253 | 98.4 | 100 | 100 | 91 | 258 | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 253 | 125.5 | 150 | 150 | 115 | 258 | | |
| | 230-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 9.4 | 1 | | | None | - | - | - | 45 | 45 | 50 | 48 | 262 | 47 | 50 | 60 | 50 | 266 | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 262 | 62.4 | 70 | 70 | 57 | 266 | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 262 | 88.9 | 90 | 90 | 82 | 266 | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 262 | 110.5 | 125 | 125 | 102 | 266 | |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 262 | 141.8 | 150 | 150 | 130 | 266 | |
| | 460-3-60 | 6.4 | 41 | 10 | 6 | 44 | 9 | 1.3 | 4.7 | 0.5 | | | None | - | - | - | 21.3 | 25 | 25 | 23 | 131 | 22.3 | 25 | 25 | 24 | 133 | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 131 | 31.9 | 35 | 35 | 29 | 133 | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 131 | 48.9 | 50 | 50 | 45 | 133 | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 131 | 56.8 | 60 | 60 | 52 | 133 | |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 131 | 69.9 | 70 | 70 | 64 | 133 | |
| | 575-3-60 | 4.6 | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 4.3 | 0.4 | | | None | - | - | - | 17.2 | 20 | 20 | 18 | 112 | 18 | 20 | 20 | 19 | 114 | |
| 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 112 | 26.9 | 30 | 30 | 25 | 114 | | |
| 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 112 | 47.3 | 50 | 50 | 43 | 114 | | |
| None | | | | | | | | | | | | | - | - | - | 45.7 | 50 | 50 | 49 | 248 | 47.9 | 50 | 60 | 51 | 253 | | |
| 11725 | | | | | | | | | | | | | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 248 | 56.8 | 60 | 60 | 52 | 253 | | |
| 09 (8.5) | 208-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | | None | - | - | - | 45.7 | 50 | 50 | 49 | 248 | 47.9 | 50 | 60 | 51 | 253 | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 54 | 60 | 60 | 50 | 248 | 56.8 | 60 | 60 | 52 | 253 | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 76.9 | 80 | 80 | 71 | 248 | 79.6 | 80 | 80 | 73 | 253 | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 95.6 | 100 | 100 | 88 | 248 | 98.4 | 100 | 100 | 91 | 253 | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 122.8 | 125 | 125 | 113 | 248 | 125.5 | 150 | 150 | 115 | 253 | | |
| | 230-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 9.4 | 1 | | | None | - | - | - | 45.2 | 50 | 50 | 48 | 257 | 47.2 | 50 | 60 | 50 | 261 | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 59.9 | 60 | 60 | 55 | 257 | 62.4 | 70 | 70 | 57 | 261 | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 86.4 | 90 | 90 | 79 | 257 | 88.9 | 90 | 90 | 82 | 261 | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 108 | 110 | 110 | 99 | 257 | 110.5 | 125 | 125 | 102 | 261 | |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 139.3 | 150 | 150 | 128 | 257 | 141.8 | 150 | 150 | 130 | 261 | |
| | 460-3-60 | 6.4 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.7 | 0.5 | | | None | - | - | - | 21.5 | 25 | 25 | 23 | 128 | 22.5 | 25 | 25 | 24 | 130 | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 30.6 | 35 | 35 | 28 | 128 | 31.9 | 35 | 35 | 29 | 130 | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 47.6 | 50 | 50 | 44 | 128 | 48.9 | 50 | 50 | 45 | 130 | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 55.5 | 60 | 60 | 51 | 128 | 56.8 | 60 | 60 | 52 | 130 | |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 68.6 | 70 | 70 | 63 | 128 | 69.9 | 70 | 70 | 64 | 130 | |
| | 575-3-60 | 4.6 | 33 | 7 | 4.8 | 33 | 8 | 1.1 | 4.3 | 0.4 | | | None | - | - | - | 17.1 | 20 | 20 | 18 | 111 | 17.9 | 20 | 20 | 19 | 113 | |
| 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 25.9 | 30 | 30 | 24 | 111 | 26.9 | 30 | 30 | 25 | 113 | | |
| 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 46.3 | 50 | 50 | 43 | 111 | 47.3 | 50 | 50 | 43 | 113 | | |

Table 174: ZL08 to 14 high indoor blower - without powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | Max fuse ² /Breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | | | | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|-------|--------|------|-------------------------|---|---|------------------------------------|-----|-----------------------------------|--|--|--|-----|-----|--|--|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA | | | |
| 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.8 | 13.5 | 1.1 | | None | - | - | - | 55.9 | 60 | 70 | 60 | 345 | 58.1 | 60 | 70 | 62 | 350 | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 58.5 | 60 | 70 | 60 | 345 | 61.3 | 70 | 70 | 62 | 350 | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81.4 | 90 | 90 | 75 | 345 | 84.1 | 90 | 90 | 77 | 350 | | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 100.1 | 110 | 110 | 92 | 345 | 102.9 | 110 | 110 | 95 | 350 | | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 127.3 | 150 | 150 | 117 | 345 | 130 | 150 | 150 | 120 | 350 | | | |
| | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 13.4 | 1 | | | None | - | - | - | 55.2 | 60 | 70 | 59 | 341 | 57.2 | 60 | 70 | 61 | 346 | | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 64.9 | 70 | 70 | 60 | 341 | 67.4 | 70 | 70 | 62 | 346 | | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.4 | 100 | 100 | 84 | 341 | 93.9 | 100 | 100 | 86 | 346 | | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113 | 125 | 125 | 104 | 341 | 115.5 | 125 | 125 | 106 | 346 | | |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.3 | 150 | 150 | 133 | 341 | 146.8 | 150 | 150 | 135 | 346 | | |
| | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 6.7 | 0.5 | | | None | - | - | - | 26.6 | 30 | 30 | 28 | 166 | 27.6 | 30 | 30 | 29 | 168 | | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.1 | 35 | 35 | 30 | 166 | 34.4 | 35 | 35 | 32 | 168 | | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.1 | 60 | 60 | 46 | 166 | 51.4 | 60 | 60 | 47 | 168 | | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58 | 60 | 60 | 53 | 166 | 59.3 | 60 | 60 | 55 | 168 | | |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.1 | 80 | 80 | 65 | 166 | 72.4 | 80 | 80 | 67 | 168 | | |
| | 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.4 | 0.4 | | | None | - | - | - | 20.4 | 25 | 25 | 22 | 134 | 21.2 | 25 | 25 | 23 | 136 | | |
| 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 27.3 | 30 | 30 | 25 | 134 | 28.3 | 30 | 30 | 26 | 136 | | | |
| 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 47.6 | 50 | 50 | 44 | 134 | 48.6 | 50 | 50 | 45 | 136 | | | |
| 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 13.5 | 0 | | None | - | - | - | 62.4 | 70 | 80 | 66 | 410 | 62.4 | 70 | 80 | 66 | 410 | | | |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 62.4 | 70 | 80 | 66 | 410 | 62.4 | 70 | 80 | 66 | 410 | | | |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 81.4 | 90 | 90 | 75 | 410 | 81.4 | 90 | 90 | 75 | 410 | | | |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 100.1 | 110 | 110 | 92 | 410 | 100.1 | 110 | 110 | 92 | 410 | | | |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 127.3 | 150 | 150 | 117 | 410 | 127.3 | 150 | 150 | 117 | 410 | | | |
| | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 13.4 | 0 | | | None | - | - | - | 61.7 | 70 | 80 | 65 | 406 | 61.7 | 70 | 80 | 65 | 406 | | |
| | | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 64.9 | 70 | 80 | 65 | 406 | 64.9 | 70 | 80 | 65 | 406 | | |
| | | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.4 | 100 | 100 | 84 | 406 | 91.4 | 100 | 100 | 84 | 406 | | |
| | | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113 | 125 | 125 | 104 | 406 | 113 | 125 | 125 | 104 | 406 | | |
| | | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.3 | 150 | 150 | 133 | 406 | 144.3 | 150 | 150 | 133 | 406 | | |
| | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 6.7 | 0 | | | None | - | - | - | 29.1 | 30 | 35 | 31 | 189 | 29.1 | 30 | 35 | 31 | 189 | | |
| | | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.1 | 35 | 35 | 30 | 189 | 33.1 | 35 | 35 | 30 | 189 | | |
| | | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.1 | 60 | 60 | 46 | 189 | 50.1 | 60 | 60 | 46 | 189 | | |
| | | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58 | 60 | 60 | 53 | 189 | 58 | 60 | 60 | 53 | 189 | | |
| | | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.1 | 80 | 80 | 65 | 189 | 71.1 | 80 | 80 | 65 | 189 | | |
| | 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 5.4 | 0 | | | None | - | - | - | 23.1 | 25 | 30 | 24 | 163 | 23.1 | 25 | 30 | 24 | 163 | | |
| 11758 | | | | | | | | | | | | | 17 | 1 | 16.4 | 27.3 | 30 | 30 | 25 | 163 | 27.3 | 30 | 30 | 25 | 163 | | | |
| 13458 | | | | | | | | | | | | | 34 | 1 | 32.7 | 47.6 | 50 | 50 | 44 | 163 | 47.6 | 50 | 50 | 44 | 163 | | | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

ZL08 to 14 high indoor blower - with powered convenience outlet

Table 175: ZL08 to 14 high indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | MCA ¹ (amps) | Min fuse ² /breaker ³ size (amps) | Max fuse ² /breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² /breaker ³ size w/ pwr exh (amps) | | Max Fuse ² /Breaker ³ size w/ pwr exh (amps) | | | | |
|-------------|----------------------|--------------|------|--------|--------------|-------|-----|----------------------|---------------------|---------------|-----------------|---|-------------------------|---|---|------------------------------------|------|-----------------------------------|--|------|--|-----|-----|-----|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | | | | | FLA | LRA | | FLA | LRA | FLA | LRA | | | |
| | | Model | kW | Stages | Amps | Model | kW | | | | | | | | | Stages | Amps | | | | | | | | |
| 08 (7.5) | 208-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 49.8 | 50 | 60 | 53 | 258 | 52 | 60 | 60 | 56 | 263 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 258 | 62.1 | 70 | 70 | 57 | 263 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 258 | 85 | 90 | 90 | 78 | 263 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 258 | 103.8 | 110 | 110 | 95 | 263 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 258 | 130.9 | 150 | 150 | 120 | 263 |
| | 230-3-60 | 14 | 83.1 | 22 | 13.5 | 88 | 21 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 49.3 | 50 | 60 | 53 | 266 | 51.3 | 60 | 60 | 55 | 271 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 266 | 67.8 | 70 | 70 | 62 | 271 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 266 | 94.3 | 100 | 100 | 87 | 271 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 266 | 115.9 | 125 | 125 | 107 | 271 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 266 | 147.1 | 150 | 150 | 135 | 271 |
| | 460-3-60 | 6.4 | 41 | 10 | 6 | 44 | 9 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 23.5 | 25 | 25 | 25 | 133 | 24.5 | 25 | 25 | 26 | 135 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 133 | 34.6 | 35 | 35 | 32 | 135 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 133 | 51.6 | 60 | 60 | 47 | 135 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 133 | 59.4 | 60 | 60 | 55 | 135 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 133 | 72.6 | 80 | 80 | 67 | 135 |
| | 575-3-60 | 4.6 | 33 | 7 | 4.9 | 34 | 8 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 18.9 | 20 | 20 | 20 | 113 | 19.7 | 20 | 20 | 21 | 115 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 113 | 29 | 30 | 30 | 27 | 115 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 113 | 49.4 | 50 | 50 | 45 | 115 | |
| None | | | | | | | | | | | | - | - | - | 50 | 50 | 60 | 53 | 253 | 52.2 | 60 | 60 | 56 | 258 | |
| 11725 | | | | | | | | | | | | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 253 | 62.1 | 70 | 70 | 57 | 258 | |
| 09 (8.5) | 208-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 9.9 | 1.1 | 8.6 | None | - | - | - | 49.5 | 50 | 60 | 53 | 253 | 52.2 | 60 | 60 | 56 | 258 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 59.4 | 60 | 60 | 55 | 253 | 62.1 | 70 | 70 | 57 | 258 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 82.3 | 90 | 90 | 76 | 253 | 85 | 90 | 90 | 78 | 258 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 101 | 110 | 110 | 93 | 253 | 103.8 | 110 | 110 | 95 | 258 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 128.1 | 150 | 150 | 118 | 253 | 130.9 | 150 | 150 | 120 | 258 |
| | 230-3-60 | 14 | 83.1 | 22 | 13.7 | 83.1 | 21 | 2.3 | 9.4 | 1 | 8.6 | None | - | - | - | 49.5 | 50 | 60 | 53 | 261 | 51.5 | 60 | 60 | 55 | 266 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 65.3 | 70 | 70 | 60 | 261 | 67.8 | 70 | 70 | 62 | 266 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 91.8 | 100 | 100 | 84 | 261 | 94.3 | 100 | 100 | 87 | 266 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 113.4 | 125 | 125 | 104 | 261 | 115.9 | 125 | 125 | 107 | 266 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 144.6 | 150 | 150 | 133 | 261 | 147.1 | 150 | 150 | 135 | 266 |
| | 460-3-60 | 6.4 | 41 | 10 | 6.2 | 41 | 10 | 1.3 | 4.7 | 0.5 | 8.6 | None | - | - | - | 23.7 | 25 | 30 | 25 | 130 | 24.7 | 25 | 30 | 27 | 132 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 33.3 | 35 | 35 | 31 | 130 | 34.6 | 35 | 35 | 32 | 132 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 50.3 | 60 | 60 | 46 | 130 | 51.6 | 60 | 60 | 47 | 132 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 58.2 | 60 | 60 | 54 | 130 | 59.4 | 60 | 60 | 55 | 132 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 71.3 | 80 | 80 | 66 | 130 | 72.6 | 80 | 80 | 67 | 132 |
| | 575-3-60 | 4.6 | 33 | 7 | 4.8 | 33 | 8 | 1.1 | 4.3 | 0.4 | 8.6 | None | - | - | - | 18.8 | 20 | 20 | 20 | 112 | 19.6 | 20 | 20 | 21 | 114 |
| 11758 | | | | | | | | | | | | 17 | 1 | 16.4 | 28 | 30 | 30 | 26 | 112 | 29 | 30 | 30 | 27 | 114 | |
| 13458 | | | | | | | | | | | | 34 | 1 | 32.7 | 48.4 | 50 | 50 | 45 | 112 | 49.4 | 50 | 50 | 45 | 114 | |

Table 175: ZL08 to 14 high indoor blower - with powered convenience outlet

| Size (ton) | Nominal unit voltage | Compressor 1 | | | Compressor 2 | | | OD fan motors (each) | Supply blower motor | Pwr exh motor | Pwr conv outlet | Electric heat field installed kit 2EK045* | | | | MCA ¹ (amps) | Min fuse ² / breaker ³ size (amps) | Max fuse ² / breaker ³ size (amps) | Min disconnect rating ⁴ | | MCA ¹ w/pwr exh (amps) | Min fuse ² / breaker ³ size w/ pwr exh (amps) | Max Fuse ² / Breaker ³ size w/ pwr exh (amps) | Min disconnect rating ⁴ / pwr exh | |
|------------|----------------------|--------------|------|-----|--------------|------|-----|----------------------|---------------------|---------------|-----------------|---|------|--------|------|-------------------------|--|--|------------------------------------|------|-----------------------------------|---|---|--|-----|
| | | RLA | LRA | MCC | RLA | LRA | MCC | | | | | Model | kW | Stages | Amps | | | | FLA | LRA | | | | FLA | LRA |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 (10) | 208-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.8 | 13.5 | 1.1 | 8.6 | None | - | - | - | 60.2 | 70 | 70 | 65 | 349 | 62.4 | 70 | 70 | 67 | 354 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 63.9 | 70 | 70 | 65 | 349 | 66.6 | 70 | 70 | 67 | 354 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 86.8 | 90 | 90 | 80 | 349 | 89.5 | 90 | 90 | 82 | 354 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 105.5 | 110 | 110 | 97 | 349 | 108.3 | 110 | 110 | 100 | 354 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 132.6 | 150 | 150 | 122 | 349 | 135.4 | 150 | 150 | 125 | 354 |
| | 230-3-60 | 16.5 | 110 | 26 | 16 | 110 | 25 | 5.2 | 13.4 | 1 | 8.6 | None | - | - | - | 59.5 | 60 | 70 | 64 | 345 | 61.5 | 70 | 70 | 66 | 350 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 70.3 | 80 | 80 | 65 | 345 | 72.8 | 80 | 80 | 67 | 350 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 96.8 | 100 | 100 | 89 | 345 | 99.3 | 100 | 100 | 91 | 350 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 118.4 | 125 | 125 | 109 | 345 | 120.9 | 125 | 125 | 111 | 350 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 149.6 | 150 | 150 | 138 | 345 | 152.1 | 175 | 175 | 140 | 350 |
| | 460-3-60 | 7.2 | 52 | 11 | 7.8 | 52 | 12 | 2.9 | 6.7 | 0.5 | 8.6 | None | - | - | - | 28.8 | 30 | 35 | 31 | 168 | 29.8 | 30 | 35 | 32 | 170 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 35.8 | 40 | 40 | 33 | 168 | 37.1 | 40 | 40 | 34 | 170 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 52.8 | 60 | 60 | 49 | 168 | 54.1 | 60 | 60 | 50 | 170 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 60.7 | 70 | 70 | 56 | 168 | 61.9 | 70 | 70 | 57 | 170 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 73.8 | 80 | 80 | 68 | 168 | 75.1 | 80 | 80 | 69 | 170 |
| 575-3-60 | 5.7 | 43.8 | 9 | 5.7 | 38.9 | 9 | 2.2 | 5.4 | 0.4 | 8.6 | None | - | - | - | 22.1 | 25 | 25 | 24 | 136 | 22.9 | 25 | 25 | 25 | 138 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 136 | 30.4 | 35 | 35 | 28 | 138 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 136 | 50.8 | 60 | 60 | 47 | 138 | |
| | | | | | | | | | | | None | - | - | - | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 | |
| | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 | |
| 14 (12.5) | 208-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.8 | 13.5 | 0 | 8.6 | None | - | - | - | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 |
| | | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 |
| | | | | | | | | | | | | 12525 | 18.6 | 1 | 51.6 | 86.8 | 90 | 90 | 80 | 414 | 86.8 | 90 | 90 | 80 | 414 |
| | | | | | | | | | | | | 13225 | 24 | 1 | 66.6 | 105.5 | 110 | 110 | 97 | 414 | 105.5 | 110 | 110 | 97 | 414 |
| | | | | | | | | | | | | 14225 | 31.8 | 2 | 88.3 | 132.6 | 150 | 150 | 122 | 414 | 132.6 | 150 | 150 | 122 | 414 |
| | 230-3-60 | 18.6 | 149 | 29 | 19.6 | 136 | 31 | 5.2 | 13.4 | 0 | 8.6 | None | - | - | - | 66 | 70 | 80 | 70 | 410 | 66 | 70 | 80 | 70 | 410 |
| | | | | | | | | | | | | 11725 | 16 | 1 | 38.5 | 70.3 | 80 | 80 | 70 | 410 | 70.3 | 80 | 80 | 70 | 410 |
| | | | | | | | | | | | | 12525 | 24.8 | 1 | 59.7 | 96.8 | 100 | 100 | 89 | 410 | 96.8 | 100 | 100 | 89 | 410 |
| | | | | | | | | | | | | 13225 | 32 | 1 | 77 | 118.4 | 125 | 125 | 109 | 410 | 118.4 | 125 | 125 | 109 | 410 |
| | | | | | | | | | | | | 14225 | 42.4 | 2 | 102 | 149.6 | 150 | 150 | 138 | 410 | 149.6 | 150 | 150 | 138 | 410 |
| | 460-3-60 | 9 | 60.9 | 14 | 8.2 | 66.1 | 13 | 2.9 | 6.7 | 0 | 8.6 | None | - | - | - | 31.3 | 35 | 40 | 33 | 191 | 31.3 | 35 | 40 | 33 | 191 |
| | | | | | | | | | | | | 11746 | 16.5 | 1 | 19.8 | 35.8 | 40 | 40 | 33 | 191 | 35.8 | 40 | 40 | 33 | 191 |
| | | | | | | | | | | | | 12846 | 27.8 | 1 | 33.4 | 52.8 | 60 | 60 | 49 | 191 | 52.8 | 60 | 60 | 49 | 191 |
| | | | | | | | | | | | | 13346 | 33 | 1 | 39.7 | 60.7 | 70 | 70 | 56 | 191 | 60.7 | 70 | 70 | 56 | 191 |
| | | | | | | | | | | | | 14246 | 41.7 | 2 | 50.2 | 73.8 | 80 | 80 | 68 | 191 | 73.8 | 80 | 80 | 68 | 191 |
| 575-3-60 | 7.1 | 56 | 11 | 6.6 | 55.3 | 10 | 2.2 | 5.4 | 0 | 8.6 | None | - | - | - | 24.8 | 25 | 30 | 26 | 164 | 24.8 | 25 | 30 | 26 | 164 | |
| | | | | | | | | | | | 11758 | 17 | 1 | 16.4 | 29.4 | 30 | 30 | 27 | 164 | 29.4 | 30 | 30 | 27 | 164 | |
| | | | | | | | | | | | 13458 | 34 | 1 | 32.7 | 49.8 | 50 | 50 | 46 | 164 | 49.8 | 50 | 50 | 46 | 164 | |
| | | | | | | | | | | | None | - | - | - | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 | |
| | | | | | | | | | | | 11725 | 12 | 1 | 33.3 | 66.7 | 70 | 80 | 71 | 414 | 66.7 | 70 | 80 | 71 | 414 | |

- 1 Minimum Circuit Ampacity.
- 2 Dual element, time delay type.
- 3 HACR type per NEC.
- 4 Non-fused disconnect. Verify on the unit nameplate that the disconnect is properly sized for the application. Units with field installed electric heat kits may exceed the factory installed disconnect amperage rating.

Weights and dimensions

ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit weights

Figure 7: Unit 4 point load weight

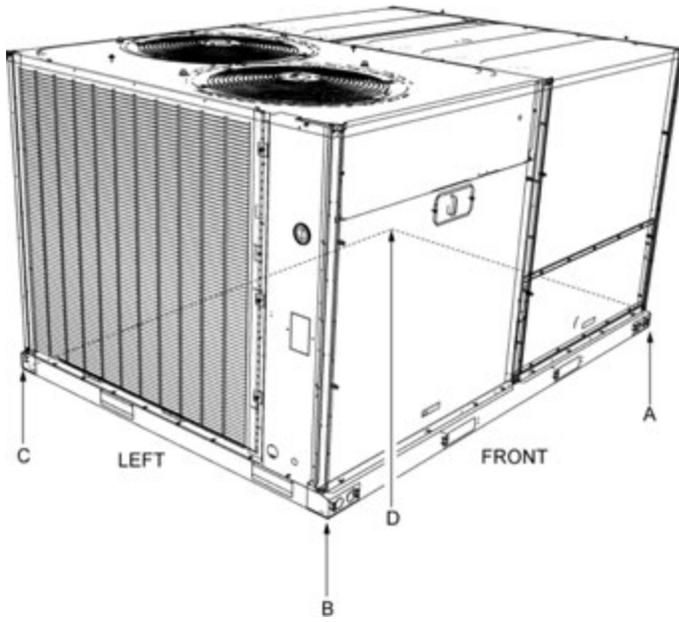


Figure 8: Unit 6 point load weight

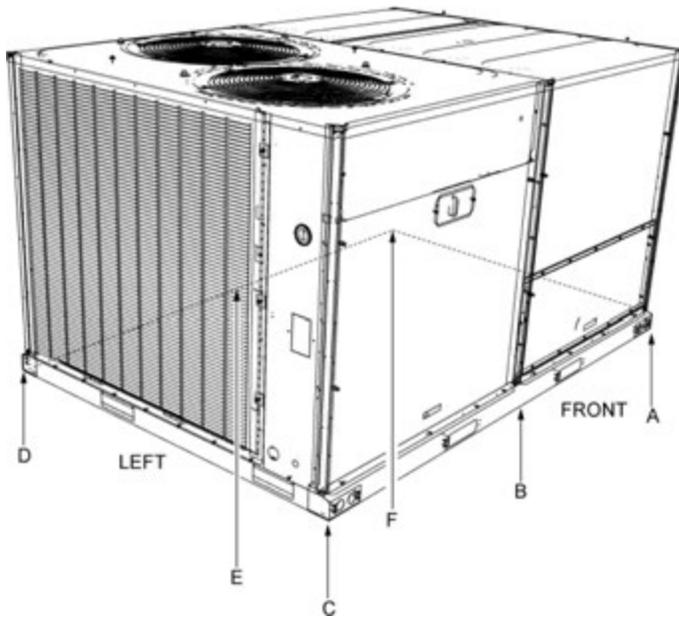


Figure 9: Unit center of gravity

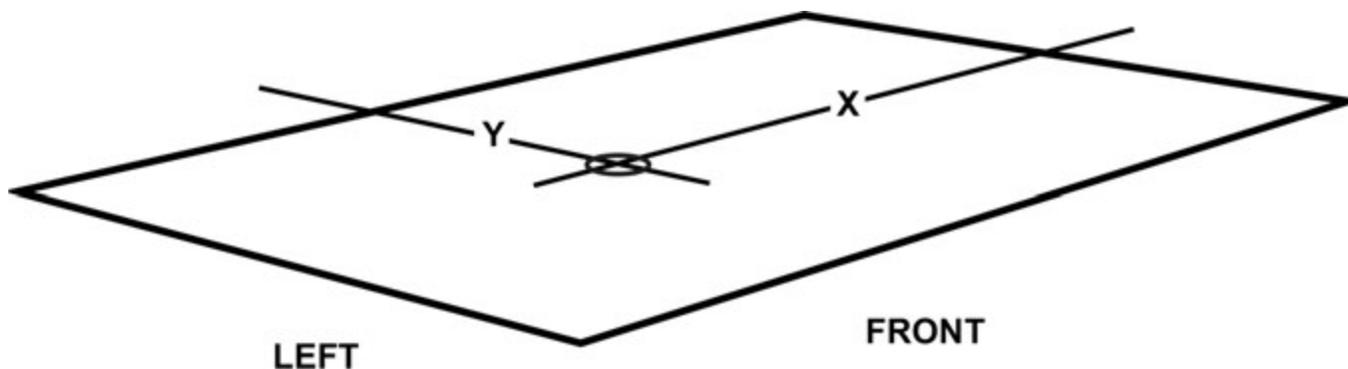


Table 176: ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 corner weights

| Model | Size (ton) | Weight (lb) | | Center of gravity | | 4 point load location (lb) | | | | 6 point load location (lb) | | | | | |
|-------|------------|-------------|-----------|-------------------|----|----------------------------|-----|-----|-----|----------------------------|-----|-----|-----|-----|-----|
| | | Shipping | Operating | X | Y | A | B | C | D | A | B | C | D | E | F |
| ZQE | 04 (3) | 479 | 450 | 36 | 26 | 121 | 117 | 104 | 108 | 81 | 79 | 78 | 69 | 71 | 72 |
| ZQE | 05 (4) | 516 | 487 | 36 | 26 | 131 | 124 | 113 | 119 | 88 | 85 | 82 | 75 | 77 | 80 |
| ZQE | 06 (5) | 590 | 561 | 36 | 24 | 140 | 134 | 140 | 147 | 94 | 91 | 89 | 93 | 96 | 99 |
| ZXE | A7 (6) | 634 | 614 | 34 | 25 | 168 | 146 | 139 | 160 | 115 | 104 | 95 | 91 | 99 | 109 |
| ZXE | 08 (7.5) | 787 | 782 | 47 | 36 | 211 | 245 | 175 | 151 | 138 | 151 | 167 | 119 | 108 | 98 |
| ZXE | 09 (8.5) | 847 | 842 | 46 | 36 | 227 | 259 | 189 | 166 | 148 | 161 | 176 | 129 | 118 | 109 |
| ZXE | 12 (10) | 874 | 869 | 46 | 36 | 239 | 268 | 191 | 170 | 156 | 169 | 182 | 130 | 120 | 111 |
| ZXE | 14 (12.5) | 936 | 931 | 45 | 36 | 262 | 281 | 200 | 187 | 173 | 181 | 190 | 135 | 129 | 123 |
| ZYE | 04 (3) | 486 | 481 | 36 | 25 | 127 | 118 | 113 | 122 | 86 | 82 | 78 | 75 | 78 | 82 |
| ZYE | 05 (4) | 569 | 564 | 36 | 25 | 145 | 140 | 137 | 142 | 97 | 95 | 93 | 91 | 93 | 95 |
| ZYE | 06 (5) | 587 | 582 | 36 | 25 | 151 | 145 | 140 | 146 | 101 | 99 | 96 | 93 | 95 | 98 |
| ZYE | 07 (6) | 730 | 725 | 44 | 36 | 206 | 211 | 156 | 153 | 137 | 139 | 141 | 104 | 103 | 101 |
| ZYE | A7 (6) | 849 | 829 | 45 | 35 | 229 | 244 | 183 | 172 | 151 | 158 | 165 | 124 | 118 | 113 |
| ZYE | 08 (7.5) | 873 | 868 | 46 | 36 | 236 | 268 | 193 | 171 | 154 | 167 | 182 | 132 | 121 | 111 |
| ZYE | 09 (8.5) | 878 | 878 | 46 | 36 | 241 | 265 | 195 | 177 | 158 | 168 | 180 | 132 | 124 | 116 |
| ZYE | 12 (10) | 907 | 902 | 47 | 36 | 239 | 278 | 207 | 178 | 155 | 171 | 190 | 142 | 128 | 116 |
| ZLE | 04 (3) | 486 | 481 | 42 | 27 | 112 | 147 | 126 | 96 | 71 | 85 | 103 | 88 | 73 | 61 |
| ZLE | 05 (4) | 569 | 564 | 36 | 26 | 153 | 145 | 130 | 137 | 103 | 99 | 96 | 86 | 89 | 92 |
| ZLE | 06 (5) | 587 | 582 | 37 | 24 | 141 | 142 | 150 | 149 | 94 | 94 | 95 | 100 | 100 | 99 |
| ZLE | 08 (7.5) | 925 | 920 | 45 | 37 | 262 | 282 | 195 | 181 | 173 | 181 | 191 | 131 | 125 | 119 |
| ZLE | 09 (8.5) | 930 | 925 | 46 | 36 | 258 | 284 | 201 | 182 | 169 | 180 | 192 | 136 | 128 | 120 |
| ZLE | 12 (10) | 960 | 955 | 46 | 35 | 258 | 287 | 216 | 194 | 169 | 181 | 195 | 146 | 136 | 127 |
| ZLE | 14 (12.5) | 985 | 980 | 44 | 35 | 277 | 283 | 213 | 208 | 184 | 186 | 189 | 142 | 140 | 138 |

Table 177: ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 corner weights

| Model | Size (ton) | Weight (lb) | | Center of gravity | | 4 point load location (lb) | | | | 6 point load location (lb) | | | | | |
|-------|------------|-------------|-----------|-------------------|----|----------------------------|-----|-----|-----|----------------------------|-----|-----|-----|-----|-----|
| | | Shipping | Operating | X | Y | A | B | C | D | A | B | C | D | E | F |
| ZQG | 04 (3) | 530 | 515 | 35 | 27 | 145 | 132 | 113 | 125 | 98 | 92 | 87 | 74 | 79 | 84 |
| ZQG | 05 (4) | 557 | 552 | 36 | 27 | 154 | 144 | 123 | 131 | 104 | 99 | 95 | 81 | 85 | 89 |
| ZQG | 06 (5) | 639 | 610 | 36 | 26 | 165 | 157 | 141 | 147 | 111 | 107 | 104 | 93 | 96 | 99 |
| ZXG | A7 (6) | 688 | 668 | 34 | 25 | 183 | 159 | 152 | 174 | 125 | 114 | 104 | 99 | 108 | 119 |
| ZXG | 07 (6) | 651 | 646 | 34 | 26 | 183 | 155 | 141 | 167 | 125 | 112 | 101 | 92 | 102 | 114 |
| ZXG | 08 (7.5) | 889 | 884 | 46 | 37 | 249 | 282 | 188 | 166 | 162 | 176 | 192 | 128 | 117 | 108 |
| ZXG | 09 (8.5) | 949 | 944 | 45 | 36 | 266 | 288 | 203 | 187 | 175 | 184 | 194 | 137 | 130 | 123 |
| ZXG | 12 (10) | 980 | 975 | 45 | 37 | 281 | 298 | 204 | 192 | 185 | 193 | 201 | 137 | 132 | 127 |
| ZXG | 14 (12.5) | 1042 | 1037 | 44 | 37 | 301 | 309 | 216 | 210 | 200 | 203 | 207 | 145 | 142 | 140 |
| ZYG | 04 (3) | 532 | 527 | 36 | 27 | 147 | 136 | 117 | 126 | 99 | 94 | 90 | 77 | 81 | 85 |
| ZYG | 05 (4) | 623 | 618 | 36 | 26 | 167 | 156 | 142 | 152 | 113 | 108 | 103 | 94 | 98 | 103 |
| ZYG | 06 (5) | 641 | 636 | 35 | 26 | 174 | 159 | 144 | 159 | 118 | 111 | 104 | 95 | 101 | 108 |
| ZYG | 07 (6) | 800 | 795 | 43 | 37 | 237 | 233 | 161 | 164 | 159 | 157 | 155 | 107 | 108 | 109 |
| ZYG | A7 (6) | 919 | 899 | 45.0 | 35 | 249 | 265 | 199 | 187 | 164 | 171 | 179 | 134 | 128 | 123 |
| ZYG | 08 (7.5) | 975 | 970 | 44 | 37 | 287 | 294 | 197 | 193 | 191 | 193 | 196 | 132 | 130 | 128 |
| ZYG | 09 (8.5) | 980 | 970 | 45 | 36 | 276 | 289 | 207 | 198 | 183 | 188 | 194 | 139 | 135 | 131 |
| ZYG | 12 (10) | 1013 | 1008 | 45 | 36 | 285 | 300 | 217 | 206 | 189 | 195 | 202 | 146 | 141 | 136 |

Table 177: ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 corner weights

| Model | Size (ton) | Weight (lb) | | Center of gravity | | 4 point load location (lb) | | | | 6 point load location (lb) | | | | | |
|-------|------------|-------------|-----------|-------------------|----|----------------------------|-----|-----|-----|----------------------------|-----|-----|-----|-----|-----|
| | | Shipping | Operating | X | Y | A | B | C | D | A | B | C | D | E | F |
| ZLG | 04 (3) | 560 | 555 | 42 | 27 | 129 | 170 | 146 | 111 | 82 | 98 | 118 | 102 | 84 | 71 |
| ZLG | 05 (4) | 607 | 602 | 36 | 26 | 163 | 155 | 139 | 146 | 109 | 106 | 102 | 92 | 95 | 98 |
| ZLG | 06 (5) | 636 | 631 | 37 | 25 | 160 | 160 | 156 | 155 | 106 | 107 | 107 | 104 | 104 | 103 |
| ZLG | 08 (7.5) | 1045 | 1040 | 44 | 37 | 304 | 312 | 215 | 210 | 202 | 205 | 209 | 144 | 141 | 139 |
| ZLG | 09 (8.5) | 1035 | 1030 | 45 | 36 | 294 | 309 | 219 | 208 | 194 | 201 | 208 | 147 | 142 | 138 |
| ZLG | 12 (10) | 1055 | 1050 | 45 | 36 | 299 | 313 | 224 | 214 | 198 | 204 | 210 | 151 | 146 | 142 |
| ZLG | 14 (12.5) | 1075 | 1070 | 44 | 36 | 309 | 316 | 225 | 220 | 205 | 208 | 211 | 151 | 148 | 146 |

Table 178: ZQ, ZX, ZY and ZL04-14 unit accessory weights

| Unit accessory | Weights (lb) |
|---|--------------|
| Powered convenience outlet factory installed | 35 |
| Non-powered convenience outlet factory installed | 10 |
| Vertical flow dry bulb economizer small footprint | 63 |
| Vertical flow dry bulb economizer large footprint | 96 |
| Horizontal flow dry bulb economizer small footprint short | 75 |
| Horizontal flow dry bulb economizer small footprint tall | 81 |
| Horizontal flow dry bulb economizer large footprint short | 105 |
| Horizontal flow dry bulb economizer large footprint tall | 102 |
| Power exhaust vertical flow small footprint | 39 |
| Power exhaust vertical flow large footprint | 39 |
| Power exhaust horizontal flow small footprint | 39 |
| Power exhaust horizontal flow large footprint | 39 |
| Hail guard kit small short factory installed | 19 |
| Hail guard kit small tall factory installed | 24 |
| Hail guard kit large short factory installed | 50 |
| Hail guard kit large tall factory installed | 50 |
| Flue extension kit (1FE0414) | 15 |
| Flue extension kit (1FE0415) | 17 |
| Flue extension kit (1FE0416) | 19 |
| Curb rigid 14 in. small footprint | 145 |
| Curb rigid 14 in. large footprint | 135 |
| Curb rigid 24 in. small footprint | 135 |
| Curb rigid 24 in. large footprint | 135 |

ZQ04-06, ZXA7, 08-14, ZY04-12, ZL04-06 and ZL08-14 unit dimensions

Figure 10: ZQ04-05, ZL04 and ZY04

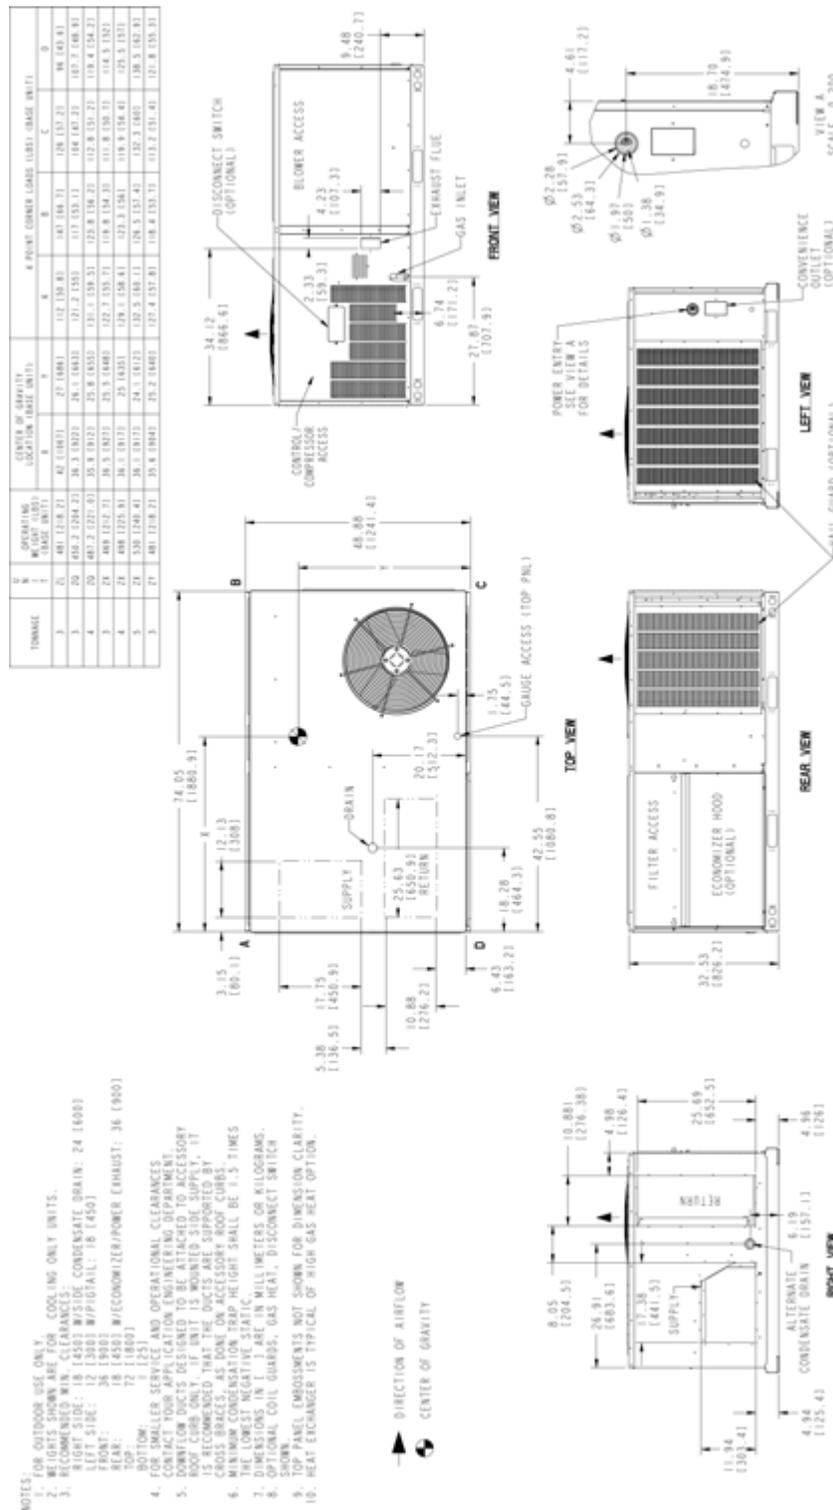


Figure 11: ZQ06, ZXA7, ZL05-06 and ZY05-06

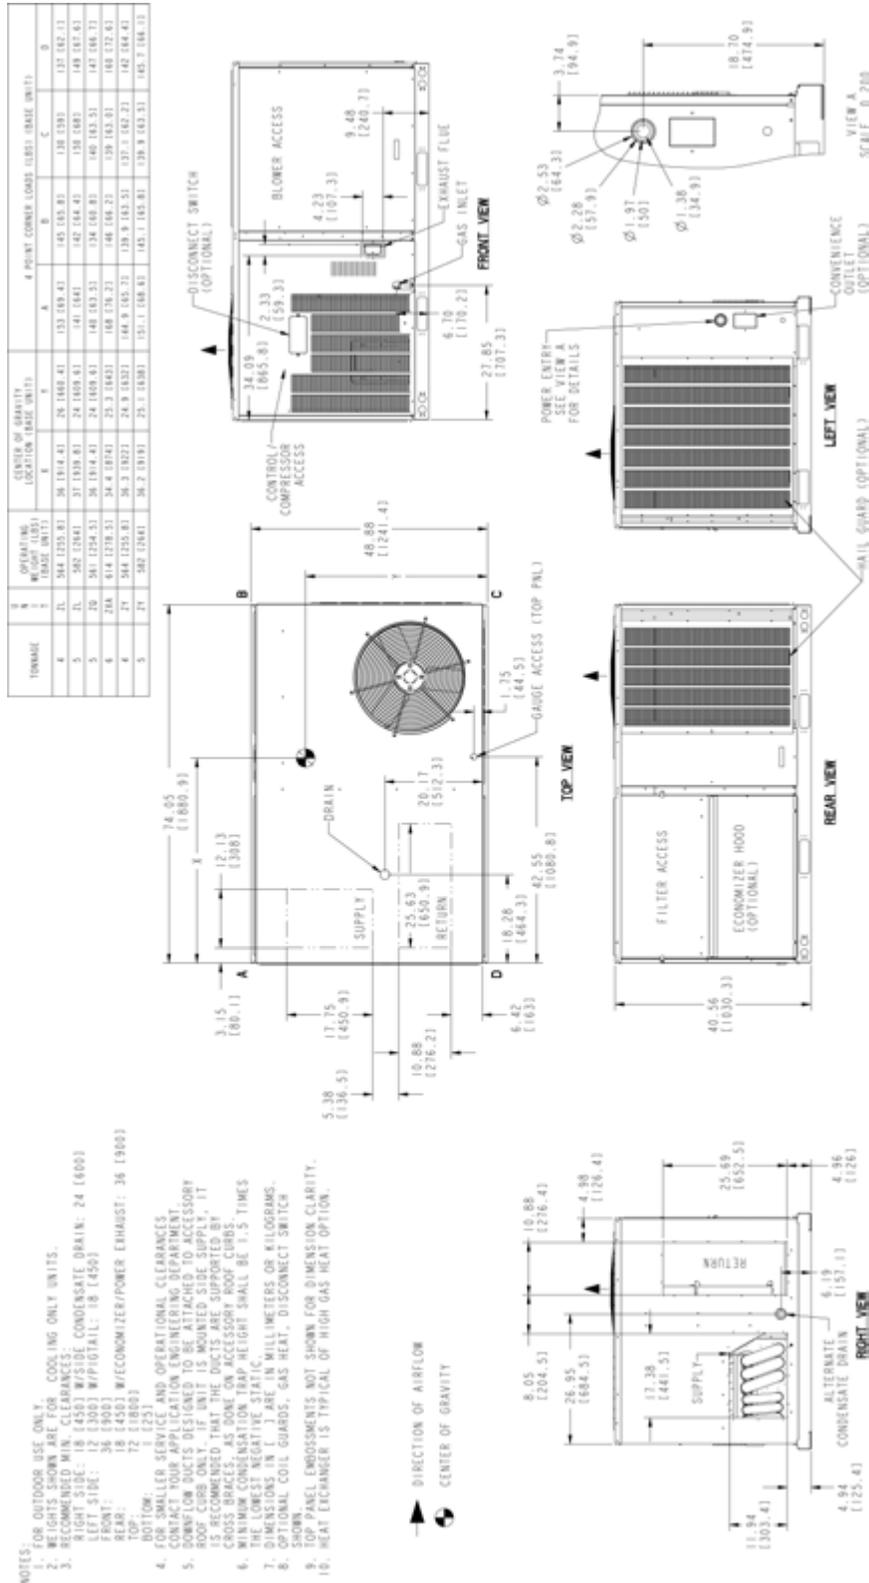


Figure 12: ZX08, ZY07, and ZYA7

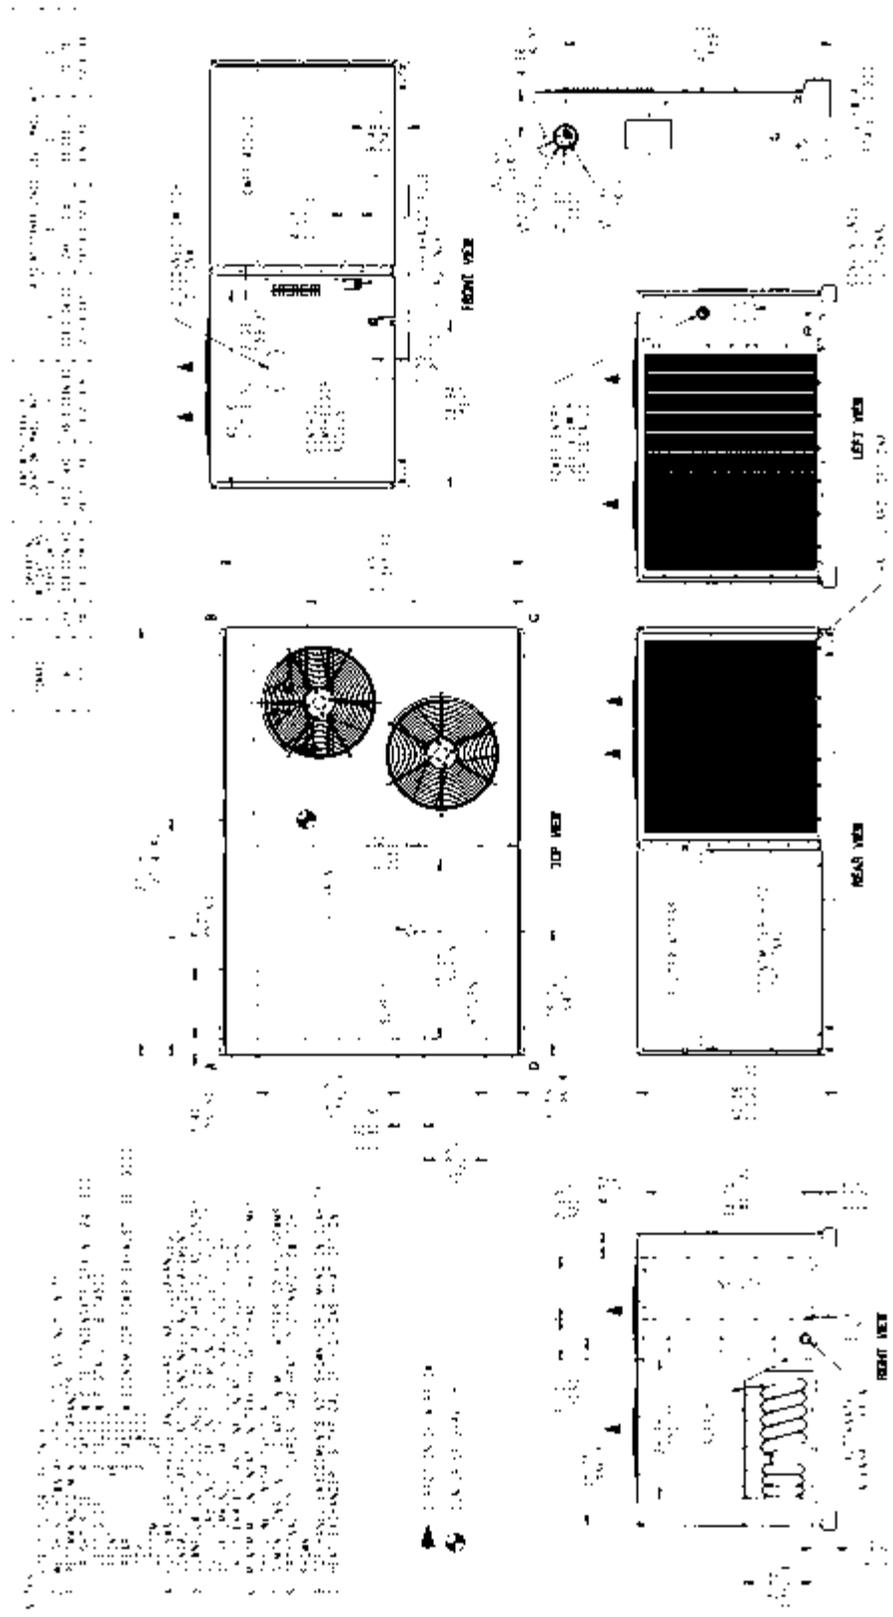


Figure 13: ZX09-12, ZY08-09 and ZL08-09

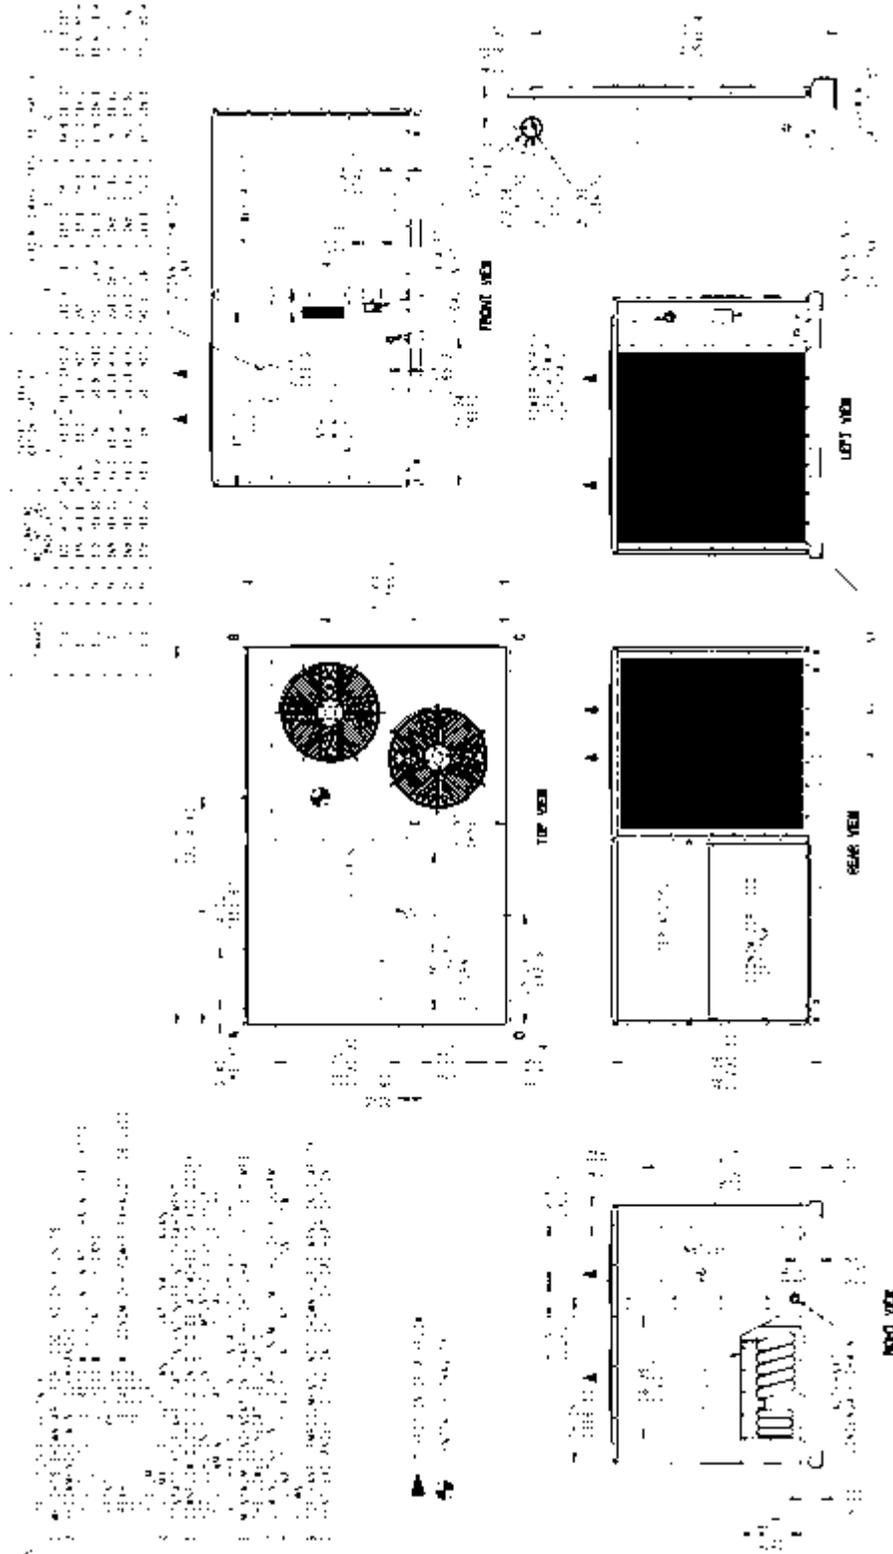


Figure 14: ZX14, ZY12 and ZL 12-14

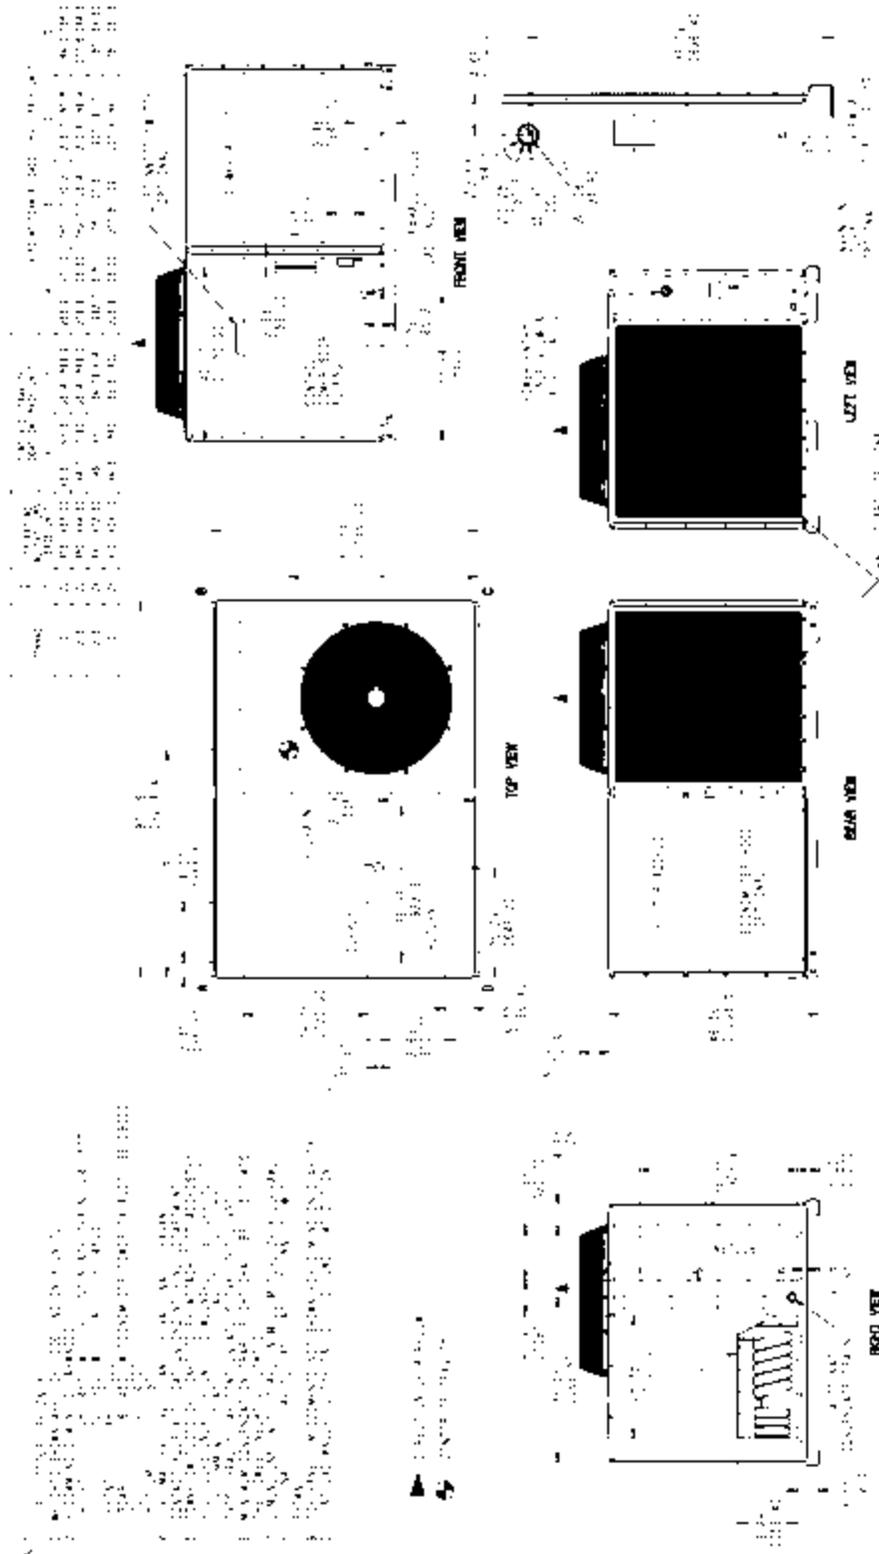


Table 179: ZQ04-06, ZXA7, ZL04-06 and ZY04-06 unit clearances

| Direction | Distance (in.) | Direction | Distance (in.) |
|------------------|----------------------------------|---------------------|----------------|
| Top ¹ | 72 | Right | 18 |
| Front | 36 | Left | 12 |
| Rear | 18 ² /36 ³ | Bottom ⁴ | 1 |

- 1 Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
- 2 Units without economizer or power exhaust.
- 3 Units equipped with an economizer or power exhaust. Flue products must not be discharged within 10 ft of the rear of the unit.
- 4 Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.


Table 180: ZX08-14, ZY07-12 and ZL08-14 unit clearances

| Direction | Distance (in.) | Direction | Distance (in.) |
|------------------|----------------------------------|---------------------|----------------|
| Top ¹ | 72 | Right | 18 |
| Front | 48 | Left | 12 |
| Rear | 18 ² /36 ³ | Bottom ⁴ | 1 |

- 1 Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
- 2 Units without economizer or power exhaust.
- 3 Units equipped with an economizer or power exhaust. Flue products must not be discharged within 10 ft of the rear of the unit.
- 4 Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.

ZQ04-06, ZXA7-14, ZY04-12, ZL04-06 and ZL08-14 unit roof curb dimensions

Figure 15: 1RC0456, 1RC0458 roof curb dimensions

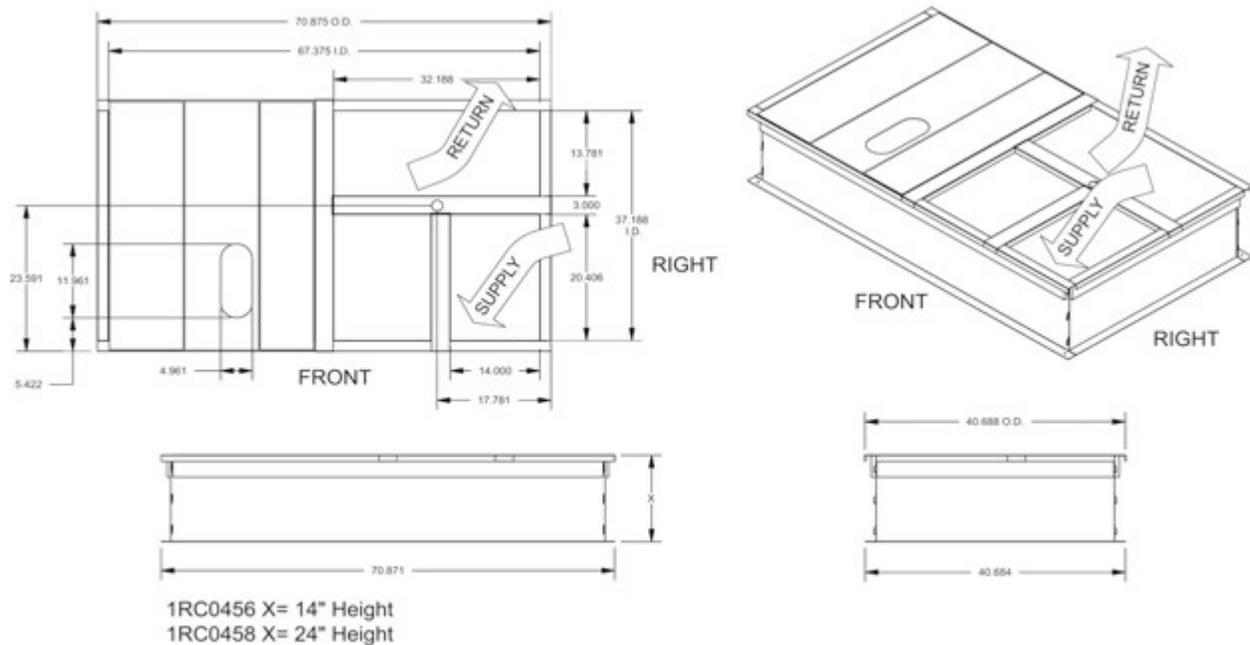

Notes:

1. Sides, ends and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

Table 181: Unit models used with 1RC0456, 1RC0458 roof curb


| | | | |
|--------|--------|--------|--------|
| • ZQ04 | • ZXA7 | • ZY04 | • ZL04 |
| • ZQ05 | | • ZY05 | • ZL05 |
| • ZQ06 | | • ZY06 | • ZL06 |

① **Note:** If utilities are required through the base of the unit or through the roof curb the following field installed accessories can be purchased through your dealer or contractor.

① **Note:** 1TB0401 - Thru the base electrical and through the curb gas

1TB0403 - Thru the base electrical and gas

Figure 16: 1RC0457, 1RC0459 roof curb dimensions

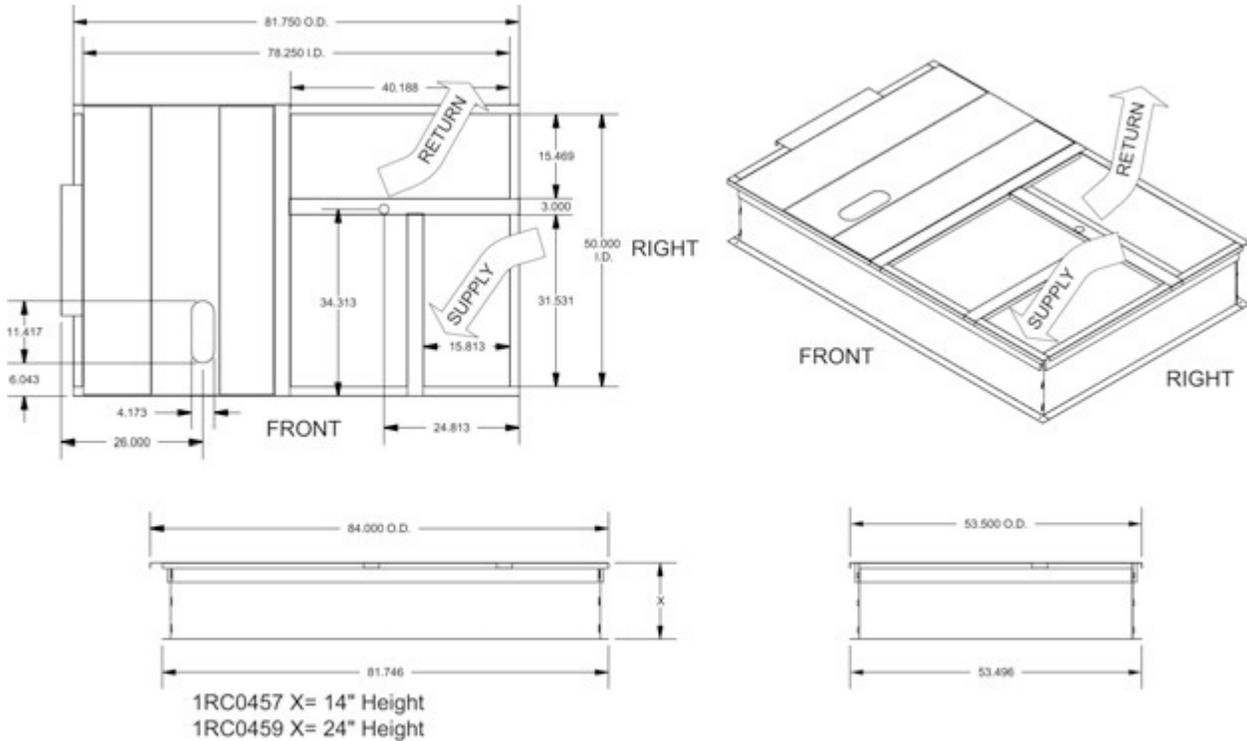

Notes:

1. Sides, ends, unit locator and cross support are 18-G90. Deck pans, R/A & S/A supports are 20-G90.
2. Full perimeter wood nailer.
3. Insulated deck pans.

Table 182: Unit models used with 1RC0457, 1RC0459 roof curb

- | | | |
|--------|--------|--------|
| • ZX08 | • ZYA7 | • ZL08 |
| • ZX09 | • ZY07 | • ZL09 |
| • ZX12 | • ZY08 | • ZL12 |
| • ZX14 | • ZY09 | • ZL14 |
| | • ZY12 | |

① **Note:** If utilities are required through the base of the unit or through the roof curb the following field installed accessories can be purchased through your dealer or contractor:

- ① **Note:** 1TB0402 - Through the base electrical and through the curb gas,
 1TB0404 - Through the base electrical and gas

Economizer options

Table 183: Economizer usage

| Application | Description | Accessory kit number |
|---|---|----------------------|
| Economizer vertical flow Everyday Thermostat Control | Econ, DB, vertical flow, small footprint w/barometric relief | 2EE04706725 |
| | Econ, DB, vertical flow, large footprint w/barometric relief | 2EE04706825 |
| Economizer vertical flow Smart Equipment Control | Econ, DB, vertical flow, small footprint | 2EE04706724 |
| | Econ, DB, vertical flow, large footprint | 2EE04706824 |
| Economizer horizontal flow Everyday Thermostat Control | Econ, DB, horizontal flow, small footprint, short cabinet w/barometric relief | 2EE04707025 |
| | Econ, DB, horizontal flow, small footprint, Tall cabinet w/barometric relief | 2EE04707125 |
| | Econ, DB, horizontal flow, large footprint, short cabinet w/barometric relief | 2EE04707225 |
| | Econ, DB, horizontal flow, large footprint, tall cabinet w/barometric relief | 2EE04707325 |
| Economizer horizontal flow Smart Equipment Control | Econ, DB, horizontal flow, small footprint, short cabinet | 2EE04707024 |
| | Econ, DB, horizontal flow, small footprint, tall cabinet | 2EE04707124 |
| | Econ, DB, horizontal flow, large footprint, short cabinet | 2EE04707224 |
| | Econ, DB, horizontal flow, large footprint, tall cabinet | 2EE04707324 |
| Power exhaust vertical flow | Power exhaust vert flow small footprint 208 V-230 V 1-ph | 2PE04704206 |
| | Power exhaust vert flow small footprint 208 V-230 V 3-ph | 2PE04704225 |
| | Power exhaust vert flow small footprint 460 V 3-ph | 2PE04704246 |
| | Power exhaust vert flow small footprint 575 V 3-ph | 2PE04704258 |
| | Power exhaust vert flow large footprint 208 V-230 V 1-ph | 2PE04704306 |
| | Power exhaust vert flow large footprint 208 V-230 V 3-ph | 2PE04704325 |
| | Power exhaust vert flow large footprint 460 V 3-ph | 2PE04704346 |
| | Power exhaust vert flow large footprint 575 V 3-ph | 2PE04704358 |
| Power Exhaust Horizontal Flow | Power exhaust horiz flow small footprint 208 V-230 V 1-ph | 2PE04704406 |
| | Power exhaust horiz flow small footprint 208 V-230 V 3-ph | 2PE04704425 |
| | Power exhaust horiz flow small footprint 460 V 3-ph | 2PE04704446 |
| | Power exhaust horiz flow small footprint 575 V 3-ph | 2PE04704458 |
| | Power exhaust horiz flow large footprint 208 V-230 V 1-ph | 2PE04704506 |
| | Power exhaust horiz flow large footprint 208 V-230 V 3-ph | 2PE04704525 |
| | Power exhaust horiz flow large footprint 460 V 3-ph | 2PE04704546 |
| | Power exhaust horiz flow large footprint 575 V 3-ph | 2PE04704558 |

Figure 17: Field Installed vertical flow economizer

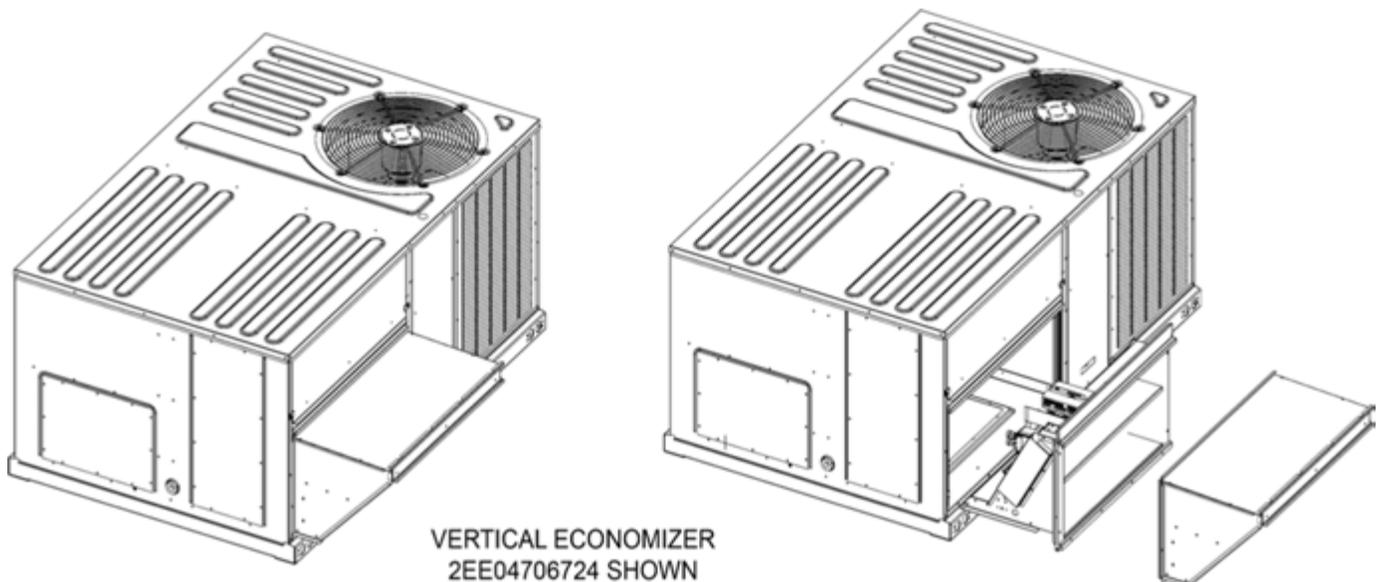


Figure 18: Field installed vertical flow economizer w/power exhaust

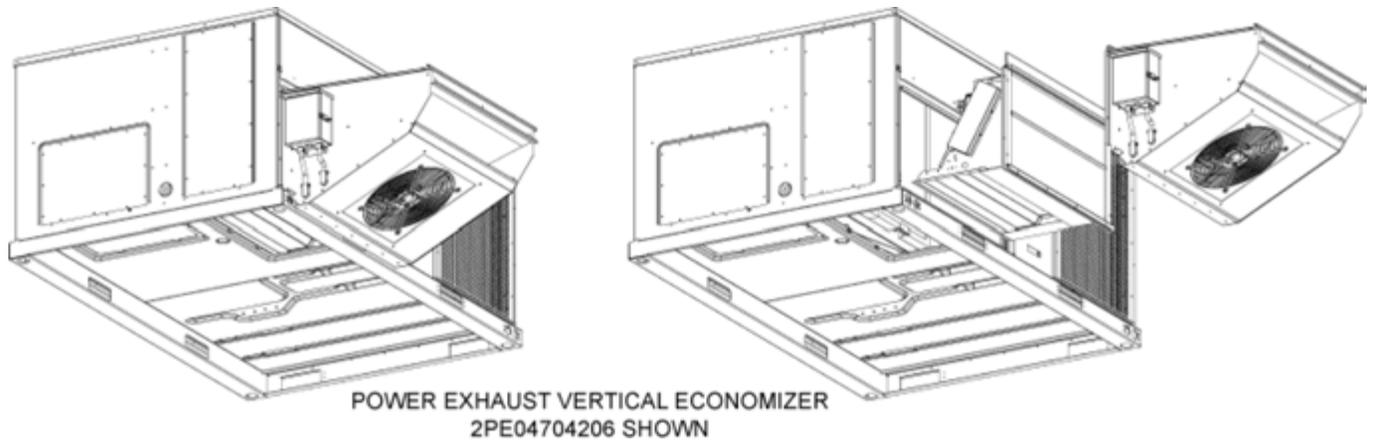


Figure 19: Field installed horizontal flow economizer


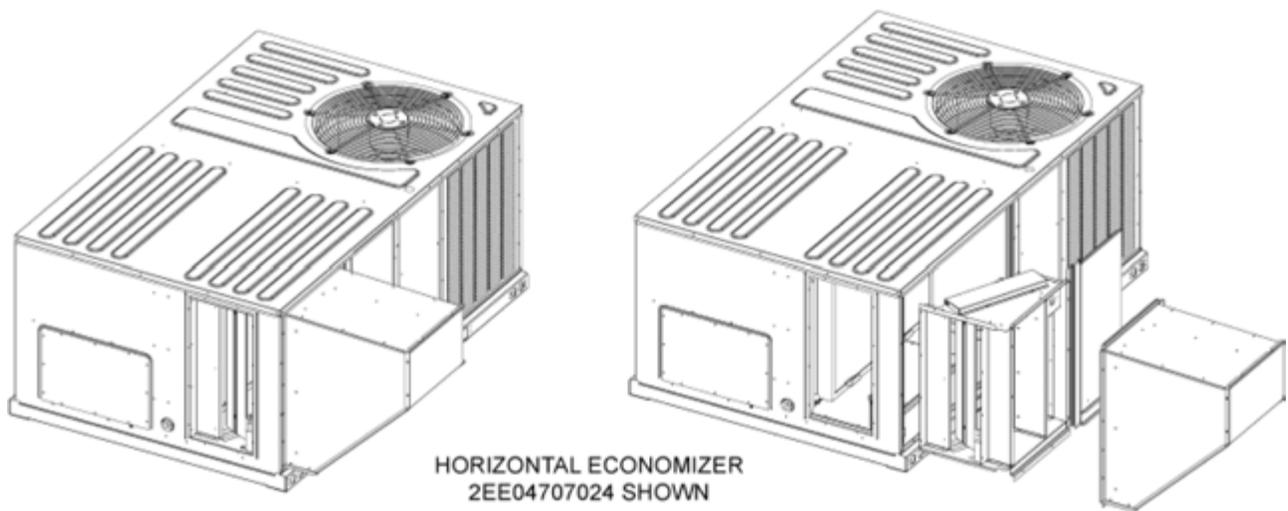


Figure 20: Field installed horizontal flow economizer w/power exhaust

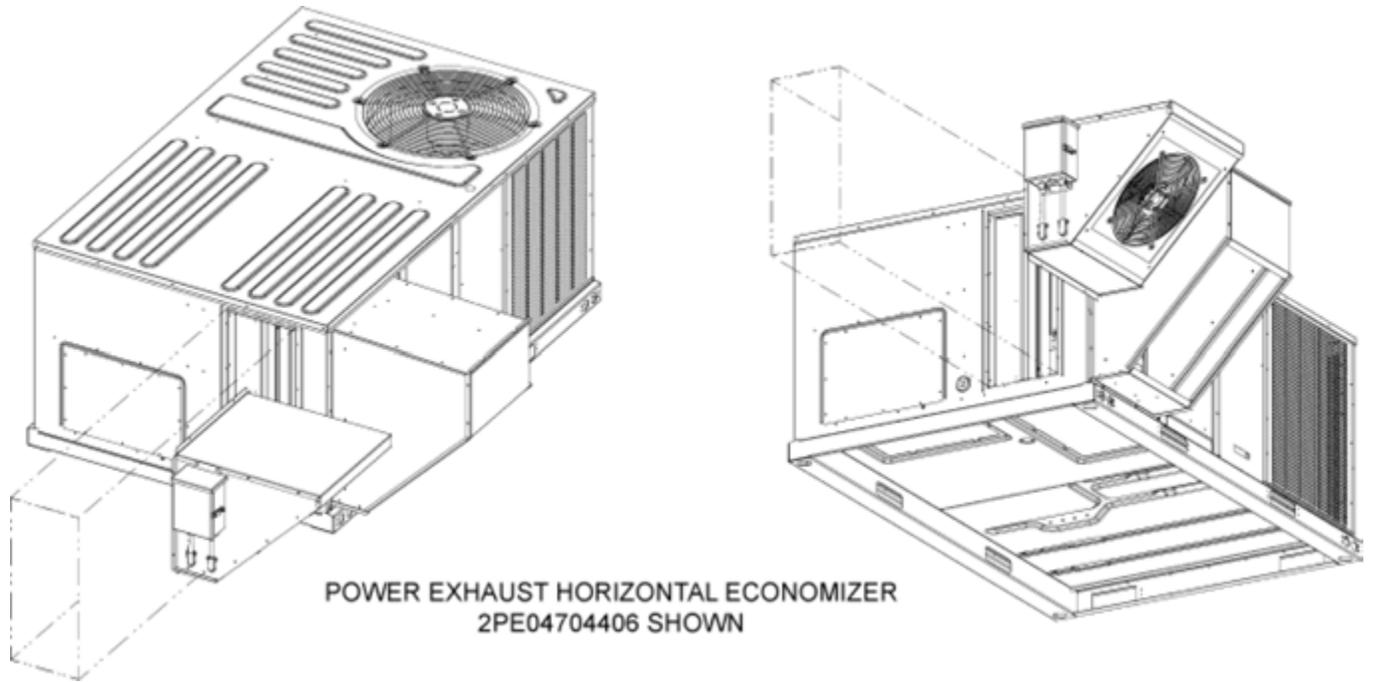

Guide specifications

YORK® GUIDE MECHANICAL SPECIFICATIONS SINGLE PACKAGE AIR CONDITIONERS

3 THRU 12-1/2 NOMINAL TONS

York® Sun™ Core SERIES

Size Range: 3 to 12-1/2 Tons Nominal Cooling

45,000 to 200,000 BTUH Nominal Gas Heating Output

Model Series: ZQ, ZX, ZY & ZL

DIVISION 23 – HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

Number Title

23 00 00 HEATING, VENTILATING, AND AIR-CONDITIONING (HVAC)

23 06 80 Schedules for Decentralized HVAC Equipment

23 06 80.13 Decentralized Unitary HVAC Equipment Schedule

23 06 80.13.A. Rooftop unit schedule

1. Schedule is per the project specification requirements.

23 07 16 HVAC Equipment Insulation

23 07 16.13.C. Economizer and Control compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, foil faced fiber glass insulation with thermal conductivity of 0.24 or better, adhered with acrylate polymer based adhesive
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

23 09 13 Instrumentation and Control Devices for HVAC

23 09 13.23 Sensors and Transmitters

23 09 13.23.A. Thermostats

1. Thermostat must
 - a. Energize "Y" when calling for cooling and "W" when calling for heating
 - b. Shall have capability to energize 2 stages of cooling and 2 stages of heating.

23 09 23 Direct-digital Control system for HVAC

23 09 23.13 Decentralized, Rooftop Units:

23 09 23.13.B. ETC Control)

1. Unit shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-volt transformer side.
2. Unit shall incorporate a lockout circuit which provides reset capability at the space thermostat or base unit, should any of the following standard safety devices trip and shut off compressor.
3. Loss-of-charge/Low-pressure switch.
4. High-pressure switch.
5. Freeze-protection thermostat, evaporator coil.
6. Unit shall incorporate "AUTORESET" compressor over temperature, over current protection.

7. Unit shall operate with conventional thermostat designs and have a low voltage terminal strip for easy hook-up.
8. Unit control board shall have on-board diagnostics and fault code display.
9. Standard controls shall include anti-short cycle and low voltage protection, and permit cooling operation down to 0°F.
10. Control board shall monitor each refrigerant safety switch independently.
11. Control board shall retain last 5 fault codes in nonvolatile memory which will not be lost in the event of a power loss.

23 09 33 Electric and Electronic Control System for HVAC

23 09 33.13 Decentralized, Rooftop Units: 23 09 33.13.A. General:

1. Shall be complete with self contained low voltage control circuit protected by a resettable circuit breaker on the 24 v transformer side. Transformer shall have 75VA capability.
2. Shall utilize color coded wiring.
3. Shall include a central control terminal board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, economizer, thermostat, and low and high pressure switches.
4. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor. See heat exchanger section of this specification.

23 09 33.23.B. Safeties:

1. Compressor over temperature, over current. High internal pressure differential.
2. Low pressure switch and high pressure switch
 - a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.
3. Automatic reset, motor thermal overload protector.
4. Heating section shall be provided with the following minimum protections:
 - a. High temperature limit switches.
 - b. Induced draft pressure sensor.
 - c. Flame rollout switch.
 - d. Flame proving controls.

23 40 13 Panel Air Filters

23 40 13.13 Decentralized, Rooftop Units:

23 40 13.13.A. Standard filter section

1. Shall consist of factory installed, low velocity, disposable 1 in. thick fiberglass filters of commercially available sizes.
2. Units can accept 1" or 2" filters and have a field convertible tool less transition.
3. Filters shall be accessible through an access panel; hinged panel with "no tool" removal option is available as described in the unit cabinet section of this specification (23 81 19.13.H).

238119 Self Contained Air Conditioners

23 81 19.13 Small Capacity Self Contained Air Conditioners

23 81 19.13.A. General

1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing a fully hermetic, suction gas cooled, direct drive compressor(s) for cooling duty and gas combustion or nickel chromium elements for heating duty.
2. Factory assembled, single piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start up.
3. Unit shall use environmentally sound, R-410A refrigerant.
4. Unit shall be installed in accordance with the manufacturer's instructions.
5. Unit must be selected and installed in compliance with local, state, and federal codes.

23 81 19.13.B. Quality Assurance

1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
2. Unit shall be rated in accordance with AHRI Standards 210/240 or 340/360.
3. Unit shall be designed to conform to ASHRAE 15, 2001.
4. Unit shall be UL tested and certified in accordance with ANSI Z21.47 -2012/CSA 2.3-2012, CSA C22.2 No. 236-11 (UL 1995) 4th edition and CSA C22.2 No. 3 - M 1988.
5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
6. Unit casing shall be capable of withstanding 1000 hour salt spray exposure per ASTM B117 (scribed specimen).
7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001.
8. Roof curb shall be designed to conform to NRCA Standards.
9. Unit shall be subjected to a completely automated run test on the assembly line. The data for each unit will be stored at the factory, and must be available upon request.
10. Unit shall be designed in accordance with UL Standard 1995, including tested to withstand rain.
11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box
12. Unit shake tested to assurance Truck 2, ASTM D4169 to ensure shipping reliability.

23 81 19.13.C. Delivery, Storage, and Handling

1. Unit shall be stored and handled per manufacturer's recommendations.
2. Overhead crane can be used to place the units on a roof using rigging holes built into the unit base rails without any additions to the unit.
3. Unit shall only be stored or positioned in the upright position.

23 81 19.13.E. Project Conditions

1. As specified in the contract.

23 81 19.13.F. Operating Characteristics

1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature, meeting maximum load criteria of AHRI Standard 210/240 or 340/360 at ± 10% voltage.
2. Compressor with standard controls shall be capable of operation down to 30°F (-1°C), ambient outdoor temperatures.
3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
4. Unit shall be factory configured for vertical supply & return configurations.
5. Unit shall be field convertible from vertical to horizontal airflow on all models.
6. Unit shall be capable of mixed operation: vertical supply with horizontal return or horizontal supply with vertical return.

23 81 19.13.I. Gas Heat

1. General
 - a. Heat exchanger shall be an induced draft design. Positive pressure heat exchanger designs shall not be allowed.
 - b. Shall incorporate a direct spark ignition system and redundant main gas valve.
 - c. Gas supply pressure at the inlet to the rooftop unit gas valve must match that required by the manufacturer.
 - d. All units shall have 2 stages of gas heating available where 1st stage is 60% of total capacity.
2. The heat exchanger shall be controlled by an integrated gas controller (IGC) microprocessor.
 - a. IGC board shall notify users of fault using an LED (light emitting diode).
 - b. The LED shall be visible without removing the control box access panel.
 - c. IGC board shall contain algorithms that modify evaporator fan operation to prevent future cycling on high temperature limit switch.
 - d. Unit shall be equipped with anti cycle protection with one short cycle on unit flame rollout switch

or 4 continuous short cycles on the high temperature limit switch. Fault indication shall be made using an LED.

3. Standard Heat Exchanger construction

- a. Heat exchanger shall be of the tubular section type constructed of a minimum of 20 gauge steel coated with a nominal 1.2mil aluminum silicone alloy for corrosion resistance.
- b. Burners shall be of the in shot type constructed of aluminum coated steel.
- c. Burners shall incorporate orifices for rated heat output up to 2000 ft. (610m) elevation. Additional accessory kits may be required for applications above 2000 ft. (610m) elevation, depending on local gas supply conditions.
- d. Each heat exchanger tube shall contain multiple dimples for increased heating effectiveness.

4. Optional Stainless Steel Heat Exchanger construction

- a. Use energy saving, direct spark ignition system.
- b. Use a redundant main gas valve.
- c. Burners shall be of the in shot type constructed of aluminum coated steel.
- d. All gas piping shall enter the unit cabinet at a single location on side of unit (horizontal plane).
- e. The optional stainless steel heat exchanger shall be of the tubular section type, constructed of a minimum of 20 gauge type 409 stainless steel.
- f. Type 409 stainless steel shall be used in heat exchanger tubes and vestibule plate.

5. Optional Low NOx Heat Exchanger construction

- a. Low NOx reduction shall be provided to reduce nitrous oxide emissions to meet California's Air Quality Management District (SCAQMD) low NOx emissions requirement of 40 nanograms per joule or less.

6. Induced draft combustion motor and blower

- a. Shall be a direct drive, single inlet, forward curved centrifugal type.
- b. Shall be made from steel with a corrosion resistant finish.
- c. Shall have permanently lubricated sealed bearings.
- d. Shall have inherent thermal overload protection.
- e. Shall have an automatic reset feature.

23 81 19.13.L. Refrigerant Circuits

1. All units shall have one or two refrigerant circuits.
2. Refrigerant circuit shall include the following control, safety, and maintenance features:
 1. Refrigerant filter drier Solid core design.
 2. Service gauge connections on suction and discharge lines.
3. Compressors
 1. Unit shall use fully hermetic, scroll compressors for each independent refrigeration circuit.
 2. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
 3. Compressors shall be internally protected from high discharge temperature conditions.
 4. Compressors shall be protected from an over temperature and over amperage conditions by an internal, motor overload device.
 5. Compressor shall be factory mounted on rubber grommets.
 6. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
 7. All non-Scroll compressors include Crankcase heaters.

23 81 19.13.M.Filter Section

1. Filters access is specified in the unit cabinet section of this specification.

23 81 19.13.N. Evaporator Fan and Motor

1. Evaporator fan motor:

- a. Shall have permanently lubricated ball-bearings.
 - b. Shall have inherent automatic reset thermal overload protection.
 - c. The job site selected brake horsepower shall be required to not exceed the motor's nameplate horsepower rating plus the service factor.
2. Evaporator Fan:
- a. Fan shall be a factory installed direct-drive (optional) or standard belt drive assembly with an adjustable pitch motor pulley.
 - b. Shall use sealed, permanently lubricated ball
 - c. Blower fan shall be double inlet type with forward curved blades.
 - d. Shall be constructed from steel with a corrosion resistant finish and dynamically balanced.

23 81 19.13.O. Multi-speed Fan Control

- 1. IntelliSpeed staged air volume system:
 - a. Fan speed shall be matched with staging of compressor operation.
- 2. Variable Frequency Drive (VFD):
 - a. Shall contain a variable frequency drive tied to the evaporator fan motor.
 - b. Shall be installed inside the unit cabinet, mounted, wired and tested.
 - c. Shall contain Electromagnetic Interference (EMI) frequency protection.
 - d. Insulated Gate Bi Polar Transistors (IGBT) used to produce the output pulse width modulated (PWM) waveform.
 - e. Built in LED display and controls. Does not require additional kit or options.
 - f. RS485 capability standard.
 - g. Electronic thermal overload protection.
 - h. 5% swinging chokes for harmonic reduction and improved power factor.
 - i. All printed circuit boards shall be conformal coated.

23 81 19.13.P. Condenser Fans and Motors

- 1. Condenser fan motors:
 - a. Shall be a totally enclosed motor.
 - b. Shall use permanently lubricated ball-bearings.
 - c. Shall have inherent thermal overload protection with an automatic reset feature.
 - d. Shall use a shaft down design.
- 2. Condenser Fans:
 - a. Shall be a direct driven propeller type fan.
 - b. Shall have aluminum blades riveted to corrosion resistant steel spider brackets and be dynamically balanced.

23 81 19.13.Q. Special Features Options and Accessories

- 1. Standard Integrated Economizer:
 - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
 - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
 - c. Damper blades shall be galvanized steel with metal gears. Plastic or composite blades on intake or return shall not be acceptable.
 - d. Damper blades shall be class 1A dampers.
 - e. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below set points.
 - f. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
 - g. Economizer shall comply with, and be certified to, the AMCA 511 standard.

- h. Standard leak rate shall be equipped with dampers not to exceed 3 cfm/ft² leakage at 1 in. wg pressure differential.
 - i. Johnson Controls RRS Economizer shall be the field installed option for units equipped with the ETC controller
 - 1. On board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, meets the requirements for California Title 24, IECC 2015, and ASHRAE 90.1
 - 2. Display alarms if the following occur
 - i. Economizer is economizing when conditions do not support
 - ii. Economizer is not economizing when conditions do support
 - iii. Damper Stuck
 - iv. Excess Outdoor Air
 - v. Failed Sensor
 - 3. Automatic sensor detection
 - 4. Capabilities for use with multiple speed indoor fan systems
 - 5. Utilize digital sensors: Dry bulb and Enthalpy
 - 6. UL, CSA, and ICES-003 recognized and FCC compliant to CFR47
 - j. Shall be capable of introducing up to 100% outdoor air.
 - k. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements. Barometric relief can be replaced by optional power exhaust.
 - l. Shall be designed to close damper(s) during loss of power situations with spring return built into motor.
 - m. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor set point shall be adjustable and shall range from 40° to 80°F / 4° to 27°C. Additional sensor options shall be available as accessories.
 - n. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
 - o. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
 - p. Dampers shall be completely closed when the unit is in the unoccupied mode.
 - q. Economizer controller shall accept a 2 10 Vdc CO₂ sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
 - r. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
 - s. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
2. BarometricReliefKit
 - a. Shall contain all materials necessary to field install a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
 3. Manual Fresh Air Damper
 - a. Shall contain all materials necessary to field install a manual fresh air damper.
 - b. Shall include a slide-in damper assembly with an outdoor hood and filters.
 - c. Shall be available with either a range of 0%-100% outdoor air entry or 0%-35% outdoor air entry.
 4. Motorized Damper
 - a. Damper shall be a Two Position Damper. Damper travel shall be from the full closed position to the field adjustable % open setpoint.
 - b. Damper shall include adjustable damper travel from 0% to 100% (full open).
 - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.

- d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.
 - e. Damper will admit up to 100% outdoor air for applicable rooftop units.
 - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
 - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
 - h. Outside air hood shall include aluminum water entrainment filter.
5. Manual damper
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25 or 50% outdoor air for year round ventilation.
6. Propeller Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
 - b. Horizontal power exhaust shall be mounted in return ductwork.
 - c. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 100% adjustable set point on the economizer control.
7. Single Enthalpy Sensor Kit
- a. The single enthalpy sensor kit shall provide a relative humidity sensor to be mounted in the outdoor air stream to provide single enthalpy economizer control
 - b. The sensor allows the unit to determine if outside air is suitable for free cooling.
8. Dual Enthalpy Sensor Kit:
- a. The dual enthalpy sensor kit shall provide 2 relative humidity sensors to be mounted in the return and outdoor air streams to provide dual enthalpy economizer control.
 - b. This kit contains all components required for dual enthalpy control and does not need to be used in conjunction with the Single Enthalpy Sensor Kit.
9. CO2 Sensor:
- a. Shall be able to provide demand ventilation control for indoor air quality (IAQ) or outdoor air quality (OAQ).
 - b. The CO2 sensor shall be available in duct mount or wall mount with LED display.
 - c. The set-points for IAQ and OAQ shall have adjustment capability between 0 and 5000 ppm in the RRS Economizer controls.
10. Smoke detectors:
- a. Shall be a Four Wire Controller and Detector.
 - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift free sensitivity.
 - c. Shall use magnet activated test/reset sensor switches.
 - d. Shall have a recessed momentary switch for testing and resetting the detector.
 - e. Controller shall include:
 - 1. One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
 - 2. Two Form C auxiliary alarm relays for interface with rooftop unit or other equipment.
 - 3. One Form C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
 - 4. Capable of direct connection to two individual detector modules.
 - 5. Can be wired to up to 49 other duct smoke detectors for multiple fan shutdown applications

Subject to change without notice. Printed in U.S.A. Copyright © 2021 by Johnson Controls. All rights reserved. Supersedes:
1068152-YTG-CC-1120